

2021 SERVICE STANDARDS & GUIDE

Historical Record: 2/19/21
Internal & External Version



GENERAL INFORMATION	000
RESIDENTIAL, COMMERCIAL & INDUSTRIAL OVERHEAD	100
CUSTOMER-OWNED METER POLES	200
UNDERGROUND ELECTRIC SERVICE	300
ELECTRIC SERVICE & METERING EQUIPMENT	500
MEDIUM VOLTAGE ELECTRIC SERVICE & METERING EQUIPMENT	600
ELECTRIC TERMINATING ENCLOSURES, 0-600 VOLTS	700
CUSTOMER GENERATION	800
GAS	1000
DISCLAIMER & CONTACTS	
SUMMARY OF CHANGES	
DETAILED TABLE OF CONTENTS	
SERVICE ORDER TEAMS & REGIONAL PROJECT MANAGEMENT OFFICES	
PROJECT MANAGEMENT REGIONAL BOUNDARY MAP	
FREQUENTLY REFERENCED STANDARDS	
ALPHABETICAL SUBJECT INDEX	
SIGNIFICANT REVISION LIST	
SAN DIEGO AREA ELECTRICAL NEWSLETTER	

ATTENTION:

THESE STANDARDS WERE DEVELOPED FOR MAINTAINING SAFETY AND RELIABILITY OF THE ELECTRIC DISTRIBUTION AND SERVICE SYSTEMS.

THE INTENT OF THIS STANDARD IS TO GUIDE ENGINEERS, DESIGNERS/PLANNERS AND CONSTRUCTION PERSONNEL AND PROVIDE TYPICAL CONSTRUCTION METHODS FOR ELECTRIC DISTRIBUTION. NOT ALL ARRANGEMENTS ARE DEPICTED AND IT IS THE USER'S RESPONSIBILITY TO APPLY THESE STANDARDS APPROPRIATELY. ALL USERS MUST USE GOOD JUDGMENT. STANDARDS ARE UPDATED AS NEEDED. CONSULT EDE FOR LATEST VERSION. SDG&E STANDARDS MUST BE APPLIED. PRE-CONSTRUCTION APPROVAL OF A "DEVIATION REQUEST" IS REQUIRED FOR ANY EXCEPTION TO THESE STANDARDS. ANY ALTERATIONS, MODIFICATIONS OR IMPROVEMENTS TO THIS AND ALL STANDARDS MUST BE REVIEWED, APPROVED AND DOCUMENTED BY EDE-CONSTRUCTION STANDARDS AND DISTRICT C&O'S.

THE CPUC'S GENERAL ORDER 95 RULES/REQUIREMENTS ARE NOT INTENDED FOR USE AS COMPLETE CONSTRUCTION SPECIFICATIONS BUT EMPLOY ONLY THE MINIMUM REQUIREMENTS WHICH ARE MOST IMPORTANT FROM THE STANDPOINT OF SAFETY AND RELIABILITY. SDG&E MAY IMPOSE STRICTER RULES AND REQUIREMENTS IN THE INTEREST OF MAINTAINING SAFETY AND RELIABILITY OF OUR ELECTRICAL SYSTEM.

CONSTRUCTION SHALL BE ACCORDING TO ACCEPTED GOOD PRACTICE FOR GIVEN LOCAL CONDITIONS IN ALL SITUATIONS NOT SPECIFIED IN THE STANDARD.

SDG&E WILL NOT ACCEPT ANY SYSTEM DESIGN OR INSTALLATION WHICH DOES NOT CONFORM TO THESE STANDARDS. DEVIATIONS CANNOT BE GRANTED WHICH CONFLICT WITH THE CPUC GENERAL ORDERS OR OTHER GOVERNING AGENCIES. THESE MAY INCLUDE SEPARATION FROM ENERGIZED FACILITIES AND WORKING CLEARANCES.

BASED ON UNUSUAL OR UNSAFE SITE CONDITIONS SDG&E MAY IN THE INTEREST OF SAFETY OR RELIABILITY REQUIRE CONSTRUCTION MEASURES BEYOND THOSE SPECIFICALLY STATED IN THIS MANUAL.

EXCEPT FOR A REQUIREMENT TO IMMEDIATELY ADOPT NEWLY PUBLISHED STANDARDS, THE APPLICATION OF NEWLY PUBLISHED STANDARDS IS REQUIRED FOR ALL WORK UP TO THE 30% PROJECT DESIGN APPROVAL LEVEL. ALL DESIGN AND CONSTRUCTION WORK AFTER 30% PROJECT DESIGN APPROVAL MAY USE CONSTRUCTION STANDARDS THAT IMMEDIATELY PRECEDE THE NEWLY UPDATED STANDARD, UNLESS THE IMMEDIATE ADOPTION OF NEWLY PUBLISHED STANDARDS IS MANDATED.

USE OF "BLOCK STOCK" MUST BE COORDINATED WITH INVENTORY & LOGISTICS AND IS GENERALLY ONLY APPLIED AS A "LAST RESORT" AFTER CONSULTATION AND AGREEMENT WITH STAKEHOLDERS AND AN ALTERNATE SOLUTION, SUPPLIER, MATERIAL OR METHOD IS DEEMED ACCEPTABLE AND AVAILABLE.

IF YOU HAVE ANY QUESTIONS REGARDING THE CONTENT OF THESE MANUALS PLEASE EMAIL CONSTRUCTIONSTANDARDSADMINISTRATORS@SEMPRAUTILITIES.COM OR CONTACT:

MANUAL	OWNER	EMAIL ADDRESS	PHONE
Electric Distribution Design Manual	Martha Lachmayr	mlachmayr@sdge.com	(858) 654-8245
Overhead Construction Standards	Greg Walters	gwalters@sdge.com	858) 654-8396
Service Standards & Guide	Israel Juarez	ijuarez@sdge.com	(858) 636-3941
Underground Construction Standards	Eddie Alcobia	ealcobia@sdge.com	(619) 574-4988
Electric Standard Practices	Joey Kucharyski	jkucharyski@sdge.com	(760) 566-5919
Tool Catalog	Roy Guilao	rguilao@sdge.com	(760) 672-6211

PRINTED COPIES:

FOR PRINTED VERSIONS, WITH BINDER AND TAPS, OF THE **OVERHEAD CONSTRUCTION STANDARDS** PLEASE CONTACT CONSTRUCTIONSTANDARDSADMINISTRATORS@SEMPRAUTILITIES.COM. THESE WILL BE PROVIDED AT THE COST OF YOUR DEPARTMENT. PLEASE INCLUDE IN THE EMAIL:

- NAME, COST CENTER #, I/O #, MAIL STOP #

NOTE:

IF YOU HAVE AN EXISTING BINDER WITH TABS YOU CAN PRINT DIRECTLY FROM THIS PDF AT YOUR LOCATION. PLEASE ENSURE THE FOLLOWING SETTINGS WHEN PRINTING:

1. PRINT IN COLOR
2. ENABLE DOUBLE SIDED PRINTING

SUMMARY OF CHANGES

DATE	STANDARD PAGES	FILE NAME
02/19/21	24, 301, (308 MOVED TO FMO)	SG2021v0219.pdf
01/22/21	COVER PAGE, DISCLAIMER	SG2021v0122.pdf
12/18/20	201, 202, 203, 204, 205, 206, 207, 208, 209, 210	SG2020v1218.pdf
05/22/20	001, 021, 022, 023, 024, INTERNAL SERVER UPGRADE	SG2020v0522.pdf
04/24/20	301, 320	SG2020v0424.pdf
02/19/20	2	SG2020v0219.pdf
01/24/20	NEW FORMAT RELEASE	SG2020v0124.pdf

[illegible]

INTRODUCTION

STANDARDS MANUAL OWNER CONTACT INFORMATION, TABLE OF CONTENTS, SERVICE ORDER TEAMS & REGIONAL PROJECT MANAGEMENT OFFICES, PROJECT MANAGEMENT REGIONAL BOUNDARY MAP, ALPHABETICAL SUBJECT INDEX, SIGNIFICANT REVISIONS LIST

SECTION 000 – GENERAL INFORMATION

DEFINITIONS OF TERMS, GENERAL INFORMATION, LINE TRUCK ACCESS

SECTION 100 – RESIDENTIAL, COMMERCIAL & INDUSTRIAL OVERHEAD

OVERHEAD SERVICE INFORMATION

SECTION 200 – CUSTOMER-OWNED METER POLES, PERMANENT & TEMPORARY SERVICE

CUSTOMER-OWNED METER POLES & TEMPORARY SERVICE INSTALLATIONS

SECTION 300 – UNDERGROUND ELECTRIC SERVICE

UNDERGROUND ELECTRIC SERVICE INFORMATION

SECTION 500 – ELECTRIC SERVICE & METERING EQUIPMENT

GENERAL REQUIREMENTS, LOW VOLTAGE SERVICE & METERING REQUIREMENTS

SECTION 600 – MEDIUM VOLTAGE ELECTRIC SERVICE & METERING EQUIPMENT

SERVICE & METERING REQUIREMENTS FOR MEDIUM VOLTAGE SERVICE

SECTION 700 – ELECTRIC TERMINATING ENCLOSURES, 0 – 600 VOLTS

GENERAL REQUIREMENTS FOR TERMINATING ENCLOSURES, CONDUCTOR IDENTIFICATION, PHASE ARRANGEMENT

SECTION 800 – CUSTOMER GENERATION

STAND-BY & DISTRIBUTED GENERATION

SECTION 1000 – GAS

GENERAL INFORMATION, GAS SERVICE & METERING EQUIPMENT, GAS SERVICE POLICIES & METER LOCATIONS, BARRICADES, GAS FACILITIES NEAR UG SUBSTRUCTURES

UG – UNDERGROUND CONSTRUCTION STANDARDS

PADS, GROUNDING, CONNECTORS, RETAINING WALLS & CLEARANCES, WIRELESS COMMUNICATIONS ATTACHMENT TO DISTRIBUTION POLE

ELECTRICAL NEWSLETTERS

INTERNATIONAL CODE COUNCIL (ICC) SAN DIEGO AREA ELECTRICAL NEWSLETTERS

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X	Indicates Latest Revision	Completely Revised	New Page	Information Removed
----------	---------------------------	--------------------	----------	---------------------

SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

TABLE OF CONTENTS

SG 1

**SIGNIFICANT REVISION
LIST**

**SIGNIFICANT REVISION
LIST**

Entire Manual

- Revised information in the page footer to include document change history and number of sheets in a specific standard.
- Added a new table of contents at the beginning of each section.
- Replaced existing index sections with new alphabetical section indexes at the beginning of each section.
- Added standard references at the bottom left side of each page, when applicable.
- Increased the number of pages needed to improve readability.
- Changed standard titles when needed to more accurately reflect the subject.

Introduction Section

- Added SG 6, Significant Revisions List.

Section 000 – General Information

- Divided “Electric Service Policies – New and Existing Customer” (old pages 013.1 – 013.12) into 4 new standards, as follows:
 - “Electric Service Policies – New & Existing Customers” (SG 011.1 – 011.2)
 - “Electric Service Policies – New Project Types” (SG 012.1 – 012.3)
 - “Electric Service Policies – Existing Customer” (SG 013.1 – 013.3)
 - “Electric Service Policies – Existing Customer Feeder Exceptions” (SG 014.1 – 014.5)
- On pages SG 012.1 and SG 013, to assist SDG&E Planners and customers in the planning phase of their project, added a new paragraph as follows:

General Service Requirement to Multiple Multi-Unit Buildings on a Single Premises – When there is more than one multi-unit building on a single premises, an individual SDG&E service is generally required to each of the multi-unit buildings. Both residential and non-residential applications are subject to this requirement. Refer to SG 014 for further detail.

Section 100 – Residential, Commercial & Industrial Overhead

- Moved old page 123 to SG 107.3 and revised content to clarify the 8’ service drop clearance as specified in G.O. 95 that is required above buildings on adjacent premises except as defined in Notes and D on page SG 107.7.

Section 200 – Customer-Owned Meter Poles, Permanent & Temporary Service

- No significant changes.

Section 300 – Underground Electric Service

- No significant changes.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 3	<div></div> Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	<input type="checkbox"/> New Page	<input type="checkbox"/> Information Removed	SG 6.1
	SDG&E SERVICE STANDARDS & GUIDE				
	SIGNIFICANT REVISIONS LIST				

Section 500 – Electric Service & Metering Equipment (New Section)

- Divided existing Section 600 into two sections by creating new Section 500 for low voltage electric service and metering equipment and changing terminology from “high” to “medium” voltage electric service and metering equipment in Section 600.
- Housekeeping pad within a building must be flush with the service equipment. Added a new requirement “Working Space for Non-Residential Service Panels Requires a Permanent Concrete Slab” on page SG 504.5. This new requirement replaces Note 5 on old page 604.1.
- Old page 604.2 is now new page SG 506.1. Under “Doors”, the California Electric Code changed the requirement for services rated 1200 amps, or more, to now apply to services rated 800 amps, or more.
- Old page 604.2, new page SG 506.1, under “Dedicated Electrical Space”, Exception 2, has been revised as, “Dry pipes and/or ducts not containing fluids, and installed for the sole purpose of venting are permitted within the 6’ (1.8m) zone.”
- Removed the communications information from the illustration on page SG 510.3, old page 607.3, removed Note 6 from old page 607.4, new page SG 510.4, and added “Metering Communications” information referencing new page SG 525 at the bottom of page SG 510.4.
- Revised the heading “Bus Tap Drawings for Approval” on page SG 517.1, old page 623, to “Switchboard Bus/Wire Tap Drawings for Approval.” Added a requirement for bus tap drawings prepared by a qualified engineer whenever mechanical lugs are being added to existing bus, or manufacturer installed wire conductors are to be tapped.
- Added new pages SG 524.8 – 524.10, “Unmetered Electric Service”, to provide a standard for installation of a customer-owned and installed wireless communications antenna attachment on a direct burial or foundation pole with conventional luminaire for roadway lighting owned by SDG&E.
- Added new page SG 525, “Metering Communications”, to provide direction for establishing effective metering communications when a meter location does not facilitate standard “Smart Meter” communication methods.

Section 600 – Medium Voltage Electric Service & Metering Equipment

- Divided existing Section 600 into two sections by creating new Section 500 for low voltage electric service and metering equipment and changing terminology from “high” to “medium” voltage electric service and metering equipment in Section 600.

Section 700 – Electric Terminating Enclosures, 0 – 600 Volts

- Revised “Phase Arrangement” information on old page 700, new page, SG 703, to require the high leg to be in the “C” phase position.
- Expanded old page 707 into new pages SG 707.1 – 707.2, “Residential Single-Phase Multi-Meter Stack”. Revised the description at the top of the page by adding “factory-manufactured pull can and meter stack(s)” and, “This standard does not apply to field installed pull cans with raceways and cabling to individual meter panels.” Added a new note 10 to page SG 707.2, as follows:

The SDG&E Planner shall provide the customer with a copy of this standard with the Electric Meter & Service Location form because it is a special application. It is important for the customer to understand the equipment must be factory-manufactured with horizontal bussing from the pull can to the metering section(s).

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 3	<div><div></div>Indicates Latest Revision</div>	<div><input checked="" type="checkbox"/> Completely Revised</div>	<div><input type="checkbox"/> New Page</div>	<div><input type="checkbox"/> Information Removed</div>	SG 6.2
	SDG&E SERVICE STANDARDS & GUIDE				
	SIGNIFICANT REVISIONS LIST				

- Modified page SG 806.13 per new 36" clearance requirements specified on pages SG 1007.1-1007.4.

- Added a definition for Large Gas Field Service Vehicle Access on page SG 1003.1.
- Added “Signage Requirements for Gas Service Locations on Multi-Tenant Buildings” on pages SG 1003.2 – 1003.3.
- Changed “Weld Hole” to “Tie-In Hole” on pages SG 1004.1 – 1004.2.
- Changed “Number of Services Allowed to a Building – New Projects” to “Gas Service Policy for New Projects – Number of Services Allowed”, on pages SG 1006.2 – 1006.3 (old page 1007), reformatted this section, and changed the titles of subsections 1, 3, and 4.
- Old pages 1008 – 1008.2 are now pages SG 1007.1 – 1007.5, with new 36” clearance requirements from gas riser.
- Old pages 1008.3 – 1008.4 are now pages SG 1008.1 – 1008.3, with the latest product information, illustrations and manufacturer’s contact information. On page SG 1008.1, the new 36” clearance requirements from gas riser are specified.
- Tables on old pages 1010 and 1011 have been revised and are now on pages SG 1009.2 and SG 1009.3.
- Old pages 1241 – 1243 are now pages SG 1012.1 – 1012.4.
- Added new page SG 1010.8, “Adequate Support for Wall-Mounted Meter Headers”, to the “Gas Meters Grouped on Meter Headers” standard.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 3 OF 3	Indicates Latest Revision	X	Completely Revised	New Page	Information Removed	SG 6.3
	SDG&E SERVICE STANDARDS & GUIDE					
	SIGNIFICANT REVISIONS LIST					

**000 - GENERAL
INFORMATION**

**000 - GENERAL
INFORMATION**

PAGE**SUBJECT**

001	TABLE OF CONTENTS
002	GENERAL INFORMATION INDEX
003	DEFINITIONS OF TERMS
004	GENERAL INFORMATION
005	LISTING OF LOCKSMITHS AUTHORIZED TO SELL SCHLAGE RESTRICTED VTQP QUAD SECTION KEYWAY
006	UTILITY'S CONTRIBUTION TO FAULT CURRENT
007	SDG&E TRANSFORMER FUSING INFORMATION
008	UTILITY'S CONTRIBUTION TO FAULT CURRENT – SECONDARY VOLTAGE SERVICE EXAMPLES
009	TRANSFORMER VAULTS
010	TESTING REQUIREMENTS FOR METAL-ENCLOSED SERVICE ENTRANCE & UNMETERED FEEDER BUSWAYS
011	ELECTRIC SERVICE POLICIES – NEW & EXISTING CUSTOMERS
012	ELECTRIC SERVICE POLICIES – NEW PROJECT TYPES
013	ELECTRIC SERVICE POLICIES – EXISTING CUSTOMER
014	ELECTRIC SERVICE POLICIES – EXISTING CUSTOMER FEEDER EXCEPTIONS
015	LINE TRUCK ACCESS REQUIREMENTS
016	PULLING DEVICES FOR INSTALLATION OF SERVICE LATERAL CONDUCTORS IN PARKING STRUCTURES
017	PLAQUE SPECIFICATIONS & EXAMPLES
018	MEDIUM-VOLTAGE CONDUCTOR CLEARANCES FOR NON-UTILITY WORKERS & EQUIPMENT
019	CLEARANCES OF OVERHEAD FACILITIES FROM TANKS CONTAINING FLAMMABLE OR EXPLOSIVE MIXTURE
020	PRODUCT DISTRIBUTORS
021	SERVICE ORDER TEAMS & REGIONAL PROJECT MANAGEMENT OFFICES
022	PROJECT MANAGEMENT REGIONAL BOUNDARY MAP
023	FREQUENTLY REFERENCED STANDARDS
024	ALPHABETICAL SUBJECT INDEX

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C							F						
B	FORMATTING	EDM	JK	--	--	5/22/2020	E						
A	NEW PAGE		LSM	LSM	TPM	11/1/2017	D						

**SHEET
1 OF 1**



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

**GENERAL INFORMATION
TABLE OF CONTENTS**

SG001.1

SUBJECT**PAGE #**

Accessibility	SG 004.5
Accessible Meter Locations	SG 005.1
Adding Load to Existing Meter Panels	SG 004.2 – 004.3
Addressing Conventions	SG 004.6
Billing Account Establishment – Application for a Billing Account	SG 003.1, SG 004.3
Character of Service	SG 004.3 – 004.4
Clearances of Overhead Facilities from Tanks Containing Flammable or Explosive Mixture	SG 019
Clearances, Medium-Voltage Conductor Clearances for Non-Utility Workers & Equipment	SG 018.1 – 018.2
Connection or Disconnection of Service	SG 004.4
Definitions of Terms	SG 003.1 – 003.3
Electric Service Policies – Existing Customer Requesting Additional Services or Remote Meter Locations	SG 013.1 – 013.3
General Service Requirement to Multiple Multi-Unit Buildings on a Single Premises	SG 013.1
Multi-Family Residential Buildings – Less Than 3 Stories High	SG 013.1
Residential Contiguous Dwellings – Townhouses (Row Homes)	SG 013.1 – 013.2
Residential or Mixed Use Buildings – 3 Stories or Greater	SG 013.1
Single Premise – Multiple Non-Residential Enterprises	SG 013.2
Single Premise – Multiple Residential Customers	SG 013.3
Single Premise – Single Non-Residential Enterprise	SG 013.2 – 013.3
Single Premise – Single Residential Customer with Other Electric Uses	SG 013.3
Electric Service Policies – Existing Customer Feeder Exceptions	SG 014.1 – 014.5
Electric Service Policies – New & Existing Customers	SG 011.1 – 011.3
Alternate Service Delivery Point Requests	SG 011.2
General Information	SG 011.1
General Requirements	SG 011.1 – 011.2

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 3	<div></div> Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	<input type="checkbox"/> New Page	<input type="checkbox"/> Information Removed	SG 002.1
	SDG&E SERVICE STANDARDS & GUIDE				
	GENERAL INFORMATION ALPHABETICAL SUBJECT INDEX				

SUBJECT**PAGE #**

Rights of Way	SG 011.3
Secondary Serving Voltages & Classification of Service Information.....	SG 011.3
Service Locations	SG 011.2
Electric Service Policies – New Project Types	SG 012.1 – 012.3
General Service Requirement to Multiple Multi-Unit Buildings on a Single Premises	SG 012.1
Multi-Family Residential Buildings – Less than 3 Stories High	SG 012.1
Residential Contiguous Dwellings – Townhouses (Row Homes).....	SG 012.1 – 012.2
Residential or Mixed Use Buildings – 3 Stories or Greater	SG 012.1
Single Premise – Multiple Residential Customers	SG 012.3
Single Premise – Single Non-Residential Enterprise	SG 012.2 – 012.3
Single Premise – Single Residential Customer with Other Electric Uses	SG 012.3
Single-Premise – Multiple Non-Residential Enterprises	SG 012.2
Equipment Responsibilities – Customer & SDG&E.....	SG 004.4
Fault Current, Utility’s Contribution.....	SG 006.1 – 006.2
Fault Current, Utility’s Contribution – Secondary Voltage Service Examples.....	SG 008.1 – 008.7
Gas & Electric Meter Access	SG 005.1
General Information	SG 004.1 – 004.6
Inaccessible Meter Locations	SG 005.1
Line Truck Access Requirements	SG 015
Locksmiths, Listing of	SG 005.1 – 005.2
Markout Service	SG 004.5
Medium-Voltage Conductor Clearances for Non-Utility Workers & Equipment	SG 018.1 – 018.2
Permit & Inspection	SG 004.3
Plaque Specifications & Examples.....	SG 017.1 – 017.3

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 3	Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	New Page	Information Removed	SG 002.2
	SDG&E SERVICE STANDARDS & GUIDE				
	GENERAL INFORMATION ALPHABETICAL SUBJECT INDEX				

SUBJECTPAGE #

Product Distributors	SG 020
Pulling Devices for Installation of Service Lateral Conductors in Parking Structures	SG 016.1 – 016.2
Purpose.....	SG 004.1
Request for Service	SG 004.2
Sample Plaque for Electrical Equipment Labels.....	SG 017.1
Scope.....	SG 004.1 – 004.2
SDG&E Transformer Fusing Information	SG 007.1 – 007.2
Sealing of Meter & Service Facilities	SG 004.5
Secondary Fault Current Calculations	SG 006.1 – 006.2
Secondary Serving Voltages & Classification of Service Information.....	SG 011.3
Service Delivery Point Policy	SG 011.1 – 011.2
Service Planning	SG 004.2
Testing Requirements for Metal-Enclosed Service Entrance & Unmetered Feeder Busways	SG 010
Transformer Fusing Information, SDG&E	SG 007.1 – 007.2
Transformer Vaults	SG 009.1 – 009.4
Trench Inspections.....	SG 004.5
Typical Plaque for Existing Buildings with Intermixed Services	SG 017.3
Typical Plaque for New Buildings or Existing Buildings with Separate Service Areas.....	SG 017.2
Utility's Contribution to Fault Current.....	SG 006.1 – 006.2
Utility's Contribution to Fault Current – Secondary Voltage Service Examples	SG 008.1 – 008.7
Work on Utility-Owned Poles.....	SG 004.5

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 3 OF 3	Indicates Latest Revision	X	Completely Revised	New Page	Information Removed	SG 002.3
	SDG&E SERVICE STANDARDS & GUIDE					
	GENERAL INFORMATION ALPHABETICAL SUBJECT INDEX					

Approved: Acceptable and in conformance with SDG&E's (Utility's) rules and policies and governmental Authorities' Having Jurisdiction (AHJ's) laws, codes and ordinances.

Billing Account Establishment: A request to the Utility for electric and/or gas service as distinguished from an inquiry as to the availability of or charges for such service. Contact the Utility's Customer Contact Center at 1-800-411-7343, to "make application" for a billing account as soon as the street address has been assigned by the AHJ.

Building: Normally a structure which stands alone and is used or intended for supporting or sheltering any use or occupancy. Whenever there is a question whether or not the structure is a separate building, the appropriate AHJ shall make that determination.

Customer Generation: Production of electrical energy not generated by the Utility.

Final Grade: The grade after paving or improvements has been completed.

Governmental Authority Having Jurisdiction (AHJ): See Inspection Authority.

Inspection Authority: An agency responsible for issuing permits, making inspections of the customer's electrical wiring system (premises wiring), and notifying the Utility that such wiring and system components meet the criteria enforced by the agency. Inspection authorities include city, county, state and federal agencies, Indian reservations authorized to make electrical inspections, appropriate sections of school, port, transit, and water districts and other entities with legal jurisdiction over premises wiring.

Meter Room: A weatherproof, illuminated room provided by the customer at their option and approved by SDG&E for the location of electric metering equipment.

Meter Sequence: The sequential relationship between the service switch and the Utility's billing meter in a series arrangement. The term 'new sequence' means a meter-switch-fuse sequence. 'Old sequence' means a switch-fuse-meter sequence.

Metered Circuits: Those conductors extending from the meter and other service equipment to the loads or outlets connected to such circuits. Metered circuits are not permitted to serve another premise.

Premises: All of the real property and apparatus employed in a single enterprise on an integral parcel of land undivided, except in the case of industrial, agricultural, oil fields, resort enterprises and public or quasi-public institutions by a dedicated street, highway, or other public thoroughfare, or a railway. Automobile parking lots constituting a part of, and adjacent to, a single enterprise may be separated by an alley from the remainder of the premises served.

Premises – Agricultural: Real property used for agricultural purposes where sprinklers, sprayers, portable irrigation pipe, etc. are used, including property in an agricultural area not under cultivation, which is capable of being traversed by vehicles or agricultural equipment.

Premises – Commercial: Real property from which services are offered and rendered to the public, or from which products are sold and distributed for gain, including premises where residential units are combined with commercial enterprises. For residential living units exceeding two in number on the same premises, see "Premises – Residential".

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 3

SDG&E SERVICE STANDARDS & GUIDE

DEFINITIONS OF TERMS

SG 003.1

Premises – Identification: Approved numbers or addresses to be placed for all new buildings or structures in such a position as to be plainly visible and legible from the street or road fronting the property.

Premises – Industrial: Real property upon which an enterprise is engaged in processing or manufacturing raw or unfinished materials into another form or product.

Premises – Residential: Real property used solely for residential purposes and complying with the following provisions:

1. Premises from which services are not offered or rendered to the public, or from which products are not commercially produced, sold, or distributed for gain.
2. Premises upon which any combination of residential living units does not exceed two in number, whether on one level or more.

Note: Residential living units exceeding two in number on the same premises are classified as a commercial enterprise and commercial premises requiring commercial service drop clearances; however, metering provisions for individual living units shall comply with residential requirements. (See pages SG 006.1 – 006.2 for Utility's contribution to fault current values.)

Pull Box: A subsurface box, usually concrete, used for pulling or splicing Utility cables. Also known as a handhole. (Not to be used to terminate customer's service entrance conductors.)

Pull Can: A wall-mounted enclosure used for pulling, routing, or connecting the Utility's service conductors to the customer's service equipment.

Pull Section: An Underground Pull Section (UGPS) is a separate compartment of freestanding, metal or metalclad switchboard; which is used for connecting the Utility's service conductors to the customer's service equipment.

Readily Accessible: Capable of being reached quickly and conveniently 24 hours a day for construction, operation, maintenance, inspection, testing or reading, without requiring those seeking access to climb over or remove obstacles, or to obtain special permission or security clearances.

Service Delivery Point: The point of connection of the Utility's service conductors and the customer's service entrance conductors.

Service Drop Conductors: The Utility's overhead conductors extending from its pole line to the point of service drop support on a building or structure.

Service Entrance Conductors – Overhead: The customer's conductors or bus bars extending from the service equipment to the point of connection to the Utility's service drop conductors.

Service Entrance Conductors – Underground: All conductors or bus bars installed by the customer beyond and including the point of connection to the Utility's service lateral conductors.

Service Lateral: The underground service lateral conductors in the customer's conduit, installed by the Utility from the designated source to the point of connection with the customer's service entrance conductors.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
2 OF 3

SDG&E SERVICE STANDARDS & GUIDE

DEFINITIONS OF TERMS

SG 003.2

Service Point: The point of connection between the facilities of the serving Utility and the premises wiring.

"Shall," "Should," "Will" and "May": Throughout this Service Standards & Guide, the words "shall" and "will" are used to indicate the more rigid requirements of the Utility or AHJ, while "should" and "may" are used to indicate recommendations, or that which is advised but not necessarily required.

Single Enterprise: A separate business or other individual activity carried on by a customer. The term does not apply to associations or combinations of customers. One person may be conducting several activities of which one activity may be a single enterprise.

Submeters: Customer-furnished, -installed, -owned, and -maintained meters behind a master Utility meter. Residential submeters may be permitted in certain special circumstances. Submetering of non-residential service is prohibited.

Terminating Enclosure: A Utility-approved pull can or pull section at the service delivery point for connecting the Utility's underground service lateral conductors and the customer's service entrance conductors. See SG 703 for 0 – 600 volt terminating enclosures and SG 608.1 – 608.3 for switchgear underground service terminating pull section.

Utility Meters: Utility-furnished, -installed, -owned and -maintained meters used to measure consumption for billing purposes.

Utility's Operating Convenience: The utilization, under certain circumstances, of facilities or practices not ordinarily employed which contribute to the overall efficiency of the Utility's operations.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
3 OF 3

SDG&E SERVICE STANDARDS & GUIDE

DEFINITIONS OF TERMS

SG 003.3

PURPOSE

San Diego Gas Electric Company (SDG&E) is an investor-owned Utility committed to building the cleanest, safest and most reliable energy company in America and providing the best possible service to its customers in the company's 4,105 square mile service area.

The Service Standards & Guide contains information essential to the establishment of service to new facilities, or to remodeled or expanded facilities where load has been added. This information is intended for use by all interested customers and particularly by members of technical and professional trades concerned with the design and building of facilities to receive service from SDG&E's system.

SCOPE

The Service Standards & Guide presents general and detailed information to help ensure that a service installation will be adequate for present and future power needs. The manual seeks to outline service requirements in accordance with the regulations of the governmental Authority Having Jurisdiction (AHJ) who will inspect the service connection prior to permitting the Utility to establish service.

The Service Standards are basically founded upon standards of good safety practices and electrical codes enforced by the AHJs in the Utility's service area. We have endeavored to bring them all together in a single, convenient form for easy use.

Following is a list of references on which this manual is based:

1. Rules for Overhead Electric Line Construction: General Order 95 of the Public Utilities Commission, State of California
2. Rules for Construction of Underground Electrical Supply and Communication Systems: General Order 128 of the Public Utilities Commission, State of California
3. Title 24. State Building Standards Electrical Code, formerly known as Electrical Safety Orders of the Division of Industrial Safety, Department of Industrial Relations, State of California
4. National Electrical Code (NFPA 70), an ANSI standard, published by the National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.
5. Applicable laws and ordinances of the county or city where the service connection is installed

The contents of the Service Standards & Guide are taken from a number of authoritative sources, and since they are compiled in a form we believe will best suit your interests, we have avoided precise footnoting of references.

When an unusual situation confronts you, one that doesn't appear to be spelled-out specifically in this manual, please contact your Customer Project Planner or Service Standards for clarification.

Project Management and the Service Order Teams are the special departments that will answer your individual questions and aid you in the design and construction of service connections. You will find a list of the offices where representatives may be reached in the front of this manual on page SG 2.

The Planner will meet with you to discuss your particular project, and work out a solution which will be satisfying for you and for the future customers the Utility will serve with safe and reliable energy.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 6

SDG&E SERVICE STANDARDS & GUIDE

GENERAL INFORMATION

SG 004.1

SERVICE PLANNING

Please be advised that whenever design of electrical plans is considered for a commercial, industrial or residential structure, contact the Utility as soon as possible.

Following are the reasons why:

1. The Utility will work with you to establish the serving voltage and an acceptable meter and service location.
2. Early discussion of the project will enable the Utility to determine the most favorable rate schedule for the customer, and provide the Utility the ability to meet your construction schedule.
3. You can prevent the unnecessary expense of redesign, construction charges, or delays by not assuming the type of service the Utility will provide.

REQUEST FOR SERVICE

At the time of this initial contact, simply provide the following information:

1. Street address and legal description of the property, and
2. Plot, grading, elevation, and site improvement plans.

For any of your building project needs, you can find brochures and forms at SDG&E's Builder Services Resources page online at <http://www.sdge.com/builder-services/builder-services-resources>.

Available forms include:

- Request for Service – Residential Single Family Dwelling
- Request for Service – Residential Subdivision/Development
- Request for Service – Residential Commercial/Industrial Development

Also, you may utilize the regional SDG&E Contacts noted in SG 2.

SDG&E Tariffs including Rule 15 can be accessed at <http://www.sdge.com/rates-regulations/current-and-effective-tariffs/current-and-effective-tariffs/>.

ADDING LOAD TO EXISTING METER PANELS

Existing customers receiving electric service at 480 volts, or less, shall provide written notification to the Utility a minimum of 30 days in advance of connecting all new electric loads with a rating of 20 kW, or greater, or smaller loads added over a 12-month period of time with aggregate ratings totaling 20 kW, or greater.

Existing customers receiving electric service at over 480 volts shall provide written notification to the Utility a minimum of 30 days in advance of connecting all new electric loads with a rating of 200 kW, or greater, or smaller loads added over a 12-month period of time with aggregate ratings totaling 200 kW, or greater.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------

SHEET
2 OF 6

SDG&E SERVICE STANDARDS & GUIDE

GENERAL INFORMATION

SG 004.2

It is the customer's responsibility to notify the Utility, in writing, within 15 days if the customer makes any change in the connected load, or the size or character of their appliances or apparatus. Such changes may require a new application for service and/or a change in the Utility's service facilities.

Refer to Rule 2, B.9 and B.10 and Rule 3, C. SDG&E Tariffs, including Rules 2 and 3, can be accessed at <http://www.sdge.com/rates-regulations/current-and-effective-tariffs/current-and-effective-tariffs/>.

APPLICATION FOR A BILLING ACCOUNT

The initial contact with the Utility for meter and service requirements is not an application for services. There is another simple step which is taken care of through a separate channel at SDG&E. An application for a billing account must be made before service can be established. Applications can usually be made by telephone. This should be done at the time of initial contact or shortly thereafter to avoid delays in establishing service. For additional information, see page SG 003.1, "Billing Account Establishment".

PERMIT & INSPECTION

Prior to service being energized, an inspection by the AHJ is required. All energy consumption must be metered.

Briefly, the steps are:

1. An electrical permit is obtained from the appropriate AHJ by the contractor or other qualified person.
2. Wiring for the facility is completed by an electrician or other qualified person.
3. Inspection of the installation is made by the AHJ who notifies the Utility of acceptance.
4. The installation is cleared to the Utility.
5. The Utility connects to the customer's service equipment and sets the meter.

Modifications, alterations, or re-establishment of electric service may require an inspection clearance by the AHJ.

CHARACTER OF SERVICE

Service supplied throughout the Utility's service area is alternating current at a frequency of approximately 60 cycles per second, and at the normal voltage available at any specific location on the distribution system. A detailed description of service is outlined in Rule 2 of the Company's Rules for the Sale of Electric Energy, as filed with the California Public Utilities Commission.

Single-family residences on individual lots and most small commercial loads are normally served by a 3-wire, single-phase, 120/240-volt service. Multi-family residential developments, industrial loads, substantial commercial loads and three-phase loads usually require special engineering studies to establish the serving voltage, and should be referred to the nearest SDG&E office at an early planning stage.

Service Standards and the appropriate AHJ may approve a 2-wire, single-phase, 120 volts where the load does not exceed one 15-amp and one 20-amp branch circuit.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 3 OF 6	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 004.3
	SDG&E SERVICE STANDARDS & GUIDE					
	GENERAL INFORMATION					

A 4-wire, three-phase, 208Y/120-volt service may be provided to multi-family buildings; however, the individual occupancies must be served and metered single-phase, 200 amps maximum. In mixed-use buildings, commercial service may be metered single-phase, 200 amps maximum.

Three-phase, 480-volt service from an overhead transformer station, where available, is supplied 3-wire, delta-connected, with B-phase grounded and a separate 4th wire service ground conductor (redundant ground, not a "neutral").

All customer requests for 480-volt service from a padmount transformer will be served three-phase, 4-wire, 480Y/277 volts.

All customers on the Utility's electric distribution system are occasionally subjected to momentary fluctuations in serving voltage. These are caused by disturbances such as lighting surges and short circuits, and are impossible to prevent. Any customer having or planning to install voltage-sensitive equipment (such as solid-state controls) which cannot override momentary voltage fluctuations should consider installing specially designed protective apparatus as part of their own electrical system.

Maximum service panel size allowed to be served by a 120/240-volt, 3-phase delta transformer installation (overhead or underground) is 600 amps.

Maximum service panel size allowed to be served by an overhead 480-volt, 3-phase delta transformer installation is 600 amps.

EQUIPMENT RESPONSIBILITIES

1. Customer:
 - a. The customer is to provide and install their own service equipment. This includes, but is not limited to, the following equipment:
 - i. Service entrance conductors (No. 8 AWG minimum for overhead services)
 - ii. Service terminating equipment
 - iii. Service switches and circuit breakers
 - iv. Fuses
 - v. Meter sockets and a stainless steel or aluminum retainer (flimsy) ring for each socket
 - vi. Meter and instrument transformer housings
 - vii. Service switchboards and associated devices
 - viii. Other related equipment as required by the Utility
 - b. After the customer has installed their equipment in accordance with the requirements of the appropriate AHJ and the Utility, the customer will be responsible for its maintenance.
2. Utility: All meters, metering transformers, test switches, and other associated metering equipment will be provided, installed, owned, and maintained by the Utility in accordance with our filed Rule 16. See definition of "Utility Meters" on page SG 003.3.

CONNECTION OR DISCONNECTION OF SERVICE

The Utility will be responsible for any connection or disconnection of service between company power lines and customer-owned facilities. Only authorized employees or agents of the company are permitted to do this work. Arrangements may be made for this work to be done on a specific day. It is advised to give as much advance notice as possible for a turn-on or shut-off of service.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 4 OF 6	<div>X</div> Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 004.4
	SDG&E SERVICE STANDARDS & GUIDE				
	GENERAL INFORMATION				

Because of safety rules and special training required, properly qualified Utility linemen are the only persons permitted to climb the Utility's poles.

The Utility will seal all service raceways, pull cans, pull sections, metering compartments with doors or removable covers, meters, test switches, and other facilities for service and metering installations. The seal is a bond of mutual protection for the Utility and for the customer. As such, it may not be broken by anyone but an authorized representative of the Utility. See page SG 503 for additional sealing requirements.

If it becomes necessary for any person to break a seal for any legitimate reason, they shall secure permission to do so by calling the nearest Project Management Regional Office listed in front of this manual on page SG 2.

In the express interests of providing the best possible electric service to all customers, the Utility must have immediate 24-hour access to their facilities located on the customer's premises. We make every effort to do our work with the least inconvenience to the customer.

When a service connection is terminated, the Utility must remove its property from the premises.

Electrically operated gates, which do not permit immediate 24-hour access to electric and gas facilities for SDG&E and local fire department personnel, could pose a safety hazard. If an electrically operated security gate is to be installed, the customer is responsible for installing a SDG&E Schlage Restricted VTQP quad section cylinder in a key switch wired to the gate controller. The key switch should be located in a housing that allows an authorized Utility employee, or authorized agent, to drive up and insert their key in the cylinder to activate the gate controller without having to leave their vehicle. If site conditions make this requirement impractical, contact SDG&E's Planner for approval of an alternate location. See pages SG 005.1 – 005.2 for a list of locksmiths authorized to sell Utility-approved locks. You should contact the fire department which services your area to obtain their requirements. The customer is also required to provide a means of opening the gate from the inside without the use of a vehicle to activate the controller. This may require the installation of an additional key switch inside the gate if there is not an unsecured switch available for the Utility's use.

Before you begin digging at your building site, call DigAlert at 811 (Underground Service Alert of Southern California [USA]) for markout service. By contacting DigAlert, you can avoid conflict with existing underground facilities. You may call DigAlert at 811, or visit their website at <http://www.digalert.org>.

To request inspections for gas and/or electric trenches, see page SG 2 for contact information.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 5 OF 6	X	Indicates Latest Revision		Completely Revised		New Page		Information Removed	SG 004.5
	SDG&E SERVICE STANDARDS & GUIDE								
	GENERAL INFORMATION								

ADDRESSING CONVENTIONS

AL	Alarm
CG	Customer Generation (Generator Output Meter)
CP	Control Power (for Primary Services)
CS	Cell Site
EL	Elevator
EV	Electric Vehicle
FA	Fire Alarm
FC	Fuel Cell (for Gas)
FM	Facility Meter
FP	Fire Pump
HM	House Meter
IR	Irrigation
MC	Meter Cabinet
ND	Network Device
PS	Pump Service (Domestic, Agricultural or Commercial)
REC	Recreation Room
RR	Railroad
SPK	Sprinkler
SL	Street Light
TEL	Telephone
TP	Temporary Power
TR	Trolley
TS	Traffic Signal
TV	Cable TV

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 6 OF 6	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 004.6
	SDG&E SERVICE STANDARDS & GUIDE					
	GENERAL INFORMATION					

SHEET 1 OF 2	Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	New Page	Information Removed	SG 005.1
	SDG&E SERVICE STANDARDS & GUIDE				
	LISTING OF LOCKSMITHS AUTHORIZED TO SELL SCHLAGE RESTRICTED VTQP QUAD SECTION KEYWAY				

EAST COUNTY AREA		
A Aaron Lock & Key 3027 Lemon Grove Ave Lemon Grove, CA 91945 619-462-3381	A Garage Door & Gate Store 9901 Maine Ave Lakeside, CA 92040 619-561-9370	Kwik-Key Locksmiths 7368 El Cajon Blvd La Mesa, CA 91941 619-667-5120
Lynn's Locksmith Service 1380 East Main St El Cajon, CA 92021 619-447-7332		
NORTH COUNTY AREA		
A-1 Lock & Safe 6020-B Paseo Del Norte Carlsbad, CA 92011 760-431-5397 (Also Serves San Diego & South Bay Areas)	Adobe Lock & Safe 184 South Rancho Santa Fe Rd San Marcos, CA 92078 760-727-5470	B&B Lock & Safe 250 Woodward Ave #C Escondido, CA 92025 760-746-8060
Carlsbad Village Lock & Key 3138 Roosevelt St #E Carlsbad, CA 92008 760-434-6600	Foothill Lock & Security 1650 Ord Way Oceanside, CA 92056 760-806-9000 / 858-999-4400	Pro-Tec Lock & Safe 601 Oceanside Blvd #A Oceanside, CA 92054 760-722-1479
Quality Lock & Safe 340 East Broadway Vista, CA 92084 760-945-4545 (Also serves Orange County)	Ramona Locksmith 811½ D St Ramona, CA 92065 760-789-4189 (Serves Julian, Ramona, Santa Ysabel)	RL Helms Lock & Door 4140 Oceanside Blvd Unit 159-406 Oceanside, CA 92056 760-685-2794
Superior Locksmith Escondido, CA 760-580-8777 (Mobile)	Vista Lock & Safe Co 1025 South Santa Fe Ave #A Vista, CA 92083 760-726-0310 (Also serves San Diego area)	
ORANGE COUNTY AREA		
Capistrano Lock and Safe 32118 Paseo Adelanto, #5AR San Juan Capistrano, CA 92675 949-496-5625	Controlled Key Systems, Inc. 17248 Red Hill Ave Irvine, CA 92614 949-756-1121	Custom Lock & Key Serves All Orange County 714-788-9660 / 949-233-4422
Martin Lock & Safe Company 26072 Merit Cir #108 Laguna Hills, CA 92653 949-582-5652 (Serves South Orange County)	Tony's Locksmith & Safe Service 429 Ave de la Estrella San Clemente, CA 92672 949-492-5700 (Serves South Orange County)	

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 2	<div></div>	Indicates Latest Revision	<div>X</div>	Completely Revised	<div></div>	New Page	<div></div>	Information Removed	SG 005.2
	SDG&E SERVICE STANDARDS & GUIDE								
	LISTING OF LOCKSMITHS AUTHORIZED TO SELL SCHLAGE RESTRICTED VTQP QUAD SECTION KEYWAY								

The California Electrical Code requires the installation of service equipment with overcurrent protective devices with a short circuit current rating equal to, or not less than, the available fault current provided by SDG&E (Utility), and when applicable, the contribution to fault current from customer's motor contribution.

The Utility's maximum contribution to fault current is stated as follows:

1. Residential – Applicable to a single-family residence or duplex as defined in Rule 1 (which may include a house meter for a total of 3 meters), multi-family residential service consisting of 3 or more dwelling units, or a mobile home; also applicable to service used in common for residential purposes in a multi-family dwelling, on a single premises, whether separately metered or combined with service to an individual dwelling unit. The Utility's contribution to the available fault current at the point of connection of service conductors to the customer's facilities will not exceed the values listed in Table 1.

TABLE 1

Phase	Serving Voltage (volts)	Service Entrance Ampacity (amps)	Utility's Contribution to Fault Current Will Not Exceed (amps)
1Ø	120/240	225 or less	10,000
1Ø	120/240	226 – 600	22,000
1Ø	120/208	200 or less	42,000
1Ø*	120/240	800	42,000
3Ø	120/240	600 or less (See Item 4)	42,000
3Ø	208Y/120	3,000 or less	42,000
3Ø	208Y/120	3,001 – 4,000	65,000

* Deviation required for 800 amps and above, single-phase, residential service requests.

Reference DM 6142.1.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
1 OF 2

SDG&E SERVICE STANDARDS & GUIDE

UTILITY'S CONTRIBUTION TO FAULT CURRENT

SG 006.1

2. Non-Residential – Applicable to all non-residential occupancies such as, but not limited to, commercial, industrial, agricultural, governmental, educational institutions, hospitals, medical clinics, etc. The Utility's contribution to the available fault current at the point of connection of the Utility's service conductors to the customer's facilities will not exceed the values listed in Table 2.

TABLE 2

Phase	Serving Voltage (volts)	Service Entrance Ampacity (amps)	Utility's Contribution to Fault Current Will Not Exceed (amps)
1Ø	120/208	200 or less	42,000
1Ø	120/240	400 or less	42,000
1Ø	240/480	200 or less	10,000
3Ø	120/240	600 or less (See Item 4)	42,000
3Ø	208Y/120	3,000 or less	42,000
3Ø	208Y/120	3,001 – 4,000	65,000
3Ø	480	600 or less (See Item 5)	30,000
3Ø	480Y/277	2,000 or less	30,000
3Ø	480Y/277	2,001 – 3,000	45,000
3Ø	480Y/277	3,001 – 4,000	65,000

3. SDG&E's available fault current for medium and high voltage services will be calculated on an individual basis and will be quoted for both the initial and ultimate three-phase, line-to-line, and line-to-ground fault current values.
4. Maximum service panel size allowed to be served by a 120/240 volt, three-phase delta-connected transformer installation, overhead or underground, is 600 amps.
5. Maximum service panel size allowed to be served by an overhead 480 volt, three-phase delta-connected transformer installation is 600 amps.

Reference DM 6142.1.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 2

SDG&E SERVICE STANDARDS & GUIDE

UTILITY'S CONTRIBUTION TO FAULT CURRENT

SG 006.2

SCOPE: This standard provides primary fusing information for SDG&E distribution transformers.

REPLACEMENT FUSE FOR BAY-O-NET						
Transformer			Catalog Number			
kV	KVA	Fuse Size Amps	Kearney	RTE	Voltage	Impedance
2.4	25	15	124080-15	4038105C07		1.2%
	50	35	124080-35	-		1.8%
	50	40	-	4038105C11		1.8%
4.16	75	15	124080-15	4038105C07		1.3%
	150	30	124080-30	-		1.3%
	500	100	-	4000353C16		3.5%
6.9	25	6	124080-6	4038105C04		1.2%
	50	12	124080-12	4038105C06		1.8%
	75	15	124080-15	4038105C07		1.8%
12.0	75	6	124080-6	4038105C04		1.3%
	150	12	124080-12	4038105C06		1.3%
	225	15	124080-15	4038105C07	2400/4160Y/2400 OR 2400/4160GrdY/2400	4.63%
			124080-15	4038105C07	240/120 3Ø 4W	1.6%
	300	25	124080-25	4038105C09	208Y/120	2.2%
			124080-25	4038105C09	480Y/277	1.3%
	500	40	-	4000353C12	2400/4160Y/2400 OR 2400/4160GrdY/2400	4.63%
			-	4000353C12	208Y/120	3.5%
			-	4000353C12	480Y/277	2.2%
	750	65	-	4000353C14		5.32%
	1000	65	-	4000353C14		5.32%
	1500	100	-	4038361C04CB		5.32%
	2000	125	-	4038361C05CB		5.32%
	2500	125	-	4038361C05CB		5.32%

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 2	<div>X Indicates Latest Revision</div>	Completely Revised	New Page	Information Removed	SG 007.1
	SDG&E SERVICE STANDARDS & GUIDE				
	SDG&E TRANSFORMER FUSING INFORMATION				

**LIVE FRONT TRANSFORMER FUSING TABLE, THREE-PHASE, 12KV
TYPE SM-4 RATED 14.4KV**

Nominal Voltage- kV	Transformer Rating-KVA	Fuse Size Amps	S&C Catalog No.	Impedance
14.4	1500	125	122200R4	5.32%
14.4	2000	150	122250R4	5.32%
14.4	2500, 3000	200	122300R4	5.32%

Note: This information may be used by the customer's engineers when calculating the incident energy levels for arc flash conditions, or performing protection coordination studies for secondary voltage services.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

**SHEET
2 OF 2**

SDG&E SERVICE STANDARDS & GUIDE


SDG&E TRANSFORMER FUSING INFORMATION

SG 007.2

EXAMPLE 1

Application: Applies to two dwelling units with grouped meters with a combined service disconnect rating of 225 amps maximum.

Exception: Two main service disconnects rated 125 amps each is permissible.

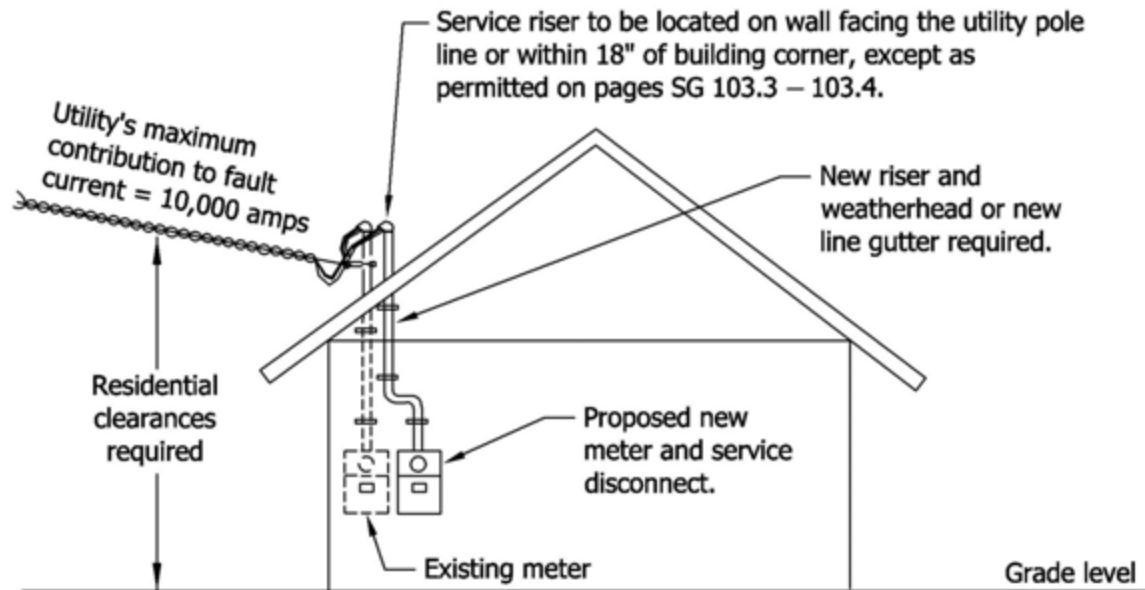

Conclusion:

New dwelling unit meter plus existing must not exceed 225 amps maximum, single-phase, 120/240 volts. Residential metering equipment is acceptable. Utility contribution to fault current will not exceed 10,000 amps. See page SG 006.1 Table 1. Residential clearances apply per G.O. 95.

Note:

Electrician shall provide equipment rated for the fault current of the system.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 7


SDG&E SERVICE STANDARDS & GUIDE

**UTILITY'S CONTRIBUTION TO FAULT CURRENT
SECONDARY VOLTAGE SERVICE EXAMPLES**

SG 008.1

EXAMPLE 2

Application: Applies to multi-family residential buildings with 3 or more residential dwelling units with grouped meters.

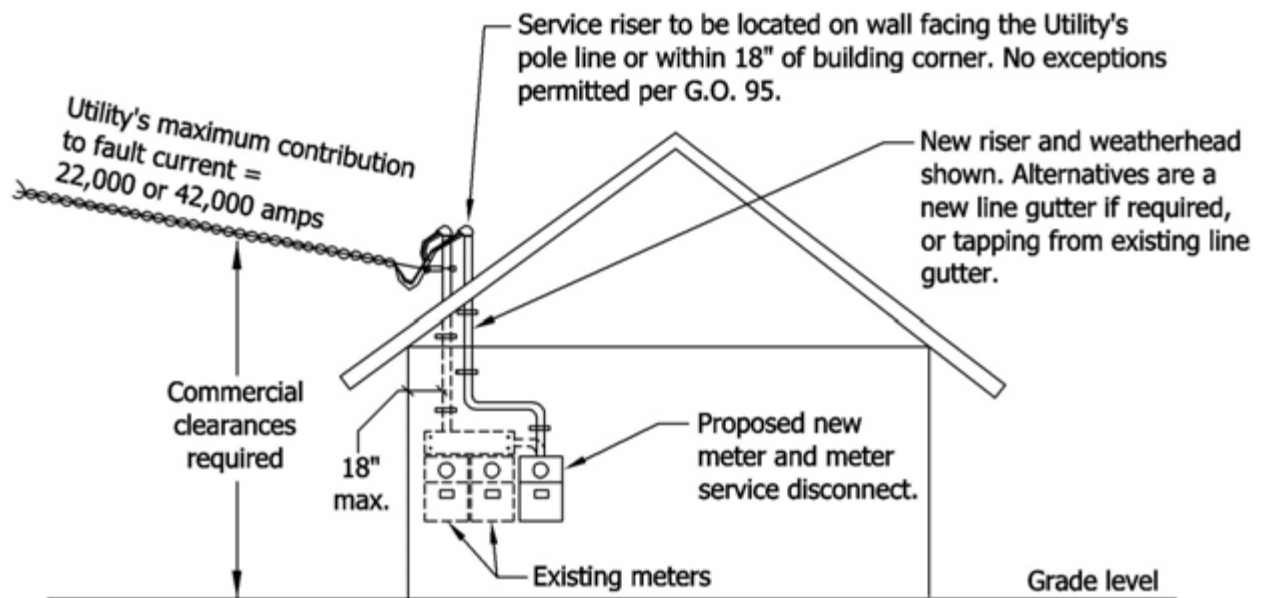

Conclusion:

New dwelling unit meter must not exceed 225 amps maximum, single-phase, 120/240 volts. Test-bypass facilities are not required. Utility's contribution to fault current will not exceed the values shown on page SG 006.1 Table 1 and are based on the service ampacity. Commercial clearances apply per G.O. 95.

Notes:

1. Electrician shall provide equipment rated for the fault current of the system.
2. A main disconnect is required ahead of 7 or more meter service disconnects.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
2 OF 7


SDG&E SERVICE STANDARDS & GUIDE

**UTILITY'S CONTRIBUTION TO FAULT CURRENT
SECONDARY VOLTAGE SERVICE EXAMPLES**

SG 008.2

EXAMPLE 3

Application: Applies to adding one new residential meter set to two existing dwelling units with grouped meters **600 amps or less service ampacity**.

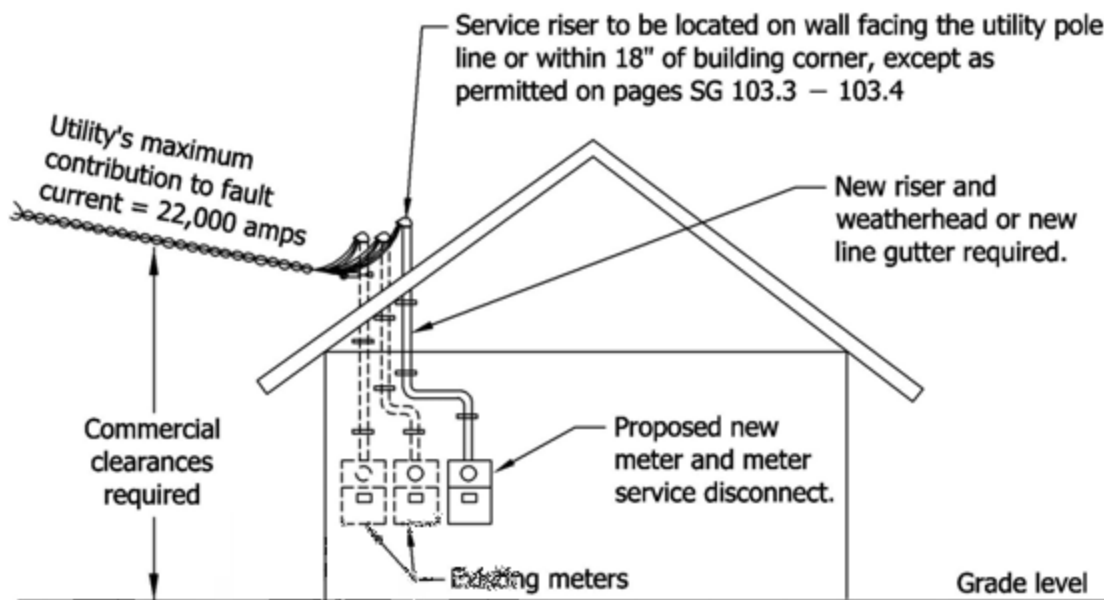

Conclusion:

600 amps maximum service size, single-phase, 120/240 volts. Test-bypass facilities are not required. Utility contribution to fault current will not exceed the values shown on page SG 006.1 Table 1. Commercial clearances apply per G.O. 95.

If service amperage exceeds 600 amps, refer to page SG 006.1 Table 1 for Utility's maximum contribution to fault current.

Note:

Electrician shall provide equipment rated for the fault current of the system.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
3 OF 7


SDG&E SERVICE STANDARDS & GUIDE

**UTILITY'S CONTRIBUTION TO FAULT CURRENT
SECONDARY VOLTAGE SERVICE EXAMPLES**

SG 008.3

EXAMPLE 4

Application: Applies to multi-family residential buildings with 3 or more residential units with grouped meters.

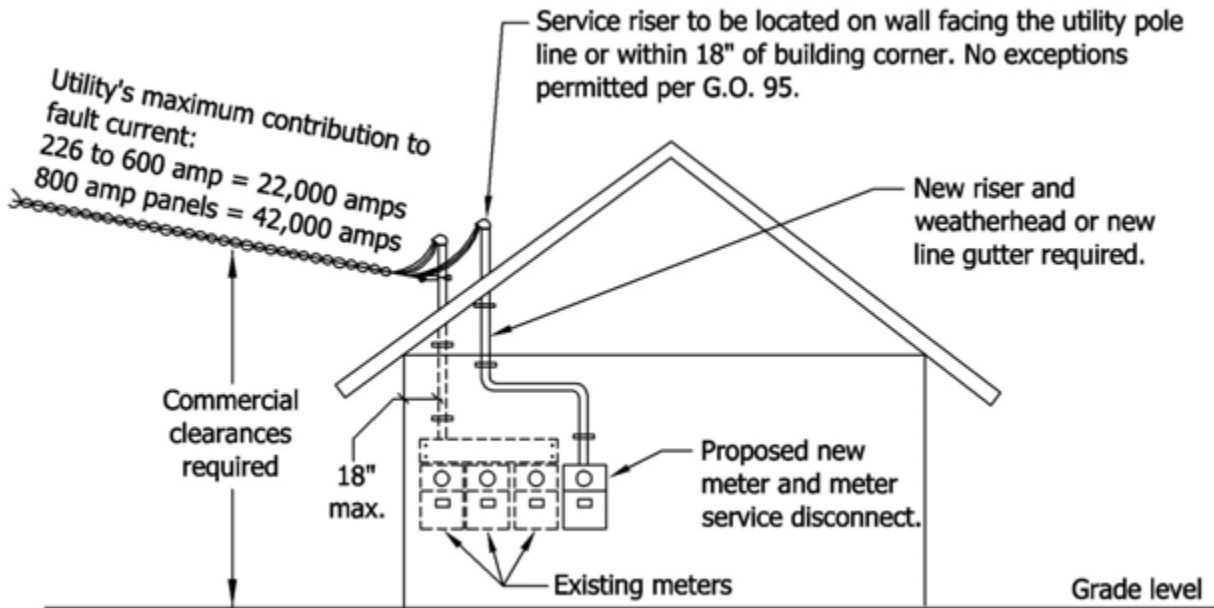

Conclusion:

New house meter – 225 amps maximum, 1 phase, 120/240 volts. Test-bypass facilities are not required. Utility's contribution to fault current will not exceed the values shown on page SG 006.1 Table 1 and are based on the service ampacity. Commercial clearances apply per G.O. 95.

Notes:

1. Electrician shall provide equipment rated for the fault current of the system.
2. A main disconnect is required ahead of 7 or more meter service disconnects.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
4 OF 7


SDG&E SERVICE STANDARDS & GUIDE

**UTILITY'S CONTRIBUTION TO FAULT CURRENT
SECONDARY VOLTAGE SERVICE EXAMPLES**

SG 008.4

EXAMPLE 5

Application: Applies to residential units (3 or more) with grouped meters in a meter cabinet (doors not shown) with a serving voltage of single-phase, 3-wire, 120/240 volts, **600 amps maximum**.

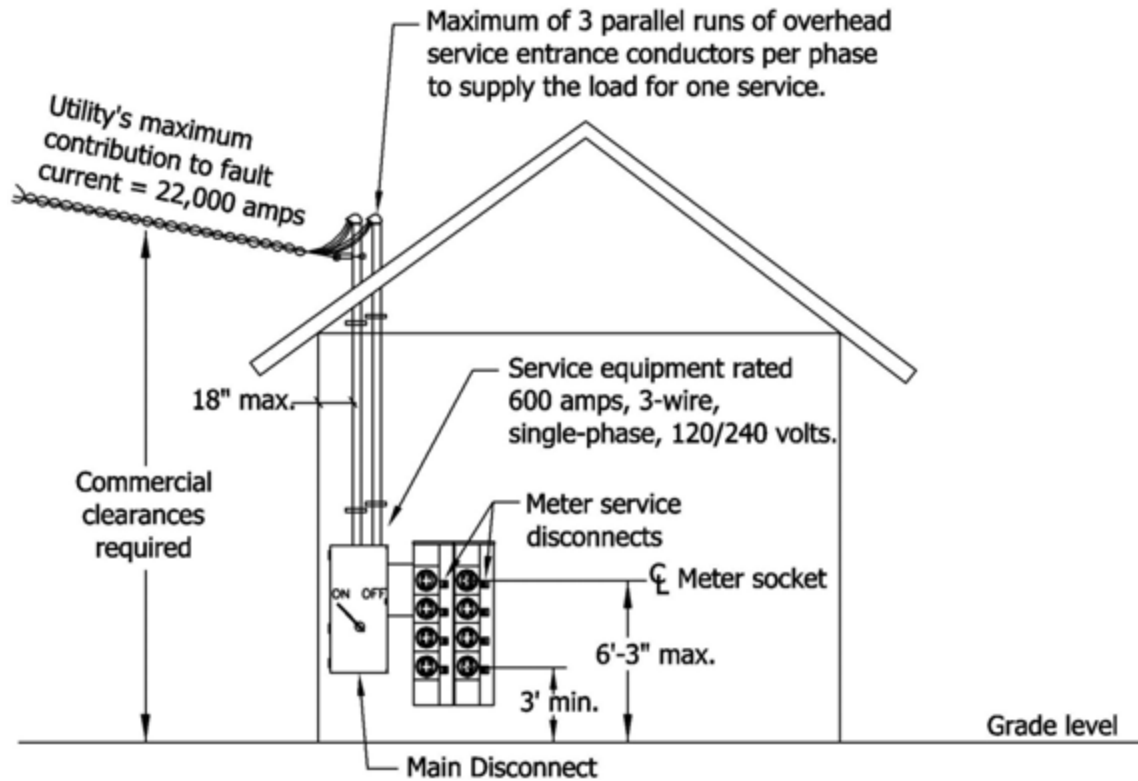

Conclusion:

Utility contribution to fault current will not exceed the values shown on page SG 006.1 Table 1 and are based on the service ampacity. Commercial clearances apply per G.O. 95.

Notes:

1. Electrician shall provide equipment rated for the fault current of the system.
2. A main disconnect is required ahead of 7 or more meter service disconnects.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
5 OF 7


SDG&E SERVICE STANDARDS & GUIDE

**UTILITY'S CONTRIBUTION TO FAULT CURRENT
SECONDARY VOLTAGE SERVICE EXAMPLES**

SG 008.5

EXAMPLE 6

Application: Applies to commercial or industrial grouped metering.

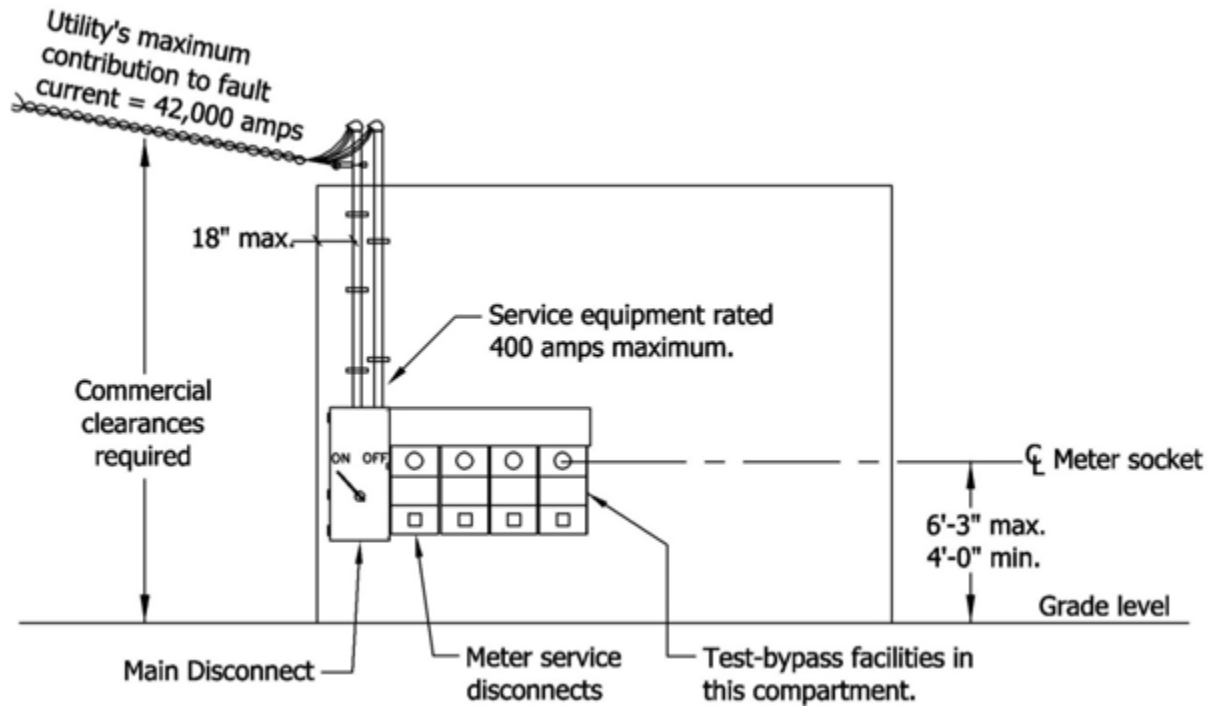

Conclusion:

Utility contribution to fault current will not exceed the values shown on page SG 006.2 Table 2 and are based on the service ampacity. Commercial clearances apply per G.O. 95.

Notes:

1. Electrician shall provide equipment rated for the fault current of the system.
2. A main disconnect is required ahead of 7 or more meter service disconnects.
3. Factory-installed test-bypass facilities are required for 100 and 200 amp commercial/industrial service equipment.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
6 OF 7


SDG&E SERVICE STANDARDS & GUIDE

**UTILITY'S CONTRIBUTION TO FAULT CURRENT
SECONDARY VOLTAGE SERVICE EXAMPLES**

SG 008.6

EXAMPLE 7

Application: Applies to temporary service – overhead or underground to serve residential and commercial/industrial premises with a 200 amp maximum, single-phase or three-phase service.

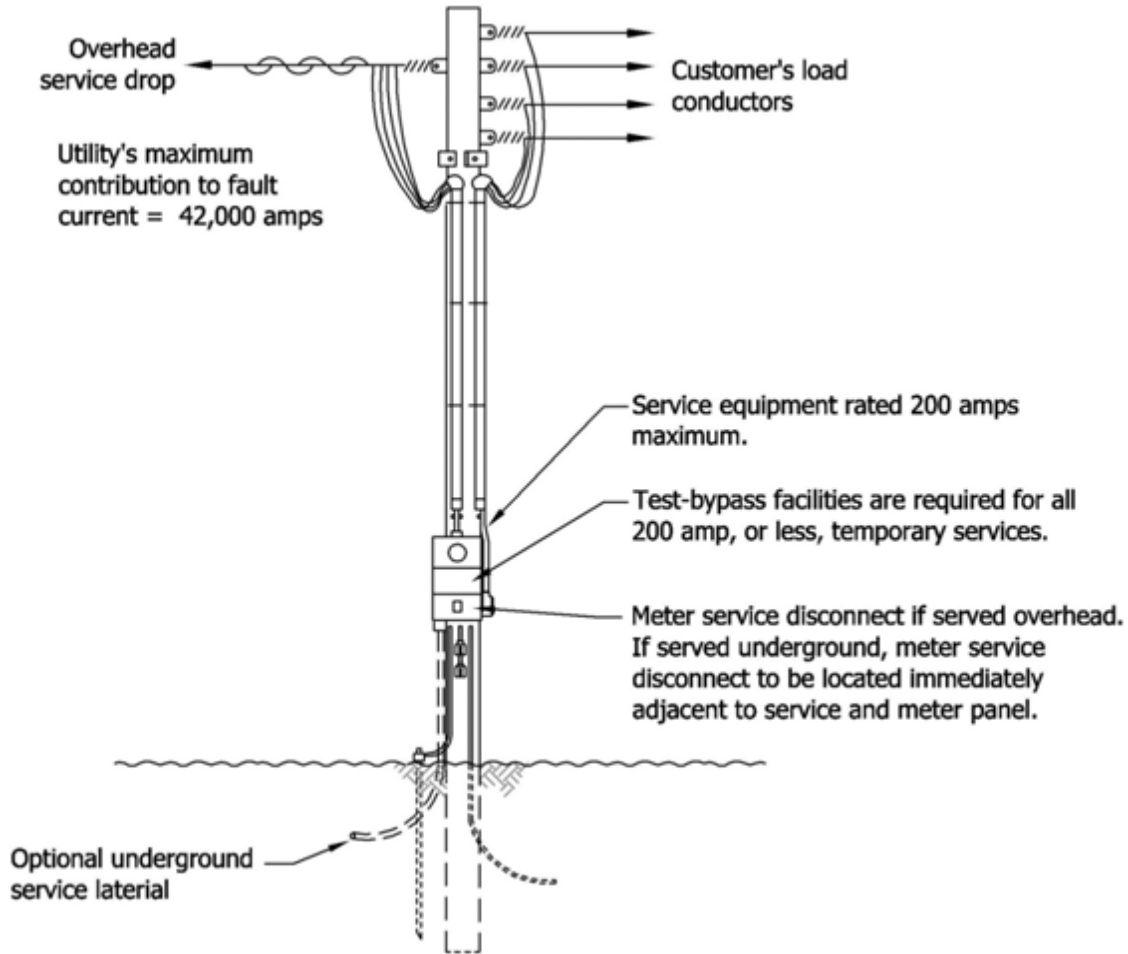

Conclusion:

Utility contribution to fault current will not exceed the values shown on page SG 006.2 Table 2 and are based on the service ampacity. Commercial clearances apply per G.O. 95.

Notes:

1. Electrician shall provide equipment rated for the fault current of the system.
2. Factory-installed test-bypass facilities are required for 100 and 200 amp commercial/industrial service equipment.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
7 OF 7

SDG&E SERVICE STANDARDS & GUIDE

**UTILITY'S CONTRIBUTION TO FAULT CURRENT
SECONDARY VOLTAGE SERVICE EXAMPLES**

SG 008.7

All requests for vault design must be reviewed and approved by SDG&E (Utility) during the architectural design phase of the project. A meeting with Utility representatives is beneficial to all parties early in the design phase to ensure proper compliance with vault standards. The main elements that will be reviewed during the meeting include the following:

1. Access for transformer installation and maintenance
2. Access to install and maintain the service lateral conductors
3. Other requirements applicable to vault installations such as power ventilation, lighting, personnel access, etc.

The following general information has been compiled as a guide for a typical installation of Utility distribution facilities in a customer-owned vault. The information is to be used only as a guideline and not for the design or construction of the vault, or installation of electrical equipment.

The dimensions will vary in size depending upon the bus ampacity of the customer service entrance equipment, serving voltage and size of the transformer to be installed by SDG&E. A typical vault size could range anywhere from 13'-6" x 9'-6" x 8'-0" high (for a 400 amp service) to 20'-0" x 16'-6" x 12'-0" high (for a 4,000 amp service) provided no equipment other than the transformer is required in the vault.

Vault installations must be in compliance with all applicable Rules of the Electrical Safety Orders of the Division of Industrial Safety, Department of Industrial Relations, State of California, National Electrical Code, other governing codes and ordinances, and comply with requirements of the Utility.

CUSTOMER SHALL FURNISH, INSTALL, OWN & MAINTAIN

1. Vault:
 - a. The walls and roof shall be constructed of 6" minimum reinforced concrete, reinforced concrete block, or 8" minimum reinforced brick. All concrete block or brick joints are to be mortared solid. A 6" threshold for oil retention is required at all access openings into the vault. The vault floor is to be capable of supporting combined equipment weight as required.
 - b. Wherever a vault is constructed over sub levels of a structure, the customer is to provide SDG&E with a certificate from a registered civil engineer verifying the structural adequacy of the building to support the transformers under normal and structural fire conditions as well as fire withstanding capabilities of the structure floor, ceiling, and walls.
 - c. Any vault construction below finished grade is to be considered a dry vault. The exterior surfaces of a dry vault which are exposed to surrounding earth conditions will be moisture-proofed against water entry. A vault must be connected to the building or structure with a main door for entrance and exit.
 - d. No ducts, pipes, or conduits, except those which are a part of the electrical installation, shall be installed in or through the vault. Water-type fire sprinkler systems are prohibited in any vault. Customer must inform the Utility when any pre-stressed concrete portions of a vault are proposed for construction.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 4	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 009.1
	SDG&E SERVICE STANDARDS & GUIDE					
	TRANSFORMER VAULTS					

2. Conduit & Bus Duct:

- a. Primary conduits shall be either direct-buried or concrete-encased as specified by SDG&E.
- b. There are no restrictions on the application of customer-supplied bus duct. Any size panel may be fed by bus duct, at the option of the customer. The only exception is bus duct cannot be applied in cases where more than one service point will be served by a single transformer.
- c. Customers may elect the option of having the Utility install and maintain service lateral conductors, regardless of board size, given the required criteria are met to the satisfaction of the Utility.
- d. The transformer to the terminating enclosure distance is limited to 75 conduit feet, which includes the elbows.

3. Customer's Metering Facilities:

Service equipment is to be installed in accordance with SDG&E's Service Standards & Guide. Meters and service equipment are not permitted in the vault.

4. Drainage System:

Standard floor drains must drain to a dry sump location as determined and approved by the appropriate inspection authority. Floor drains are not to be connected to the sewer or drain system.

5. Equipment Openings:

- a. Below Grade: When the equipment opening is to be through a vault ceiling, the customer shall provide a removable 3-hour fire approved concrete cover. Both opening and cover shall have matching beveled edges, with minimum 1/2" vertical deflection. Four lifting inserts are to be provided for removal of the cover. Lifting inserts are to be 1" minimum coil, with slotted setting studs, as supplied by a professional concrete accessory products company. The equipment opening inside and out must be kept clear and unobstructed by customer-installed equipment. Proper clearance for operation of heavy equipment, including cranes, must be provided above the opening for installation and removal of material and equipment in and out of the vault. Contact the Utility for required clearances. Customer shall seal the cover to prevent water entry following installation of equipment.
- b. On Grade: Equipment opening is to be through an exterior vault wall, and the equipment door is to be 3-hour fire approved. Customer is to provide and install a Schlage VTQP Quad Section MA Series key section in a storeroom function (self-locking) Rhodes series lockset. SDG&E will replace the MA Series cylinder with an Electric Series cylinder prior to energizing equipment in the vault. The customer is required to notify SDG&E's Inspector when the lockset is installed. The Utility will replace the MA series cylinder prior to energizing the service. A permanent 6' clear and level working area is required at the vault floor level outside the access door. Door shall provide 24-hour direct access for Utility personnel.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------

SHEET
2 OF 4

SDG&E SERVICE STANDARDS & GUIDE

TRANSFORMER VAULTS

SG 009.2

6. Grounding System:

A ground grid will be required within the vault, and the requirements will be as specified on the drawings provided by SDG&E.

7. Lighting:

The vault is to be illuminated. The ventilation blower motor and vault lighting system are to be separately protected.

8. Personnel Access Door:

- a. A minimum 3' wide x 6' high x 8" thick, 3-hour approved, self-closing fire door is required. Refer to the SDG&E Electric Vault Requirements and Specifications document.
- b. Access must be through a door on an exterior wall of the building to provide immediate 24-hour-a-day access. The door must swing out of the room in the direction of egress, and it must be equipped with panic hardware. If the door is to be locked during construction and prior to energizing electrical equipment in the vault, the customer is required to provide and install a Schlage VTQP Quad Section MA Series key section in a storeroom function (self-locking) Rhodes series lockset. The customer is required to notify SDG&E's Inspector when the lockset is installed. SDG&E will replace the MA Series cylinder with an Electric Series cylinder prior to energizing equipment in the vault.
- c. The door threshold is to be 6" above the vault floor for oil retention.
- d. The customer shall provide SDG&E with an approved route and access easement to the personnel access door in the vault. The door shall provide direct 24-hour access for Utility personnel.

9. Pick Up Inserts & Pulling Eyes:

Pick up inserts and pulling eyes are required for installation of the transformer, and the pulling and training of the cables.

10. Ventilation Systems:

- a. The customer shall provide for adequate ventilation, all vents or ducting, and related facilities as required by SDG&E.
- b. Installation is to comply with all local codes and ordinances.
- c. Fire dampers may be required by the appropriate inspection authority.

Note: When transformer vaults are improperly constructed because the Utility was not contacted in advance, the customer will be responsible for all modifications.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------

SHEET
3 OF 4

SDG&E SERVICE STANDARDS & GUIDE

TRANSFORMER VAULTS

SG 009.3

SDG&E WILL FURNISH, INSTALL, OWN & MAINTAIN

1. Transformers
2. Primary distribution cable and equipment
3. Service lateral conductors (in customer's conduit) from the transformer secondary terminals to the customer's terminating enclosure (underground pull section)
4. Service lateral conductors from the transformer secondary terminals to the bus stubs where the customer provides a bus duct service

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------

SHEET
4 OF 4

SDG&E SERVICE STANDARDS & GUIDE

TRANSFORMER VAULTS

SG 009.4

SCOPE: This standard outlines the SDG&E (Utility) requirement for third-party testing of metal-enclosed service entrance and unmetered feeder busways.

The Utility requires the inspection and testing of metal-enclosed "service entrance and unmetered feeder busways" in accordance with the latest edition of the International Electrical Testing Association, Inc. (NETA), Acceptance Testing Specifications for Electric Power Distribution Equipment and Systems as follows:

3. Qualifications of Testing Organization and Personnel

3.1 Testing Organization – as published. Note: A testing organization that does not have a "Full Membership" in NETA but meets all other requirements of section 3.1 and 3.2, and tests in compliance with NETA specifications noted below, may be allowed to perform the testing if acceptable to the Authority Having Jurisdiction (AHJ) and the Utility.

3.2 Testing Personnel – as published

7.4 Metal-Enclosed Busways

7.4.1 Visual and Mechanical Inspection – as published

7.4.2 Electrical Tests – as published

7.4.3 Test Values – as published

The installer of the system shall provide a written test report to the AHJ and the Utility's Inspector A. The AHJ will not release an inspection clearance to the Utility, nor will the Utility energize its transformer and the service until receipt, review, and acceptance of the written test report.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

**TESTING REQUIREMENTS FOR METAL-ENCLOSED
SERVICE ENTRANCE & UNMETERED FEEDER BUSWAYS**

SG 010

1. **Tariff Schedules** – Where otherwise allowed or required under the Utility's tariff schedules, or
2. **Utility Convenience** – At the option of, and as determined by the Utility, for its operating convenience, consistent with its engineering design for different voltage and phase classification, or when replacing an existing service, or
3. **Ordinance** – Where required by ordinance or other applicable law, for such things as fire pumps, fire alarm systems, etc.



Service Delivery Point Policy

Definitions

- Note:** A terminating enclosure shall be permanently accessible without entering the building, shall not project into any driveway, walk or public way, and shall provide access and working space in compliance with all Service Standards & Guide requirements. By special permission, the terminating enclosure may be installed in an electric meter room or in a parking structure when approved by the Utility and installed per the Utility's applicable standards. Reference pages SG 506.1 – 506.4 for Electric Meter Room standards and pages SG 016.1 – 016.2 for Pulling Devices for Installation of Service Lateral Conductors in Parking Structures.

1. One service delivery point will normally be established as near as practicable to the closest corner of the building wall which is accessible, with a minimum length of service lateral conductors from the Utility's source. Aesthetics will not be considered when determining the service delivery point.
 - a. All Utility meters and associated metering equipment shall be located at some protected location on applicant's premises as approved by the Utility.
 - b. In a building with two or more tenants, or where the Utility furnishes more than one meter on the same premises, Utility's meters normally shall be grouped at one central location.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 3		Indicates Latest Revision		Completely Revised		New Page		Information Removed	SG 011.1
	SDG&E SERVICE STANDARDS & GUIDE								
	ELECTRIC SERVICE POLICIES NEW & EXISTING CUSTOMERS								

- c. More than one group of meters may be established where acceptable to the Utility, provided the applicant installs, owns, and maintains the service entrance conduit(s) and conductors from the service delivery point (terminating enclosure) to each meter location in compliance with the Utility's requirements and receives prior approval from the governmental Authority Having Jurisdiction (AHJ).
 - d. For single- and multi-family residential buildings, and single- and multi-occupancy commercial and industrial buildings, meters may be installed:
 - i. Outdoors-mounted on or recessed in an exterior building wall.
 - ii. In an approved meter room. Reference pages SG 506.1 – 506.4.
 - iii. Meter locations are not required to be at or near the service delivery point, but are to be located in accordance with the Utility's rules and service standards. Reference pages SG 510.1 – 510.5 for Electrical Metering in Mid- and High-Rise Buildings.
2. Two service delivery points to a single building or premises may be established at the Utility's option if all of the following requirements are met:
- a. All Electric Service Policies for New Projects & Existing Customers as outlined in this standard are met; and
 - b. Meters are grouped at or near each service delivery point or at a location approved by the Utility; and
 - c. The appropriate AHJ approves the installation.

ALTERNATE SERVICE DELIVERY POINT REQUESTS

An applicant may request an alternate service delivery point that is not necessarily the corner of the building wall closest to the Utility's underground or overhead source. The request may be approved provided the requested location is acceptable to the Utility's Planner, and the applicant agrees to pay for the additional facilities required per the provisions of Rule 2, I. Special Facilities and Maintenance. Consult with the Utility's Planner for approval of an alternate service delivery point in the project's design phase to avoid project delays and to obtain cost information.

SERVICE LOCATIONS

The service delivery point must be confirmed in writing by the Utility's Planner. It is important to contact the Utility's Service Planning or Project Management Regional Office (see listing on page SG 2) and request an Electric Meter & Service Location form for the following:

1. A new service connection is being considered for any type of project.
2. Additions, alterations, renewals, or a change in the electric service delivery point location is being proposed to an existing service. This includes, but is not limited to, replacement of customer-owned service entrance conduits, conductors, service equipment, or metering enclosures.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 3	<div></div> Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	<input type="checkbox"/> New Page	<input type="checkbox"/> Information Removed	SG 011.2
	SDG&E SERVICE STANDARDS & GUIDE				
	<div>ELECTRIC SERVICE POLICIES NEW & EXISTING CUSTOMERS</div>				

RIGHTS OF WAY

The Utility will own, operate and maintain Distribution Line Extension facilities only as follows:

1. Along public streets, alleys, roads, highways and other publicly dedicated ways and places which the Utility has the legal right to occupy (franchise areas); and
2. On public lands and private property across which rights of way and permits satisfactory to the Utility may be obtained without cost to or condemnation by the Utility.

The customer is responsible for providing a clear route, free of obstructions, which would inhibit the construction of either underground or overhead service extensions on their property.

The Utility cannot be responsible for correcting any portion of the customer's service installation necessitated by the customer's or their contractor's deviation from the Utility's Service Standards & Guide requirements, or where the service equipment location was assumed and conflicts with the location approved by the Utility's Planner.

A service location does not constitute an "Application for Service". See page SG 004.3 for "Application for a Billing Account" information. Ensuring an application for service has been made for the billing account can help avoid delays in establishing new electric service.

SECONDARY SERVING VOLTAGES & CLASSIFICATION OF SERVICE INFORMATION

1. The following are the Utility's standard secondary serving voltages:
 - a. Single-phase – 120/240, 120/208, and 240/480 (for highway lighting) volts
 - b. Three-phase delta serving voltages – 120/240 and 480 (corner-grounded) volts
 - c. Three-phase wye serving voltages – 208Y/120 and 480Y/277 volts
 - d. A different class of service shall be considered two services with each having a different "phase-to-neutral" or "phase-to-ground" voltage.
2. The following three-phase voltages are considered different classes of service by the Utility:
 - a. 208Y/120 or 120/240 volts
 - b. 480 (corner-grounded) volts
 - c. 480Y/277 volts

Note: "Single-phase 120/208 volts and three-phase 208Y/120 volts" are the same class of service and are not considered by the Utility as a different class of service than "single- or three-phase 120/240 volts", because the phase-to-neutral voltage is the same for all of them (120 volts).

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 3 OF 3		Indicates Latest Revision	<input checked="" type="checkbox"/>	Completely Revised		New Page		Information Removed	SG 011.3
	SDG&E SERVICE STANDARDS & GUIDE								
	ELECTRIC SERVICE POLICIES NEW & EXISTING CUSTOMERS								

The following information is intended to provide guidance to developers, architects, engineers, electrical contractors, and consultants planning customers' new electrical service needs.

General Service Requirement to Multiple Multi-Unit Buildings on a Single Premises

When there is more than one multi-unit building on a single premises, an individual SDG&E service is generally required to each of the multi-unit buildings. Both residential and non-residential applications are subject to this requirement. Refer to pages SG 014.1 – 014.5 for further details.

Multi-Family Residential Buildings – Less than 3 Stories High

One service per building will be granted, unless the distance between service points and meter locations is 300', or greater. If the service size exceeds 4,000 amps and a second service of the same class is required, the service points will be grouped at one location unless the distance between service points is 300', or greater. A separate service of a different class, normally 480Y/277-volts for serving house loads, may be granted and grouped with the service(s) for the multi-family dwelling units or located at a more convenient location acceptable to SDG&E's (Utility's) Planner based on the design of the customer's electrical system and the Utility's service delivery point policy, and with approval from the governmental Authority Having Jurisdiction (AHJ). There is no minimum distance required between services of a different class. Rule 16 will apply, and the Rule 15 residential and non-residential allowances will be applied to the cost of all services meeting the criteria above.

Residential or Mixed Use Buildings – 3 Stories or Greater

The customer may receive as many 3-phase, 208Y/120-volt services as required, normally grouped at one location, to serve the dwelling units that must be individually metered by the Utility. The Planner may approve more than one service point and meter location for services of the same class if the distance between them is 300', or greater, or when it is in the best interest of the Utility to provide multiple service points and meter locations. A separate service of a different class, normally 480Y/277-volts, may be granted for house loads and may be grouped with the service(s) for the multi-family dwelling units or located at a more convenient location acceptable to the Planner based on the design of the customer's electrical system and our service delivery point policy, and with approval from the AHJ. There is no minimum distance required between services of a different class. Rule 16 will apply and the Rule 15 residential and non-residential allowances will be applied to the cost of all services meeting the criteria above.

Residential Contiguous Dwellings – Townhouses (Row Homes)

Each individual townhouse or duplex located on a parcel of land bounded by legal property lines must be provided with an individual electric service and meter(s) located on the property served. Each individual townhouse or duplex located on a single parcel of property divided with "assumed property lines" may be:

1. Provided with an individual electric service and meter(s) located on the townhouse bounded by assumed property lines, or

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 3	<div>X</div> Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 012.1
	SDG&E SERVICE STANDARDS & GUIDE				
	ELECTRIC SERVICE POLICIES NEW PROJECT TYPES				

- Served through a single service point, with meters grouped at one location in a common area remote from the buildings. Easements will be required to be established and recorded in the deed of every townhouse allowing for privately-owned electric lines to cross assumed property lines. The Utility is not involved in the easement process, but it is important for developers to understand this requirement. Main electric service disconnects (maximum of six) may be grouped at one location to accommodate grouping of the electric service and of the electric service and metering equipment. If the number of service disconnects exceeds six, a main disconnect will be required ahead of all meters and their related meter service disconnect. The meter service disconnect must be located at or immediately adjacent to the meter. A ¾" or larger electrical conduit must be installed, per the requirements of the California Electrical Code and approved by the AHJ, between the grouped meter location and each individual townhouse. This conduit will provide access for future installation of alternative energy sources, such as photovoltaic systems.

Single Premise – Multiple Non-Residential Enterprises (such as Shopping Centers & Office Buildings)

One service per building will be granted, unless the distance between meter locations is greater than 300', or the customer is requesting two classes of service. In the case of two classes of service, the services may be grouped at the same location, or located at a more convenient location acceptable to the Planner based on the design of the customer's electrical system and the Utility's service delivery point policy, and with approval from the AHJ. There is no minimum distance required between services of a different class. Rule 16 for service extensions will apply, and the non-residential allowances per Rule 15 will be applied to the cost of all services meeting the criteria above.

Single Premise – Single Non-Residential Enterprise (Customer)

Normally, one service per premise serving a single enterprise will be granted, for example, schools, church complexes, manufacturing plants, etc.

If the planned secondary voltage service exceeds 4,000 amps, we will provide a maximum of 3 secondary voltage services rated at not more than 4,000 amps each at a single location or at a location approved by the Planner and the AHJ, based on the configuration and capacity of our distribution system and good engineering practice. Loads greater than 3 at 4,000 amps (maximum 12,000 amps at secondary voltage) will require the customer to install a medium voltage service and primary metering equipment.

If more than one secondary voltage service is required because the service size exceeds 4,000 amps, Rule 16 for service extensions will apply and Rule 15 non-residential allowances will be applied to the cost of all services grouped at one location. When we determine it is in the customer's best interest for the Utility to approve a second or third secondary voltage service of the same class not grouped at one location, the customer will pay for only the additional facilities required per the provisions of Rule 2, Special Facilities, unless the minimum distance between all services is as follows:

- 120/240-volts or 208Y/120-volts – 500' minimum separation between services of the same class is required.
- 480Y/277-volts – 1,000' minimum separation between services of the same class is required.

If the customer requests a second class of secondary voltage service, all services may be grouped at the same location, or the service of a different class may be located at a more convenient location acceptable to the Planner and the AHJ based on the design of the customer's electrical system and our service

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 3	<div>X</div> Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 012.2
	SDG&E SERVICE STANDARDS & GUIDE				
	ELECTRIC SERVICE POLICIES NEW PROJECT TYPES				

delivery point policy. There is no minimum distance required between services of a different class. Rule 16 for service extensions will apply and the non-residential allowances per Rule 15 will be applied to the cost of the second service of a different class.

Single Premise – Single Residential Customer with Other Electric Uses

One service per premise will be granted. A second service may be approved for other electric uses such as accessory dwelling unit (ADU), wells, barns, garages, etc., provided the location is more than 150' from the existing service and meter location at the residence, and the AHJ approves a second service and meter on the property. When both of these conditions are met, Rule 16 will apply, and the Rule 15 non-residential allowance will be applied to the cost of the second service.

Single Premise – Multiple Residential Customers

Each separate structure containing two or more legal dwelling units must be individually served by the Utility. Each dwelling unit must be individually metered by the Utility. Rule 16 for service extensions and the residential allowances per Rule 15 for each dwelling unit will apply to each service. Approval by the AHJ is required.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 3 OF 3	<div>X</div> Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 012.3
	SDG&E SERVICE STANDARDS & GUIDE				
	ELECTRIC SERVICE POLICIES NEW PROJECT TYPES				

The following information is intended to provide guidance to developers, architects, engineers, electrical contractors, and consultants working with an existing customer planning for additions to their electrical service(s) or remote meter locations.

General Service Requirement to Multiple Multi-Unit Buildings on a Single Premises

When there is more than one multi-unit building on a single premises, an individual SDG&E service is generally required to each of the multi-unit buildings. Both residential and non-residential applications are subject to this requirement. Refer to pages SG 014.1 – 014.5 for further details.

Multi-Family Residential Buildings – Less than 3 Stories High

Customer requests for a second service of the same class will not be granted unless the service size exceeds 4,000 amps. When the service size will exceed 4,000 amps, a second service of the same class may be grouped as close as practical to the existing service or a second service a minimum of 300' apart may be granted. Rule 16 will apply, and Rule 15 allowances may be granted for the second service request based on the type of load additions. For example, if the load additions are in the existing dwelling units only, no allowances will be given. If house loads are being added through a new service and meter, allowances for the incremental load increase will be granted.

A separate service of a different class, normally 480Y/277-volts, may be granted for house loads and may be grouped with the service(s) for the multi-family dwelling units or located at a more convenient location acceptable to the Planner based on the design of the customer's electrical system and our service delivery point policy and with approval from the governmental Authority Having Jurisdiction (AHJ). There is no minimum distance required between services of a different class. Rule 16 for service extensions and the non-residential allowances for the incremental load increase per Rule 15 will apply to the second service.

Residential or Mixed Use Buildings – 3 Stories or Greater

The customer may receive as many 3-phase, 208Y/120-volt services as required, normally grouped at one location, to serve the dwelling units that must be individually metered by the Utility. The Planner may approve more than one service point and meter location for services of the same class if the distance between them is 300', or greater, or when it is in the best interest of the Utility to provide multiple service points and meter locations. A separate service of a different class, normally 480Y/277-volts, may be granted for house loads and may be grouped with the service(s) for the multi-family dwelling units or located at a more convenient location acceptable to the Planner based on the design of the customer's electrical system and our service delivery point policy, and with approval from the AHJ. There is no minimum distance required between services of a different class. Rule 16 will apply and the Rule 15 residential and non-residential allowances will be applied to the cost of all services meeting the criteria above.

Residential Contiguous Dwellings – Townhouses (Row Homes)

Each individual townhouse or duplex located on a parcel of land bounded by legal property lines must be provided with an individual electric service and meter(s) located on the property served. Each individual townhouse or duplex located on a single parcel of property divided with "assumed property lines" may be:

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 3	X	Indicates Latest Revision		Completely Revised		New Page		Information Removed	SG 013.1
	SDG&E SERVICE STANDARDS & GUIDE								
	ELECTRIC SERVICE POLICIES – EXISTING CUSTOMER								

1. Provided with an individual electric service and meter(s) located on the townhouse bounded by assumed property lines, or
2. Served through a single service point, with meters grouped at one location in a common area remote from the buildings. Easements will be required to be established and recorded in the deed of every townhouse allowing for privately-owned electric lines to cross assumed property lines. The Utility is not involved in the easement process, but it is important for developers to understand this requirement. Main electric service disconnects (maximum of 6) may be grouped at one location to accommodate grouping of the electric service and of the electric service and metering equipment. The meter service disconnect must be located at or immediately adjacent to the meter. A ¾" or larger electrical conduit must be installed, per the requirements of the California Electrical Code and approved by the AHJ, between the grouped meter location and each individual townhouse. This conduit will provide access for future installation of alternative energy sources, such as photovoltaic systems.

Single Premise – Multiple Non-Residential Enterprises (Such as Shopping Centers & Office Buildings)

Customer requests for a second service of the same class to serve an existing building will not be granted unless the service size exceeds 4,000 amps. When the service size will exceed 4,000 amps, a second service of the same class may be grouped as close as practical to the existing service or a second service a minimum of 300' apart may be granted. Rule 15 allowances will be granted for the second service request based on the incremental load increase.

Requests for a second class of service will be granted and may be grouped with the existing service(s) or located at a more convenient location acceptable to the Planner and the AHJ based on the design of the customer's electrical system and our service delivery point policy. There is no minimum distance required between services of a different class. This applies to an existing primary metered customer who is allowing a new separate enterprise to operate a business on the single premises. A secondary voltage service will be granted at a location approved by the Planner and the AHJ. Rule 16 for service extensions and the non-residential allowances per Rule 15 will apply to the second service.

NOTE: Area separation walls constructed as part of a tenant improvement may result in the creation of a separate building contiguous with the existing building. When the building official confirms in writing a new separate building has been created, a new gas and/or electric service is allowed provided there is space on the building for the service and metering equipment. Rule 16 for service extensions will apply and the non-residential allowances per Rule 15 may be granted for the new service request if there is an incremental load increase.

Single Premise – Single Non-Residential Enterprise (Customer)

The customer will not be granted both a primary metered service and a secondary voltage service, even though the services are technically a different class. If a customer's load requirements exceed 3 at 4,000 amps secondary voltage service, the customer will be required to take service at a primary voltage level and install primary metering medium voltage switchgear.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 3	<div>X</div> Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 013.2
	SDG&E SERVICE STANDARDS & GUIDE				
	ELECTRIC SERVICE POLICIES – EXISTING CUSTOMER				

Exception: When an existing primary metered customer requests a new secondary voltage service with the intent of removing their existing primary metered service, we will provide up to 3 secondary voltage services, not exceeding 3 at 4,000 amps each. Rule 15, Section I, Item 1, Facility Relocation or Rearrangement, will apply. The customer is responsible for the total estimated installed cost of the new facilities and removal of the existing primary metered service, including the metering. If the customer is adding load and the existing primary metered service was adequate to serve the load additions, the customer will not be granted Rule 15 allowances for the incremental load increase. The customer is allowed to continue receiving primary metered service and the new secondary voltage service for a maximum of five years and shall provide the Planner written confirmation of their acceptance of the maximum timeframe for removal of the existing primary metered service. This will allow the customer adequate time to re-feed their electrical loads from the new secondary voltage source(s) and facilitate a phased approach when more than one secondary voltage service is needed. Typically, Planners will receive this type of request from school districts or campus type facilities.

When we determine it is in the customer's best interest for the Utility to approve a second or third secondary voltage service of the same class not grouped with the existing service at one location, the customer will pay for only the additional facilities required per the provisions of Rule 2, Section I, Item 1, Special Facilities and Maintenance, unless the minimum distance between the existing and all proposed new services are as follows:

- 120/240-volts or 208Y/120-volts – 500' minimum separation between services of the same class is required.
- 480Y/277-volts – 1,000' minimum separation between services of the same class.

Rule 16 for service extensions will apply when the above criteria is met, and the non-residential allowances per Rule 15 may be granted for the new service request if there is an incremental load increase.

Requests for a second class of secondary voltage service will be granted and may be grouped with the existing service(s) or located at a more convenient location acceptable to the Planner and the AHJ based on the design of the customer's electrical system and our service delivery point policy. There is no minimum distance required between services of a different class. Rule 16 for service extensions and the non-residential allowances per Rule 15 will apply to the second service.

Single Premise - Single Residential Customer with Other Electric Uses

One service per premise will be granted. A second service may be approved for other electric uses such as accessory dwelling unit (ADU), wells, barns, garages, etc., provided the location is more than 150' from the existing service and meter location at the residence, and the AHJ approves a second service and meter on the property. When both of these conditions are met, Rule 16 will apply, and the Rule 15 non-residential allowance will be applied to the cost of the second service.

Single Premise – Multiple Residential Customers

Each separate structure containing two or more legal dwelling units must be individually served by the Utility. Each dwelling unit must be individually metered by the Utility. Rule 16 for service extensions and the residential allowances per Rule 15 for each dwelling unit will apply to each service. Approval by the AHJ is required.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 3 OF 3	<div>X</div> Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 013.3
	SDG&E SERVICE STANDARDS & GUIDE				
	ELECTRIC SERVICE POLICIES – EXISTING CUSTOMER				

SINGLE PREMISE WITH MULTIPLE BUILDINGS – SERVICE & METERING REQUIREMENTS

For compliance with the California Electrical Code, Article 225.30, an individual SDG&E (Utility) service drop or service lateral will be provided to each building containing 2 or more residential or non-residential units located on a single parcel of land. Each building will have the meters for the units within that building grouped at one central location. The governmental Authority Having Jurisdiction (AHJ) shall approve and inspect the customer's premises wiring system.


Exception: For rewires or conversion of service from overhead to underground on existing parcels with 2 or more multi-unit buildings, it is sometimes impracticable to establish a direct service from the Utility source to rear or remotely located buildings on the parcel. For example, a structure built lot line to lot line between the Utility source and another multi-unit building on the same parcel would be considered impracticable. Customer-owned and -installed service entrance conductors or unmetered feeder will be allowed between buildings in these situations by deviation only. This is by exception and applies only when approved in advance by SDG&E Service Standards. Examples 1 – 3 of possible scenarios are shown on pages SG 014.2 – 014.4.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 5	<div>X Indicates Latest Revision</div>	Completely Revised	New Page	Information Removed	SG 014.1
	SDG&E SERVICE STANDARDS & GUIDE				
	<div>ELECTRIC SERVICE POLICIES</div> <div>EXISTING CUSTOMER FEEDER EXCEPTIONS</div>				

EXAMPLE 1

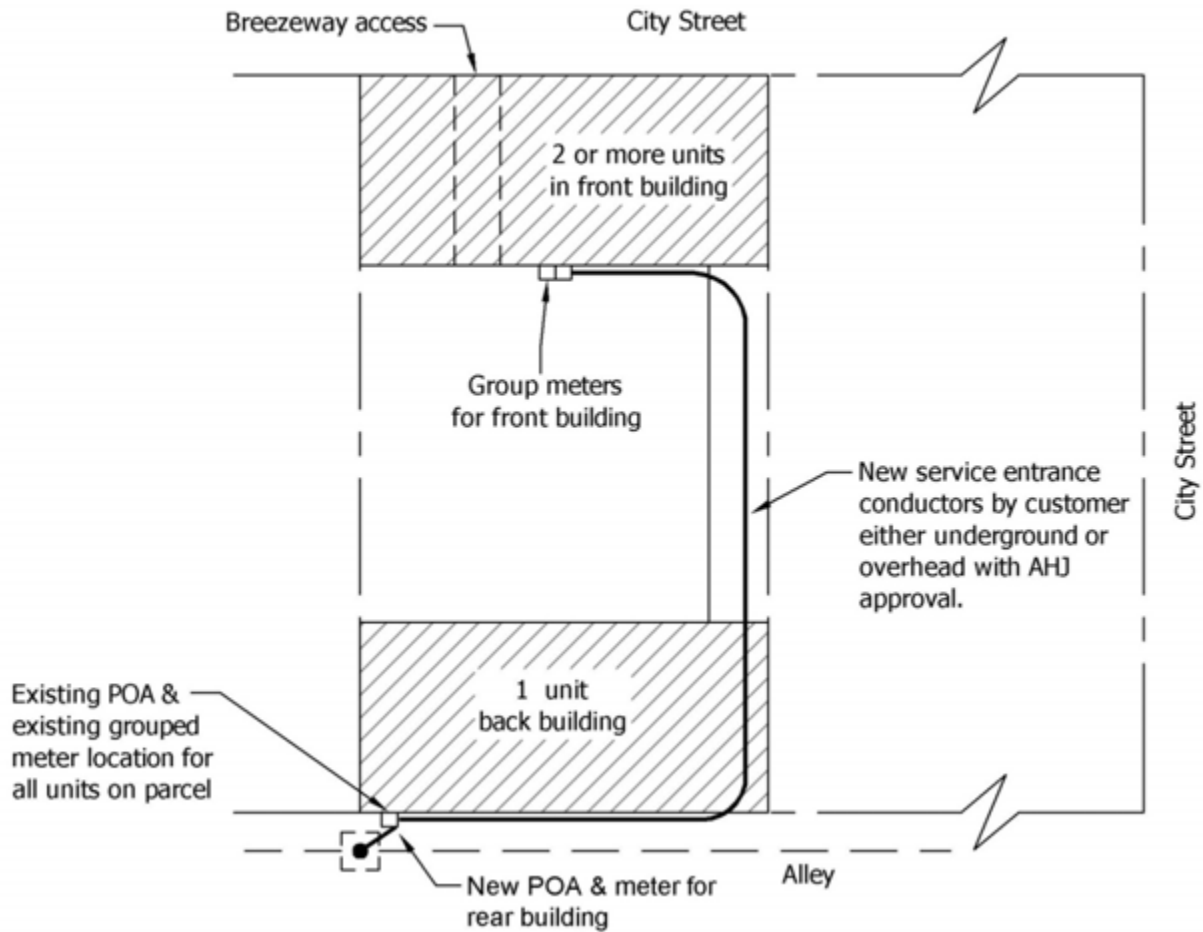

Notes:

1. This standard applies only when standard OH or UG service cannot be established to both buildings due to physical construction limitations. A deviation is required from Service Standards before negotiating this method of service with the customer or their contractor, or on a conversion project.
2. Point of Attachment (POA)
3. SDG&E source in alley and no SDG&E source on street side of parcel
4. A plaque is required at each meter location connected to the service identifying the location of all meter locations served. Refer to pages SG 017.1 – 017.3 for plaque specifications and examples.
5. Service entrance conduits installed underground between buildings shall be concrete-encased (one sack slurry).

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed


SHEET
2 OF 5

SDG&E SERVICE STANDARDS & GUIDE

**ELECTRIC SERVICE POLICIES
EXISTING CUSTOMER FEEDER EXCEPTIONS**

SG 014.2

EXAMPLE 2

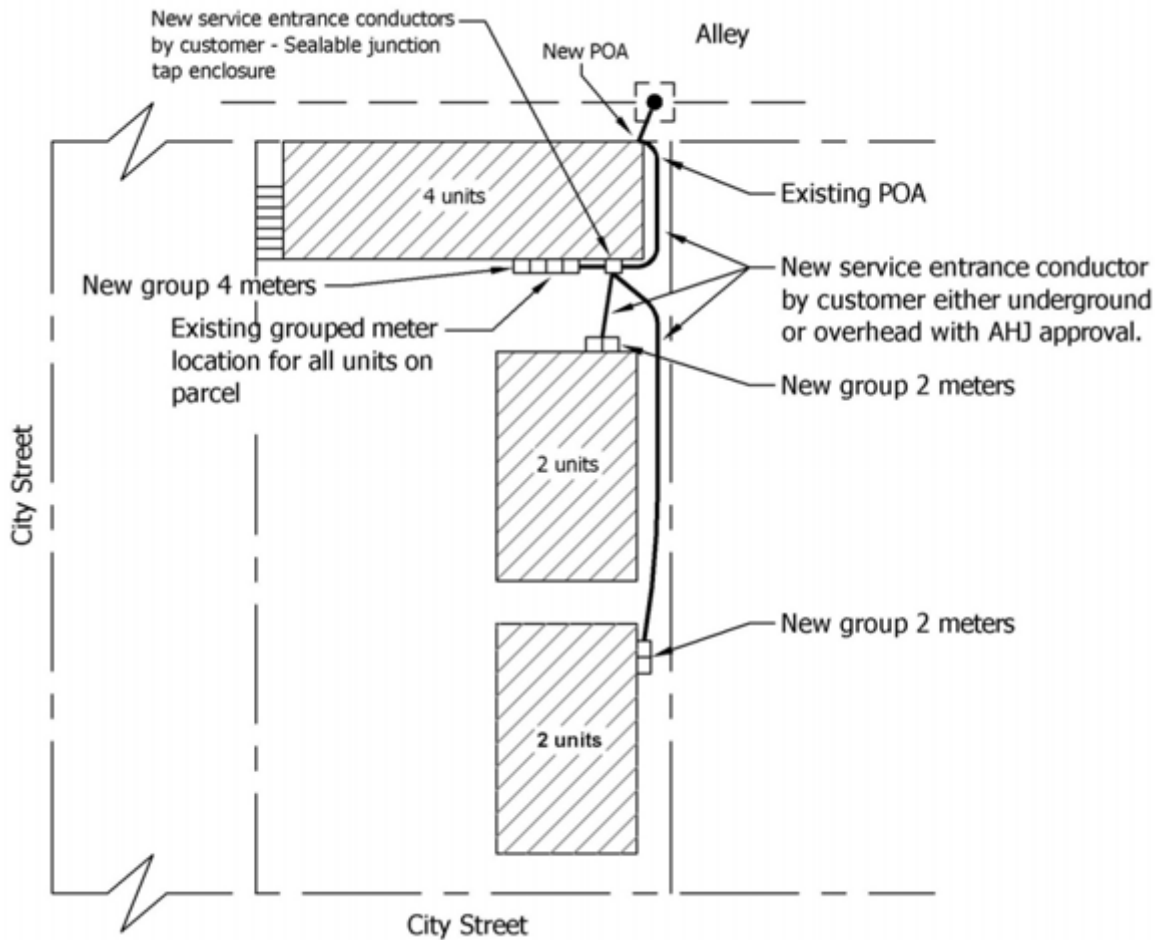

Notes:

1. This standard applies only when standard OH or UG service cannot be established to all buildings due to physical construction limitations. A deviation is required from Service Standards before negotiating this method of service with the customer or their contractor, or on a conversion project.
2. Point of Attachment (POA)
3. SDG&E source in alley and no SDG&E source on street side of parcel.
4. A plaque is required at each meter location connected to the service identifying the location of all meter locations served. Refer to page SG 017.1 – 017.3 for plaque specifications and examples.
5. Service entrance conduits installed underground between buildings shall be concrete-encased (one sack slurry).

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed


SHEET
3 OF 5

SDG&E SERVICE STANDARDS & GUIDE

**ELECTRIC SERVICE POLICIES
EXISTING CUSTOMER FEEDER EXCEPTIONS**

SG 014.3

EXAMPLE 3

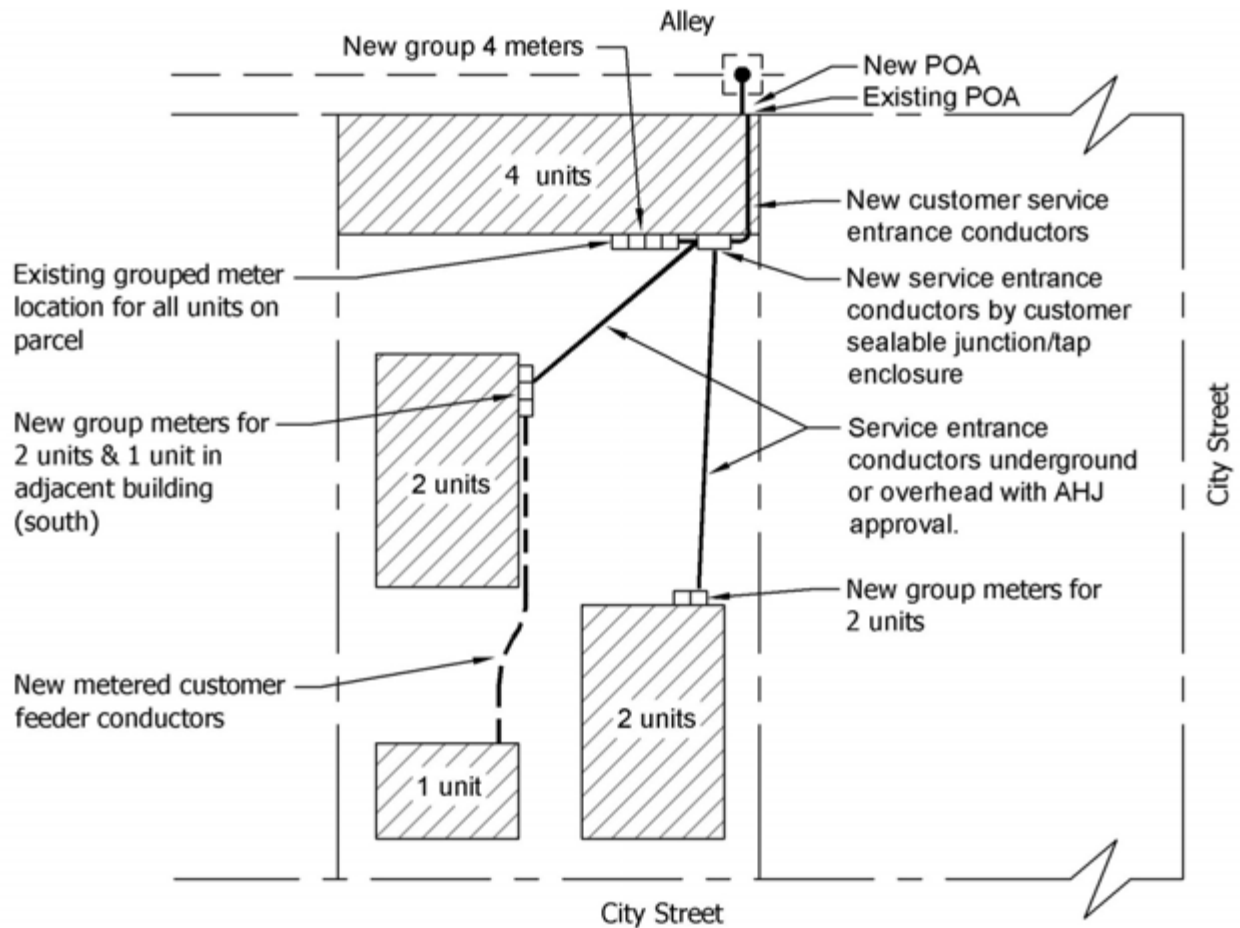

Notes:

1. This standard applies only when standard OH or UG service cannot be established to all buildings with multiple tenants due to physical construction limitations. A deviation is required from Service Standards before negotiating this method of service with the customer or their contractor, or on a conversion project.
2. Point of Attachment (POA)
3. SDG&E source in alley and no SDG&E source on street side of parcel
4. A plaque is required at each meter location connected to the service identifying the location of all meter locations served. Refer to pages SG 017.1 – 017.3 for plaque specifications and examples.
5. Service entrance conduits installed underground between buildings shall be concrete-encased (one sack slurry).

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed


SHEET
4 OF 5

SDG&E SERVICE STANDARDS & GUIDE

**ELECTRIC SERVICE POLICIES
EXISTING CUSTOMER FEEDER EXCEPTIONS**

SG 014.4

EXAMPLE 4

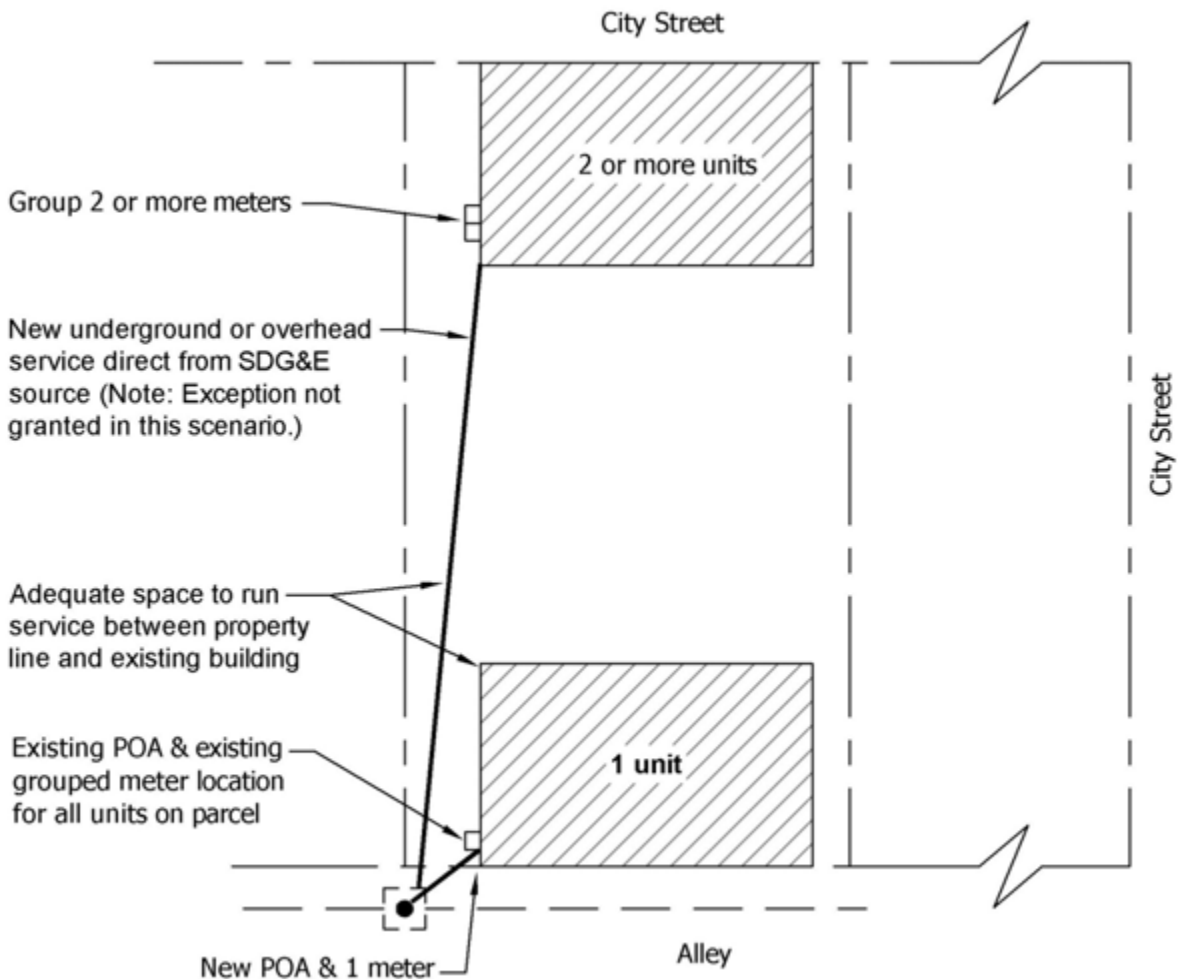

Notes:

1. Point of Attachment (POA)
2. SDG&E source in alley and no SDG&E source on street side of parcel
3. A plaque is required at each meter location connected to the service identifying the location of all meter locations served. Refer to pages SG 017.1 – 017.3 for plaque specifications and examples.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------

SHEET
5 OF 5

SDG&E SERVICE STANDARDS & GUIDE

ELECTRIC SERVICE POLICIES

EXISTING CUSTOMER FEEDER EXCEPTIONS

SG 014.5

SCOPE: This standard provides SDG&E (Utility) line truck access requirements to terminating enclosures.

1. Line truck access is defined as a minimum 16' wide "all weather" driven way of sufficient strength to support a truck weight class H20 (20 tons), with a clear height of 13'-6" and a 40' minimum turning radius measured from inside curb.
2. The maximum distance from line truck access to an electric meter room door applies when the terminating enclosure is located in the electric meter room directly in front of the access door, or when the terminating enclosure is located on an exterior building wall. The maximum distance is dependent upon the size of the electric service. Larger services require larger diameter and greater number of conduits to serve the customer's ultimate electrical needs.

Special Instructions: If the terminating enclosure is within a meter room, and located other than directly in front of the access door, pulling eye hooks and coil inserts as specified on SG 016.1 – 016.2 may be required to rig cable pulling operations. Consult with the Utility's Planner if this is proposed.

3. The maximum size conductor the Utility installs is No. 1,000 kCMIL aluminum conductors in a 5" conduit. The maximum distances shown in the table below have been established to help ensure a safe installation and to shorten restoration time should a cable failure occur during the life of the service.
4. All electric meter rooms without the terminating enclosure located inside the electric meter room shall be a maximum of 100' from pick-up truck access. Pick-up truck access is defined as a minimum 8' height clearance, 14' minimum turning radius measured from inside curb, and 14' wide all weather driven way of sufficient strength to support a minimum truck weight of 4,000 lbs.
5. It is the customer's responsibility to provide and maintain the required truck access for the life of the electrical system.

Size of Electric Conduit Entering Terminating Enclosure	Maximum Distance from Line Truck Access to an Electric Meter Room Door or Terminating Enclosure Located on Exterior of Building
Less than 4"	30'
4"	20'
5"	10'

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE


LINE TRUCK ACCESS REQUIREMENTS

SG 015

SCOPE: This standard provides an alternative to line truck access to the exterior of an electric meter room door for installation and removal of service lateral conductors in the underground terminating enclosure (UGPS) located in a parking structure. This standard may be used when all of the requirements can be met. Examples 1 and 2 are not drawn to scale.

Definition Note: Truck access for this standard is defined as a minimum 8' height clearance and 14' minimum turning radius measured from inside curb.


EXAMPLE 1
Main Electrical Room
UGPS on wall directly opposite doorway.

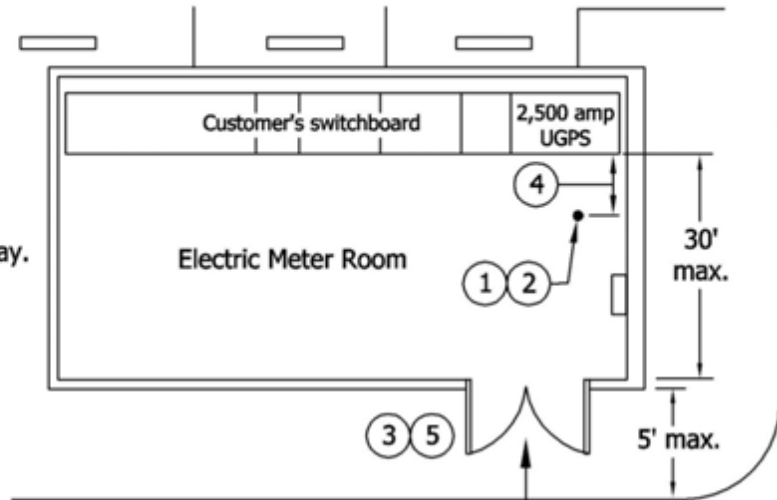

Truck access required. Utility must be able to position pickup truck perpendicular to access door.



EXAMPLE 2
Main Electrical Room
UGPS perpendicular to doorway.

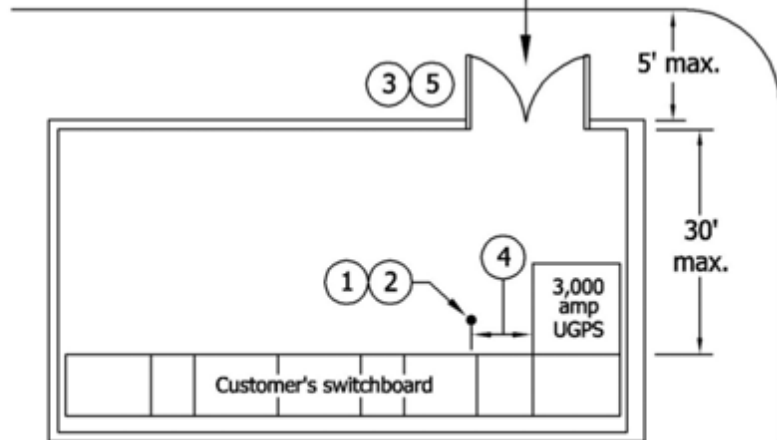

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
1 OF 2

SDG&E SERVICE STANDARDS & GUIDE

**PULLING DEVICES FOR INSTALLATION OF SERVICE
LATERAL CONDUCTORS IN PARKING STRUCTURES**

SG 016.1

Notes:

- ① Customer to provide pulling eye hook structurally in the ceiling with a load capacity of 8,000 lbs. Locate eye hook in front of, and centered to, the UGPS. Customer to submit the structural engineer's approved drawing(s) to SDG&E's (Utility) Planner prior to installation of the eye hook and coil insert (reference Note 2). Coordinate the installation with the Utility's Inspector.
- ② Customer to provide a 1" x 4-1/2" Dayton/Richmond flared thin slab coil insert (F-63), or equivalent, with a safe working load tension of 4,750 lbs. and a Dayton/Richmond T-12 swivel lifting plate with a 1" bolt diameter, or equivalent, with a safe working load of 8,000 lbs. when used in combination with the coil insert specified above. Install the coil insert and swivel lifting plate directly below the pulling eye hook specified in Note 1. Coordinate the installation with the Utility's Inspector. To ensure safety, installation of the coil insert and swivel lifting plate shall be in compliance with the manufacturer's installation instructions.
- ③ The rigging path through the meter room door is to be directly in line from truck access to the floor-mounted coil insert and swivel lifting plate through the meter room door.
- ④ The pulling eye hook specified in Note 1, and the floor-mounted coil insert and swivel lifting plate specified in Note 2 are to be positioned at a distance out from the UGPS such that angle A (see Figure 1) is not greater than 15 degrees. The rigging path through the front of the UGPS is to be unobstructed, and the rigging is to have no contact with the top, bottom, or sides of the pull section opening. Maximum allowable height of top pulling eye is 14'.
- ⑤ Customer to provide the Utility 24-hour direct access to within 5' of the meter room door(s).

General Notes:

1. Precast concrete companies stock the pulling devices specified above.
2. Upon completion of installation of pulling devices, certification of compliance with this standard is required under structural/mechanical engineer's seal.

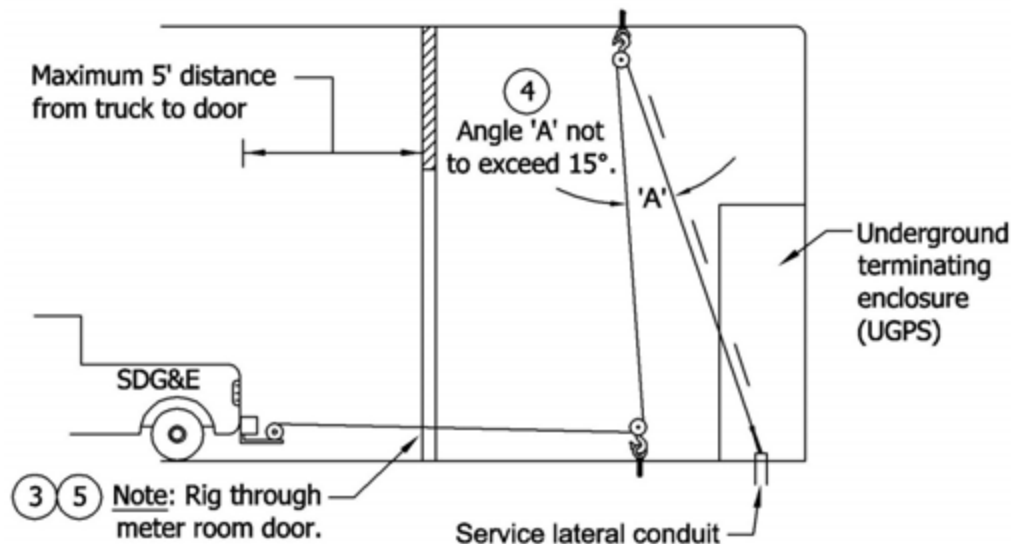


FIGURE 1

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed


**SHEET
2 OF 2**

SDG&E SERVICE STANDARDS & GUIDE

**PULLING DEVICES FOR INSTALLATION OF SERVICE
LATERAL CONDUCTORS IN PARKING STRUCTURES**

SG 016.2

SAMPLE PLAQUE FOR ELECTRICAL EQUIPMENT LABELS

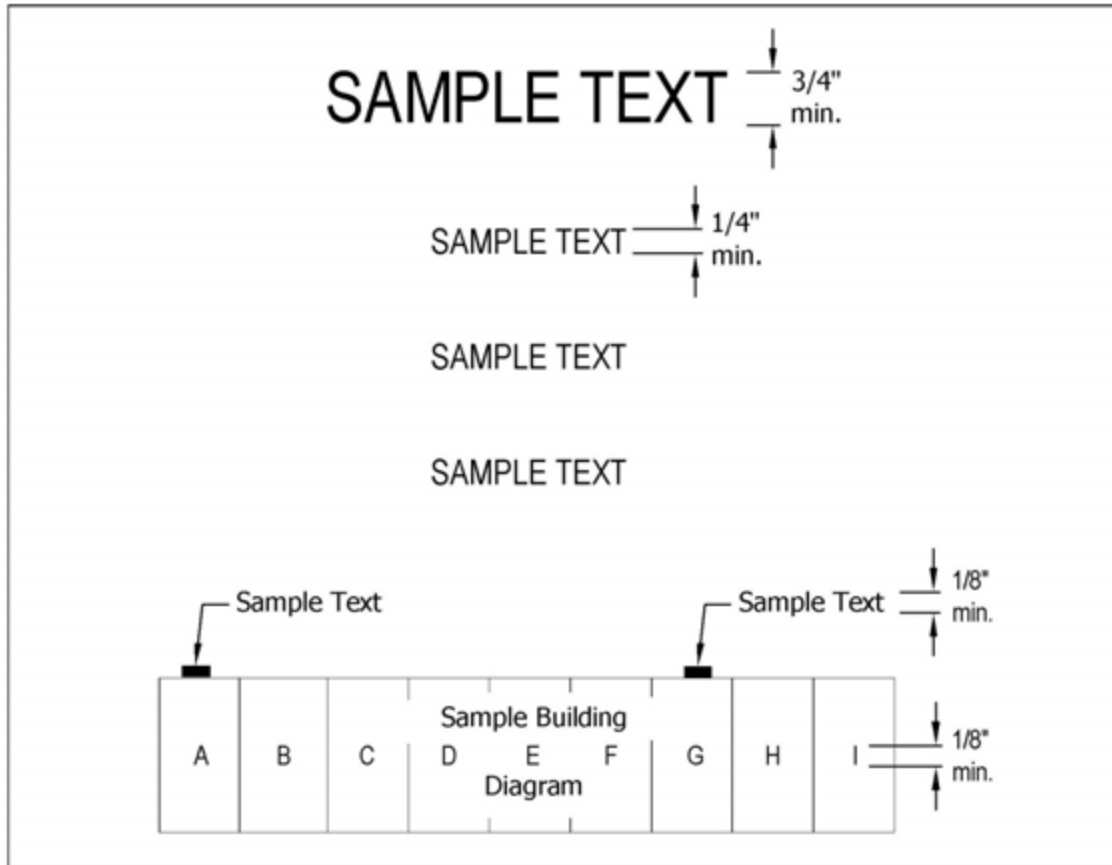

The plaque or directory required by Section 230.2 of the National Electrical Code shall be manufactured in metal or plastic with engraved or machine-printed lettering, or electro-photo-plating, in a contrasting color. The plaque shall include a footprint of the entire building and shall be attached to the service disconnecting means with pop-rivets or other fasteners acceptable to the governmental Authority Having Jurisdiction (AHJ). Epoxy is no longer an acceptable method of securing.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------


SHEET
1 OF 3

SDG&E SERVICE STANDARDS & GUIDE

PLAQUE SPECIFICATIONS & EXAMPLES

SG 017.1

**TYPICAL PLAQUE FOR NEW BUILDINGS OR EXISTING
BUILDINGS WITH SEPARATE SERVICE AREAS**

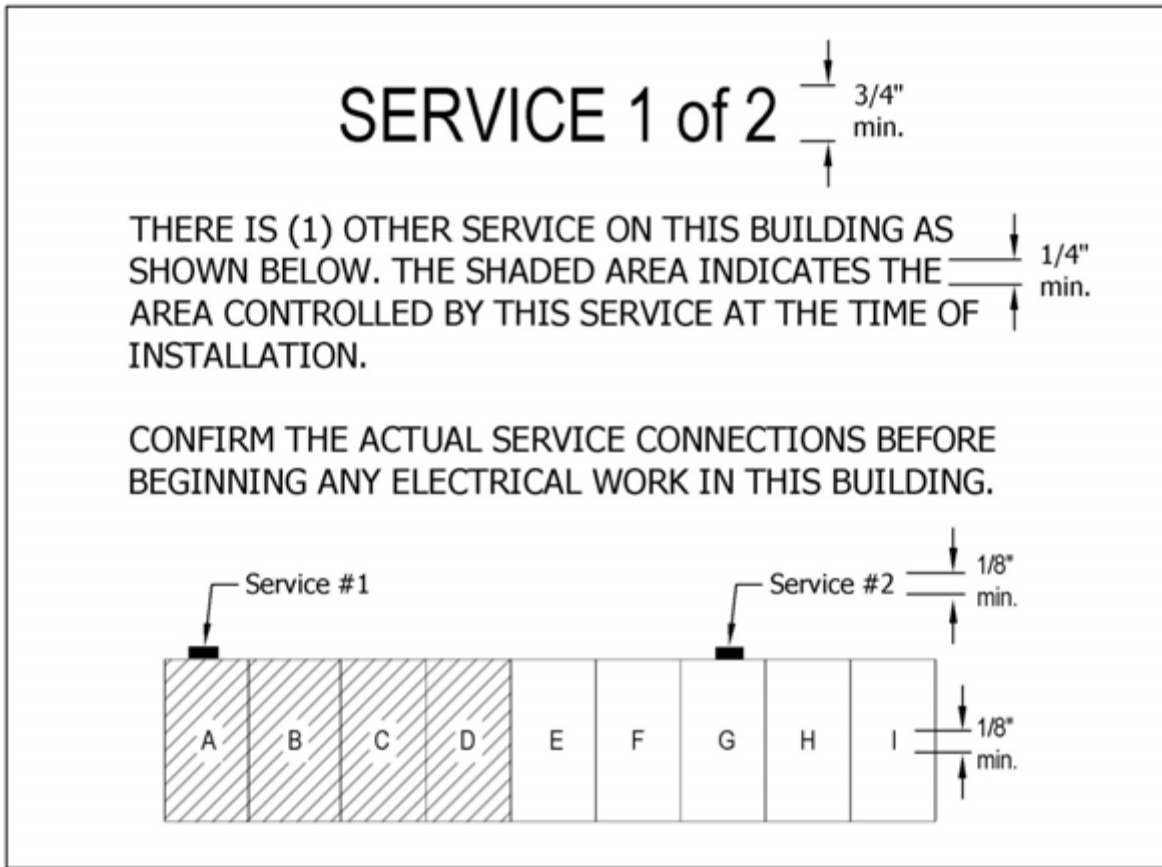


The plaque or directory required by Section 230.2 of the National Electrical Code shall be manufactured in metal or plastic with engraved or machine-printed lettering, or electro-photo-plating, in a contrasting color. The plaque shall include a footprint of the entire building with the area served by each service clearly delineated. The plaque shall be attached to the service disconnecting means with pop-rivets or other fasteners acceptable to the AHJ. Epoxy is no longer an acceptable method of securing.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 3	X Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 017.2
	SDG&E SERVICE STANDARDS & GUIDE				
	PLAQUE SPECIFICATIONS & EXAMPLES				

**TYPICAL PLAQUE FOR EXISTING
BUILDINGS WITH INTERMIXED SERVICES**

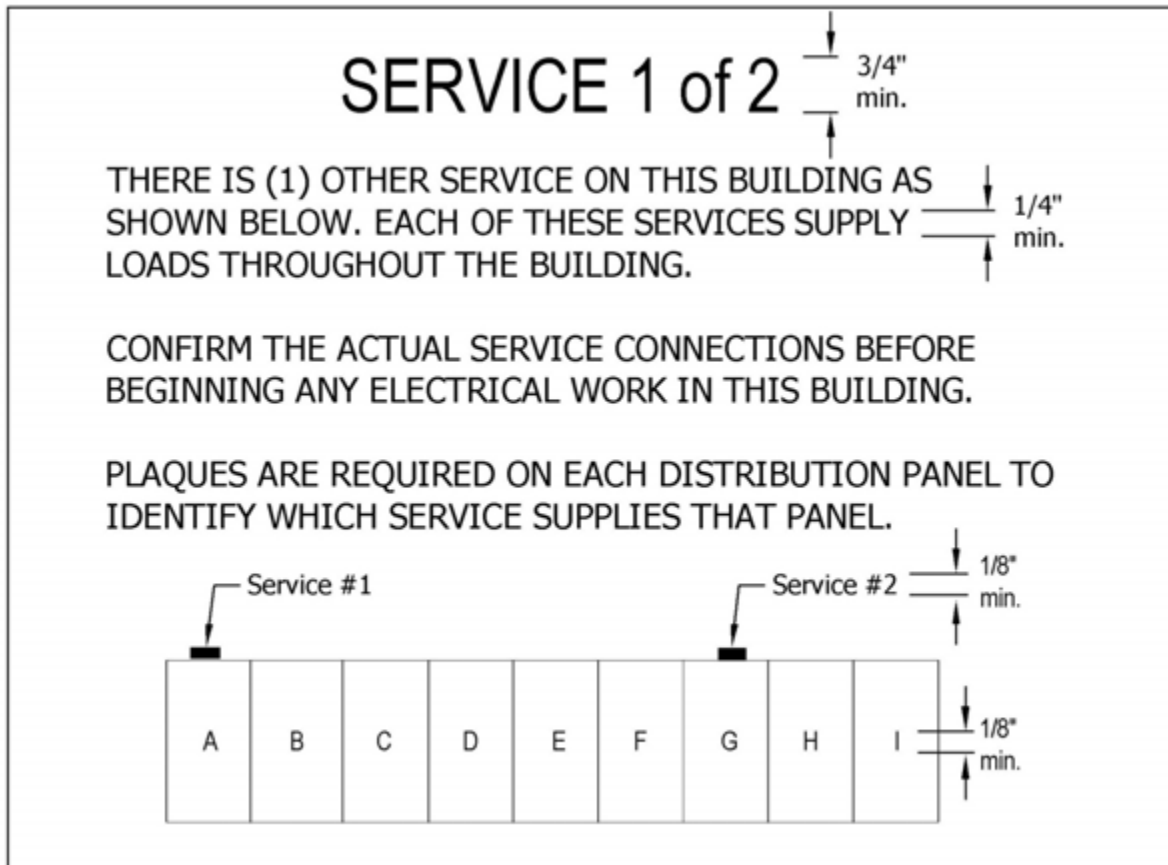

The plaque or directory required by Section 230.2 of the National Electrical Code shall be manufactured in metal or plastic with engraved or machine-printed lettering, or electro-photo-plating, in a contrasting color. The plaque shall include a footprint of the entire building and shall be attached to the service disconnecting means with pop-rivets or other fasteners acceptable to the AHJ. Epoxy is no longer an acceptable method of securing.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------


SHEET
3 OF 3

SDG&E SERVICE STANDARDS & GUIDE

PLAQUE SPECIFICATIONS & EXAMPLES

SG 017.3

SCOPE: These clearances apply to all persons who are not qualified electrical workers authorized by SDG&E to work on SDG&E-owned medium-voltage (600V – 50kV) conductors.

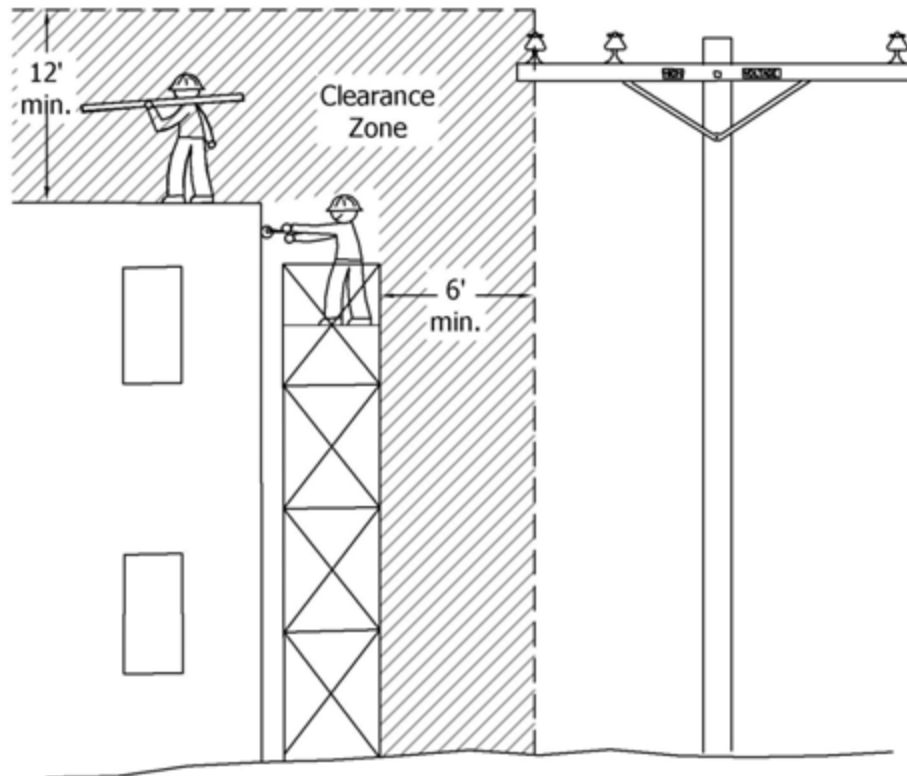

Workers or objects not supported by boom-type equipment must maintain 6' horizontal and 12' vertical clearance from medium-voltage (600V – 50kV) conductors.

Note: Cal-OSHA Electrical Safety Order 2948 makes the customer responsible for notifying SDG&E (Utility) if adjustments need to be made in the electrical system to comply with Title 8. The customer should contact the Utility's Customer Project Planner for the area where the job site is located for available options.

Reference: California Administrative Code Title 8 Industrial Relations Electrical Safety Orders – 2946 & 2948 & Fed-OSHA 1926.1408.

Reference OH 228.1.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed


SHEET
1 OF 2

SDG&E SERVICE STANDARDS & GUIDE

MEDIUM-VOLTAGE CONDUCTOR CLEARANCES FOR NON-UTILITY WORKERS & EQUIPMENT

SG 018.1

SCOPE: These clearances apply to all persons who are not qualified electrical workers authorized by SDG&E to work on SDG&E-owned medium-voltage (600V – 50kV) conductors.

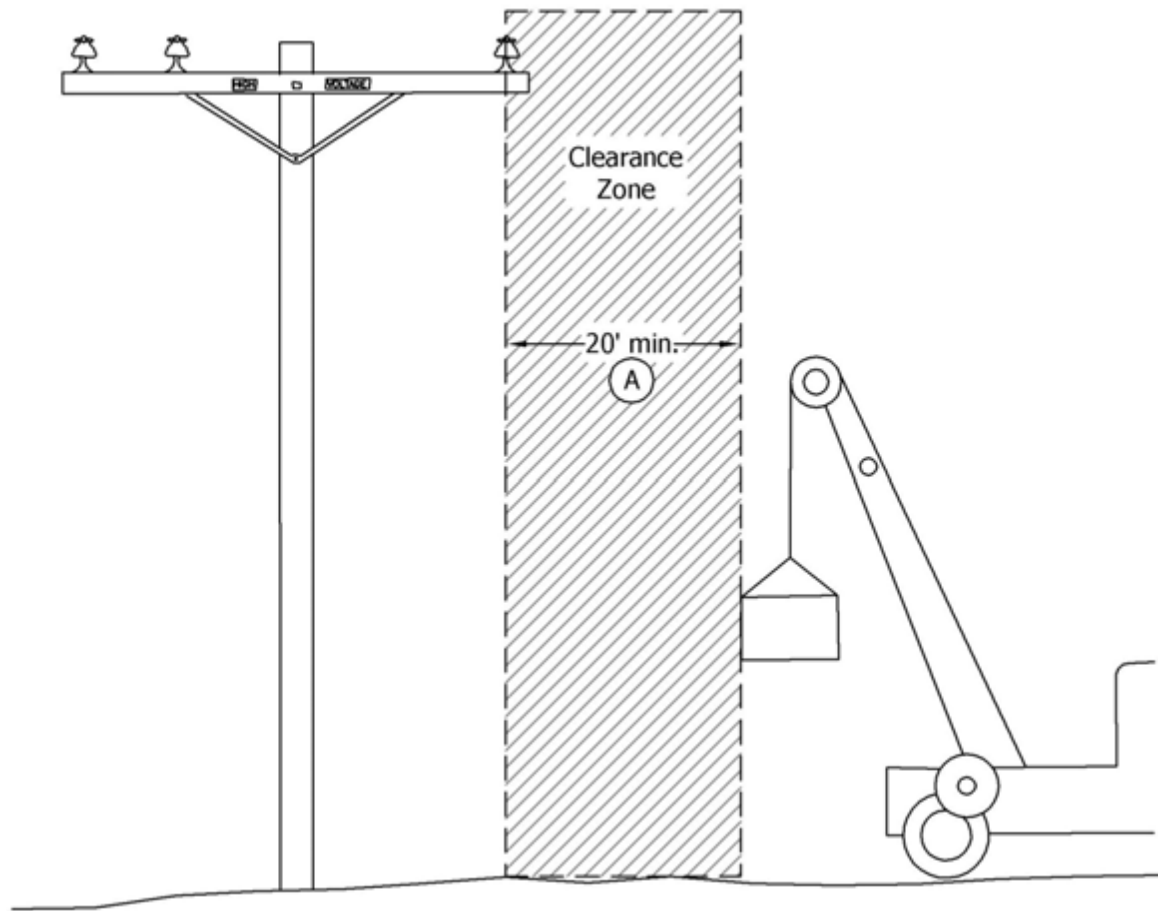

Boom-type lifting or hoisting equipment, including load, must maintain 20' horizontal clearance from medium-voltage (600V – 50kV) conductors.

- (A) To reduce minimum distance to 10', refer to "Cranes & Derricks in Construction" in Fed-OSHA 1926.1408.

Note: Cal-OSHA Electrical Safety Order 2948 makes the customer responsible for notifying SDG&E (Utility) if adjustments need to be made in the electrical system to comply with Title 8. The customer should contact the Utility's Customer Project Planner for the area where the job site is located for available options.

Reference: California Administrative Code Title 8 Industrial Relations Electrical Safety Orders – 2946 & 2948 & Fed-OSHA 1926.1408.

Reference OH 228.2.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed


SHEET
2 OF 2

SDG&E SERVICE STANDARDS & GUIDE

MEDIUM-VOLTAGE CONDUCTOR CLEARANCES FOR NON-UTILITY WORKERS & EQUIPMENT

SG 018.2

SCOPE: This standard shows the minimum clearance and separation requirements of energized overhead conductors from containers of flammable or explosive mixtures.

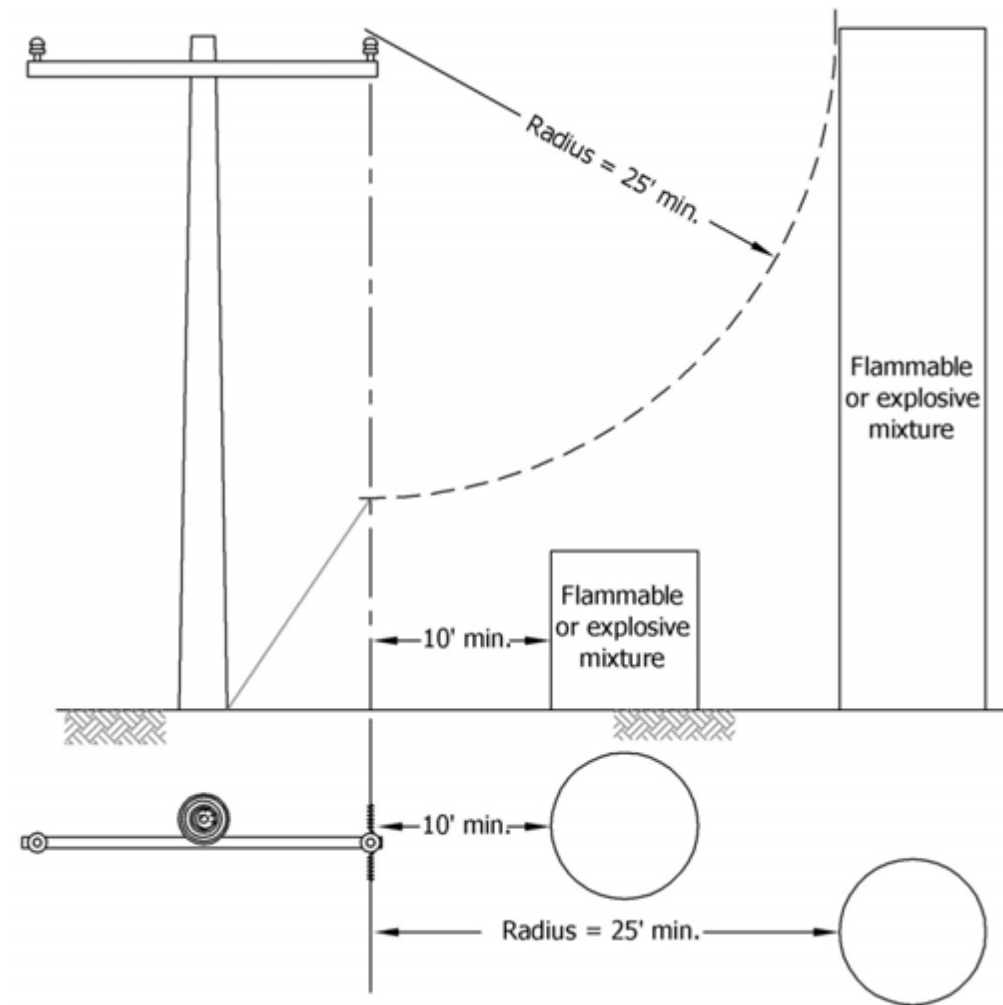

Notes:

1. All energized overhead facilities of any voltage classification shall have a minimum clearance of 10' measured horizontally and a radius of 25' from any exposed tank, vent, or fill tube containing flammable or explosive mixtures.
2. This standard does not apply to facilities installed prior to November 15, 1983. See G.O. 95, Rule 12.3.
3. Reference: Title 8 (OSHA) Article 34.

Reference OH 236.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

**CLEARANCES OF OVERHEAD FACILITIES FROM TANKS
CONTAINING FLAMMABLE OR EXPLOSIVE MIXTURE**

SG 019

Conduit pulling tape, concrete products, and wood poles purchased for use on SDG&E's distribution system and customer-owned meter poles must meet the American Society for Testing & Materials (ASTM) International standards. Below is a current listing of suppliers that carry products approved by SDG&E. Prior to purchase, it is advised that you verify with the supplier that the products you are procuring meet ASTM International standards.

Supplier	Phone Number	Conduit	Concrete Products	Poles	Pulling Tape
Brooks Products – Ontario	909-947-7470		X		
California Electric Supply Chula Vista El Cajon	619-427-2370 619-579-0711	X			
Consolidated Electric Distributors Carlsbad Escondido Ramona San Clemente San Diego Santee Temecula	760-438-9691 760-747-2900 760-788-6112 949-492-5161 858-268-1020 619-562-3004 951-296-9555	X			
Crescent Electric Supply Company	855-999-2372	X	X	X	X
CSC (Communications Supply Corporation/WESCO Distribution)	858-279-0233	X			
Grand Electric Supply – Vista	760-727-0400	X			
Graybar Electric Company San Diego San Marcos	858-547-6550 760-591-4788	X			
Jensen Precast – Fontana	909-350-4111		X		
Oldcastle Precast Escondido Fontana	760-737-8590 800-626-3860		X		
One Source Distributors El Centro Garden Grove Oceanside San Diego – Miramar San Diego – Kearny Mesa	760-352-1015 714-685-5340 760-966-4500 858-452-9001 858-565-8866				X
Pine Tree Lumber – Escondido	760-745-0411			X	
ProGlass, Inc. – Gig Harbor (WA)	253-884-4008		X		
Rexel El Cajon Escondido San Diego	619-442-9255 760-747-2211 858-636-4400	X			

Note: Conduit must be gray.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 1	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 020
	SDG&E SERVICE STANDARDS & GUIDE					
	PRODUCT DISTRIBUTORS					

SCOPE: THIS SERVICE GUIDE EXPLAINS HOW TO OBTAIN A SERVICE AND METER LOCATION FOR NEW ELECTRIC SERVICES, SERVICE RELOCATIONS, AND SERVICE UPGRADES.

TABLE 1:

SERVICE ORDER TEAMS FOR RESIDENTIAL CUSTOMERS UP TO 400 AMPS AND NON-RESIDENTIAL CUSTOMERS UP TO 200 AMPS		
BEACH CITIES 4848 SANTE FE ST SAN DIEGO, CA 92109 (858) 581-7544	METRO 701A 33RD ST SAN DIEGO, CA 92102 (619) 230-7800	NORTH COAST 4940 CARLSBAD BLVD CARLSBAD, CA 92008 (760) 476-5621
NORTHEAST 571 ENTERPRISE ST ESCONDIDO, CA 92029 (760) 480-7745	EASTERN 904 WEST MAIN ST EL CAJON, CA 92020 (619) 441-3969	ORANGE COUNTY 662 CAMINO DE LOS MARES SAN CLEMENTE, CA 92673 (949) 361-8066

TABLE 2:

PROJECT MANAGEMENT OFFICES FOR RESIDENTIAL CUSTOMERS UP TO 400 AMPS AND NON-RESIDENTIAL CUSTOMERS UP TO 200 AMPS		
SOUTHERN REGION (METRO) 8315 CENTURY PARK CT, STE 210 SAN DIEGO, CA 92123-1550 (858) 636-6805	NORTHERN REGION 571 ENTERPRISE ST ESCONDIDO, CA 92029 (760) 480-7603	ORANGE COUNTY REGION 662 CAMINO DE LOS MARES SAN CLEMENTE, CA 92673 (949) 361-8028

IN ALL CASES, YOU MAY ALSO CONTACT SDG&E BY CALLING (877) 789-9866 OR VIA THE INTERNET AT:

<https://www.sdge.com/businesses/savings-center/services/service-planning-for-expansionrelocation/service-and-meter-request-form>

TO REQUEST A **TRENCH INSPECTION**, CONTACT ONE OF THE FOLLOWING NUMBERS BETWEEN 7:00 A.M. AND 2:00 P.M. BASED ON THE LOCATION OF YOUR PROJECT.

TABLE 3:

SAN DIEGO GAS & ELECTRIC TRENCH INSPECTIONS		
SOUTHERN REGION (METRO) (877) 610-2948	NORTHERN REGION (760) 432-5805	ORANGE COUNTY REGION (949) 361-8061

FOR SERVICE STANDARDS INTERPRETATIONS OR TO PURCHASE A SERVICE STANDARDS & GUIDE, CONTACT:

ISRAEL JUAREZ
SERVICE STANDARDS TEAM LEAD
ijuarez@sdge.com
(858) 636-3941



© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	FORMATTING	EDM	JK	--	--	5/22/2020	F						
B	EDITORIAL CHANGES		CSE	IPJ	CZH	2/10/2020	E						
A	EDITORIAL CHANGES		LSM	IPJ	TPM	11/1/2017	D						



Indicates Latest Revision

Completely Revised

New Page

Information Removed


SHEET
1 OF 1

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

SERVICE ORDER TEAMS & REGIONAL
PROJECT MANAGEMENT OFFICES

SG021.1

BORDER WITH SOUTHERN CALIFORNIA EDISON

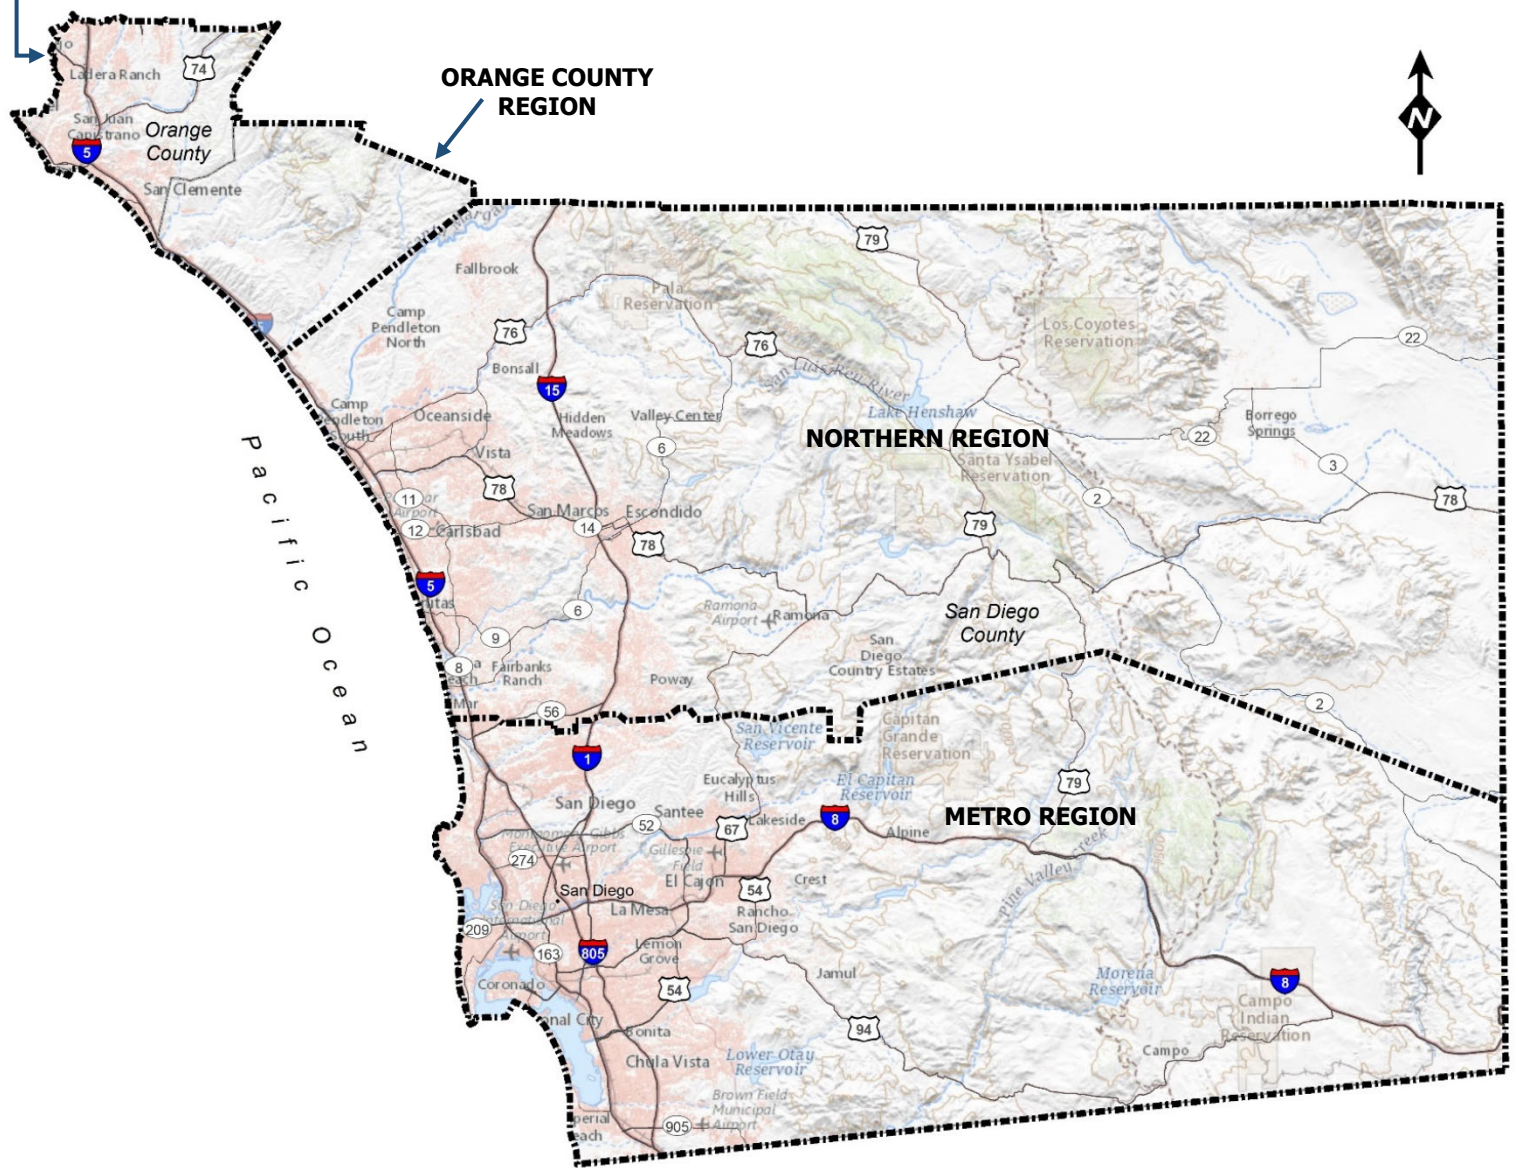

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C							F						
B	FORMATTING	EDM	JKI	--	--	5/22/2020	E						
A	EDITORIAL CHANGES		LSM	LSM	TPM	11/1/2017	D						

X	Indicates Latest Revision	Completely Revised	New Page	Information Removed
SDG&E ELECTRIC SERVICE STANDARDS & GUIDES				

SHEET
1 OF 1

PROJECT MANAGEMENT
REGIONAL BOUNDARY MAP

SG022.1

SUBJECT – ELECTRIC**PAGE**

CONDUITS, CUSTOMER-OWNED & -INSTALLED	309.1 – 309.3
DEFINITIONS OF TERMS	003.1 – 003.3
ELECTRIC METER CABINETS	509.1 – 509.4
ELECTRIC METER ROOMS	506.1 – 506.4
ELECTRIC SERVICE POLICIES	011.1 – 014.5
FAULT CURRENT, UTILITY'S CONTRIBUTION & EXAMPLES	006.1 – 006.2, 008.1 – 008.7
LOCKSMITHS, LISTING OF	005.1 – 005.2
METER ACCESS	004.5
METER POLES, CUSTOMER-OWNED SERVICE & METER POLES	204.1 – 205.4
METER TYPE & SOCKET CLIP ARRANGEMENT	516
SERVICE LATERAL, UNDERGROUND ELECTRIC SERVICE LATERAL RESIDENTIAL OR COMMERCIAL	309.1 – 309.3
TERMINATING ENCLOSURES	
<i>PULL CAN, 0-600 VOLTS</i>	705.1 – 706.2
<i>PULL SECTION, 0-600 VOLTS</i>	708.1 – 708.2
<i>PULL SECTION, MEDIUM-VOLTAGE SWITCHGEAR</i>	608.1 – 608.3
TRENCH INSPECTIONS	21, 004.5
TRUCK ACCESS	015 – 016.2
UNACCEPTABLE METER LOCATIONS	504.3 – 504.4
WORKING SPACE	504.4 – 504.5

SUBJECT – GAS

GAS METER CAPACITY & SELECTION	1005
GAS SERVICE RISER & HOUSELINE SPACING, CLEARANCES, & MINIMUM WORKING SPACE	1009.1 – 1009.3
GAS TRENCH ONLY FOR SAN DIEGO COUNTY	1004.1 – 1004.2
METER CABINET FOR SINGLE RESIDENTIAL GAS METER	1008.1 – 1008.3
UTILITY PLACEMENT IN JOINT TRENCH & GAS METER SET ASSEMBLY INSTALLATION	1007.1 – 1007.5

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C							F						
B	FORMATTING	EDM	JK	--	--	5/22/2020	E						
A	NEW PAGE		LSM	BRB	TPM	11/1/2017	D						

**SHEET
1 OF 1**



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

FREQUENTLY REFERENCED STANDARDS

SG023.1

ELECTRIC SECTIONS

SUBJECT

PAGE

ACCESSIBILITY	004.5
ACCESSIBLE/INACCESSIBLE METER LOCATION.....	005.1
ADDING LOAD TO EXISTING METER PANELS.....	004.2 – 004.3
ADDITIONS, ALTERATIONS OR RENEWAL OF EXISTING SERVICE & METERING EQUIPMENT	504.1
ADDRESSING CONVENTIONS.....	004.6
ALTERNATE SERVICE DELIVERY POINT REQUESTS	011.2
APPLICATION FOR A BILLING ACCOUNT.....	004.3
BARRIERS FOR SERVICE & METERING EQUIPMENT	505
BIL RATING.....	603.4
BUS TAP DRAWINGS FOR APPROVAL	517.1 – 517.2, 603.3
BUSWAY SERVICE HEADS	110.1 – 110.2
CABLE POLE QUADRANT & RISER IDENTIFICATION.....	314.1 – 314.3
CABLE POLE RISER INSTALLATION	315.1 – 315.5
CABLE POLE RISER POSITION USING LADDER ARM BRACKET & SINGLE RISER.....	313.1 – 313.2
CABLE TERMINATION BUS STUBS	709.1 – 709.3
CHARACTER OF SERVICE	004.3 – 004.4
CLEARANCES OF OVERHEAD FACILITIES FROM TANKS CONTAINING FLAMMABLE OR EXPLOSIVE MIXTURE	019
CLEARANCES, MEDIUM-VOLTAGE CONDUCTORS	018.1 – 018.2
CONDUIT BEND & RISER AT BUILDING	312.1 – 312.2
CONDUIT, SAFETY OVERFLOW FITTING.....	307
CONNECTION OR DISCONNECTION OF SERVICE	004.4
CONTROL POWER TRANSFORMER METERING	605
CONVERSIONS	303, 304.1 – 304.2, 305.1 – 305.2
CURRENT TRANSFORMER DIMENSIONS	606

© 1998 - 2021 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.


REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	SG308 MOVED TO FMO	EDM	JKI	IPJ	CZH	02/08/2021	F						
B	FORMATTING	EDM	JKI	--	--	05/22/2020	E						
A	NEW PAGE	--	LSM	LSM	TPM	11/01/2017	D						

 Indicates Latest Revision

 Completely Revised

 New Page



 Information Removed

**SHEET
1 OF 9**

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

ALPHABETICAL SUBJECT INDEX

SG024.1

SUBJECT**PAGE**

CUSTOMER GENERATION

CLEARANCE REQUIREMENTS FROM SDG&E-OWNED ELECTRIC METER & SERVICE & GAS METER ASSEMBLY.....	806.13
DISCONNECTION DEVICES.....	806.2 – 806.4
DISCONNECTION OF GENERATOR.....	806.15
DISTRIBUTED GENERATION.....	806.1 – 806.16
GENERAL INFORMATION.....	803.1
INSPECTION.....	806.15
METERING DEVICES INFORMATION & TABLE.....	806.14
METERING EXAMPLES FOR BILLING & PURCHASE OF ENERGY.....	806.16
NET GENERATION OUTPUT METERING.....	806.5 – 806.12
STAND-BY GENERATOR	805.1 – 805.3
STAND-BY GENERATOR SAFETY TRANSFER SWITCH.....	804
TELEMETERING	806.15
TRANSFORMER REQUIREMENTS.....	806.15
VOLTAGE STANDARDS.....	806.15

CUSTOMER WILL FURNISH, INSTALL, OWN, & MAINTAIN	009.1 – 009.3
---	---------------

CUSTOMER-OWNED SERVICE & METER

ADDRESS MARKING	203.2
MULTIPLE METER INSTALLATION	206, 207
PERMANENT POLE	204.1 – 204.3
TEMPORARY POLE	205.1 – 205.4
TEMPORARY SERVICE FROM AN OVERHEAD SOURCE.....	205.1 – 205.4, 206
UNDERGROUND INSTALLATION	207

DEFINITIONS OF TERMS	003.1 – 003.3
----------------------------	---------------

DRIP LOOPS.....	104.5, 112.2, 112.4, 112.6
-----------------	----------------------------

© 1998 - 2021 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	SG308 MOVED TO FMO	EDM	JK	IPJ	CZH	02/08/2021	F						
B	FORMATTING	EDM	JK	--	--	05/22/2020	E						
A	NEW PAGE	--	LSM	LSM	TPM	11/01/2017	D						



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 9

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

ALPHABETICAL SUBJECT INDEX

SG024.2

SUBJECT**PAGE****ELECTRIC METER & SERVICE LOCATION – COMMERCIAL & RESIDENTIAL PREMISES**

COMMERCIAL & INDUSTRIAL, METER LOCATIONS	504.2 – 504.3
GENERAL INFORMATION.....	504.1 – 504.2
INACCESSIBLE.....	005.1
MID-RISE & HIGH-RISE BUILDINGS.....	510.1 – 510.5
REQUESTS, ELECTRIC METER & SERVICE LOCATION	503, 504.1
RESIDENTIAL, METER LOCATIONS	504.2
SINGLE OR MULTIPLE METER INSTALLATIONS	507.1 – 507.2
UNACCEPTABLE METER LOCATIONS.....	504.3 – 504.4
ELECTRIC METER CABINET – COMMERCIAL OR RESIDENTIAL MULTI-METER INSTALLATIONS	509.1 – 509.4
ELECTRIC METER ROOM.....	506.1 – 506.4
ELECTRIC SERVICE DISCONNECTS & METER SERVICE DISCONNECTS	511.1 – 511.3, 515.1
ELECTRIC SERVICE POLICIES	011.1 – 014.5
ELECTRIC TERMINATING ENCLOSURES, 0 – 600 VOLTS.....	703
GENERAL INFORMATION.....	003.3, 703
OVERHEAD SERVICE TERMINATING ENCLOSURE	704
UNDERGROUND PULL SECTION.....	708.1 – 708.2
EQUIPMENT PROVIDED, BY CUSTOMER & UTILITY.....	004.4
EXISTING CUSTOMERS REQUESTING ADDITIONAL SERVICES OR REMOTE METER LOCATIONS.....	013.1 – 013.3
EXISTING GAS METER BELOW ELECTRIC SERVICE & METERING EQUIPMENT	504.1 – 504.2
FACILITIES	004.5, 503
FIELD HEATING SERVICE LATERAL CONDUITS	306
GAS & ELECTRIC METER ACCESS	005.1
GENERAL INFORMATION	004.1 – 004.5
GROUNDING & BONDING	112.3
INGRESS & EGRESS TO ELECTRIC SERVICE & METERING EQUIPMENT	504.2 – 504.3

© 1998 - 2021 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	SG308 MOVED TO FMO	EDM	JKI	IPJ	CZH	02/08/2021	F						
B	FORMATTING	EDM	JKI	--	--	05/22/2020	E						
A	NEW PAGE	--	LSM	LSM	TPM	11/01/2017	D						

**SHEET
3 OF 9**



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

ALPHABETICAL SUBJECT INDEX

SG024.3

SUBJECT**PAGE**

INSPECTION AUTHORITY	003.1
INSTRUMENT TRANSFORMER MOUNTING SPECIFICATIONS.....	607
LOCKSMITHS, LISTING OF	005.1 – 005.2
MANUFACTURER’S DRAWINGS FOR APPROVAL.....	517.1, 603.1
MARKOUT SERVICE	004.5
MEDIUM-VOLTAGE CONDUCTOR CLEARANCES FOR NON-UTILITY WORKERS & EQUIPMENT	018.1 – 018.2
MEDIUM VOLTAGE METERING CUBICLE	604.1 – 604.6
MEDIUM VOLTAGE SERVICE & METERING EQUIPMENT	603.1 – 603.6
METER CABINET RECESS	508.1 – 508.2
METER HEIGHTS	504.1
METER LOCATIONS (REFER TO ELECTRIC METER & SERVICE LOCATION – COMMERCIAL & RESIDENTIAL PREMISES ON PAGE 024.3)	
METER MARKING	504.1
METER PEDESTAL FOUNDATION DETAILS	519.5
METER PEDESTAL, COMMERCIAL	519.1 – 519.5
METER PEDESTAL, FIELD REPLACEMENT OF EXISTING 120-VOLT METER PEDESTAL.....	520.1 – 520.2
METER PEDESTAL, RESIDENTIAL	518.2 – 518.3
METER SOCKET SEALING RINGS	503
METER TYPE & SOCKET CLIP ARRANGEMENT	516
METERED & UNMETERED CONDUCTORS	503
METERING COMMUNICATIONS	525
MID-RISE & HIGH-RISE BUILDINGS	510.1 – 510.5
MOBILE HOME PARK SERVICE & METER PEDESTALS.....	518.1 – 518.3
MULTI-FAMILY RESIDENTIAL BUILDINGS – LESS THAN 3 STORIES HIGH	012.1, 013.1
OVERHEAD ELECTRIC CLEARANCES OVER SWIMMING POOLS.....	108.1 – 108.2
PERMIT & INSPECTION	004.3
PLAQUE SPECIFICATIONS & EXAMPLES.....	017.1 – 017.3

© 1998 - 2021 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	SG308 MOVED TO FMO	EDM	JKI	IPJ	CZH	02/08/2021	F						
B	FORMATTING	EDM	JKI	--	--	05/22/2020	E						
A	NEW PAGE	--	LSM	LSM	TPM	11/01/2017	D						



Indicates Latest Revision

Completely Revised

New Page

Information Removed

**SHEET
4 OF 9**

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

ALPHABETICAL SUBJECT INDEX

SG024.4

SUBJECT**PAGE**

PRODUCT DISTRIBUTORS	020
PULLING DEVICES FOR INSTALLATION OF SERVICE LATERAL CONDUCTORS IN PARKING STRUCTURES.....	016.1 – 016.2
PURPOSE	004.1
READILY ACCESSIBLE DEFINITION	503
REQUEST FOR SERVICE.....	021, 004.2
RESIDENTIAL OR MIXED USE BUILDINGS – 3 STORIES OR GREATER	012.1, 013.1
RESIDENTIAL SINGLE-PHASE MULTI-METER STACK.....	707
RESIDENTIAL CONTIGUOUS DWELLINGS – TOWNHOUSES (ROW HOMES)	012.1 – 012.2, 013.1 – 013.2
RIGHTS OF WAY	011.3
RISERS	
METALLIC CONDUIT RISERS	105.1 – 105.2
SOLID WOOD RISERS	106.1 – 106.2
SAFETY SOCKET METER CANS	514.1 – 514.5
SAMPLE PLAQUE FOR ELECTRICAL EQUIPMENT LABELS.....	017.1
SCOPE	004.1
SDG&E TRANSFORMER FUSING INFORMATION	007.1 – 007.2
SDG&E WILL FURNISH, INSTALL, OWN, & MAINTAIN	009.4
SEALING OF METER & SERVICE FACILITIES	004.5, 503
SECONDARY SERVING VOLTAGES & CLASSIFICATION OF SERVICE INFORMATION	011.3
SERVICE DROPS	
ATTACHMENTS.....	103.1 – 103.5, 105.1 – 105.2, 106.1 – 106.2
CLEARANCES	107.1 – 107.11
CLEARANCES OVER SWIMMING POOLS.....	108.1 – 108.2
GENERAL INFORMATION.....	103.1
LENGTH	103.1
SUPPORTS.....	104.1 – 104.5

© 1998 - 2021 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	SG308 MOVED TO FMO	EDM	JKI	IPJ	CZH	02/08/2021	F						
B	FORMATTING	EDM	JKI	--	--	05/22/2020	E						
A	NEW PAGE	--	LSM	LSM	TPM	11/01/2017	D						

**SHEET
5 OF 9**



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

ALPHABETICAL SUBJECT INDEX

SG024.5

SUBJECT**PAGE**

SERVICE & METERING EQUIPMENT, RESIDENTIAL SELF-CONTAINED

COMBINATION PULL & METER CANS	512.1 – 512.8
EQUIPMENT CONNECTED AHEAD OF A MAIN SERVICE DISCONNECT	512.1
METER SOCKET CLOSING DEVICES	512.1
METER SOCKET CONNECTIONS.....	512.1
SELF-CONTAINED METER SOCKETS.....	512.1
SERVICE ENTRANCE CONDUCTORS, 0 – 600 VOLTS.....	112.1 – 112.6
SERVICE ENTRANCE LIMITATIONS.....	503
SERVICE ENTRANCE RACEWAYS	111
SERVICE HEADS.....	109.1 – 109.2
SERVICE LOCATIONS.....	011.2
SERVICE PLANNING.....	004.2
SINGLE PREMISE – MULTIPLE NON-RESIDENTIAL ENTERPRISES.....	012.2, 013.2
SINGLE PREMISE – MULTIPLE RESIDENTIAL CUSTOMERS.....	012.3, 013.3
SINGLE PREMISE – SINGLE NON-RESIDENTIAL ENTERPRISE.....	012.2, 013.2 – 013.3
SINGLE PREMISE – SINGLE RESIDENTIAL CUSTOMER WITH OTHER ELECTRIC USES	012.3, 013.3
SINGLE PREMISE WITH MULTIPLE BUILDINGS – SERVICE & METERING REQUIREMENTS	014.1 – 014.5
STANDARD SWITCHBOARD SERVICE SECTIONS	517.1 – 517.20
SWITCHGEAR UNDERGROUND TERMINATING PULL SECTION, MEDIUM VOLTAGE	608.1 – 608.3
TEST-BYPASS FACILITIES FOR SAFETY SOCKETS.....	513
TESTING REQUIREMENTS FOR METAL-ENCLOSED SERVICE ENTRANCE & UNMETERED FEEDER BUSWAYS	010
TRANSFORMER FUSING INFORMATION, SDG&E	007.1 – 007.2
TRANSFORMER RATED METER [CURRENT TRANSFORMER (CT)].....	515.1 – 515.6
TRANSFORMER VAULTS.....	009.1 – 009.4
TRENCH INSPECTIONS	004.5
TROLLEY TRACTION STATION, 12KV SERVICE POINT CONNECTION	609

© 1998 - 2021 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	SG308 MOVED TO FMO	EDM	JK	IPJ	CZH	02/08/2021	F						
B	FORMATTING	EDM	JK	--	--	05/22/2020	E						
A	NEW PAGE	--	LSM	LSM	TPM	11/01/2017	D						



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
6 OF 9

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

ALPHABETICAL SUBJECT INDEX

SG024.6

SUBJECT**PAGE**

TRUCK ACCESS REQUIREMENTS, LINE	015
TYPICAL PLAQUE FOR EXISTING BUILDINGS WITH INTERMIXED SERVICES	017.3
TYPICAL PLAQUE FOR NEW BUILDINGS OR EXISTING BUILDINGS WITH SEPARATE SERVICE AREAS.....	017.2
UNACCEPTABLE METER LOCATIONS.....	504.3 – 504.4
UNDERGROUND ELECTRIC SERVICE LATERAL CLEARANCES	
GASOLINE DISPENSING & SERVICE STATIONS.....	316, 318
LEACH FIELDS	319
PROPANE TANKS	317.1 – 317.2, 318
UNDERGROUND ELECTRIC SERVICE LATERAL CONDUIT REQUIREMENTS	309.1 – 309.3
UNDERGROUND PULL CAN WITH CABLE TERMINATION BUS STUBS	706.1 – 706.2
UNDERGROUND PULL CAN WITH OR WITHOUT MECHANICAL LUGS	705.1 – 705.4
UNDERGROUND PULL SECTION (SEE ELECTRIC TERMINATING ENCLOSURES, 0 – 600 VOLTS ON PAGE SG 024.3)	
UNDERGROUND SERVICE FROM OVERHEAD FACILITIES (LOW VOLTAGE)	310.1 – 310.2
UNDERGROUND SERVICE FROM OVERHEAD FACILITIES-PADMOUNT TRANSFORMER.....	311.1 – 311.2
UNMETERED ELECTRIC SERVICE.....	524.1 – 524.10
UTILITY METERS.....	003.3
UTILITY'S CONTRIBUTION TO FAULT CURRENT	006.1 – 006.2
UTILITY'S CONTRIBUTION TO FAULT CURRENT SECONDARY VOLTAGE SERVICE EXAMPLES	008.1 – 008.7
VENTILATION	517.2, 603.5
WIRELESS COMMUNICATIONS ON PRIVATE PROPERTY	522.1 – 522.2
WIRELESS COMMUNICATIONS PROVIDER – METERED ELECTRIC SERVICE	523.1 – 523.3
WORK ON UTILITY-OWNED POLES	004.5
WORKING SPACE	
LOW VOLTAGE (0 – 600 VOLTS).....	504.4 – 504.5
MEDIUM-VOLTAGE SWITCHGEAR	603.3 – 603.4

© 1998 - 2021 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	SG308 MOVED TO FMO	EDM	JK	IPJ	CZH	02/08/2021	F						
B	FORMATTING	EDM	JK	--	--	05/22/2020	E						
A	NEW PAGE	--	LSM	LSM	TPM	11/01/2017	D						

**SHEET
7 OF 9**



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

ALPHABETICAL SUBJECT INDEX

SG024.7

GAS SECTION

SUBJECT

PAGE

ASSISTANCE & INFORMATION AVAILABLE.....	1003.3
BARRICADES FOR GAS METER SETS.....	1014.1 – 1014.3
BILLING ACCOUNT ESTABLISHMENT	1003.3
BUILDING RECESS FOR GAS SERVICE & METERS.....	1012.1 – 1012.4
CUSTOMER RESPONSIBILITY FOR APPLIANCES	1003.3
DEFINITIONS OF TERMS	1003.1 – 1003.2
ELECTRIC BONDING & GROUNDING OF GAS PIPE.....	1003.5
ESTABLISHING GAS METER LOCATION & LOCATION OF CUSTOMER'S HOUSELINE	1003.2
EXISTING GAS SERVICE – CUSTOMER REQUESTS FOR ADDITIONAL SERVICES	1006.3 – 1006.4
GAS FACILITIES NEAR UNDERGROUND PADMOUNTED EQUIPMENT OR SUBSTRUCTURES.....	1015.1 – 1015.7
GAS METER CAPACITY & SELECTION	1005
GAS METERS GROUPED ON METER HEADERS.....	1010.1 – 1010.8
GAS SERVICE & METERING.....	1003.2
GAS SERVICE & METER BEHIND WING WALLS.....	1011
GAS SERVICE RISER & HOUSELINE SPACING, CLEARANCES, & MINIMUM WORKING SPACE	1009.1 – 1009.3
GAS TRENCH ONLY FOR SAN DIEGO COUNTY	1004.1 – 1004.2
HOUSELINE MODIFICATIONS.....	1003.4
MARKOUT SERVICE	1003.5
METER & SERVICE LOCATION.....	1006.1 – 1006.5
METER CABINET FOR SINGLE RESIDENTIAL GAS METER	1008.1 – 1008.3
METER LOCATIONS	1006.1 – 1006.2
MOBILE HOME METER PAD	1013
NUMBER OF SERVICES ALLOWED TO A BUILDING	1006.2 – 1006.3
OWNERSHIP & MAINTENANCE OF UTILITY'S FACILITIES	1003.4

© 1998 - 2021 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	SG308 MOVED TO FMO	EDM	JKI	IPJ	CZH	02/08/2021	F						
B	FORMATTING	EDM	JKI	--	--	05/22/2020	E						
A	NEW PAGE	--	LSM	LSM	TPM	11/01/2017	D						

SHEET 8 OF 9	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG024.8
	SDG&E ELECTRIC SERVICE STANDARDS & GUIDES					
	ALPHABETICAL SUBJECT INDEX					

SUBJECT**PAGE**

PURPOSE	1003.1
RESALE OF NATURAL GAS	1003.5
SCOPE	1003.1
SERVICE LOCATIONS.....	1006.5
SIGNAGE REQUIREMENTS FOR GAS SERVICE LOCATIONS ON MULTI-TENANT BUILDINGS.....	1003.2 – 1003.3
TERRITORY SERVED.....	1003.1
UTILITY PLACEMENT IN JOINT TRENCH & GAS METER SET ASSEMBLY INSTALLATION	1007.1 – 1007.5
UTILITY'S RIGHT OF ACCESS TO CUSTOMER'S PREMISES.....	1003.3 – 1003.4

© 1998 - 2021 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	SG308 MOVED TO FMO	EDM	JIK	IPJ	CZH	02/08/2021	F						
B	FORMATTING	EDM	JIK	--	--	05/22/2020	E						
A	NEW PAGE	--	LSM	LSM	TPM	11/01/2017	D						



Indicates Latest Revision

Completely Revised

New Page

Information Removed

**SHEET
9 OF 9**

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

ALPHABETICAL SUBJECT INDEX

SG024.9

**100 - RESIDENTIAL,
COMMERCIAL &
INDUSTRIAL OVERHEAD**

**100 - RESIDENTIAL,
COMMERCIAL &
INDUSTRIAL OVERHEAD**

SUBJECTPAGE #

Aluminum Service Entrance Conductors..... SG 112.4

Busway Service Heads..... SG 110.1 – 110.2

Clearances

Above Commercial or Industrial Buildings & Structures,
Service Entrance Conductors, 0 – 600 Volts SG 112.4 – 112.6

Above Ground, Thoroughfares, Driveways & Public/Private Property SG 107.2

Commercial or Industrial Premises Service Drop Conductor, 0 – 600 Volts SG 107.10

From Buildings & Structures, Residential, Commercial/Industrial Premises SG 107.7, SG 112.4 – 112.6

From Doors, Exits, Windows, Fire Escapes, Balconies, Etc..... SG 107.8

From Other Conductors SG 107.6

From Signs SG 107.6

Horizontal & Vertical Clearances of Supply & Service Drop Conductors from Buildings,
Bridges & Other Structures SG 107.11

Over Buildings & Structures SG 107.3 – 107.5

Over Thoroughfares, from Buildings & at Point of Attachment to Building

Residential Premises SG 107.9

Commercial or Industrial Premises SG 107.10

Swimming Pools..... SG 108.1 – 108.2

Connection of Service Entrance Conductors to Service Drop Conductors..... SG 112.2

Drip Loops..... SG 103.1, SG 104.3, SG 112.2, SG 112.4

Galvanized Rigid Conduit Riser or Intermediate Metallic Conduit
for Overhead Service Attachment..... SG 105.1 – 105.2

General Information

Busway Service Heads..... SG 110.1 – 110.2

Overhead Electric Clearances over Swimming Pools SG 108.1

Service Drops, Overhead Electric..... SG 103.1

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 4	Indicates Latest Revision	X	Completely Revised	New Page	Information Removed	SG 102.1
	SDG&E SERVICE STANDARDS & GUIDE					
	RESIDENTIAL, COMMERCIAL & INDUSTRIAL OVERHEAD ALPHABETICAL SUBJECT INDEX					

SUBJECTPAGE #

Residential Buildings or Structures	SG 103.2 – 103.4
Supports.....	SG 104.1 – 104.5
Swimming Pools.....	SG 108.1 – 108.2
Service Drop Supports.....	SG 104.1 – 104.5
Attachment Riser, Angle Iron Rack.....	SG 104.2
Buildings Other Than Wood	SG 104.1
Clearance Risers or Structures	SG 104.1 – 104.2
General Information	SG 104.1
Installation	SG 104.3 – 104.5
Maintenance Responsibility & Liability.....	SG 104.2
Wood Buildings.....	SG 104.1
Wood-Reinforcing Block.....	SG 104.1
Service Entrance Cable.....	SG 112.2
Service Entrance Conductors, 0 – 600 Volts	SG 112.1 – 112.6
Connection of Service Entrance Conductors to Service Drop Conductors.....	SG 112.2
Definitions	SG 112.1
Identification	SG 112.2
Maximum Length of Service Entrance Conductors	SG 112.2
Other Conductors in Service Entrance Raceways	SG 112.3
Service Entrance Cable	SG 112.2
Size & Capacity	SG 112.1
Taps & Splices in Service Raceways	SG 112.2 – 112.3
Service Entrance Raceways	SG 111

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 3 OF 4	Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	<input type="checkbox"/> New Page	<input type="checkbox"/> Information Removed	SG 102.3
	SDG&E SERVICE STANDARDS & GUIDE				
	RESIDENTIAL, COMMERCIAL & INDUSTRIAL OVERHEAD ALPHABETICAL SUBJECT INDEX				

SUBJECTPAGE #

Service Heads..... SG 109.1 – 109.2

Location SG 109.1

Multiple Service Head Installations SG 109.2

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

Indicates Latest Revision



Completely Revised

New Page

Information Removed

SHEET
4 OF 4

SDG&E SERVICE STANDARDS & GUIDE

**RESIDENTIAL, COMMERCIAL & INDUSTRIAL OVERHEAD
ALPHABETICAL SUBJECT INDEX**

SG 102.4

GENERAL INFORMATION

Where SDG&E's distribution pole line is located on the customer's premises, or on a street, highway, lane, alley, road, or private easement contiguous thereto, SDG&E (Utility) will, at its own expense, furnish and install a service drop (single span of service wires) from its pole line to the customer's permanent service drop support. Upon the Utility's receipt of approval from the governmental Authority Having Jurisdiction (AHJ), the Utility will connect to the customer's service entrance conductors provided such support is of a type acceptable to the Utility.

The customer is required to provide, or pay for, a clear route on any private property that is clear of obstructions which would inhibit the construction of overhead service facilities. This includes tree trimming, or tree removal, if required.

LENGTH OF SERVICE DROP

The maximum length of service drop normally shall not exceed 100'. In order to minimize service drop stress on the building, the point of attachment shall be located as near as practicable to the Utility's service pole. Where the character of load necessitates heavy service drop conductors with excessive sag and stress, the maximum length of service drop shall be subject to approval of the Utility's Service Planner.

SERVICE DROP ATTACHMENT

General Information

1. The point of service drop attachment shall normally be located on that portion of a building or structure facing and nearest the street, alley, easement, or public way on which the Utility's pole line is located, and installed at a height not less than specified herein for residential, commercial and industrial buildings. This is to permit the service drop conductors to be:
 - a. Installed and maintained in accordance with vertical, horizontal and radial clearances required above ground and from roofs, obstructions, windows, doorways, openings, balconies, fire escapes, swimming pools and other conductors.
 - b. Run free of obstruction from trees, structures, poles, masts, antennas, vents, flood lights, etc. An 18" radial clearance is required from electric risers supporting service conductors to vents or chimneys conveying products of combustion to the outside atmosphere, such as a water heater vent or wood burning stove vent. A vent shall not be installed within the working space of the electrical equipment. A 12" minimum radial clearance is required from vents to service drop conductors crossing over a structure to within 18" of the riser.
 - c. Installed at an approach angle of not less than 30 degrees with the building wall when service attaches below roofline.
 - d. Readily accessible for installation, inspection and maintenance.
 - e. Installed at a location where the weatherhead and point of attachment are safely accessible from a ladder placed on the ground. Distance from the ladder to the weatherhead and point of attachment are not to exceed 24".
 - f. Attached at only one point on the building and without intermediate support.
 - g. Attached in the proximity of the service entrance so that the open wiring between the service drop and the service head (drip loop) does not exceed 3'.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 5

SDG&E SERVICE STANDARDS & GUIDE

SERVICE DROPS – OVERHEAD ELECTRIC

SG 103.1

- h. Attached at not more than 30' above the ground.
 - i. So arranged as not to hamper or endanger workers and firemen in the performance of their duties.
 - j. Substantially supported at the building.
2. The service drop will normally be run to the building or structure from the Utility's nearest pole adjacent to the premises. Under this condition the service drop may, where approved by the Utility, cross an adjoining premises provided the necessary rights-of-way can be obtained at no cost to the Utility. In every case, the point of service drop attachment shall be located on the wall facing and nearest the Utility's pole line or within 18" of that point to permit the Utility, as necessitated for its operating convenience, to install a service drop from some point along its line passing the premises served whether or not a pole exists. See pages SG 103.3, Figure 3, and SG 103.5, Figures 1 and 5.

Residential Buildings or Structures

1. The point of service drop attachment on a residential building or structure shall normally be located on the wall facing and nearest the Utility's pole line, and so located that the service head, service drop and open wires between the service head and point of connection to the service drop (drip loop) will have not less than 12' clearance above final grade on residential premises, and whenever necessary, be located at a greater height to obtain required clearances. The 12' clearance may be reduced for insulated services (SSC) to not less than 10'. (See page SG 103.3, Figure 1.)

Residential dwelling units exceeding two in number on the same premises are classified as a commercial enterprise and premises, requiring the service drop attachment to be located at a point affording commercial service drop clearances.

2. The point of service drop attachment may be selected on a residence side wall which is at right angles to the Utility's pole line, where the wall of the residence facing and nearest the Utility's pole line does not afford sufficient service drop clearance above ground or from obstructions. Such a location is subject to approval by the Service Planner, and to conformance with provisions of the following exceptions:
- a. Exception for Obtaining Ground Clearance – Where the height of a residence wall facing and nearest the Utility's pole line is insufficient to obtain service drop conductor clearance without the installation of a clearance riser or structure on the front of the residence, a point of service drop attachment may be located up the gable wall not farther back than is necessary to obtain service drop clearance, but in no case more than 12' back from the wall facing the Utility's pole line nor further back than the peak of a gable roof. (See page SG 103.3, Figure 2.) The service drop conductors may not pass over the roof (excluding eaves) of the residence served.
 - b. Exception for Clearing Windows and Obstructions – Where windows or other building components conflict with providing an acceptable point of service drop attachment on the wall facing and nearest the Utility's pole line, or within 18" of that point, a riser or structure may be located on a residence side wall. This location may not be farther back than is necessary to obtain service drop clearances, but in no case more than 7' back from the wall facing the pole line. Service drop conductors may not pass over the roof (excluding eaves) of the residence served.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 5	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 103.2
	SDG&E SERVICE STANDARDS & GUIDE					
	SERVICE DROPS – OVERHEAD ELECTRIC					


In either exception, the service drop attachment shall be located at a point which will not require the service drop to pass over an adjacent lot or a building site on the same premises.

3. Where the height of a residence will not afford sufficient service drop clearance above ground or from obstructions, a service drop support riser or structure shall be installed on the wall facing, or within 18" of that point, and nearest the Utility's pole line to provide clearance. See Figures 3 and 4 below.

Impaired Clearances

When any of the service drop clearances required by the Utility, or the AHJ, become impaired because of changes created by the tenant or owner of the premises, it is incumbent upon the customer, at their expense, to provide a means to correct the infraction.

RESIDENTIAL BUILDINGS OR STRUCTURES

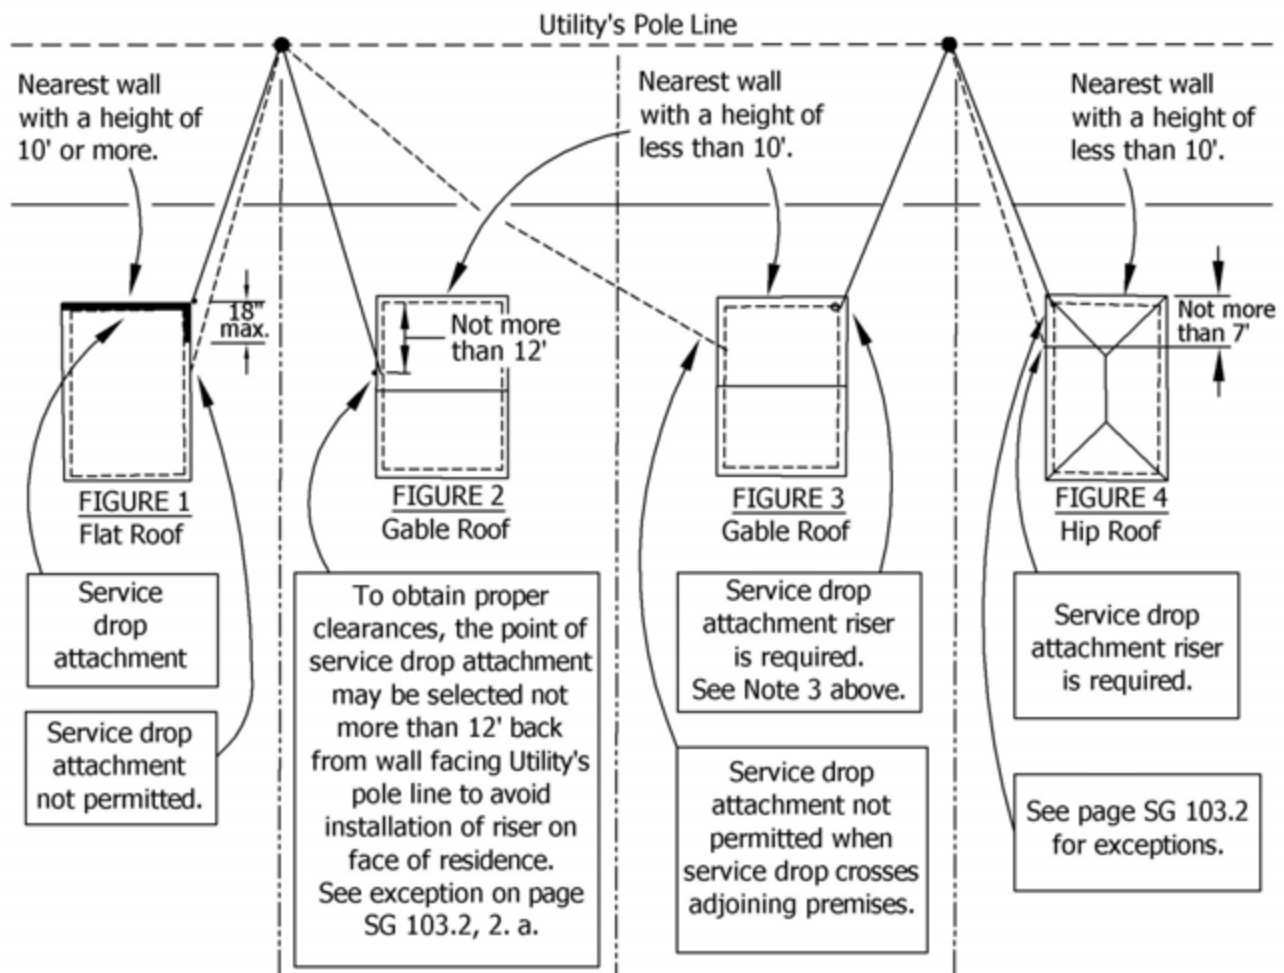

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
3 OF 5

SDG&E SERVICE STANDARDS & GUIDE

SERVICE DROPS – OVERHEAD ELECTRIC

SG 103.3

Maximum Permissible Length of Service Drop over Roof to Service Drop Attachment Riser

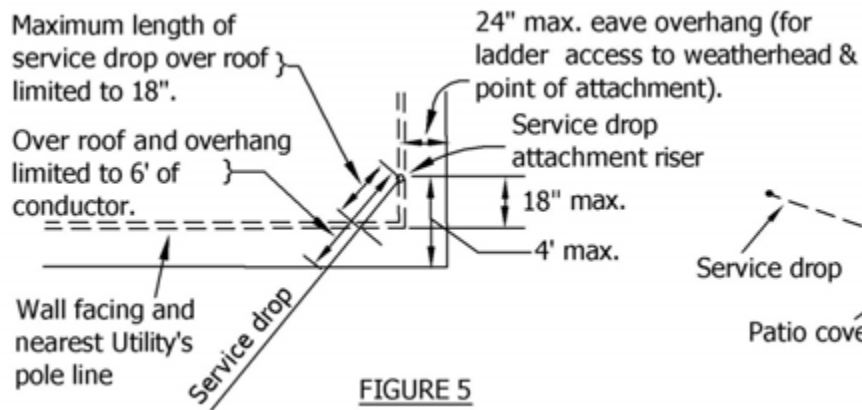


FIGURE 5

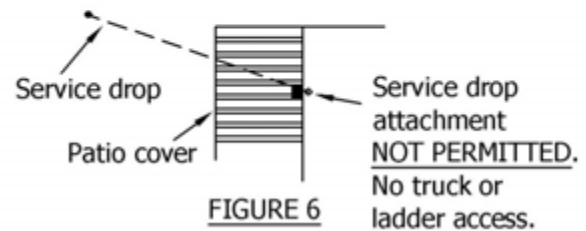


FIGURE 6

Note: When the distance from building to an obstruction will not accommodate safe use of a ladder for access, bucket truck access is required.

Commercial – Industrial Buildings or Structures

1. The point of service drop attachment on a commercial or industrial building shall normally be located on the wall facing and nearest the Utility's pole line, and so located that the service head, service drop and the open wires between the service head and point of connection to the service drop will have not less than 16' of clearance above finished grade, and whenever necessary be located at a greater height to obtain required clearances. The 16' clearance may be reduced for insulated services (SSC) to not less than 10' in areas accessible to pedestrians only. (See page SG 107.10.)
2. Where the service drop will pass over only the premises served, the point of service drop attachment may be on any wall of the building facing and parallel to the Utility's pole line. (See page SG 103.5, Figure 2.)
3. Where the building wall facing and nearest the Utility's pole line is on a shed or similar building projection, which wall does not afford sufficient service drop clearance without the installation of a service drop support riser or structure, and there is another wall of adequate height facing the Utility's pole line, the point of service drop attachment may be located on such wall, provided applicable clearances can be obtained. (See page SG 103.5, Figure 3.) This option does not apply to a building of normal height or construction having a higher section set back from the wall facing and nearest the Utility's pole line, such as a hip roof. When service drop clearances cannot be met, a service drop support riser or structure shall be provided on the wall facing and nearest the Utility's pole line to obtain required clearances. (See page SG 103.5, Figure 4.)

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

**SHEET
4 OF 5**

SDG&E SERVICE STANDARDS & GUIDE

SERVICE DROPS – OVERHEAD ELECTRIC

SG 103.4

COMMERCIAL & INDUSTRIAL BUILDINGS OR STRUCTURES

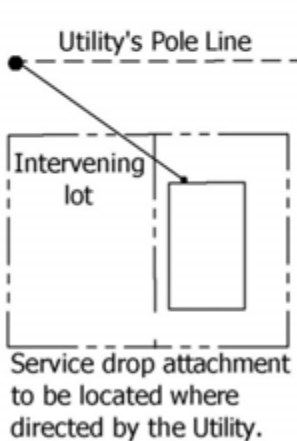
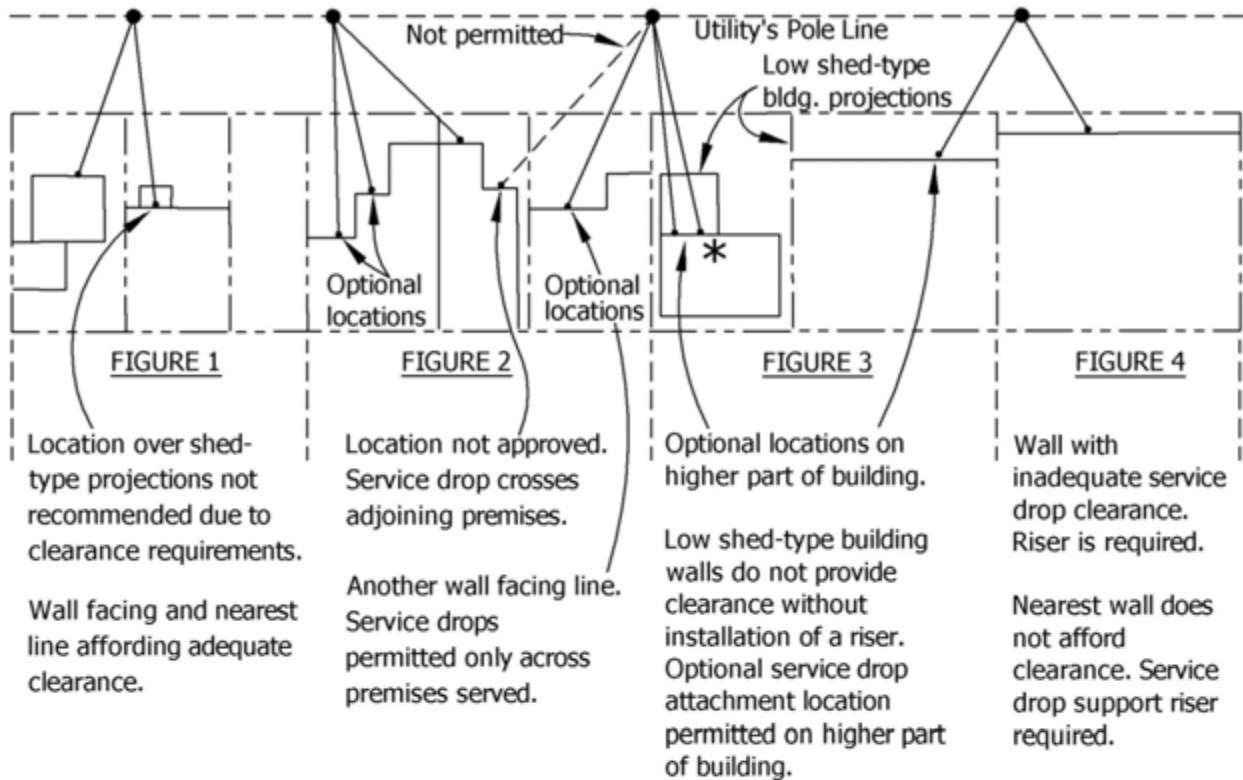


FIGURE 5
Service drop over intervening lot not permitted.

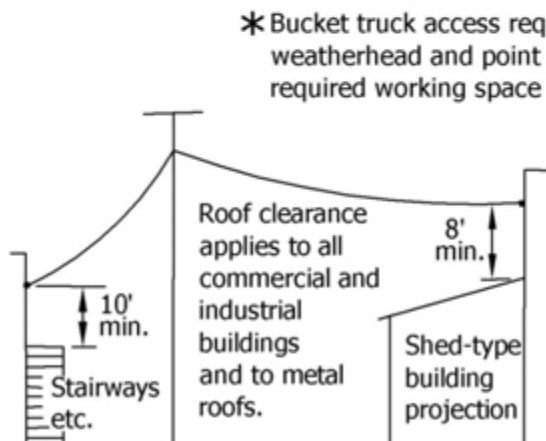


FIGURE 6
Service drop clearance over stairways and shed-type building projections.

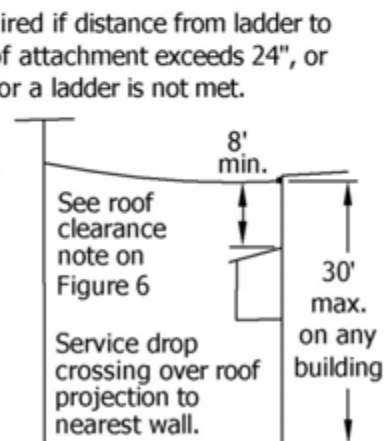


FIGURE 7
Maximum height service drop attachment.

* Bucket truck access required if distance from ladder to weatherhead and point of attachment exceeds 24", or required working space for a ladder is not met.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
5 OF 5

SDG&E SERVICE STANDARDS & GUIDE

SERVICE DROPS – OVERHEAD ELECTRIC

SG 103.5

GENERAL INFORMATION

1. A service drop will be attached at only one point of support on a building. At this point of support, the building shall have adequate strength to safely withstand the stress of the service drop conductors.
2. Where, in the opinion of SDG&E (Utility), a building does not afford sufficient strength to safely support service drop conductors, an underground service or a customer-owned service and meter pole should be installed.
3. Where the size of service entrance conductors indicates unusually heavy service drop conductors will be required, contact the Utility's nearest Project Management Regional Office. (See listing on page SG 2.)

WOOD BUILDINGS

The Utility will furnish, at the contractor's request, a service bracket or insulators to support service drop conductors on a wood frame or stucco building, provided the wood building members have not less than a 2" nominal thickness and are properly located with respect to a point of service drop attachment acceptable to the Utility. The following wood structural members are approved for supporting service drop conductors:

1. An un-enclosed, non-metallic roof overhang, eave or rafter end projecting outside an exterior wall.
2. A fascia, bargeboard, or an un-enclosed eave projecting outside an exterior wall.

WOOD REINFORCING BLOCK

1. Where the wood roof or eave overhang members at the point of service drop support have less than a 2" nominal thickness, or are otherwise considered to be inadequate to withstand the pull of the service drop conductors, a 2" x 4" minimum wood reinforcing block of sufficient length shall be lagged or bolted to the roof rafters to provide a safe anchorage for installation of service insulators by the Utility.
2. Service insulators or wood reinforcing blocks for the support of service insulators shall not be installed in any roof section inside the outer face of an exterior wall or roof surface of an enclosed cornice or within a soffit. (See Figure 7 on page SG 104.4.)

BUILDINGS OTHER THAN WOOD

The contractor shall install bolts, service insulators or other suitable means of service drop conductor support on buildings constructed of tile, brick, concrete, adobe, stone, metal or similar material. The Utility will furnish, at the contractor's request, bolts or insulators necessary to support the service drop conductors.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 5

SDG&E SERVICE STANDARDS & GUIDE

SERVICE DROP SUPPORTS

SG 104.1


CLEARANCE RISERS OR STRUCTURES

Where a service drop riser or structure is necessary on a building to obtain service drop clearance, a galvanized rigid conduit riser, intermediate metallic conduit, or un-spliced timber shall be securely lagged or bolted to the building to support service insulators furnished and installed by the Utility. Galvanized conduit risers are preferred. (See pages SG 105.1 – 106.3.)

MAINTENANCE RESPONSIBILITY & LIABILITY

1. Any service drop clearance riser or structure installed shall be properly maintained at the expense of the property owner or customer.
2. The Utility will not assume liability for any damage caused by:
 - a. Roof leakage around a riser or any other type of service drop support.
 - b. Mechanical failure of a riser or any other type of service drop support.
 - c. Failure of any part of the building at the point where a riser or any other types of service drop support is attached.

SERVICE DROP ATTACHMENT RISER – ANGLE IRON RACK

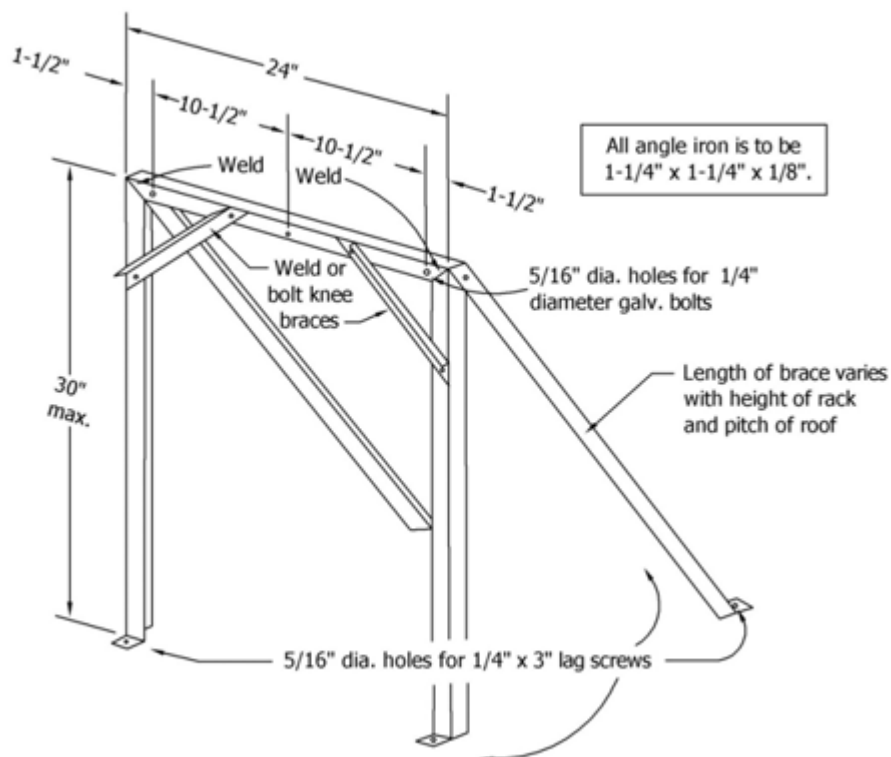

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 5

SDG&E SERVICE STANDARDS & GUIDE

SERVICE DROP SUPPORTS

SG 104.2

Notes:

1. Angle iron rack for attachment of Utility service drop provided and installed by customer.
2. Steel clearance structures shall be hot-dipped galvanized after fabrication.

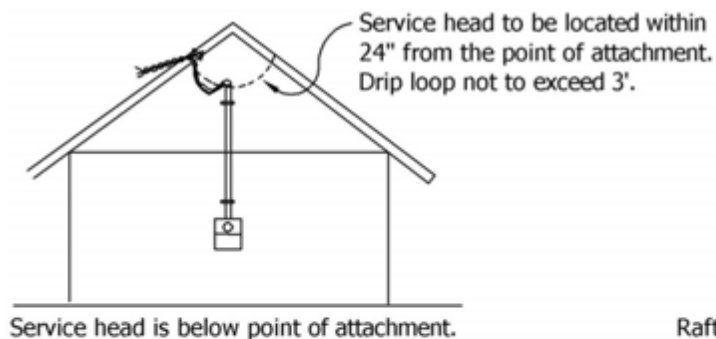


FIGURE 1
Typical Installation

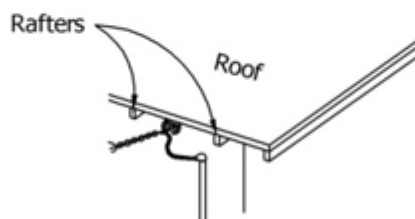


FIGURE 2
Rafter Ends

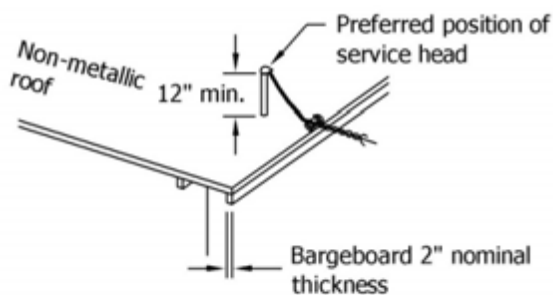


FIGURE 3
Un-enclosed Eave or Roof Overhang

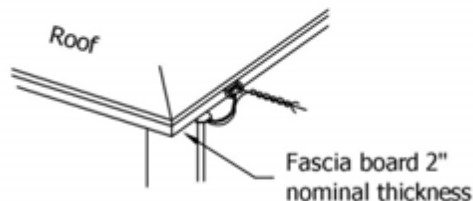


FIGURE 4
Fascia Board-Enclosed or Un-enclosed Eaves

See Installation Notes to Figures 1 – 7 on page SG 104.5.

Reference OH 241.3.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
3 OF 5

SDG&E SERVICE STANDARDS & GUIDE

SERVICE DROP SUPPORTS

SG 104.3

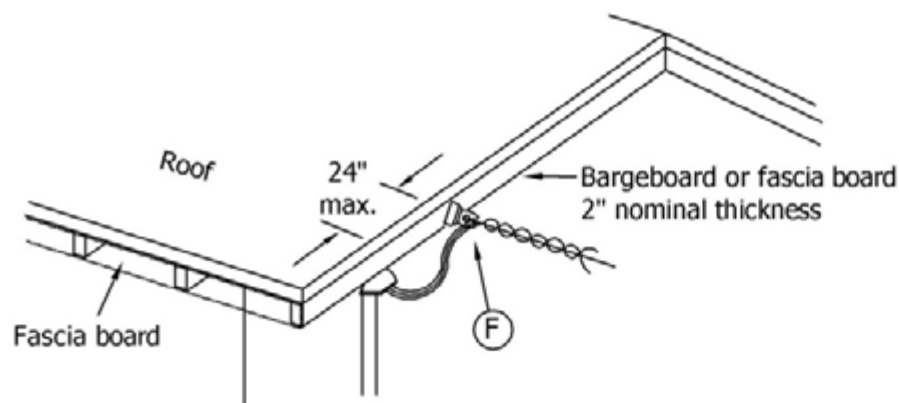


FIGURE 5
Bargeboard

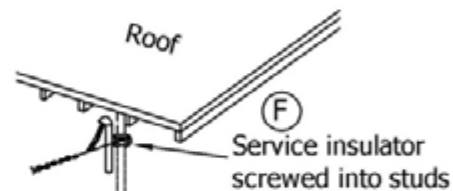


FIGURE 6
Concealed Studs or Timbers

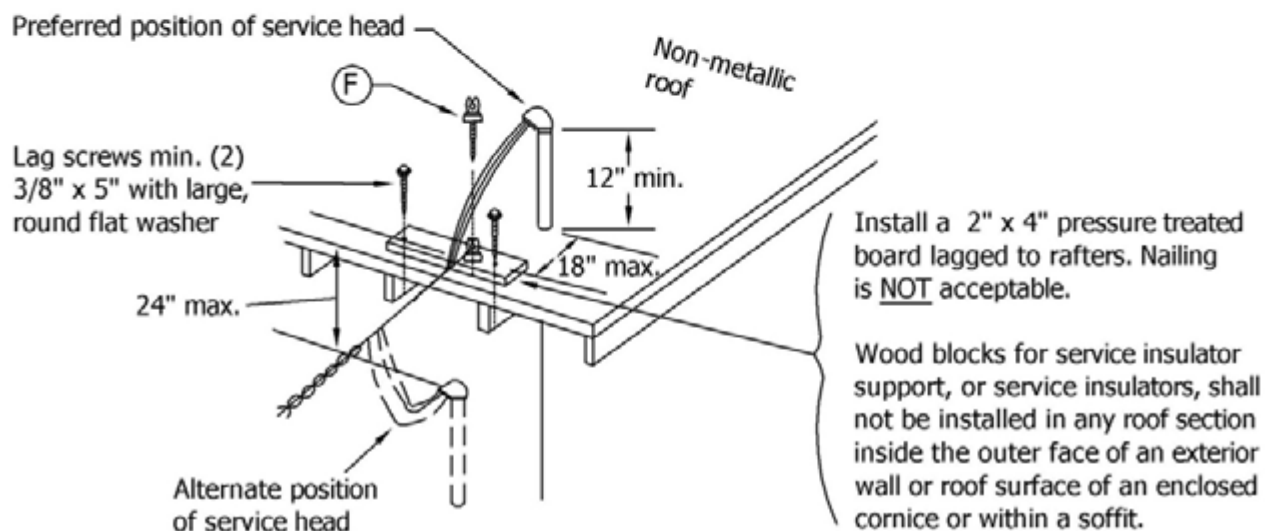


FIGURE 7
Wood Reinforcing Block

See Installation Notes to Figures 1 – 7 on page SG 104.5.

Reference OH 241.3.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
4 OF 5

SDG&E SERVICE STANDARDS & GUIDE

SERVICE DROP SUPPORTS

SG 104.4

Installation Notes:

- A. Service drop attachment should normally be located on the wall facing and nearest the Utility's pole line.
- B. See pages SG 105.1 – 106.3 for methods of attaching service drops to galvanized conduit and solid wood service drop support risers.
- C. It is recommended that service heads be installed 1' above the point of service drop attachment to prevent siphoning of moisture into the service conduit. Where service heads are installed below the point of service drop attachment, drip loops shall be formed in open service entrance conductors. To prevent water from siphoning into the service raceway and equipment, an inverted "V" notch should be cut through the insulation to the current-carrying strand(s) at the lowest point on the bottom side of each service entrance drip loop.
- D. Wood blocks for service insulator support or service insulators shall not be installed in any roof section inside the outer face of an exterior wall or roof surface of an enclosed cornice or within a soffit.
- E. See pages SG 107.1 – 107.11 for service drop clearances.
- F Insulators will be provided by the Utility and installed by the contractor or customer.
- G. Communications drops, attachment supports and antennae are to have a minimum 12" radial clearance from the SDG&E service drop and service drop support.

Reference OH 241.3.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed


SHEET
5 OF 5

SDG&E SERVICE STANDARDS & GUIDE


SERVICE DROP SUPPORTS

SG 104.5


**GALVANIZED RIGID CONDUIT RISER OR INTERMEDIATE METALLIC CONDUIT
FOR OVERHEAD SERVICE ATTACHMENT**

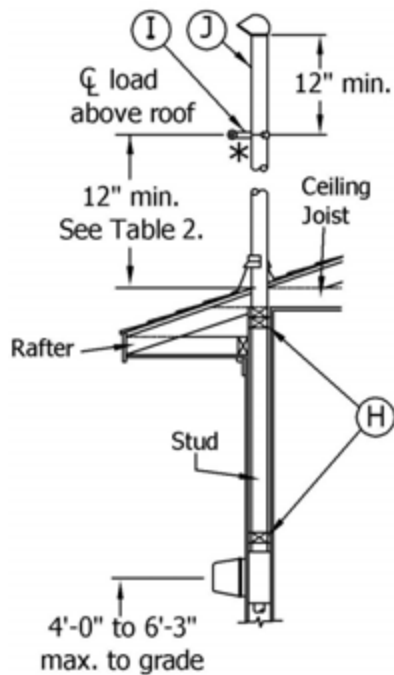

ENCLOSED

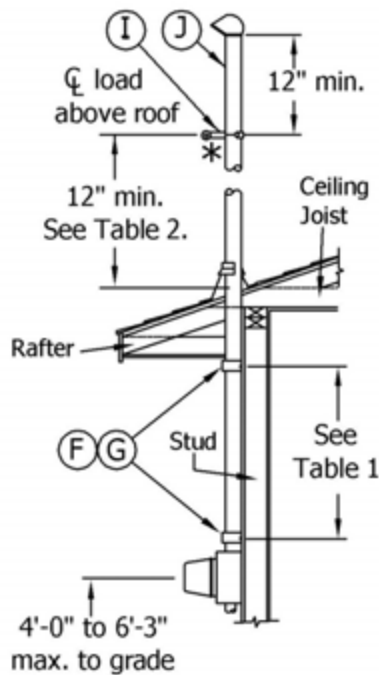

EXTERIOR 1

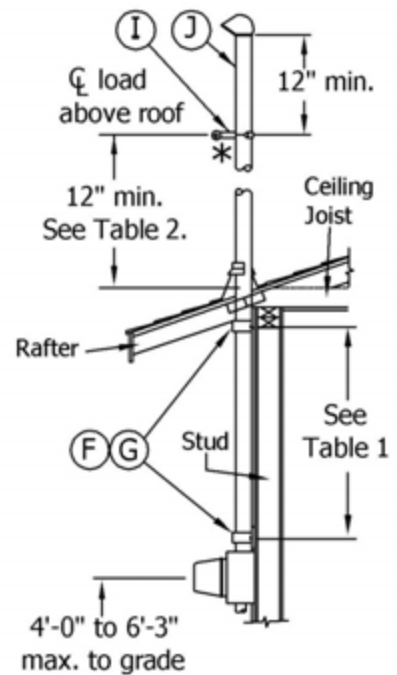

EXTERIOR 2

*Bucket truck access required if distance from ladder to weatherhead and point of attachment exceeds 24".

Table 1		Table 2	
Minimum Support Distance Measured from Centerline of Heavy Duty Pipe Straps		Maximum Distance of Centerline of Load Above Roof	
Conduit Size	Distance	Conduit Size	Distance
1-1/4"	12"	1-1/4"	30"
1-1/2"	15"	1-1/2"	40"
2"	22"	2"	5'
2-1/2"	30"	2-1/2"	8'

Reference OH 641.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 2

SDG&E SERVICE STANDARDS & GUIDE
**OVERHEAD SERVICE ATTACHMENT
FOR METALLIC CONDUIT RISERS**

SG 105.1

Installation Notes:

- A. SDG&E (Utility) will not be responsible for any damage to the building caused by rain or structural failure.
- B. These methods are suggested to obtain the required ground and roof clearances as required by the governmental Authorities Having Jurisdiction (AHJ). When this method is used, it will be acceptable to the Utility provided the dimensions and construction details are in compliance with this standard.
- C. See page SG 507.2 where residential meter installation is to be recessed, pages SG 508.1 – 508.2 where single residential meter installation is to be enclosed in a meter cabinet, pages SG 509.1 – 509.4 where multi-meter commercial or residential are to be enclosed in a cabinet, or pages SG 506.1 – 506.4 when located in a meter room.
- D. No couplings will be permitted between, or above, the top two pipe strap supports for conduit sizes 1-1/4" to 2" inclusive. If a coupling is necessary in the 2-1/2" size conduit to obtain the maximum point of attachment of 8' feet above the top support or roofline, the coupling shall be installed at the upper end near the weatherhead.
- E. Service drop attachment shall normally be located on the wall facing and nearest SDG&E's pole line. See page SG 103.2 – 103.3, 2.a. and 2.b. for exceptions to obtain service drop clearances on residential buildings or structures.
- F Heavy duty two-hole pipe straps. Upper strap must be directly below soffit (see page SG 105.1, Exterior 1), or screwed with 3/8" x 3" lag screws into plate (see page SG 105.1, Exterior 2). 1/4" toggle bolts may be used in lieu of lag screws. Zamac nail heads 1/4" x 1.875" (mushroom) may be used in place of lag screws when attaching to cinder block or concrete walls.
- G Heavy duty one-hole pipe straps are acceptable if used with 3/8" x 3" lag crew (min. size) into wall stud or plate. Zamac nail heads 1/4" x 1.875" (mushroom) may be used in place of lag screws when attaching to cinder block or concrete walls.
- H Enclosed risers must be securely supported at the plate and immediately above the meter socket enclosure.
- I The Utility will provide the clamp and insulator for attachment of the service drop to the customer's riser.
- J Only the Utility's service drop conductors shall be permitted to be attached to the service riser. This is a Utility and California Electrical Code requirement.

Reference OH 641.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



X	Indicates Latest Revision	Completely Revised	New Page	Information Removed
----------	---------------------------	--------------------	----------	---------------------

SHEET
2 OF 2

SDG&E SERVICE STANDARDS & GUIDE

**OVERHEAD SERVICE ATTACHMENT
FOR METALLIC CONDUIT RISERS**

SG 105.2

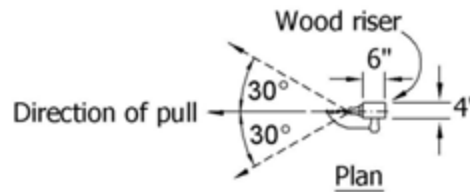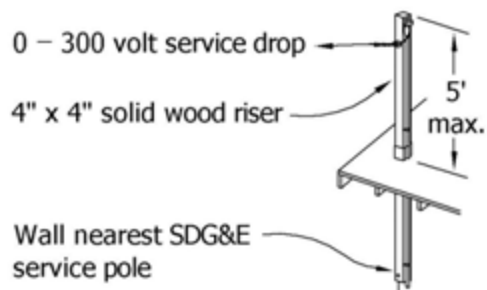

Service drop attachment shall normally be located on the wall facing and nearest SDG&E's pole line.

FIGURE 1

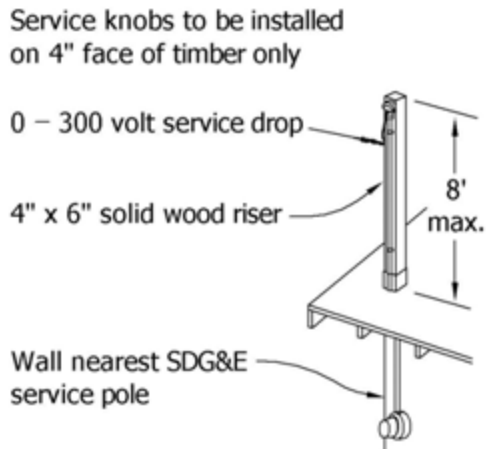


FIGURE 2

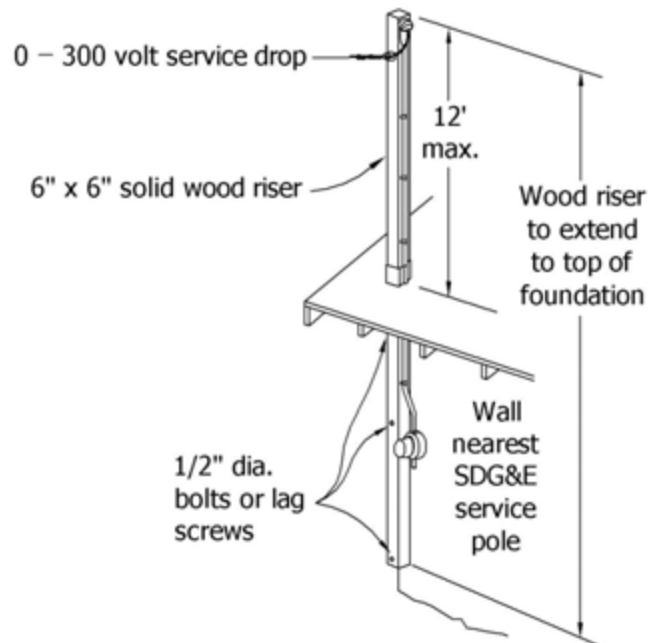


FIGURE 3

See Installation Notes on page SG 106.3.

Reference OH 643.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
1 OF 3

SDG&E SERVICE STANDARDS & GUIDE

**OVERHEAD SERVICE ATTACHMENT
FOR SOLID WOOD RISERS**

SG 106.1

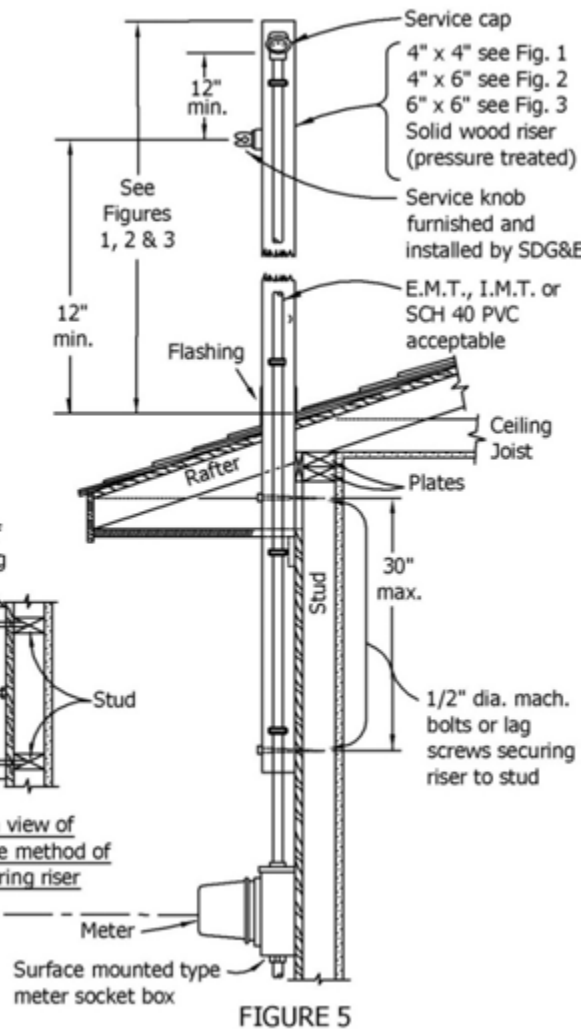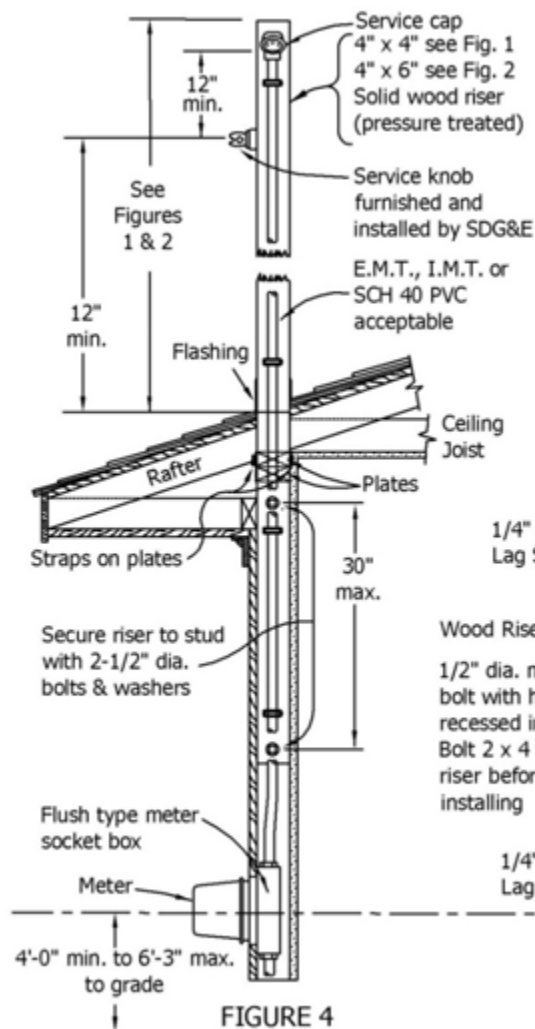

Reference OH 643.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 3

SDG&E SERVICE STANDARDS & GUIDE

**OVERHEAD SERVICE ATTACHMENT
FOR SOLID WOOD RISERS**

SG 106.2

Installation Notes:

- A. SDG&E (Utility) will not be responsible for any damage to the building caused by rain or structural failure.
- B. For service drop clearances refer to pages SG 107.1 – 107.11.
- C. Service drop attachment shall normally be located on the wall facing and nearest the Utility's pole line. See page SG 103.2, 2.a. and 2.b., under Residential Buildings or Structures, for exceptions to obtain service drop clearances on residential buildings or structures.
- D. Wood risers shall not be spliced or of laminated construction, 2 x 4's, 2 x 6's, etc. Nailed or bolted together risers are not acceptable.
- E. Bucket truck access is required if the distance from ladder to weatherhead and point of attachment exceeds 24".
- F. Only the Utility's service drop conductors shall be permitted to be attached to the solid wood riser structure. This is a Utility and California Electrical Code requirement.

Reference OH 643.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X	Indicates Latest Revision	Completely Revised	New Page	Information Removed
----------	---------------------------	--------------------	----------	---------------------

SHEET
3 OF 3

SDG&E SERVICE STANDARDS & GUIDE

**OVERHEAD SERVICE ATTACHMENT
FOR SOLID WOOD RISERS**

SG 106.3

GENERAL INFORMATION

1. The vertical, horizontal and radial service drop conductor (including the drip loop) clearances tabulated and illustrated throughout this manual are minimum requirements of State, County or municipal codes, laws and ordinances. Deviation from these minimum clearance requirements cannot be granted by SDG&E (Utility). The Utility primarily uses insulated abrasion-resistant Self-Supporting Cable (SSC) for service drop conductors. However, the Utility used to install open-wire weatherproof (WP) uninsulated service drop conductors. The older WP service drops still exist, though they are not common. The use of open-wire service drop conductors in commercial/industrial applications may occur today when the estimated load requires a higher ampacity rating for the service drop conductors that are only available in open-wire conductor sizes. The abbreviations SSC and WP are commonly used throughout this section.
2. Weather and time adversely affect service drop conductors and the service support, resulting in ultimate service drop conductor sag greater than the initial sag obtained at the time of installation. Accordingly, when selecting a point of attachment method provide a height that will permit the service drop conductors to be maintained in compliance with applicable clearance requirements for the ultimate sag.
3. A service drop support riser or rack shall not be located more than 18" back from the front face of the building wall facing the Utility's pole line, except as permitted for residential buildings.
4. Service support insulators or bracket shall not be installed on the top of any cornice, appendage, eave, roof or parapet wall of a building, except as allowed on pages SG 104.3 – 104.5.
5. Where non-insulated (WP) open wire service drop conductors approach a building wall at any angle of less than 60 degrees, the spacing of the insulators in horizontal configuration at the point of attachment shall be increased to provide at least 8" conductor separation. Vertical configuration is preferable where the angle between the service drop and the wall is less than 60 degrees, and is acceptable for any angle.
6. Service drops should be arranged so as not to hinder or endanger workers and firefighters while performing their duties.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 11

SDG&E SERVICE STANDARDS & GUIDE

SERVICE DROP CONDUCTOR CLEARANCES 0 – 600 VOLTS

SG 107.1

CLEARANCES ABOVE GROUND, THOROUGHFARES, DRIVEWAYS & PUBLIC/PRIVATE PROPERTY

Vertical clearances above ground for service drop conductors crossing over public or private thoroughfares, driveways and properties shall be not less than those specified by CPUC General Order 95 as shown below. See illustrations on pages SG 107.9 and SG 107.10. The governmental Authority Having Jurisdiction (AHJ) may in some instances require greater clearances than those shown.

<u>Condition</u>	<u>Minimum Vertical Clearance in Feet</u>
Crossing railroad tracks	25
Crossing public thoroughfares.....	18
(Public or privately owned roadways maintained by a public agency, i.e. County Service Area)	
Exception: This clearance may be reduced from 18' at a position not more than 12' horizontally from the curb line to a clearance at the curb line of not less than	16
(Where no curb exists, the outer limits of possible vehicular movement shall be used in lieu of a curb line.)	
Crossing private driveways, lanes, or other private property areas accessible to vehicles on commercial or industrial premises	16
(Includes privately-owned roadways not maintained by a public agency)	
Crossing premises accessible to agricultural equipment	15
Crossing private driveways, lanes, or other areas accessible to vehicles on residential premises.....	12
Exception: This clearance may be reduced for insulated services (SSC) to not less than	10
Crossing areas on residential, commercial or industrial premises that are accessible only to pedestrians	12
Exception: This clearance may be reduced for insulated services (SSC) to not less than	10
Crossing over or in proximity to swimming pools and/or related diving boards, diving platforms, slides, etc.	See pages SG 108.1 – 108.2

Reference OH 224.1 – 224.2 and 225.1.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 11	X Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 107.2
	SDG&E SERVICE STANDARDS & GUIDE				
	SERVICE DROP CONDUCTOR CLEARANCES 0 – 600 VOLTS				

CLEARANCES OVER BUILDINGS & STRUCTURES

1. 0 – 600 volt service drop conductors shall be maintained at a vertical clearance of not less than 8' if WP, or 2' if SSC, above any portion of a metallic or non-metallic residential, commercial or industrial building or structure, including any other building or structure on the premises except that 0 – 300 volt service drop conductors may be reduced in accordance with the following:

- a. Exception for WP Reduced Clearance Above Residential Building Served

0 – 300 volt WP service drop conductors may be less than 8', but shall be maintained at a clearance of not less than 12" above a metallic or non-metallic residential roof or eave of the building served, provided:

- i. The service drop conductors are supported on a riser or rack located not more than 18" back from the wall facing the Utility's pole line, and
- ii. The point of service support is located not more than 4' back from the outer edge of the roof eaves extending beyond the wall facing the Utility's pole line.

See illustration of reduced clearances in Figure 2 below and refer to the G.O. 95 Table 10 on page SG 107.7 for reduced clearances.

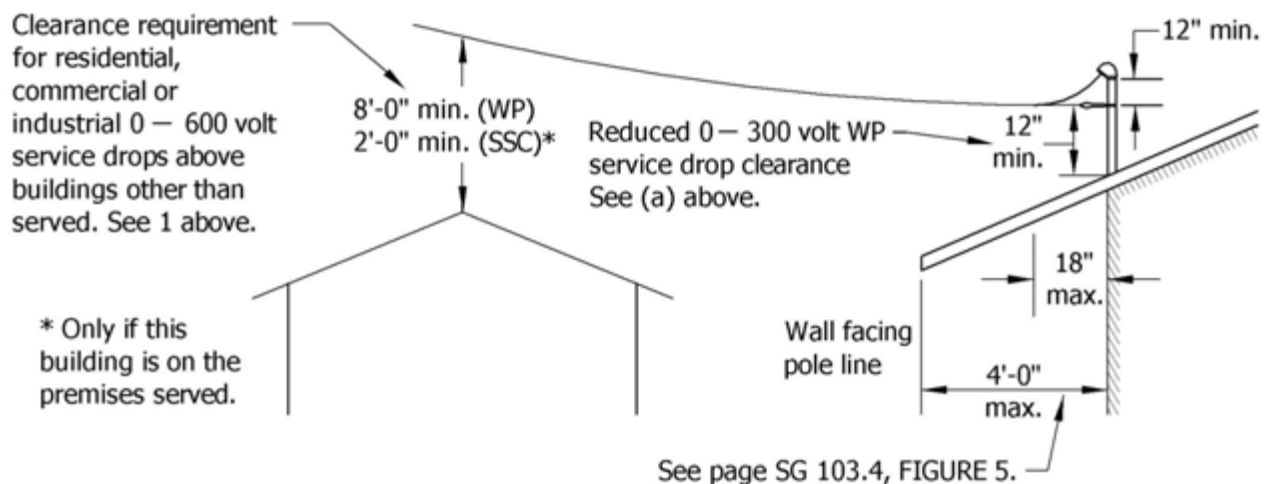


FIGURE 1

Clearance above residential, commercial, or industrial buildings on premises served other than the building served.

FIGURE 2

Reduced 0 – 300 volt WP service drop clearance above a residential roof or eave on the building served.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
3 OF 11

SDG&E SERVICE STANDARDS & GUIDE

**SERVICE DROP CONDUCTOR CLEARANCES
0 – 600 VOLTS**

SG 107.3

b. Exception for Reduced Clearance Above Commercial & Industrial Buildings

Service drop conductors may be less than 8', but not less than 1' above a metallic or non-metallic roof, eave, parapet wall, cornice, or decorative appendage of the building served provided:

- Any cornice or decorative appendage does not extend more than 1' from the front face of the building wall facing the Utility's pole line, and
- The point of attachment of the service drop is not more than 18" back from the front face of the building wall facing the Utility's pole line, and
- The service drop conductors are insulated (SSC) for the voltage being supplied.

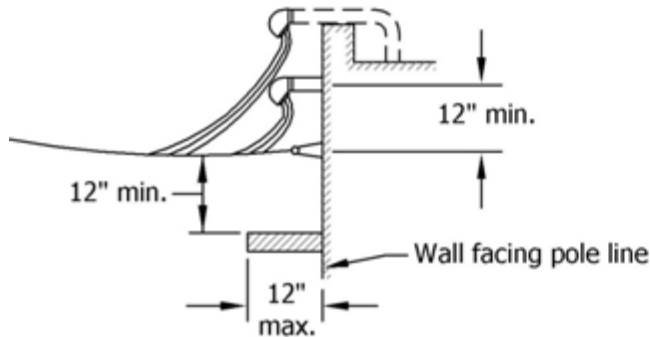


FIGURE 1

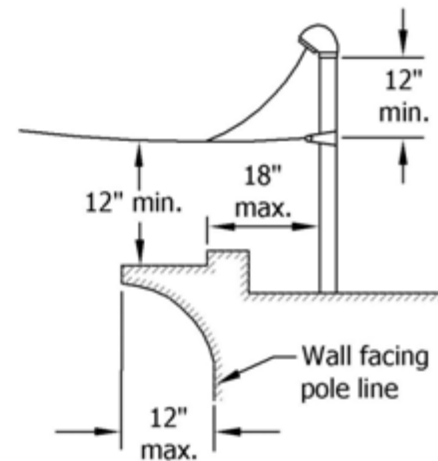


FIGURE 2

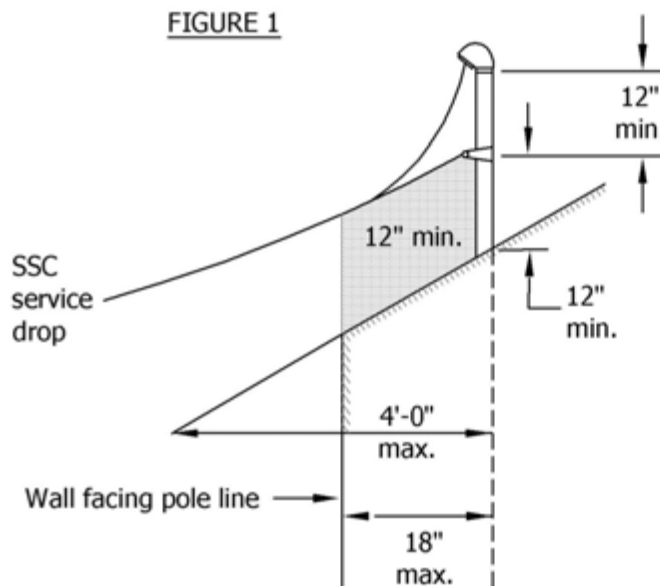


FIGURE 3

No supply service wires permitted within shaded zone

Reference OH 241.2.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
4 OF 11

SDG&E SERVICE STANDARDS & GUIDE

SERVICE DROP CONDUCTOR CLEARANCES
0 – 600 VOLTS

SG 107.4


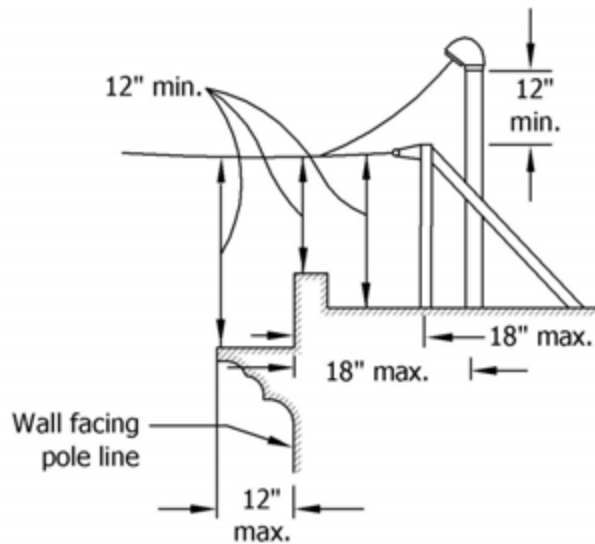


FIGURE 4

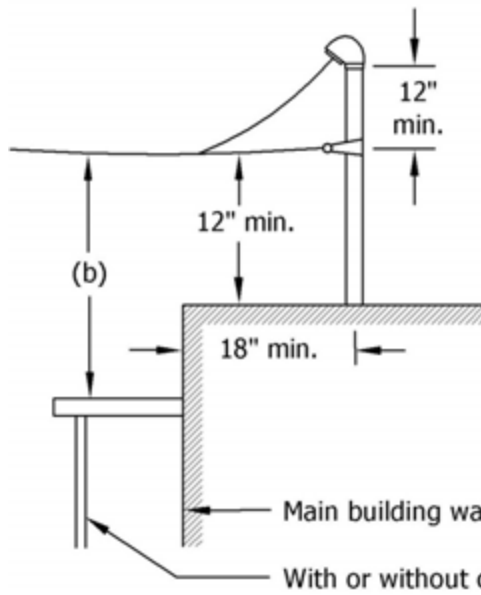

(b) A walkable marquee, building projection, canopy, roof section, or eaves extended from a building wall to form a shelter over a walkway, driveway, passenger loading area, etc., outside the building fire wall requires 8' minimum clearance. If non-walkable, may reduce to 2' provided the service drop is insulated (SSC).

FIGURE 5

Note to Figures 1 – 5:

Bucket truck access is required if the distance from a ladder to the weatherhead and point of attachment exceeds 24".

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
5 OF 11

SDG&E SERVICE STANDARDS & GUIDE

SERVICE DROP CONDUCTOR CLEARANCES
0 – 600 VOLTS

SG 107.5

CLEARANCES FROM OTHER CONDUCTORS

The vertical clearance of service drop conductors from other conductors at crossings and radially where approaching crossings shall not be less than the minimum clearances specified:

<u>Condition</u>	<u>Minimum Vertical Clearance in Feet</u>
Below telephone cable supported on a messenger	4
Below open-wire telephone and fire alarm	2
Above telephone cable, open-wire telephone and fire alarm conductors	2
Radial from telephone service drops.....	2
Except where within 15' of the point of attachment on a building this clearance may be reduced to...	1
From other electric service drops	2

CLEARANCES FROM SIGNS

The vertical and horizontal service drop conductor clearance from signs, whether mounted on a building, isolated structures, or otherwise constructed, shall not be less than the minimum clearances specified:

<u>Condition</u>	<u>Minimum Clearance in Feet</u>
Vertical clearance above signs upon which a person can walk.....	8
Vertical clearance above signs upon which a person cannot walk	2
Vertical clearance under signs which are illuminated	2
Vertical clearance under signs which are non-illuminated.....	1
Horizontal clearance from signs which are illuminated	3
Horizontal clearance from signs which are non-illuminated	1

Note: These clearances do not apply to service drop conductors which are attached to signs for the purpose of serving such sign. Reference SDG&E Overhead Standard 230.1 – 230.2 for minimum clearances of wires (0 – 750 volt service drops and 750 – 300,000 volt supply conductors and cables) to illuminated and non-illuminated signs.

All clearances of more than 6" shall be applicable from the centerline of the conductors concerned. Lesser clearances shall be applicable from the conductor surface.

Reference OH 225.1 for radial clearances from other conductors.

Reference OH 230.1 – 230.2 for clearance from signs.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------

SHEET
6 OF 11

SDG&E SERVICE STANDARDS & GUIDE


SERVICE DROP CONDUCTOR CLEARANCES 0 – 600 VOLTS

SG 107.6

CLEARANCES FROM BUILDINGS & STRUCTURES, RESIDENTIAL, COMMERCIAL/INDUSTRIAL PREMISES

G.O. 95 Table 10: Minimum Allowable Clearance of Service Drops of 0 – 750 Volts from Buildings		
	Minimum Clearance from Buildings	
	Weather Resistant Covered Conductors 0 – 750 volts	Insulated Conductors (Rule 20.8–G) 0 – 750 volts
Vertical Clearance Above:		
1) All portions of buildings including metallic or non-metallic cornice, decorative appendage, eaves, roof or parapet wall of the building served.	8 feet	(a)(b)
2) Metallic or non-metallic non-walkable overhang, patio cover, or other structure.	8 feet	(a)(b)
3) Other buildings on the same premises.	8 feet	2 feet ①
4) Buildings on other premises.	8 feet	8 feet (c)②
Horizontal & Radial Clearances:		
1) From fire escapes, exits, windows and doors.	3 feet	3 feet

- (a) No limit specified but the greatest practicable clearance should be obtained. (Note: SDG&E minimum requirement is 1'.)
- (b) The point of attachment of the service drop for industrial and commercial premises is not to be more than 18 inches back of the front face of the building wall facing the pole line from which the service drop originates.
- (c) Reduce to 2 feet for non-metallic roofs, more than 3/8 pitch (approximately 37 degrees from horizontal, see sketch)

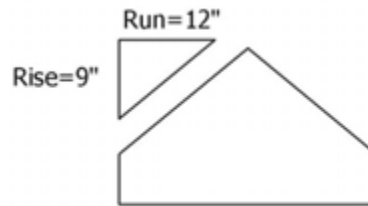

Notes:

- ① The AHJ may enforce the more restrictive California Electrical Code requirement of 8' minimum clearance, or 3' minimum clearance when the voltage between conductors does not exceed 300 volts and the roof has a slope of not less than 4" in 12". It is the customer's responsibility to verify the local AHJ's requirements before start of construction.
- ② Non-Walkable Definition – Those surfaces not normally intended to support humans, such as but not limited to: handrails, fences, walls, chimneys, parapet walls, cornices, aluminum or lath patio covers and decorative appendages or other light weight material used for patio covers. However, such surfaces, when used for a dual purpose as in the case of a wide surface used as a platform to work on lights, signs, etc., must be considered as a surface that a person might normally walk upon. All clearances of this type must be measured from the walkable surface.

Reference OH 241.2.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.


REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 7 OF 11	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 107.7
	SDG&E SERVICE STANDARDS & GUIDE					
	SERVICE DROP CONDUCTOR CLEARANCES 0 – 600 VOLTS					

**SERVICE DROP CONDUCTOR CLEARANCES, 0 – 600 VOLTS,
FROM DOORS, EXITS, WINDOWS, FIRE ESCAPES, BALCONIES, ETC.**

1. The vertical, horizontal, and radial service drop conductor (including the drip loop) clearances:

<u>Condition</u>	<u>Minimum Clearance in Feet</u>
a. Vertically above walkable surfaces of fire escapes, balconies, stairways, and walkways.....	8
b. Horizontally and radially from fire escapes, exits, openable windows, doors, and other points at which human contact might be expected	3

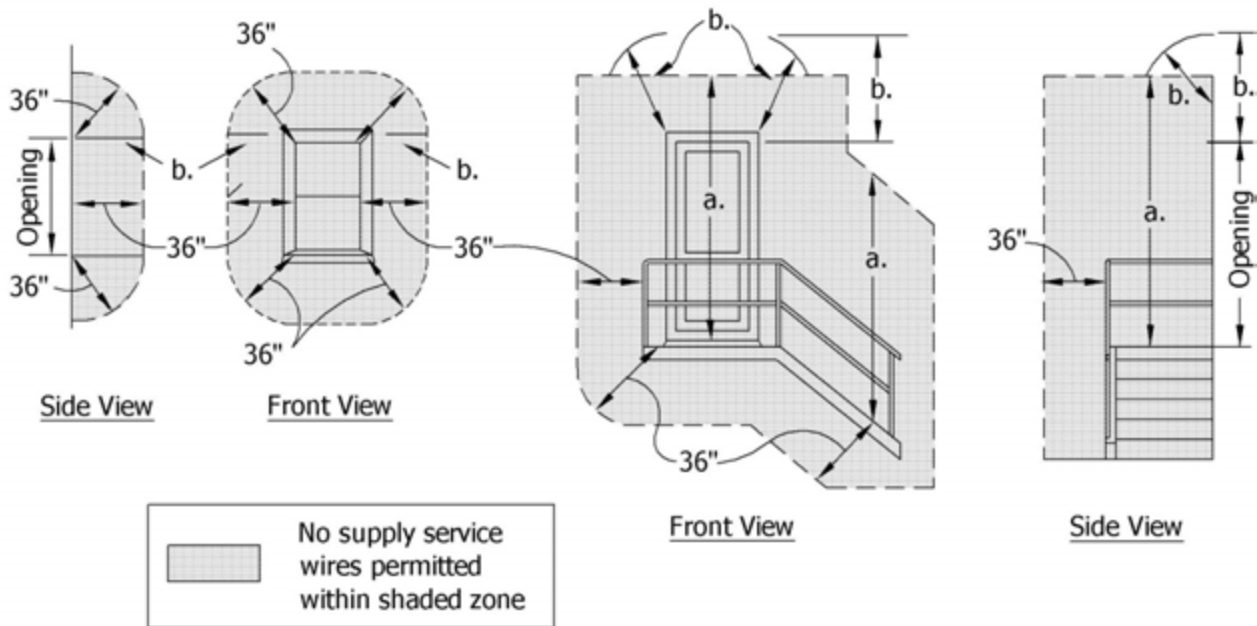

Notes:

- A. Service drop conductors are not permitted within shaded zones.
- B. The porch rail illustrated is not considered a walkable surface. The clearance will be measured from the porch deck.

Reference OH 241.2.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
8 OF 11

SDG&E SERVICE STANDARDS & GUIDE


**SERVICE DROP CONDUCTOR CLEARANCES
0 – 600 VOLTS**

SG 107.8

The following illustrations provide minimum clearances required for service drop conductors over thoroughfares, from buildings, at point of attachment to building, and cross reference pages for Residential, Commercial, or Industrial Premises.

Notes to Figures 1 – 3:

- (A) Clearance Requirements: Non-Walkable Surface – 2', Walkable Surface – 8'. See page SG 107.7, G.O 95 Table 10, for walkable surface clearances and definition of "non-walkable" in Note 2.
- (B) Clearance may be reduced for insulated services (SSC) to not less than 10'. Clearance is measured from the lowest point, which includes the drip loop, to finished grade.
- (C) The point of service drop attachment on any riser shall in no case be more than 18" back of the front face of the wall facing the pole line to which the service drop originates, except as permitted on page SG 103.3, Residential Buildings or Structures, and on page SG 103.5, for Commercial or Industrial Buildings or Structures.

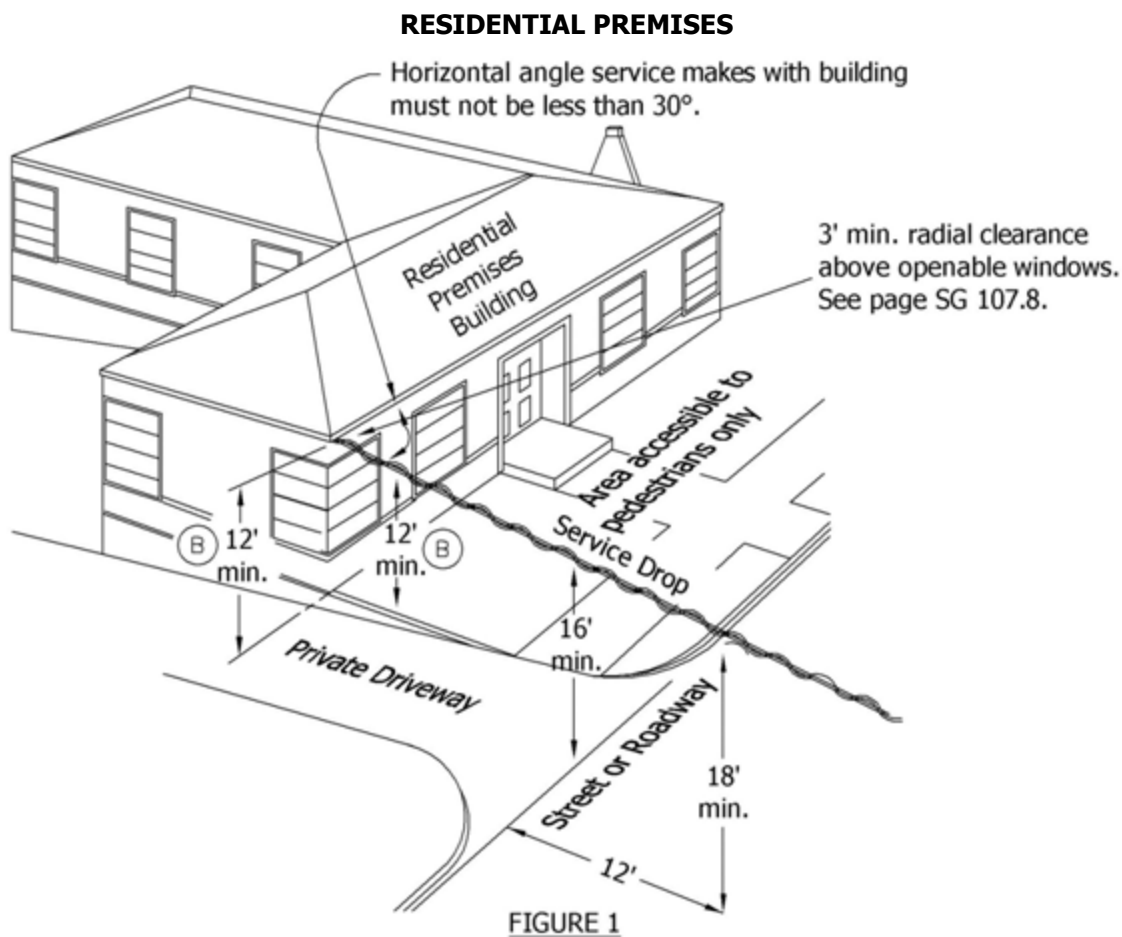

Reference OH 241.1.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
9 OF 11

SDG&E SERVICE STANDARDS & GUIDE

**SERVICE DROP CONDUCTOR CLEARANCES
0 – 600 VOLTS**

SG 107.9

COMMERCIAL OR INDUSTRIAL PREMISES

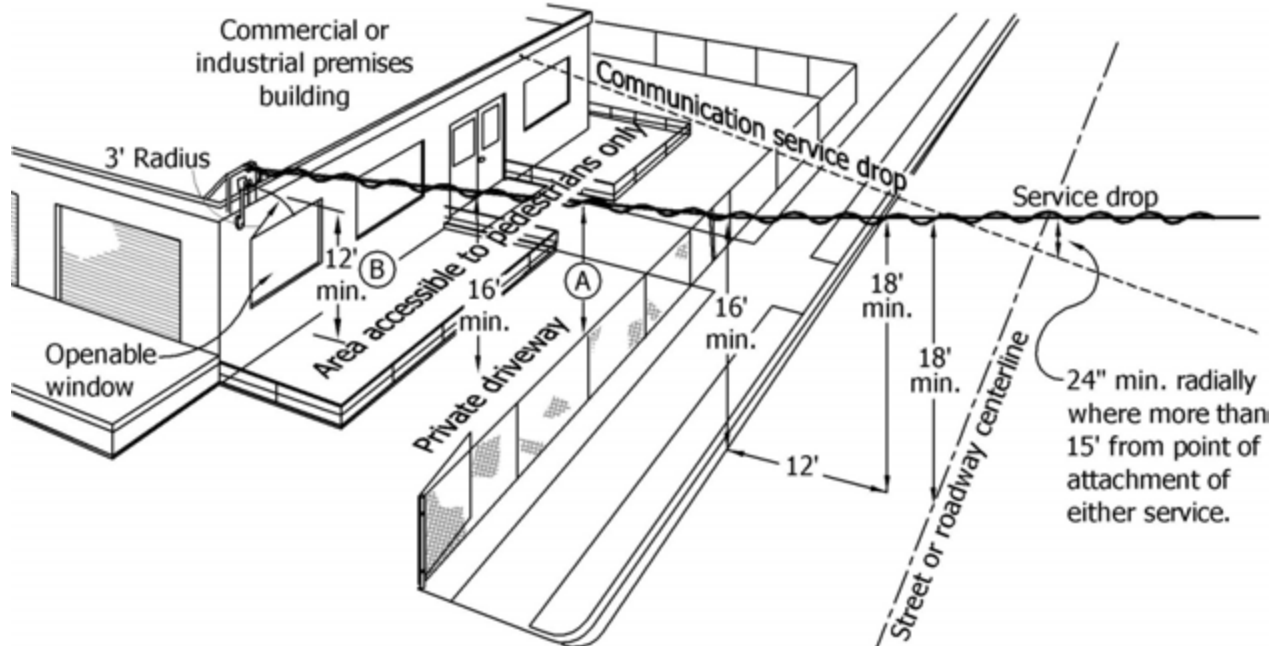


FIGURE 2

Horizontal angle service makes with building must not be less than 30°.

Drip loop not to exceed 3'.

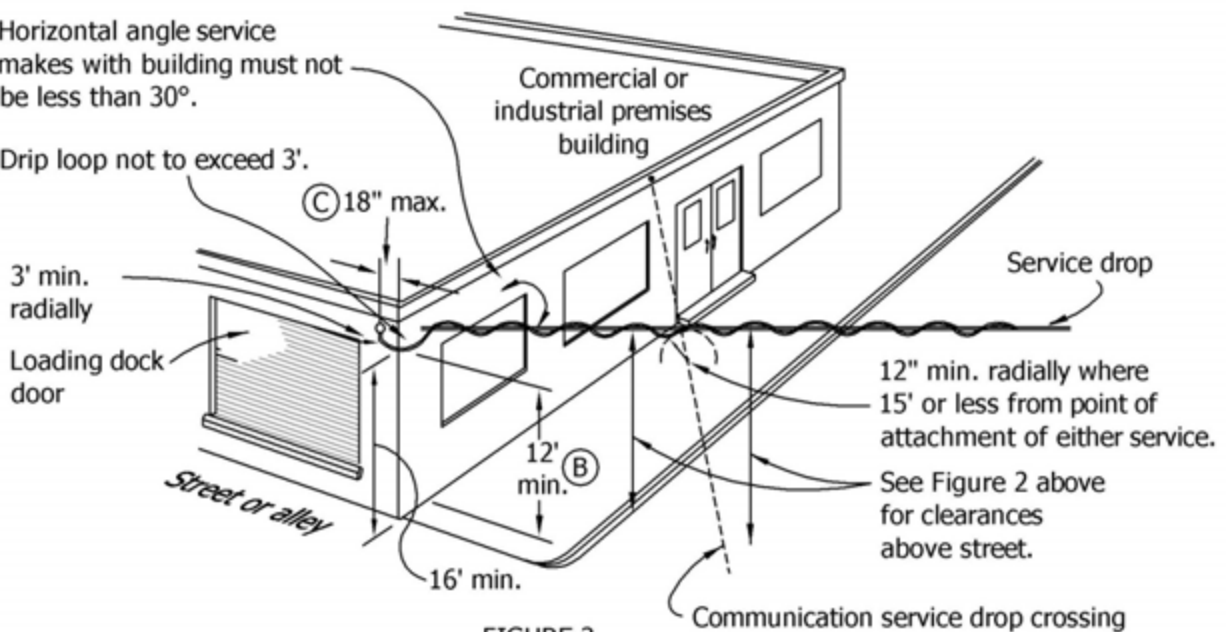


FIGURE 3

Reference OH 241.1.

Refer to Notes on page SG 107.9.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed


SHEET
10 OF 11

SDG&E SERVICE STANDARDS & GUIDE

**SERVICE DROP CONDUCTOR CLEARANCES
0 – 600 VOLTS**

SG 107.10

HORIZONTAL & VERTICAL CLEARANCES OF SUPPLY & SERVICE DROP CONDUCTORS FROM BUILDINGS, BRIDGES & OTHER STRUCTURES

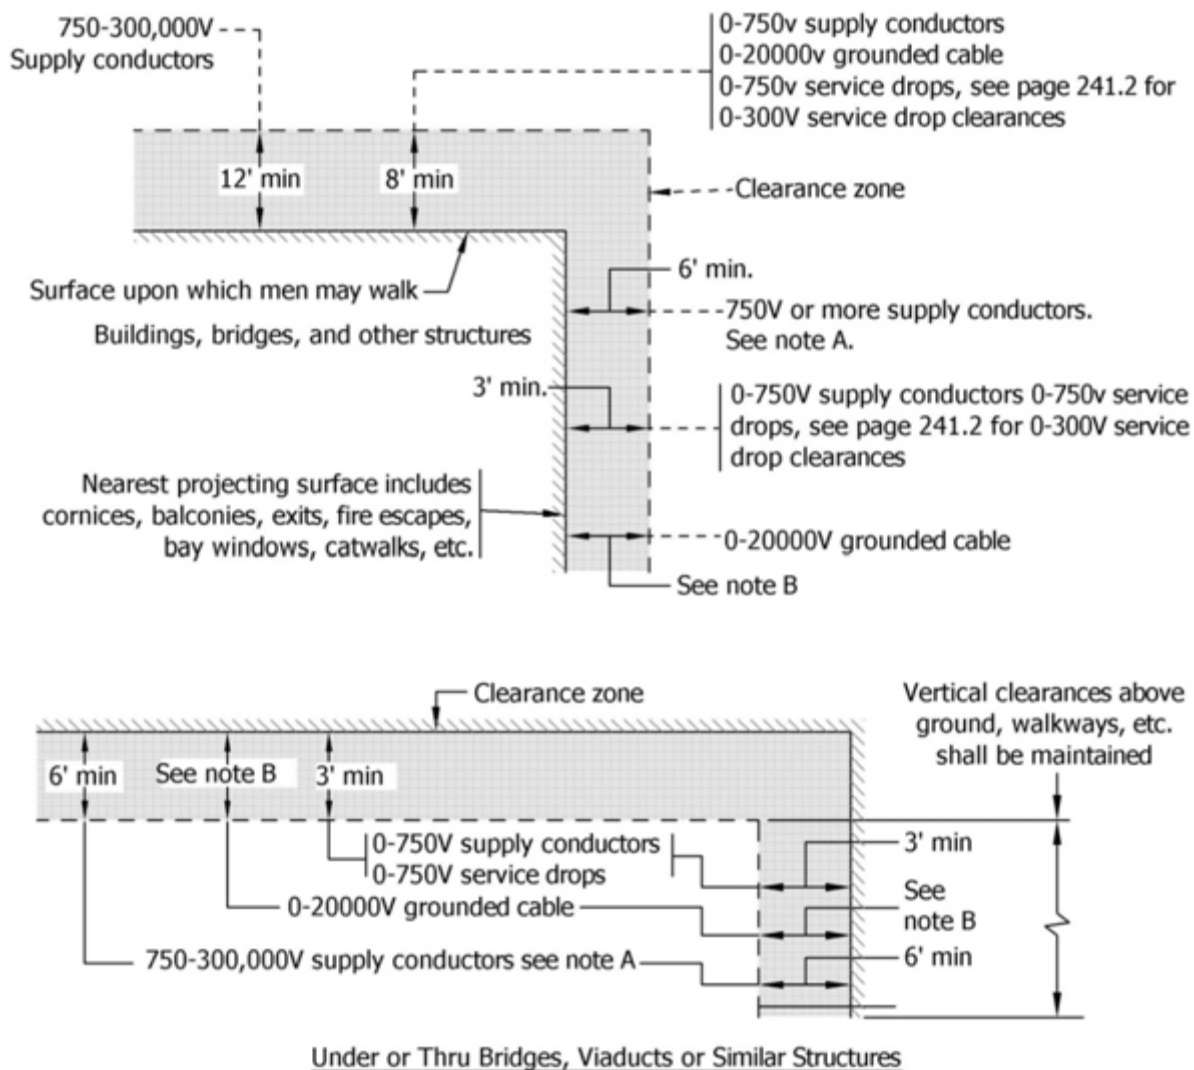

Notes:

- (A) Horizontal clearance of 750 – 7,500 volt conductors from building walls may be reduced to 4' where conductors are in excess of 35' above ground. Reduced clearance does not apply to bridges, fire escapes, windows, balconies, or structures where human contact may be expected.
- (B) No limit required but the greatest practicable clearance should be maintained. Provide mechanical (physical) clearance for cable protection.
- C. See G.O. 95 Rule 54.4I for sign requirements on bridges, viaducts, etc., when attaching conductors 750 – 22,500 volts beneath or through same. Data taken from G.O. 95, Table 1, Case 6 and 7 and Rule 54.4H and I.

Reference OH 229.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
11 OF 11

SDG&E SERVICE STANDARDS & GUIDE

SERVICE DROP CONDUCTOR CLEARANCES
0 – 600 VOLTS

SG 107.11

GENERAL INFORMATION

1. The State of California General Order 95 (G.O. 95) Rule 23.6 defines Swimming Pool as "that portion of any natural or artificially contained body of water which is 24 inches or more in depth at any point below the highest water level, which is intended for use for swimming, bathing or other similar recreational purposes, and which has a surface area exceeding 100 square feet."
2. Contact SDG&E (Utility) to obtain an acceptable point of service drop attachment whenever a swimming pool is proposed to be constructed in an area between the Utility's pole line and the building to be served, or a swimming pool has been constructed creating a G.O. 95 overhead electric clearance infraction.
3. Installation of 0 – 600 volt service drop conductors above a public or private swimming pool and adjacent recreational area shall be avoided. Service conductors shall be routed around these areas at a horizontal clearance sufficient to provide for human safety, and to avoid contamination and nuisance caused by "droppings" from birds resting on conductors. Sufficient horizontal clearance is defined as a clearance dimension as conditions warrant to prevent persons in the pool area from coming into accidental contact with service conductors, or bringing conducting materials into contact with service conductors by use of pool cleaning or maintenance equipment.
4. Swimming pools shall not be placed under existing overhead conductors, including service drops and any other open overhead wiring, unless the Utility determines any necessary easements have been granted to the Utility, and all minimum clearances shown in the table on page SG 108.2 are met.
5. Where it is not practicable to clear a swimming pool and recreational area at a horizontal clearance as specified, service drop conductors shall be maintained at a radial and vertical clearance of not less than shown in the table on page SG 108.2.

PRACTICABLE as defined by the Rules for Overhead Line Construction means capable of being accomplished by reasonably available and economic means.


6. Clearance requirements for spas, hot tubs, etc. may vary according to the governmental Authority Having Jurisdiction (AHJ). Most AHJs require swimming pool clearances be met over all outdoor spas, regardless of size.
7. Underground electric service conduit and gas services are to maintain a minimum 5' separation from the outside wall of swimming pools and spas.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 2	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 108.1
	SDG&E SERVICE STANDARDS & GUIDE					
	OVERHEAD ELECTRIC CLEARANCES OVER SWIMMING POOLS					

Minimum Vertical and Radial Clearances over Swimming Pools	A Minimum Vertical	B Minimum Radial
Unprotected Line Conductors (Vertical Over Highest Water Level and Radial from Top Edge of Pool Walls)		
1. 0 – 750 Volts	20 Feet	20 Feet
2. 750 – 22,500 Volts	25 Feet	25 Feet
3. 22.5 – 300kV	30 Feet	30 Feet
Service Drops (Vertical Over Highest Water Level and Radial from Top Edge of Pool Walls)		
4. Pools Public and Commercial	16 Feet	16 Feet
5. Pools Residential	12 Feet	12 Feet
Service Drops (Over Diving Boards or Platforms)		
6. Portion of Board or Platform That is Over Water Surface	16 Feet	8 Feet
7. Portion of Board or Platform That is not Over Water Surface	12 Feet	3 Feet
Guys (Ungrounded Portions)		
8. Over Highest Water Level and from Top Edge of Pool Walls	18 Feet	18 Feet
9. Over Diving Board or Platform (The Portion that is Over the Water Surface)	18 Feet	8 Feet
10. Over Diving Board or Platform (The Portion that is not Over the Water Surface)	12 Feet	6 Feet
Guys (Grounded Portions)		
11. Over the Highest Water Level	16 Feet	–
12. Over Diving Board or Platform (The Portion that is Over the Water Surface)	16 Feet	8 Feet
13. Over Diving Board or Platform (The Portion that is not Over the Water Surface)	8 Feet	3 Feet

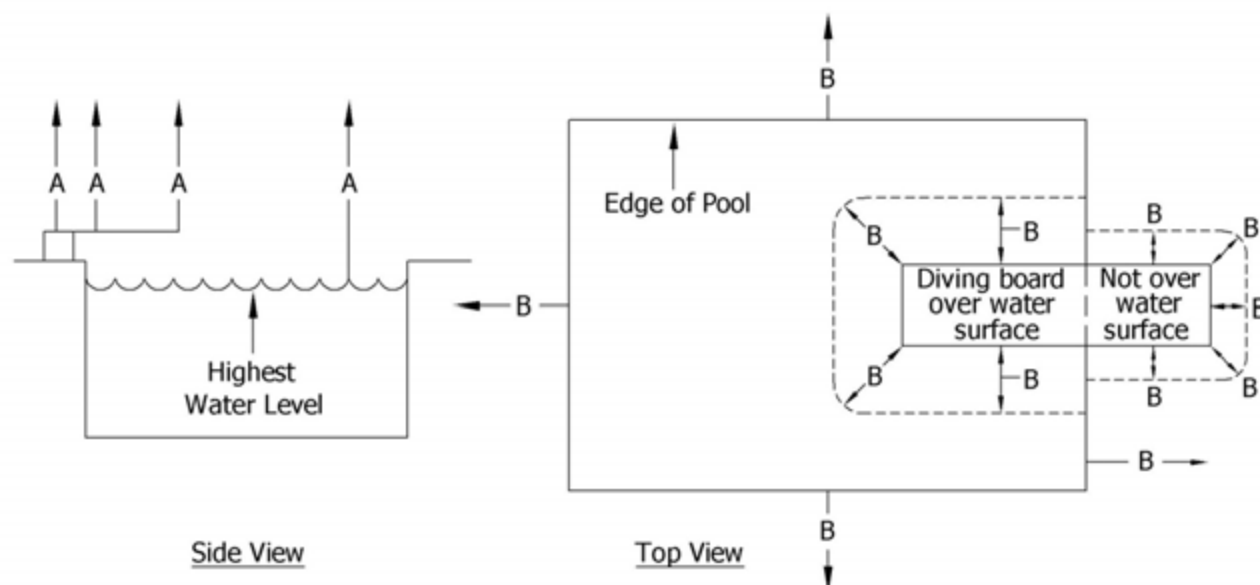

Reference G.O. 95 Rule 54.4-A3

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 2

SDG&E SERVICE STANDARDS & GUIDE

OVERHEAD ELECTRIC CLEARANCES OVER SWIMMING POOLS

SG 108.2

GENERAL INFORMATION

A service head of a type approved by the governmental Authority Having Jurisdiction (AHJ) shall be provided on the supply end of every service raceway terminated above ground for an overhead service connection.

LOCATION

The service head shall normally be located above or on the wall of the building facing and nearest the Utility's pole line. It may be located below the roof of the building served under the conditions outlined below in item 2. In any case, it shall be located so the service head and point of connection to the service drop conductors will comply with clearances required by applicable electrical codes and ordinances enforced by the AHJ, as well as provisions specified on other pages of this Service Standards & Guide and the following:

1. The service head shall be located so that only one point of attachment is required to support the service drop on a building or structure and should, where practicable, be at least one foot above the level of the point of service drop support.
2. Where it is impractical to locate the service head above the point of attachment, the service head may be located not more than 24" radially from the point of attachment. The service head shall be located so the length of open service entrance conductors between the service head and the point of connection of the Utility's service drop conductors (drip loop) will not exceed 3'.
3. Where more than one service head for the same phase and voltage is installed on a building or structure, all such service heads shall be located so they may be served through a single service drop. The maximum number of service heads permitted is three. See page SG 109.2 for Multiple Service Head Installations.
4. Where service heads for different phase or voltage are installed on a building for which a single point of delivery is established, such service heads shall be located as close together as practicable or as otherwise directed by the SDG&E Service Planner.
5. A service head shall not be located on any wall or structure which faces and is less than 3' from a common property line.
6. A radial distance of not less than 3' shall be maintained from a service head, service entrance conductors and service drop to any open load conductors or yard lighting.
7. A service head shall not be located more than 30' above grade level measured from the standing surface nearest such head.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 2


SDG&E SERVICE STANDARDS & GUIDE

SERVICE HEADS

SG 109.1

Number of Service Heads Permitted

More than one service head may be installed on a building up to a maximum of three provided the installation conforms to applicable electrical codes and ordinances enforced by the AHJ pertaining to the permissible number of services to a building, and conforms to all meter location and access requirements for their location in accordance with the provisions of the Service Standards & Guide.

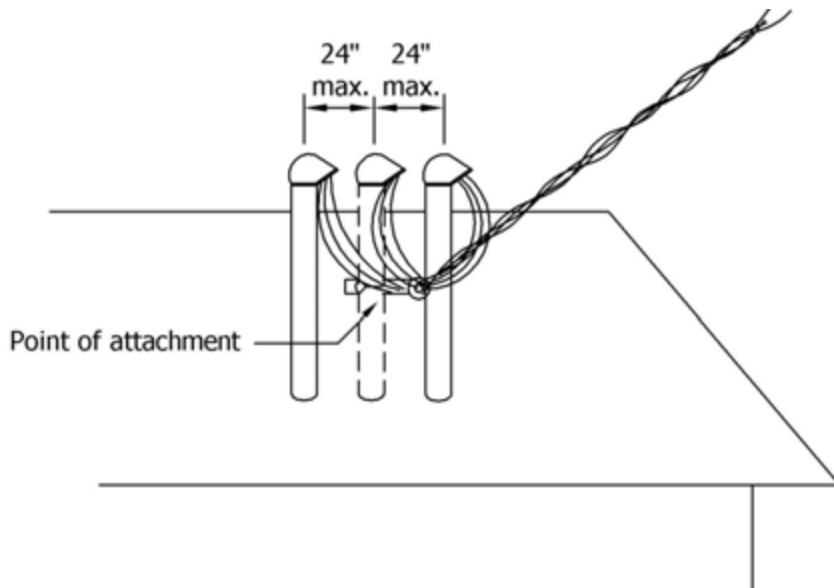

Notes:

- A. The point of attachment is to be on the center riser, which is to meet all standard requirements found on pages SG 105.1 – 105.2.
- B. Drip loops are not to exceed 3' in overall cable length per service head. See page SG 112.4.
- C. The Utility service drop is not to cross over more than 6' of roof to reach the point of attachment. See page SG 103.4, Figure 5.
- D. Actual configuration will vary based on site conditions.
- E. The builder's actual design and installation are subject to all approvals, permits, and inspections required by the AHJ.
- F. All proposed meter locations for this application require Utility approval and a "Meter Location & Service Order" form from an SDG&E Service Planner prior to construction.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 2

SDG&E SERVICE STANDARDS & GUIDE





SERVICE HEADS

SG 109.2

GENERAL INFORMATION

Busway type service entrance shall be limited to 600 volts maximum and is a requirement when more than three paralleled overhead service entrance conductors per phase are necessary to supply the load for one metering location. Refer to the following information and installation notes on page SG 110.2 for specifications.

1. Single-Phase, Three-Wire Service

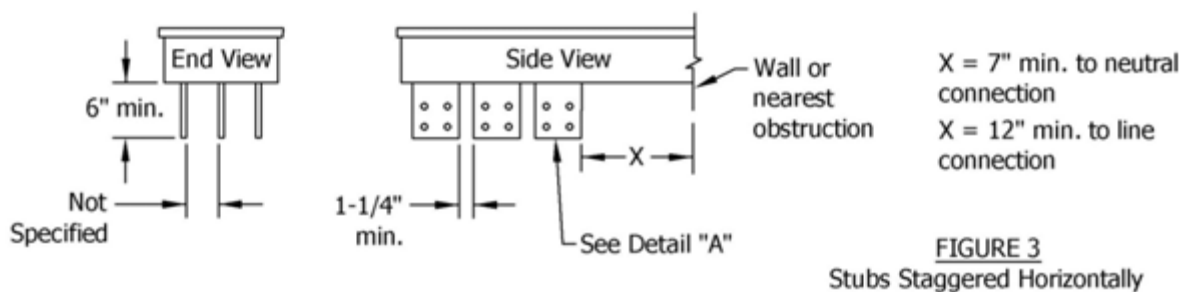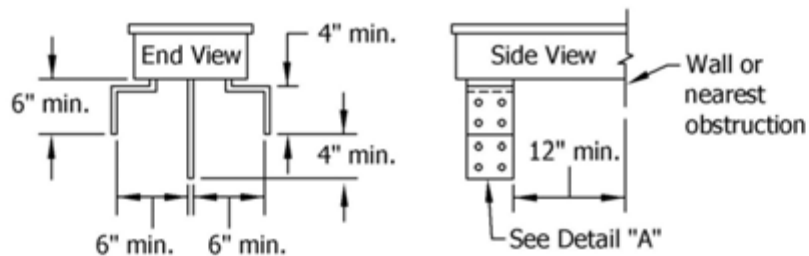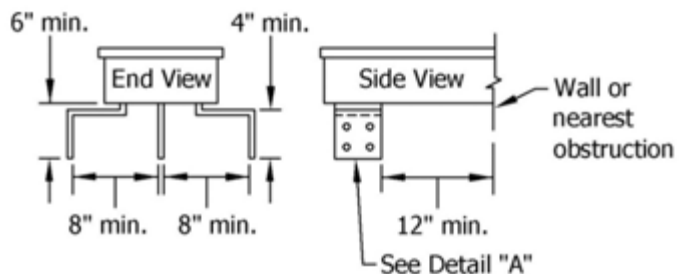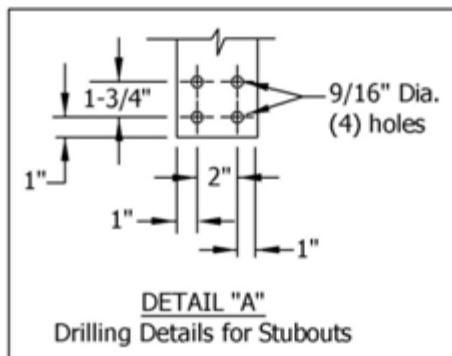

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed




SHEET
1 OF 2

SDG&E SERVICE STANDARDS & GUIDE

BUSWAY SERVICE HEADS

SG 110.1

2. Three-Phase, Four-Wire, Wye or Delta-Connected Service

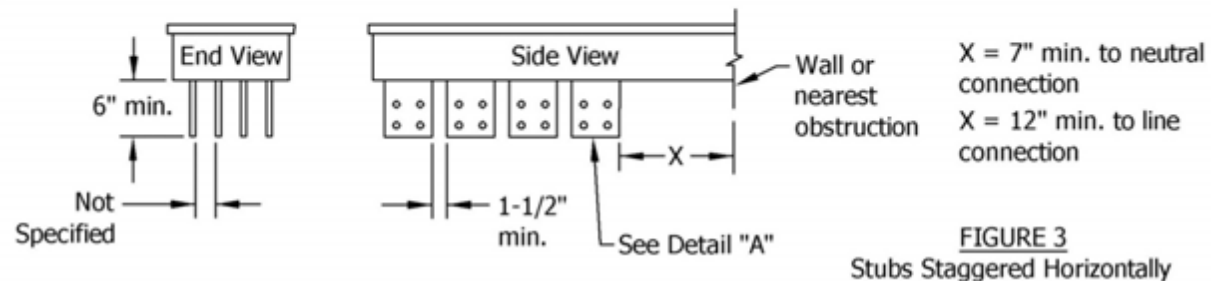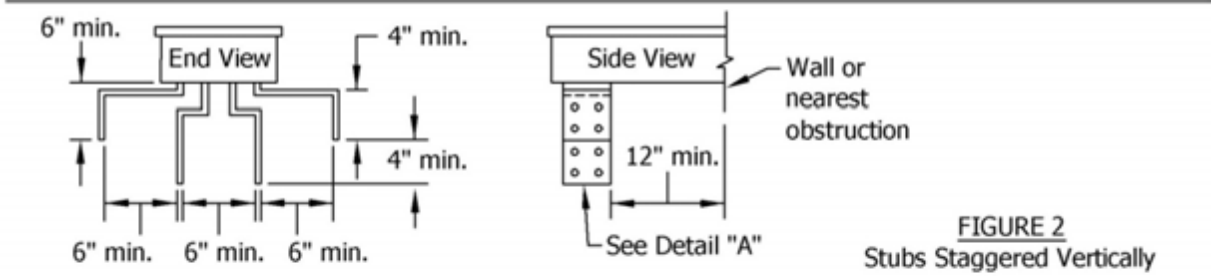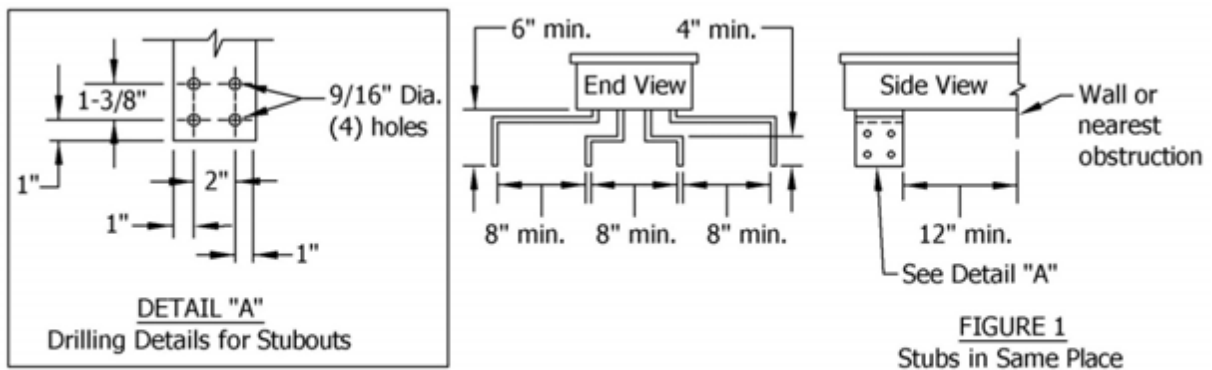

Notes to Figures 1 – 3 on page SG 110.1 and Figures 1 – 3 above:

- A. Bus stubs shall be drilled as shown in Detail "A".
- B. Manufacturer shall provide an insulated barrier to shield the bus bars. Only the stubs are to be exposed for connection of service drop conductors by SDG&E's crew.
- C. All neutral and delta power leg bus stubs shall be permanently identified (marked) in a manner conforming to the requirements of the governmental Authority Having Jurisdiction (AHJ) and SDG&E. See page SG 112.2, Identification.
- D. SDG&E will furnish lugs and insulate the connections below the barrier.
- E. Contact the appropriate Project Management Regional Office for vault installations (see page SG 2).

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
2 OF 2

SDG&E SERVICE STANDARDS & GUIDE

BUSWAY SERVICE HEADS

SG 110.2

GENERAL INFORMATION

For each overhead service connection, the contractor furnishes and installs an approved raintight service entrance raceway, including all fittings, from the service equipment to the point of service drop attachment. Such a service raceway may be concealed or exposed. The installation must comply with all applicable electrical codes and ordinances of the governmental Authority Having Jurisdiction (AHJ).

INSTALLATION METHOD

1. The service entrance raceway should be continuous and without conduit or junction box. However, with the prior approval of the AHJ and SDG&E (Utility), such devices may be installed when excessive length and bends in the service entrance raceway make a continuous run impractical.
 - a. If exposed to weather, the devices shall be raintight.
 - b. If a conduit or junction box is approved in the service entrance raceway, it will need to be equipped with accessories to permit sealing.
 - c. Between the metering equipment and the service entrance connection, the devices shall be located so that they are plainly visible for perpetual inspection by the Utility.

SEALING SERVICE ENTRANCE RACEWAYS & METERING ENCLOSURES

The Utility will seal auxiliary raceways, gutters, or meter troughs containing service entrance conductors (unmetered conductors), including meter enclosures, meter socket boxes and similar enclosures which form a part of the service entrance installation that is on the supply (line) side of the metering equipment. It is not acceptable to install the customer's feeder (metered) conductors in a service entrance raceway, line gutter or meter trough, or in a metering enclosure ahead (on the line side) of the over-current protective device. Electrically protected (fused) and unprotected (unfused) conductors are not allowed to occupy the same raceway or line gutter. See Sealing of Meters & Metering Equipment and Sealing Requirements on page SG 503 for additional information.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

SERVICE ENTRANCE RACEWAYS

SG 111

DEFINITIONS

1. The following definitions distinguish between service entrance conductors and service drop conductors:
 - a. Service Entrance Conductors (Overhead): The customer-owned conductors extending from the service equipment to the point of connection to the Utility service drop conductors.
 - b. Service Drop Conductors: The SDG&E (Utility's) overhead conductors extending from its pole line to the point of service drop support on a building or structure.

GENERAL INFORMATION

1. For each overhead service connection, the contractor furnishes and installs service entrance conductors from the service equipment to the point of connection to the Utility's service drop conductors. These conductors may be an individual set or parallel sets in conduit raceways, busway or service entrance cable of types approved by the governmental Authority Having Jurisdiction (AHJ).
2. Busway type service entrance shall be required where more than three paralleled overhead service entrance conductors per phase are necessary to supply the load for one metering location. See pages SG 109.1 – 110.2.
3. In general, a building should have only one set of service entrance conductors, except as follows:
 - a. Where permitted by the AHJ, buildings with multiple types of occupancy may have two or more separate sets of service entrance conductors which are tapped from a single point of service delivery. Up to six sets of service entrance conductors may be tapped from a single set of main service entrance conductors provided the phase-to-phase voltage between the conductors does not exceed 300 volts. Where main service entrance conductors supply several units of a multiple occupancy building, the junction boxes in which sub-service entrance conductors are connected to the main service need to be in a readily accessible and visible location on the exterior of the building or in a public area. They must be sealable and if exposed to weather, raintight.
 - b. Buildings of unusually large area may have more than one point of service delivery. Refer to Electric Service Policies on pages SG 013.1 – 013.3.
 - c. A separate set of service entrance conductors may be installed if required for fire pumps or for emergency lighting purposes.
 - d. Additional service entrance conductors may be installed for a second class of service (different voltage) when approved by the Utility.

SIZE & CAPACITY

The capacity of service entrance conductors shall comply with electrical codes and ordinances enforced by the AHJ. The smallest size should not be less than No. 6 AWG, except that No. 8 AWG may be used in either two-wire, or three-wire service entrance installations which supply not more than two 2-wire branch circuits, with a maximum of 1-15 amp and 1-20 amp circuit.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 6	X Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 112.1
	SDG&E SERVICE STANDARDS & GUIDE				
	SERVICE ENTRANCE CONDUCTORS 0 – 600 VOLTS				

IDENTIFICATION

All neutral conductors shall be permanently identified white or gray in color in a manner acceptable to the AHJ. For 3-phase delta-connected services, the power leg shall be permanently identified orange in color in a manner acceptable to the AHJ. The identification for both neutral and power leg conductors shall be applied on the open conductors (drip loop) extended from a service head or on the bus stubs of a busway service head, whichever is applicable, and throughout the meter and service equipment. The Utility does not require other conductors to be identified.

MAXIMUM LENGTH OF SERVICE ENTRANCE CONDUCTORS EXTENDED FROM SERVICE HEAD & THE DRIP LOOP

1. The length of open service entrance conductors between the service head and the point of connection to the Utility's service drop (drip loop) shall not exceed 3'.
2. The contractor should ensure that the service entrance conductors extended from the service head have sufficient length to be connected to the Utility's service drop conductors. Splices are not permitted in the customer-owned service entrance conductors. When the actual length required is not known, 3' will be sufficient.
3. See page SG 112.4 for Drip Loop installation instructions when, by necessity, a service head is installed below the point of service drop attachment.

CONNECTION OF SERVICE ENTRANCE CONDUCTORS TO SERVICE DROP CONDUCTORS

1. The Utility will complete the service connection by:
 - a. Connecting the customer's service entrance conductors to its service drop conductors, or
 - b. Connecting its service drop conductors to busway service head bus-duct stubs, except when voltage rated insulated service entrance conductors are required between the busway bus-duct stubs and the service drop conductors at locations where service entrance conductors will pass above any portion of a building at the reduced clearance permitted by some exceptions. See page SG 112.4, Clearances above Commercial or Industrial Buildings & Structures. The insulated service entrance conductors, in such a case, shall be furnished and connected to the bus-duct stubs by the contractor and be of sufficient length for connection to the Utility's service drop conductors.

SERVICE ENTRANCE CABLE

1. Where permitted by the AHJ, standard types of service entrance cable with approved raintight fittings may be furnished and installed by the contractor in lieu of service entrance conductors in raceways.
2. Service entrance cables shall be installed on the surface of the building.

TAPS & SPLICES IN SERVICE RACEWAYS

1. The conductors shall be continuous without taps or splices, except as follows:

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 6	<div>X</div> Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 112.2
	SDG&E SERVICE STANDARDS & GUIDE				
	SERVICE ENTRANCE CONDUCTORS 0 – 600 VOLTS				

- a. Approved clamped or bolted connections may be made in junction boxes or approved devices. See page SG 111.
- b. Taps may be made in approved junction boxes where subsets of individual service entrance conductors are permitted to be extended from main bus service entrance conductor run.
- c. Taps may be made in auxiliary gutters or meter troughs where individual sets of service entrance conductors are permitted to be tapped to an approved group of individual service switches.
- d. The neutral shall be continuous without splice until terminated at the grounding bus. Taps may be made as indicated previously. Neutral conductors broken at an approved landing block or bus shall be considered as continuous.

OTHER CONDUCTORS IN SERVICE ENTRANCE RACEWAYS

1. No conductors other than service entrance conductors are permitted in the service entrance raceway, except when continuous bonding wires are required by the appropriate inspection authority to connect multiple sections of the customer's service equipment. Where a main disconnect is installed on the line side of a group of meters and service switches, the conductors on the line side of the main disconnect, and any unmetered conductors (feeders) on the load side of the main disconnect to the meters will be treated as service entrance conductors. The purpose of this ruling is to prohibit metered and unmetered conductors in the same raceway.
2. Line side (unmetered) and load side (metered) conductors are prohibited from occupying the same raceway, except in meter sockets and terminating enclosures.
3. No conductors from the load side of any or from a similar, source may re-enter an auxiliary gutter or meter trough containing unmetered feeder or service entrance conductors, except in a separately barriered section.
4. A main grounding connection from the grounding electrode or water pipe to a neutral conductor of the service may be in an auxiliary gutter or meter trough where more than one meter is involved, provided the installation is made so as to minimize interference and approved by the AHJ.

GROUNDING & BONDING

1. The service raceway, metering enclosure and service equipment for all classes of service, including any neutral service entrance conductor, needs to be bonded and grounded in compliance with electrical codes and ordinances enforced by the AHJ. In addition, a neutral bond connection shall be made by the contractor, connecting the neutral service entrance conductor to the interior of the meter socket, enclosure for multiple sockets, or sealed service gutter. In such cases, the complete neutral bond connection shall be entirely within the part of the enclosure which is under the Utility's seal. In combination meter socket and breaker enclosures, the neutral bond connection shall be entirely on the supply side of the barrier between the upper part of the device and the breaker compartment.
2. Electric bonding to, or use of SDG&E gas service piping, gas risers or gas meter facilities for electric bonding and grounding is not permitted.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					


SHEET 3 OF 6	X Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 112.3
	SDG&E SERVICE STANDARDS & GUIDE				
	SERVICE ENTRANCE CONDUCTORS				
	0 – 600 VOLTS				

ALUMINUM SERVICE ENTRANCE CONDUCTORS

Aluminum service entrance conductors may be used provided the terminals and connectors making connections, taps or splices in meter and service devices are of a type suitable for receiving aluminum conductors and are furnished and installed by the contractor in accordance with applicable electrical codes enforced by the AHJ.

DRIP LOOPS

Where by necessity a service head is installed below the point of service drop attachment, drip loops should be formed in the open service entrance conductors. To prevent siphoning of water into service raceway or equipment, an inverted "V" notch should be cut through the insulation on the current carrying strands at the lowest point on the bottom side of each service entrance conductor drip loop as shown below.

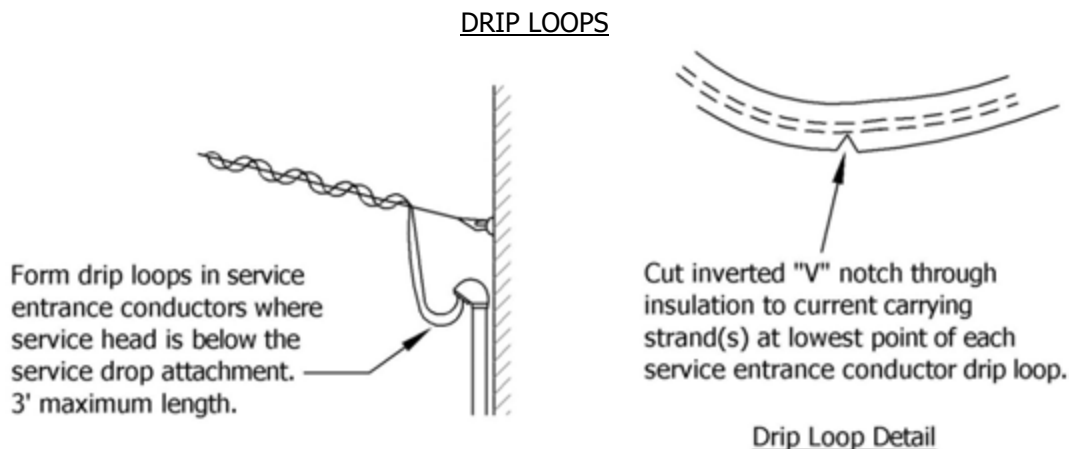

CLEARANCES ABOVE COMMERCIAL OR INDUSTRIAL BUILDINGS & STRUCTURES

1. The legal requirement for 0 – 600-volt open wire service entrance conductors is a vertical clearance of not less than 8' above any portion of a metallic or non-metallic building or structure served, except:
 - a. 0 – 300-volt service entrance conductors may be less than 8' but not less than 12" above a non-metallic decorative appendage, eave, roof, or parapet wall, provided the service head is located not more than 18" back of the exterior face of the building wall.
 - b. 0 – 300-volt service entrance conductors may be less than 8' but not less than 12" above a metallic eave, roof or parapet wall, provided the service head is not more than 18" back of the outer edge of the eave, roof, or parapet wall.
 - c. 0 – 600-volt service entrance conductors may be less than 8' but not less than 12" above a metallic or non-metallic eave, roof, or parapet wall, provided the service head is not more than 18" back of the outer edge of the eave, roof, or parapet wall.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
4 OF 6

SDG&E SERVICE STANDARDS & GUIDE

SERVICE ENTRANCE CONDUCTORS
0 – 600 VOLTS

SG 112.4

**0 – 600V CLEARANCE ABOVE A METALLIC OR
NON-METALLIC DECORATIVE APPENDAGE, EAVE, ROOF OR PARAPET WALL**

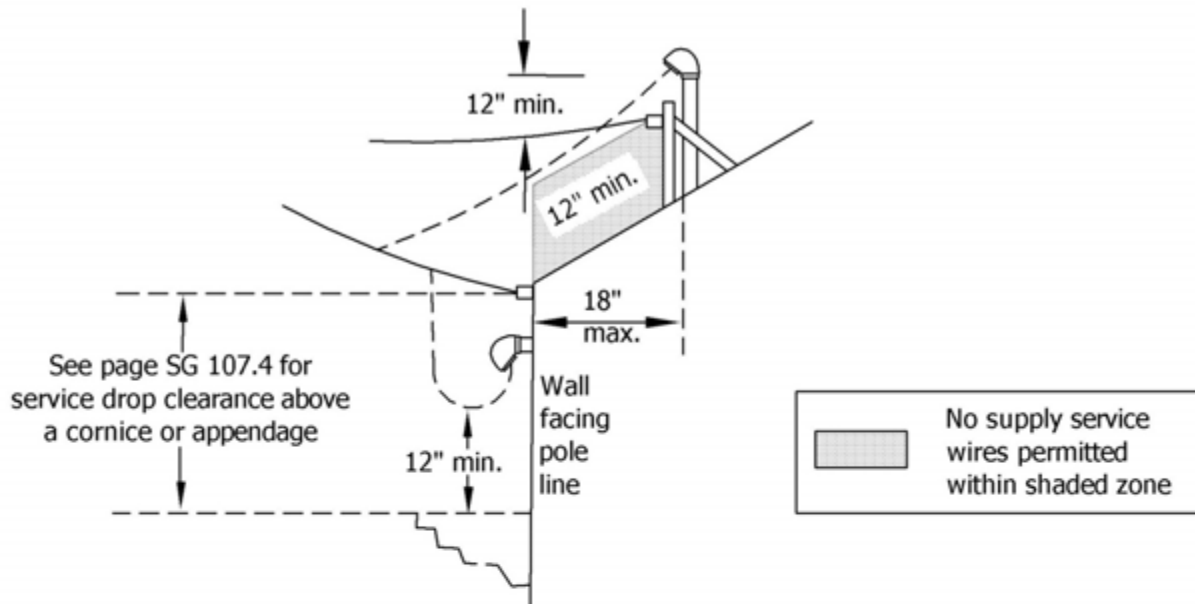


FIGURE 1
Decorative Appendage and/or Roof

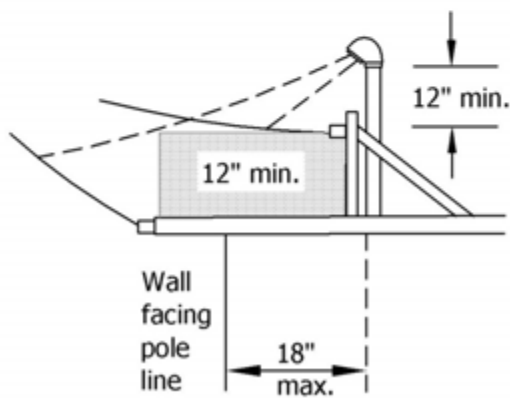


FIGURE 2
Flat or Sloping Eave or Roof

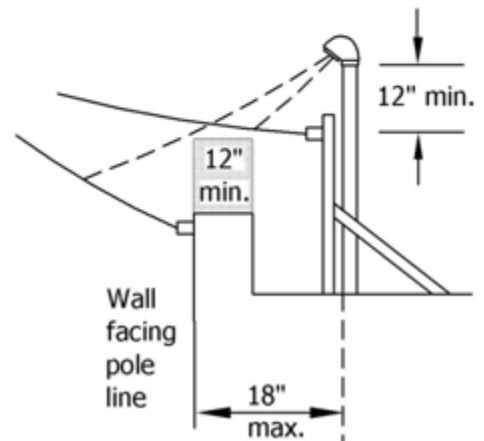


FIGURE 3
Parapet Wall

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

**SHEET
5 OF 6**

SDG&E SERVICE STANDARDS & GUIDE
SERVICE ENTRANCE CONDUCTORS
0 – 600 VOLTS

SG 112.5

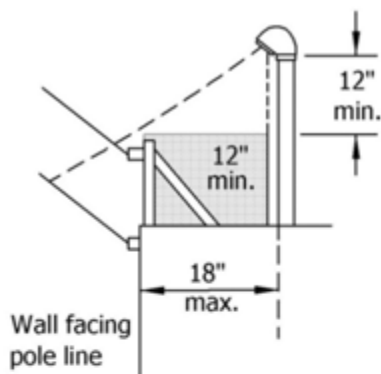


FIGURE 4
Flat Roof

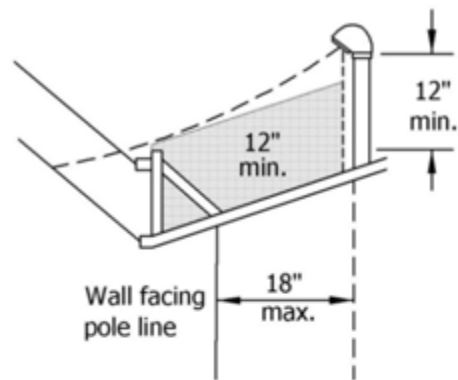


FIGURE 5
Flat or Sloping Eave or Roof

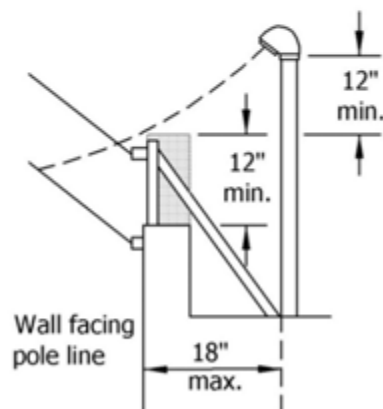



FIGURE 6
Parapet Wall

 No supply service wires permitted within shaded zone

Notes to Figures 1 – 6:

1. Service entrance conductors and service drop conductors are not permitted within the shaded zones illustrated.
2. 0 – 600-volt service drop conductors and supporting service insulator may be attached to a conduit riser in lieu of the support rack illustrated in Figures 1 – 6 provided the service entrance conductors and service drop conductors do not pass through the shaded zones illustrated.
3. The lengths of open service entrance conductors between the service head and point of connection to the service drop conductors (drip loop) shall not exceed 3’.
4. Service entrance conductors shall be without splices.
5. See page SG 107.3 – 107.5 for service drop conductor clearances above buildings.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
6 OF 6

SDG&E SERVICE STANDARDS & GUIDE

SERVICE ENTRANCE CONDUCTORS
0 – 600 VOLTS

SG 112.6

**200 - CUSTOMER-OWNED
METER POLES**

**200 - CUSTOMER-OWNED
METER POLES**

PAGE**SUBJECT**

202	ALPHABETICAL SUBJECT INDEX
203	GENERAL INFORMATION
204	CUSTOMER-OWNED SERVICE & METER POLE PERMANENT/CLIMBABLE, 0 – 600 VOLTS
205	CUSTOMER-OWNED SERVICE & METER POLES TEMPORARY/NON-CLIMBABLE, 0 – 600 VOLTS
206	CUSTOMER-OWNED SERVICE & METER POLE WITH MULTIPLE METERS PERMANENT OR TEMPORARY INSTALLATION
207	CUSTOMER-OWNED SERVICE WITH MULTIPLE METERS FOR UNDERGROUND PERMANENT OR TEMPORARY INSTALLATION
208	TEMPORARY SERVICE FROM SDG&E HANDHOLE TO CUSTOMER-OWNED SERVICE & METER INSTALLATION
209	TEMPORARY SERVICE FROM SDG&E POLE OR PADMOUNT TRANSFORMER TO CUSTOMER-OWNED SERVICE & METER INSTALLATION
210	TEMPORARY SERVICE TO PERMANENT SERVICE & METERING ENCLOSURE (TSPB)

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C							F						
B	FORMATTING	EDM	JK	--	--	12/07/2020	E						
A	NEW PAGE	--	LSM	LSM	TPM	11/01/2017	D						

**SHEET
1 OF 1**

Indicates Latest Revision

Completely Revised

New Page



Information Removed

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

**CUSTOMER-OWNED METER POLES
TABLE OF CONTENTS**

SG201.1

SUBJECT**PAGE**

ADDRESS MARKING.....	203.2
AVAILABLE SECONDARY FAULT CURRENT	203.2
CUSTOMER-OWNED SERVICE & METER POLE FOR PERMANENT OR TEMPORARY SERVICE, 0 – 600 VOLTS	203.1 - 203.2
CUSTOMER-OWNED SERVICE & METER POLES PERMANENT/CLIMBABLE, 0 – 600 VOLTS	204.1 – 204.3
CUSTOMER-OWNED SERVICE & METER POLES TEMPORARY/NON-CLIMBABLE, 0 – 600 VOLTS	205.1 – 205.4
CUSTOMER-OWNED SERVICE & METER POLE WITH MULTIPLE METERS PERMANENT OR TEMPORARY INSTALLATION	206
CUSTOMER-OWNED SERVICE WITH MULTIPLE METERS FOR UNDERGROUND PERMANENT OR TEMPORARY INSTALLATION.....	207
GENERAL INFORMATION	203.1
GENERAL REQUIREMENTS	203.1
MARKING, ADDRESS.....	203.2
MULTIPLE METER INSTALLATION	206, 207
PERMANENT POLES.....	204.1 – 204.3
PERMANENT OR TEMPORARY SERVICE INSTALLATIONS	206, 207
SERVICE & METER POLE SPECIFICATIONS	203.1
SERVICE DROP CLEARANCES	203.1, 204.2, 205.3
STEEL SERVICE & METER POLES.....	203.1 – 203.2
TEMPORARY POLES.....	205.1 – 205.4
TEMPORARY SERVICE FROM AN OVERHEAD SOURCE	205.1 – 205.4, 206, 209.1 – 209.2
TEMPORARY SERVICE FROM AN UNDERGROUND SOURCE	207, 208, 209
TEMPORARY SERVICE FROM SDG&E HANDHOLE TO CUSTOMER-OWNED SERVICE & METER INSTALLATION	208.1 – 208.2
TEMPORARY SERVICE FROM SDG&E POLE OR PADMOUNT TRANSFORMER TO CUSTOMER-OWNED SERVICE & METER INSTALLATION	209.1 – 209.2
TEMPORARY SERVICE TO PERMANENT METERING ENCLOSURE (TSPB)	210

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C							F						
B	FORMATTING	EDM	JKI	--	--	12/07/2020	E						
A	EDITORIAL CHANGES	--	LSM	LSM	TPM	11/01/2017	D						

**SHEET
1 OF 1**



Indicates Latest Revision

Completely Revised

New Page

Information Removed


SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

**CUSTOMER-OWNED METER POLES
ALPHABETICAL SUBJECT INDEX**

SG202.1

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.													
REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C							F						
B	FORMATTING	EDM	JKI	--	--	12/07/2020	E						
A	EDITORIAL CHANGES	--	LSM	IPJ	TPM	11/01/2017	D						
SHEET 2 OF 2		X	Indicates Latest Revision		Completely Revised		New Page		Information Removed		SG203.2		
			SDG&E ELECTRIC SERVICE STANDARDS & GUIDES										
			GENERAL INFORMATION										

SCOPE: THIS STANDARD SHOWS AND DESCRIBES THE INSTALLATION OF A CUSTOMER-OWNED PERMANENT/CLIMBABLE SERVICE AND METER POLE.

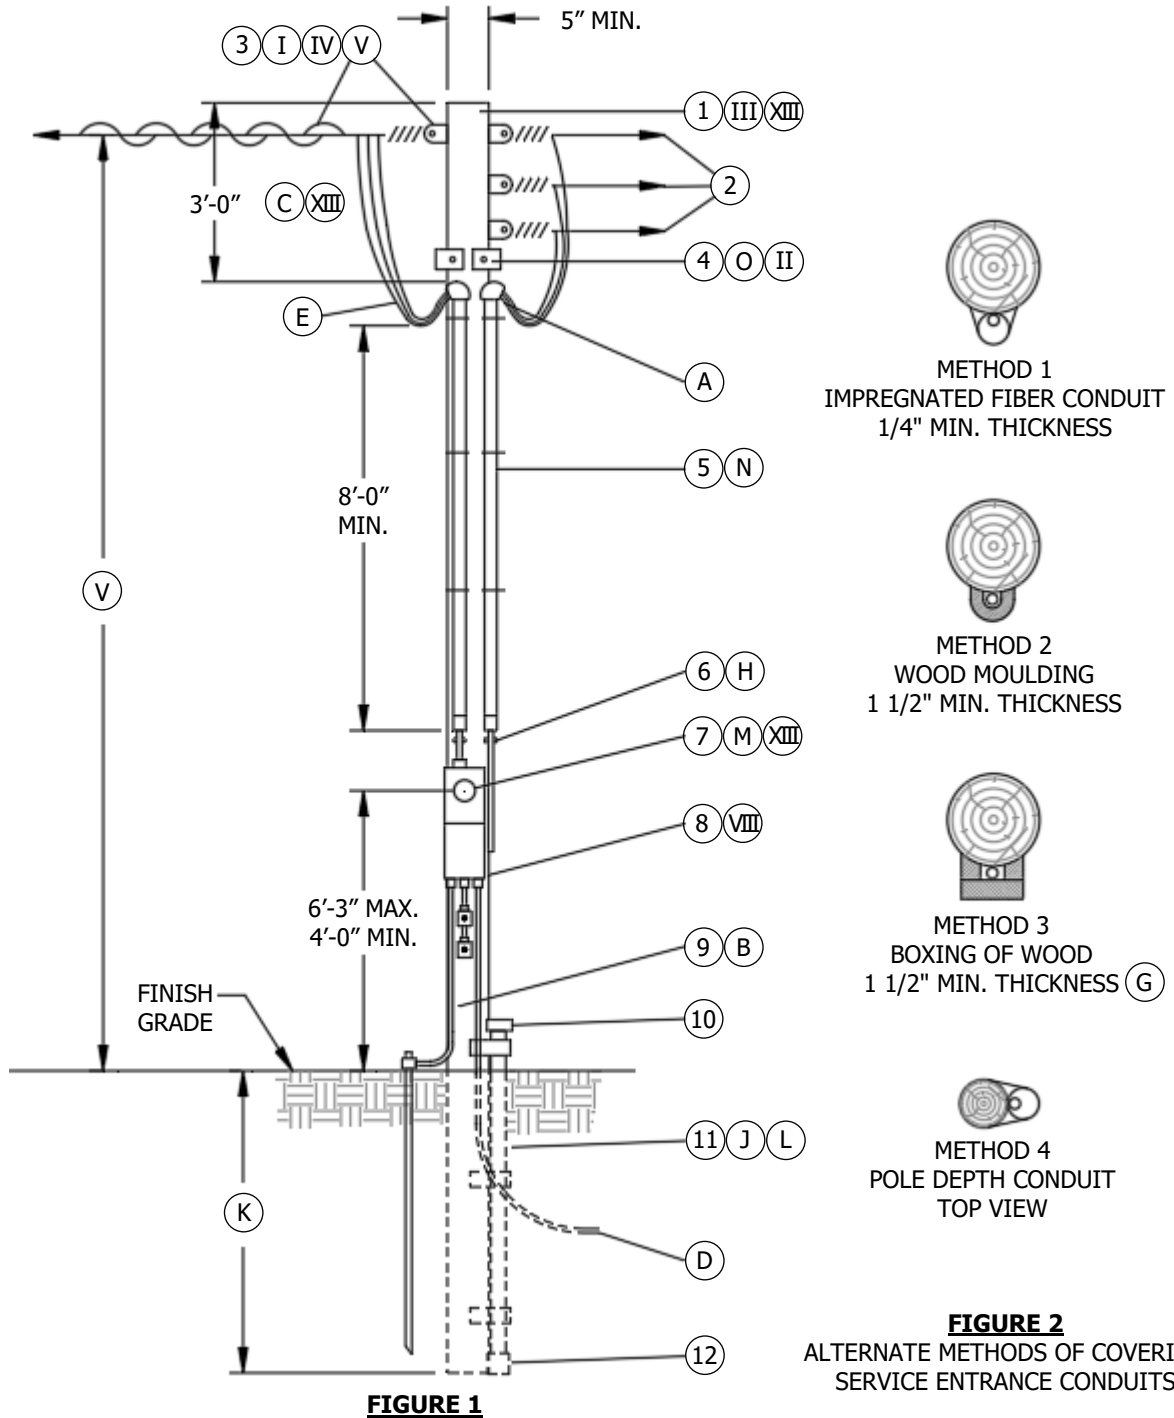

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C							F						
B	FORMATTING	EDM	JK	--	--	12/07/2020	E						
A	EDITORIAL CHANGES	--	LSM	IPJ	TPM	11/01/2017	D						



Indicates Latest Revision

Completely Revised

New Page

Information Removed

**SHEET
1 OF 5**

SDG&E SERVICE STANDARDS & GUIDES

**CUSTOMER-OWNED SERVICE & METER POLE
PERMANENT/CLIMBABLE, 0 – 600V**

SG204.1

INSTALLATION:

- (A) EXTEND PROTECTIVE COVERING OVER METALLIC CONDUIT TO BOTTOM OF SERVICE HEADS. DO NOT LEAVE CONDUITS EXPOSED.
- (B) SERVICE GROUND TO COMPLY TO CALIFORNIA ELECTRIC CODE AND BE MECHANICALLY PROTECTED IN COMPLIANCE WITH G.O. 95 PER ONE OF THE FOLLOWING METHODS:
1. ENCASED IN RIGID STEEL CONDUIT.
 2. MINIMUM NO. 8 AWG ARMORED COPPER GROUND WIRE.
 3. COVERED BY A MINIMUM OF:
HARDWOOD MOULDING (OF OAK OR ROCK ELM) 3/8-INCH THICKNESS, OR
DOUGLAS FIR MOULDING 1/2-INCH THICKNESS, OR
RIGID CONDUIT OR RIGID U-SHAPED MOULDING OF A MINIMUM SCHEDULE 40 PVC, OR
POLY PROTECTED GROUND WIRE.
- (C) CUSTOMER TO WIRE OUT 3 FEET BELOW TOP OF POLE.
- (D) WHEN CUSTOMER'S LOAD CONDUCTORS ARE UNDERGROUND, INSTALL CONDUIT AS INDICATED BY DASHED LINES.
- (E) PROVIDE AT LEAST 18 INCHES OF WIRE OUTSIDE OF SERVICE HEAD.
- (F) COVERING TO BE STRAPPED TO POLE WITH GALVANIZED TWO-HOLE PIPE STRAPS SPACED NOT TO EXCEED 3 FEET APART.
- (G) COVER TO BE NAILED TO SIDE PIECES.
- (H) INSTALL STRAPS BELOW FIBER CONDUITS TO PREVENT SLIPPING.
- (J) CAP ON BOTTOM AND STRAP TO POLE.
- (K) POLE SETTING DEPTH

TABLE 1

POLE SETTING DEPTH	
HEIGHT	SETTING DEPTH
25'-0"	5'-0"
30'-0"	5'-6"
35'-0"	5'-6"

- (L) CUSTOMER TO DIG POLE HOLE IN NATURAL SOIL. BACKFILL MUST BE COMPACTED TO 90% MINIMUM WITHIN A 5-FOOT RADIUS OF THE POLE. POLE DEPTH WILL BE CONFIRMED BY INSERTION OF A GROUND ROD OR SIMILAR PROBE INTO THE PCV DEPTH CONDUIT ATTACHED TO CLIMBABLE POLE. INSTALL REMOVABLE CAP ON TOP OF CONDUIT TO PREVENT FALLING DEBRIS ENTERING CONDUIT. GUY WIRES ARE NOT PERMITTED AS A MEANS OF SUPPORTING A METER POLE.
- (M) ALL METER POLES MUST HAVE THE NUMERIC PORTION OF THE STREET ADDRESS FIRMLY ATTACHED AND FACING THE STREET OR DRIVABLE SURFACE. PLASTIC OR METALLIC NUMBERS OF THE TYPE USED FOR HOUSE ADDRESSES ARE ACCEPTABLE.
- (N) ALL CONDUIT FITTINGS MUST BE RAINTIGHT. APPROVED WIRE, NOT LESS THAN NO. 8 AWG, SHALL BE USED IN THE SERVICE ENTRANCE CONDUIT.
- (O) BOLTED TO POLE IN 1/2-INCH GAINS.

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C							F						
B	FORMATTING	EDM	JK	--	--	12/07/2020	E						
A	EDITORIAL CHANGES	--	LSM	IPJ	TPM	11/01/2017	D						



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 5

SDG&E SERVICE STANDARDS & GUIDES

CUSTOMER-OWNED SERVICE & METER POLE
PERMANENT/CLIMBABLE, 0 – 600V

SG204.2

BILL OF MATERIALS:

ITEM	DESCRIPTION		QUANTITY	STANDARD PAGE	STOCK NUMBER	DESIGN UNITS
1	POLE, TREATED, FULL LENGTH ROUND, 25'-0", CLASS 5 MIN.		1	--	--	--
2	CUSTOMER LOAD CONDUCTORS		AS REQ'D	--	--	--
3	HOLDER, SERVICE DROP & WIRE		AS REQ'D	--	--	--
	RACK, SERVICE			--	--	--
4	WOOD BLOCK, 4" X 4" X 6"		AS REQ'D	--	--	--
5	CONDUIT, SERVICE ENTRANCE	PVC, SCHEDULE 40, PLASTIC (PREFERRED)	AS REQ'D	--	--	--
		IRON, RIGID, GALV., 3/4" MIN. WITH PROTECTIVE COVERING (ALTERNATE)				
6	STRAP, PIPE		AS REQ'D	--	--	--
7	METER		AS REQ'D	--	--	--
8	SAFETY SOCKET CAN WITH BYPASS TEST FACILITIES (IF REQUIRED)		AS REQ'D	--	--	--
9	SERVICE GROUND		AS REQ'D	--	--	--
10	REMOVABLE CAP		AS REQ'D	--	--	--
11	CONDUIT, PVC, SCHEDULE 40, 6'-0", 3/4", POLE DEPTH		AS REQ'D	--	--	--
12	CONDUIT CAP		AS REQ'D	--	--	--

NOTES:

- Ⓘ MAXIMUM LENGTH OF SERVICE DROP SPAN SHALL BE 100 FEET.
- Ⓜ BLOCK NOT REQUIRED FOR PVC, SCHEDULE 40 PLASTIC CONDUIT RUNS.
- Ⓜ THESE ARE MINIMUM REQUIREMENTS FOR PERMANENT CUSTOMER-OWNED SERVICE AND METER POLES. THEY ARE APPROVED FOR TEMPORARY INSTALLATIONS. Ⓥ
- Ⓖ **POLE LOCATION:**
- POLE SHALL BE SET NOT MORE THAN 100 FEET NOR LESS THAN 10 FEET FROM THE SURFACE OF SDG&E'S SERVICE POLE AND SO LOCATED THAT ALL REQUIRED SERVICE DROP CLEARANCES WILL BE OBTAINED FROM GROUND, BUILDINGS, STRUCTURES AND OTHER CONDUCTORS ON SDG&E'S POLE INCLUDING FOREIGN COMMUNICATION AND SUPPLY CONDUCTORS. IN SELECTING THE POLE LOCATION, CONSIDERATION SHOULD BE GIVEN TO PROVIDING ADEQUATE CLEARANCE IN AREAS WHERE:
 - CONSTRUCTION EQUIPMENT WILL BE OPERATED.
 - CHANGES IN GRADE OF STREETS, DRIVEWAY, AND OTHER LANDS ARE PROPOSED.
 - BUILDINGS OR STRUCTURES ARE PROPOSED TO BE ADDED DURING THE PERIOD OF PERMANENT OR TEMPORARY SERVICE
 - ADEQUATE CLEARANCE SHALL BE PROVIDED, WHETHER OR NOT SUCH AREAS OF CONFLICT OR OBSTRUCTION ARE ON THE PREMISES SERVED.
 - CONTACT SDG&E AT ANY REGIONAL PROJECT MANAGEMENT OFFICE AND REQUEST AN ELECTRIC METER AND SERVICE LOCATION FORM. Ⓡ

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C							F						
B	FORMATTING	EDM	JK	--	--	12/07/2020	E						
A	EDITORIAL CHANGES	--	LSM	IPJ	TPM	11/01/2017	D						



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
3 OF 5

SDG&E SERVICE STANDARDS & GUIDES

CUSTOMER-OWNED SERVICE & METER POLE
PERMANENT/CLIMBABLE, 0 – 600V

SG204.3

V SERVICE DROP MINIMUM CLEARANCES:

TABLE 2

SERVICE DROP MINIMUM CLEARANCES VII	
LOCATION	MIN. CLEARANCE (FT)
AT CENTER OF STREET OR 12'-0" FROM CURB, WHICHEVER IS LESS	18
AT CURB LINE	16
OVER COMMERCIAL OR INDUSTRIAL DRIVEWAYS, PARKING AREAS OR AREAS CAPABLE OF BEING TRAVERSED BY VEHICLES	16
OVER RESIDENTIAL DRIVEWAYS	12 VI
OVER AGRICULTURAL AREAS	15
OVER RAILROADS OR FOR OTHER SPECIAL CONDITIONS	CONSULT YOUR SDG&E PROJECT PLANNER

- VI MAY BE REDUCED TO 10 FEET IF SELF-SUPPORTING CABLE (SSC) SERVICE. SERVICE DROP CABLE (SSC) SHALL BE USED BY SDG&E. THE TYPE OF CONSTRUCTION USED BY THE CUSTOMER IS THEIR OPTION.
- VII WHERE CLEARANCES CANNOT BE OBTAINED WITH THE 25-FOOT POLE SHOWN, A 35-FOOT MAXIMUM POLE SHALL BE USED.
- VIII SAFETY SOCKET CAN WITH TEST-BYPASS FACILITIES IS REQUIRED WHEN POLE IS TO BE USED FOR TEMPORARY SERVICE OR PERMANENT NON-RESIDENTIAL SERVICE. SERVICE EQUIPMENT AND RECEPTACLES MUST BE RAIN-TIGHT, PROPERLY RATED FOR THE LOAD TO BE SERVED, AND SHALL BE ADEQUATELY BONDED AND GROUNDED.
- IX. RECEPTACLES USED TO CONNECT PORTABLE TOOLS SHALL BE 3-POLE TYPE FOR SINGLE-PHASE MOTORS AND 4-POLE TYPE FOR THREE-PHASE MOTORS, ONE CONTACT TO BE USED FOR GROUNDING CONNECTION. WHERE MORE THAN ONE VOLTAGE TYPE IS USED, RECEPTACLES SHALL BE NON-INTERCHANGEABLE.
- XI. PERMIT AND INSPECTION MUST BE OBTAINED FROM THE GOVERNMENTAL AUTHORITY HAVING JURISDICTION (AHJ) BEFORE SERVICE WILL BE CONNECTED AND A METER SET BY SDG&E
- XII. CONSULT SDG&E FOR SERVICE REQUIREMENTS WHENEVER THREE-PHASE SERVICE IS DESIRED.
- XIII. SDG&E WILL FURNISH AND INSTALL THE METER, SERVICE DROP AND SERVICE DROP RACK OR WIRE HOLDERS. ALL OTHER EQUIPMENT, INCLUDING THE POLE, SHALL BE FURNISHED AND INSTALLED BY THE CUSTOMER.
- XIV. FLOOD LIGHTS, SIGNS, ROPES AND ANY SIMILAR EQUIPMENT SHALL NOT BE ATTACHED TO SERVICE AND METER POLES.
- XV. A TELEPHONE AND/OR CABLE TV SERVICE DROP MAY ATTACH TO A METER POLE PROVIDED:
- THE ATTACHMENT IS OUTSIDE THE CLIMBING SPACE,
 - A MINIMUM RADIAL CLEARANCE OF 12 INCHES IS MAINTAINED FROM ANY PORTION OF THE DRIP LOOP, AND
 - IT MEETS ALL G.O. 95 REQUIREMENTS.
- XVI. REQUIRED WORK AREA AROUND CLIMBABLE METER AND SERVICE POLES: 8 FEET OF UNOBSTRUCTED RADIAL CLEARANCE AROUND THE POLE IS REQUIRED.
- XVII. REQUIRED WORKING SPACE IN FRONT OF THE METER PANEL: A MINIMUM OF 3-FOOT BY 3-FOOT CLEAR AND LEVEL WORKING SPACE IS REQUIRED IN FRONT OF THE METER PANEL MEASURED FROM FACE OF PANEL.
- XVIII. TO MAINTAIN SAFE, CLEAR AND LEVEL WORKING SPACE IN FRONT OF NEW OR EXISTING NON-RESIDENTIAL METER AND SERVICE EQUIPMENT, A CONCRETE SLAB IS REQUIRED FOR THE FULL WORKING SPACE. C

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C							F						
B	FORMATTING	EDM	JK	--	--	12/07/2020	E						
A	EDITORIAL CHANGES	--	LSM	IPJ	TPM	11/01/2017	D						



Indicates Latest Revision

Completely Revised

New Page

Information Removed

**SHEET
4 OF 5**

SDG&E SERVICE STANDARDS & GUIDES

**CUSTOMER-OWNED SERVICE & METER POLE
PERMANENT/CLIMBABLE, 0 – 600V**

SG204.4

REFERENCE:

- a. REFER TO OH645.
- (b) REFER TO SG021.
- (c) REFER TO SG504.5.

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C							F						
B	FORMATTING	EDM	JKI	--	--	12/07/2020	E						
A	EDITORIAL CHANGES	--	LSM	IPJ	TPM	11/01/2017	D						



Indicates Latest Revision

Completely Revised

New Page

Information Removed

**SHEET
5 OF 5**

SDG&E SERVICE STANDARDS & GUIDES

**CUSTOMER-OWNED SERVICE & METER POLE
PERMANENT/CLIMBABLE, 0 – 600V**

SG204.5

SCOPE: THIS STANDARD SHOWS AND DESCRIBES THE INSTALLATION OF A CUSTOMER-OWNED TEMPORARY/NON-CLIMBABLE SERVICE AND METER POLE.

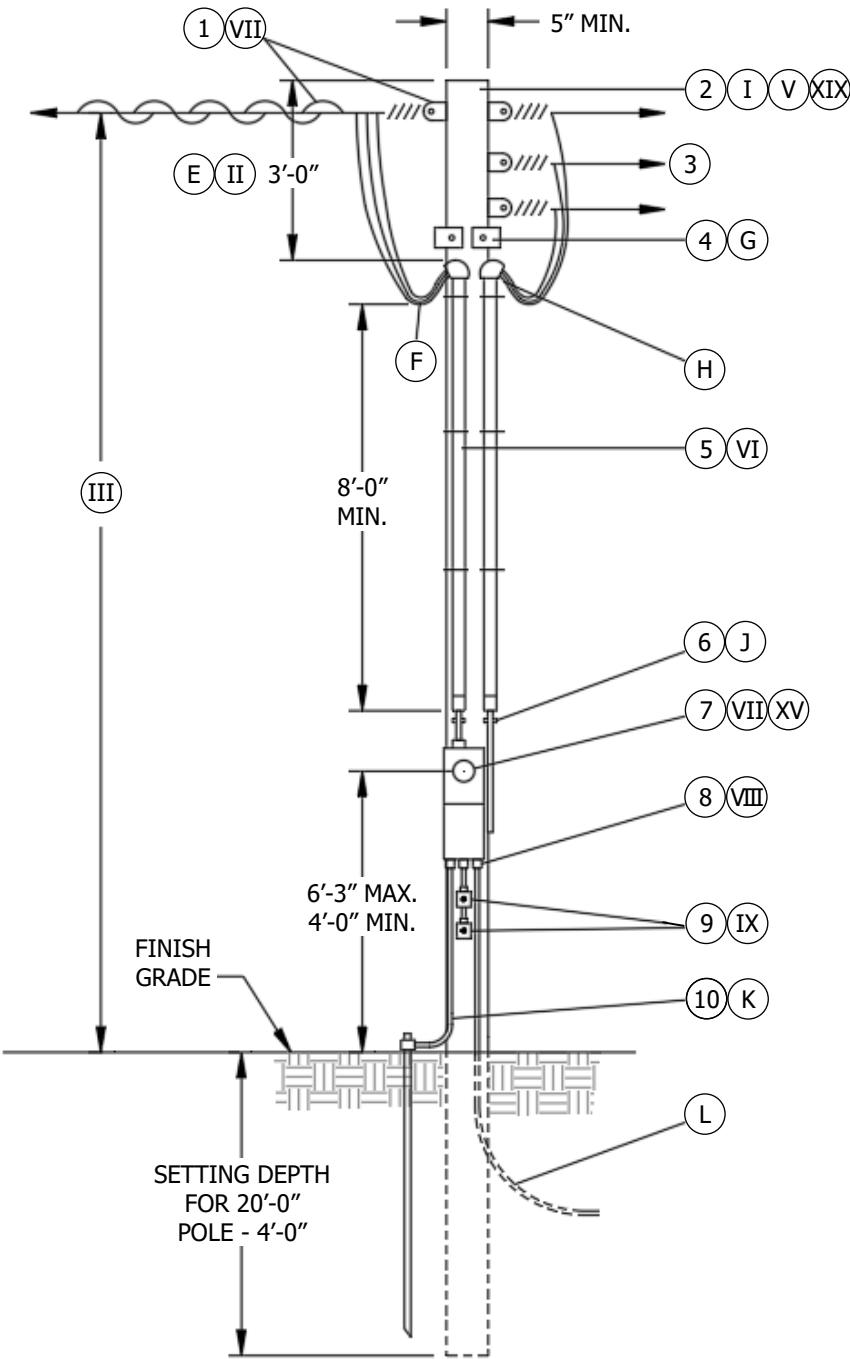


FIGURE 1

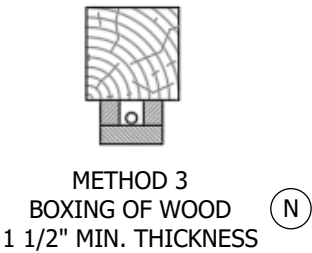


FIGURE 2
ALTERNATE METHODS OF COVERING SERVICE ENTRANCE CONDUITS

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	FORMATTING	EDM	JKI	--	--	12/07/2020	F						
B	EDITORIAL CHANGES	--	LSM	IPJ	TPM	11/01/2017	E						
A	NO CHANGES-REAFFIRMED	--	JC	TPM	MDJ	08/06/2015	D						

X Indicates Latest Revision Completely Revised New Page Information Removed

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

SHEET
1 OF 4

CUSTOMER-OWNED SERVICE & METER POLE
TEMPORARY/NON-CLIMBABLE, 0 – 600V

SG205.1

INSTALLATION:

- A. NO SDG&E EMPLOYEE SHALL PLACE A LADDER AGAINST OR OTHERWISE CLIMB THE TEMPORARY POLE FOR THE PURPOSE OF INSTALLING, REPAIRING, OR REMOVING THE ELECTRIC SERVICE CONNECTIONS.
- B. TEMPORARY SERVICE OR METER POLES SHALL NOT BE SET AT ANY LOCATION WHERE A CHANGE TO PERMANENT STATUS IS PLANNED.
- C. THE TEMPORARY/NON-CLIMBABLE POLE MUST BE LOCATED WITHIN A 20-FOOT RADIUS FROM A ROAD OR OTHER DRIVABLE SURFACE SO SDG&E CAN CONNECT AND MAINTAIN THE SERVICE DROP FROM A BUCKET TRUCK. TRUCK ACCESS MUST BE MAINTAINED DURING THE PERIOD OF TEMPORARY SERVICE. (I)
- D. ANY SERVICE OR METER POLES THAT CANNOT BE LOCATED WITHIN THE 20-FOOT RADIUS MUST BE BUILT TO THE STANDARD OF A PERMANENT/CLIMBABLE POLE.
- (E) CUSTOMER TO WIRE OUT 3 FEET BELOW TOP OF POLE.
- (F) PROVIDE AT LEAST 18 INCHES OF WIRE OUTSIDE OF SERVICE HEAD.
- (G) WOOD BLOCKS TO BE BOLTED TO POLE WITH 1/2-INCH GAINS. BLOCK NOT REQUIRED FOR SCHEDULE 40 PVC PLASTIC CONDUIT RUNS.
- (H) EXTEND PROTECTIVE COVERING OVER METALLIC CONDUIT TO BOTTOM OF SERVICE HEADS. DO NOT LEAVE CONDUITS EXPOSED.
- (J) INSTALL STRAPS BELOW FIBER CONDUITS TO PREVENT SLIPPING.
- (K) SERVICE GROUND TO COMPLY TO CALIFORNIA ELECTRIC CODE AND BE MECHANICALLY PROTECTED IN COMPLIANCE WITH G.O. 95 PER ONE OF THE FOLLOWING METHODS:
1. ENCASED IN RIGID STEEL CONDUIT.
 2. MINIMUM NO. 8 AWG ARMORED COPPER GROUND WIRE.
 3. COVERED BY A MINIMUM OF:
 - HARDWOOD MOULDING (OF OAK OR ROCK ELM) 3/8-INCH IN THICKNESS, OR
 - DOUGLAS FIR MOULDING 1/2-INCH IN THICKNESS, OR
 - RIGID CONDUIT OR RIGID U-SHAPED MOULDING OF A MINIMUM SCHEDULE 40 PVC.
- (L) WHEN CUSTOMER'S LOAD CONDUCTORS ARE UNDERGROUND, INSTALL CONDUIT AS INDICATED BY DASHED LINES.
- (M) COVERING TO BE STRAPPED TO POLE WITH GALVANIZED TWO-HOLE PIPE STRAPS SPACED NOT TO EXCEED 3 FEET APART.
- (N) COVER TO BE NAILED TO THE SIDE PIECES.

BILL OF MATERIALS:

ITEM	DESCRIPTION	QUANTITY	STANDARD PAGE	STOCK NUMBER	DESIGN UNITS
1	HOLDER, WIRE	AS REQ'D	--	--	--
	RACK, SERVICE				
2	TIMBER, SELF-SUPPORTING, 6" X 6" X 20'-0"	1	--	--	--
	POLE, ROUND, 20'				
	POLE, SELF-SUPPORTING, METER, 20'-0"				
3	CONDUCTOR, LOAD, CUSTOMER-OWNED	AS REQ'D	--	--	--
4	WOOD BLOCK, 4" X 4" X 6"	AS REQ'D	--	--	--
5	CONDUIT, PVC, SCHEDULE 40, PLASTIC (SERVICE ENTRANCE – PREFERRED)	AS REQ'D	--	--	--
	CONDUIT, IRON, RIGID, GALV. 3/4" MIN. (SERVICE ENTRANCE – ALTERNATE)				

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	FORMATTING	EDM	JKI	--	--	12/07/2020	F						
B	EDITORIAL CHANGES	--	LSM	IPJ	TPM	11/01/2017	E						
A	NO CHANGES-REAFFIRMED	--	JC	TPM	MDJ	08/06/2015	D						

SHEET 2 OF 4	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG205.2
	SDG&E ELECTRIC SERVICE STANDARDS & GUIDES					
	CUSTOMER-OWNED SERVICE & METER POLE TEMPORARY/NON-CLIMBABLE, 0 – 600V					

BILL OF MATERIALS (CONT'D):

ITEM	DESCRIPTION	QUANTITY	STANDARD PAGE	STOCK NUMBER	DESIGN UNITS
6	STRAP, PIPE	AS REQ'D	--	--	--
7	METER	AS REQ'D	--	--	--
8	SAFETY SOCKET CAN WITH BYPASS TEST FACILITIES	AS REQ'D	--	--	--
9	BOXES AND RECEPTACLES, WEATHERPROOF	AS REQ'D	--	--	--
10	SERVICE GROUND	AS REQ'D	--	--	--

NOTES:

- ① THESE ARE MINIMUM REQUIREMENTS FOR ALL TEMPORARY SERVICES. TEMPORARY SERVICE IS FOR A PERIOD OF ONE YEAR, OR LESS.
- ② **POLE LOCATION:**
- MAXIMUM LENGTH OF SERVICE DROP SHALL BE 100 FEET. POLE SHALL BE SET NOT MORE THAN 100 FEET, NOR LESS THAN 10 FEET, FROM THE SURFACE OF SDG&E'S SERVICE POLE AND SO LOCATED THAT ALL REQUIRED SERVICE DROP CLEARANCES WILL BE OBTAINED FROM GROUND, BUILDINGS, STRUCTURES, AND OTHER CONDUCTORS ON SDG&E'S POLE INCLUDING FOREIGN COMMUNICATION AND SUPPLY CONDUCTORS. IT ALSO MUST BE LOCATED WITHIN A 20-FOOT RADIUS FROM A ROAD OR OTHER DRIVABLE SURFACE SO SDG&E CAN CONNECT AND MAINTAIN THE SERVICE DROP FROM A BUCKET TRUCK. IN SELECTING THE POLE LOCATION, CONSIDERATION SHOULD BE GIVEN TO PROVIDING ADEQUATE CLEARANCE IN AREAS WHERE:
 - CONSTRUCTION EQUIPMENT WILL BE OPERATED.
 - CHANGES IN GRADE OF STREETS, DRIVEWAY, AND OTHER LANDS ARE PROPOSED.
 - BUILDINGS OR STRUCTURES ARE PROPOSED TO BE ADDED DURING THE PERIOD OF PERMANENT OR TEMPORARY SERVICE.
 - ADEQUATE CLEARANCE SHALL BE PROVIDED, WHETHER OR NOT SUCH AREAS OF CONFLICT OR OBSTRUCTION ARE ON THE PREMISES SERVED.
 - CONTACT SDG&E AT ANY REGIONAL PROJECT MANAGEMENT OFFICE AND REQUEST AN ELECTRIC METER & SERVICE LOCATION FORM. ③

③ **SERVICE DROP MINIMUM CLEARANCES:****TABLE 1**

SERVICES DROP MINIMUM CLEARANCES	
LOCATION	MIN. CLEARANCE (FT)
AT CENTER OF STREET OR 12'-0" FROM CURB, WHICHEVER IS LESS	18
AT CURB LINE	16
OVER COMMERCIAL OR INDUSTRIAL DRIVEWAYS, PARKING AREAS OR AREAS CAPABLE OF BEING TRAVERSED BY VEHICLES	16
OVER RESIDENTIAL DRIVEWAYS	12 ④
OVER AGRICULTURAL AREAS	15
OVER RAILROADS OR FOR OTHER SPECIAL CONDITIONS	CONSULT YOUR SDG&E PROJECT PLANNER

- ④ MAY BE REDUCED TO 10 FEET IF SELF-SUPPORTING CABLE (SSC) SERVICE. SERVICE DROP CABLE (SSC) SHALL BE USED BY SDG&E. THE TYPE OF CONSTRUCTION USED BY THE CUSTOMER IS THEIR OPTION.
- ⑤ WHERE CLEARANCES CANNOT BE OBTAINED WITH THE 20-FOOT POLE SHOWN, A PERMANENT/CLIMBABLE POLE IS REQUIRED.

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	FORMATTING	EDM	JKI	--	--	12/07/2020	F						
B	EDITORIAL CHANGES	--	LSM	IPJ	TPM	11/01/2017	E						
A	NO CHANGES-REAFFIRMED	--	JC	TPM	MDJ	08/06/2015	D						



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
3 OF 4

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

CUSTOMER-OWNED SERVICE & METER POLE
TEMPORARY/NON-CLIMBABLE, 0 – 600V

SG205.3

NOTES (CONT'D.):

- (VI) ALL CONDUIT FITTINGS MUST BE RAINTIGHT. APPROVED WIRE, NOT LESS THAN NO. 8 AWG, SHALL BE USED IN THE SERVICE ENTRANCE CONDUIT. SEE FIGURE 2 FOR RIGID IRON PROTECTIVE COVERING.
- (VII) FURNISHED & INSTALLED BY SDG&E.
- (VIII) SAFETY SOCKET CAN WITH TEST-BYPASS FACILITIES IS REQUIRED WHEN POLE IS TO BE USED FOR TEMPORARY/ CONSTRUCTION POWER. SERVICE EQUIPMENT AND RECEPTACLES MUST BE RAINTIGHT, PROPERLY RATED FOR THE LOAD TO BE SERVED, AND SHALL BE ADEQUATELY BONDED AND GROUNDED.
- (IX) RECEPTACLES USED TO CONNECT PORTABLE TOOLS SHALL BE 3-POLE TYPE FOR SINGLE-PHASE MOTORS AND 4-POLE TYPE FOR THREE-PHASE MOTORS, ONE CONTACT TO BE USED FOR GROUNDING CONNECTION. WHERE MORE THAN ONE VOLTAGE TYPE IS USED, RECEPTACLES SHALL BE NON-INTERCHANGEABLE.
- XI. PERMIT AND INSPECTION MUST BE OBTAINED FROM THE GOVERNMENTAL AUTHORITY HAVING JURISDICTION (AHJ) BEFORE SERVICE WILL BE CONNECTED AND A METER SET BY SDG&E.
- XII. CONSULT SDG&E FOR SERVICE REQUIREMENTS WHENEVER THREE-PHASE SERVICE IS DESIRED.
- XIII. FLOOD LIGHTS, SIGNS, ROPES AND ANY SIMILAR EQUIPMENT SHALL NOT BE ATTACHED TO SERVICE AND METER POLES.
- XIV. COVERING OF METALLIC CONDUIT WILL NOT BE REQUIRED ON METAL POLES, PROVIDED THE METAL POLE IS EFFECTIVELY GROUNDED AND PROVIDED ALL METALLIC CONDUITS ARE ADEQUATELY BONDED TO THE METAL POLE WITH APPROVED CLAMPS OR CONNECTORS.
- (XV) ALL METER POLES MUST HAVE THE NUMERIC PORTION OF THE STREET ADDRESS FIRMLY ATTACHED AND FACING THE STREET OR DRIVABLE SURFACE. PLASTIC OR METALLIC NUMBERS OF THE TYPE USED FOR HOUSE ADDRESSES ARE ACCEPTABLE.
- XVI. A TELEPHONE AND/OR CABLE TV SERVICE DROP MAY ATTACH TO A METER POLE PROVIDED:
 - a. THE ATTACHMENT IS OUTSIDE THE CLIMBING SPACE,
 - b. A MINIMUM RADIAL CLEARANCE OF 12 INCHES IS MAINTAINED FROM ANY PORTION OF THE DRIP LOOP, AND
 - c. IT MEETS ALL G.O. 95 REQUIREMENTS.
- XVII. REQUIRED WORKING SPACE IN FRONT OF THE METER PANEL: A MINIMUM 3-FOOT BY 3-FOOT CLEAR AND LEVEL WORKING SPACE IS REQUIRED IN FRONT OF THE METER PANEL MEASURED FROM FACE OF PANEL.
- XVIII. TO MAINTAIN SAFE, CLEAR AND LEVEL WORKING SPACE IN FRONT OF NEW OR EXISTING NON-RESIDENTIAL METER AND SERVICE EQUIPMENT, A CONCRETE SLAB IS REQUIRED FOR THE FULL WORKING SPACE. (C)
- (XIX) SELF-SUPPORTING METER POLE SHALL MEET EQUIVALENT STRENGTH REQUIREMENTS.

REFERENCE:

- a. REFER TO OH646 TEMPORARY SERVICE AND METER POLES.
- (b) REFER TO **SG021**.
- (c) REFER TO SG504.5.

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	FORMATTING	EDM	JKI	--	--	12/07/2020	F						
B	EDITORIAL CHANGES	--	LSM	IPJ	TPM	11/01/2017	E						
A	NO CHANGES-REAFFIRMED	--	JC	TPM	MDJ	08/06/2015	D						

X Indicates Latest Revision Completely Revised New Page Information Removed

**SHEET
4 OF 4**

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

**CUSTOMER-OWNED SERVICE & METER POLE
TEMPORARY/NON-CLIMBABLE, 0 – 600V**

SG205.4

SCOPE: THIS SERVICE GUIDE DESCRIBES PERMANENT OR TEMPORARY INSTALLATION OF CUSTOMER-OWNED SERVICE OR METER POLE WITH MULTIPLE METERS.

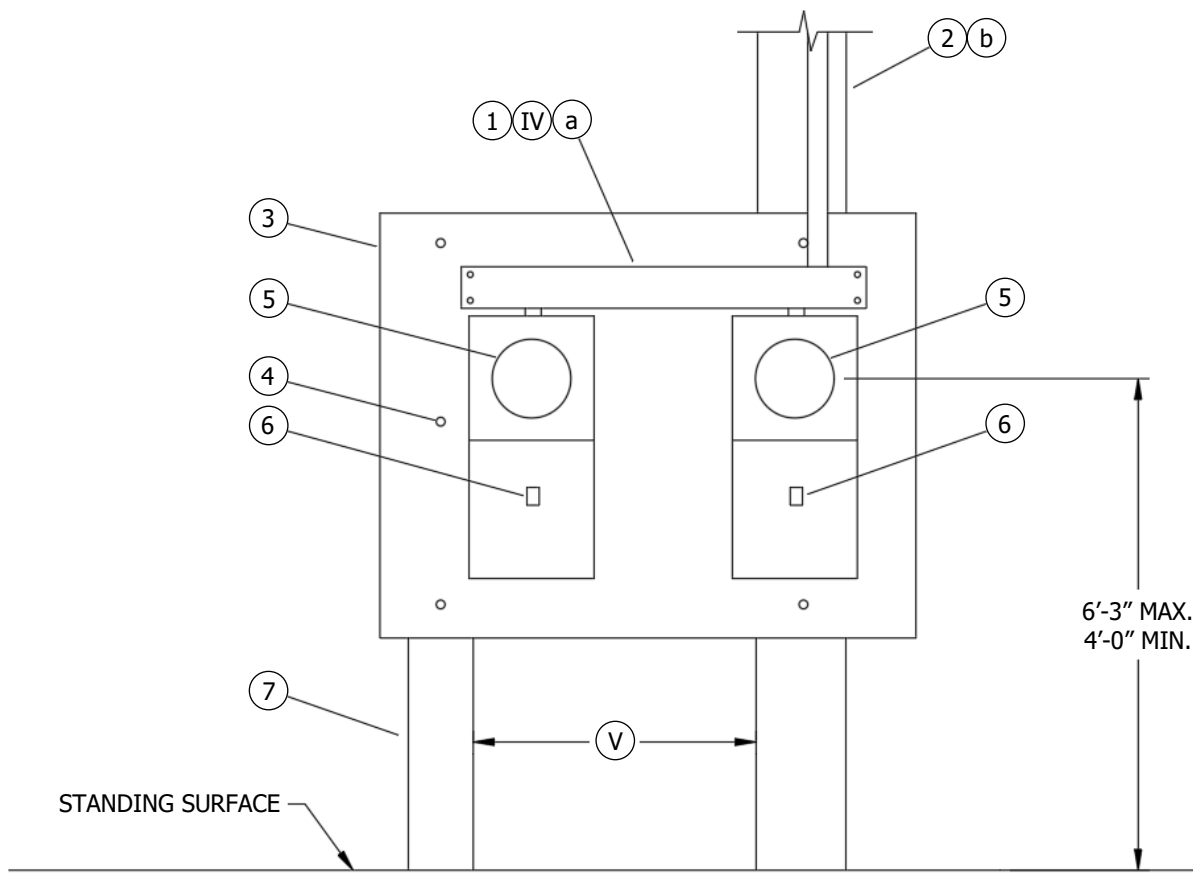


FIGURE 1

INSTALLATION: NONE

BILL OF MATERIALS:

ITEM	DESCRIPTION	QUANTITY	STANDARD PAGE	STOCK NUMBER	DESIGN UNITS
1	LINE GUTTER, SEALABLE	AS REQ'D	--	--	--
2	POLE, SERVICE & METER, APPROVED	AS REQ'D	--	--	--
3	BACKBOARD, PLYWOOD, EXTERIOR GRADE, 3/4" MIN	AS REQ'D	--	--	--
4	THRU BOLT, NUT & BOLT ASSY, 1/2" (TYP)	AS REQ'D	--	--	--
5	METER	AS REQ'D	--	--	--
6	METER SERVICE DISCONNECTS	AS REQ'D	--	--	--
7	TREATED WOOD, 4" X 4"	AS REQ'D	--	--	--

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	FORMATTING	EDM	JKI	--	--	12/07/2020	F						
B	EDITORIAL CHANGES	--	LSM	IPJ	TPM	11/01/2017	E						
A	NO CHANGES-REAFFIRMED	--	JC	TPM	MDJ	08/06/2015	D						

SHEET 1 OF 2	<div><div>X</div><div>Indicates Latest Revision</div></div>	<div><div></div><div>Completely Revised</div></div>	<div><div></div><div>New Page</div></div>	<div><div></div><div>Information Removed</div></div>	SG206.1
	SDG&E ELECTRIC SERVICE STANDARDS & GUIDES				
	CUSTOMER-OWNED SERVICE & METER POLE WITH MULTIPLE METERS PERMANENT OR TEMPORARY INSTALLATION				

NOTES:

- I. A LINE GUTTER IS REQUIRED WHEN SERVING FOUR OR MORE METERS. A SECOND RISER FOR TWO METERS, OR A THIRD RISER FOR THREE METERS, MAY BE INSTALLED IN PLACE OF A LINE GUTTER. VERIFY METHOD OF INSTALLATION WITH THE SDG&E PLANNER AND THE GOVERNMENTAL AUTHORITY HAVING JURISDICTION (AHJ) PRIOR TO START OF CONSTRUCTION.
- II. THIS APPLICATION IS LIMITED TO A SINGLE-PHASE OR THREE-PHASE SERVICE, 600 AMPS MAXIMUM. A MAIN SWITCH IS REQUIRED AHEAD OF MORE THAN 6 METER SERVICE DISCONNECTS. THERE IS NO LIMIT TO THE NUMBER OF METERS THAT CAN BE INSTALLED PER THIS STANDARD.
- III. WHEN THE INSTALLATION IS PERMANENT, NO RISERS, WIRE, OR EQUIPMENT ARE PERMITTED ON THE REAR HALF OF THE METER POLE IN ORDER TO PROVIDE THE LEGALLY REQUIRED CLIMBING SPACE.
- IV. BUS DUCT OR CABLE MAY BE USED FOR SERVICE ENTRANCE CONDUCTORS IN LINE GUTTER.
- V. DISTANCE BETWEEN POLE AND POST AS REQUIRED.

REFERENCE:

- a. REFER TO SG503 FOR SEALING REQUIREMENTS.
- b. REFER TO SG204 OR SG205, WHICHEVER IS APPLICABLE.

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	FORMATTING	EDM	JKI	--	--	12/07/2020	F						
B	EDITORIAL CHANGES	--	LSM	IPJ	TPM	11/01/2017	E						
A	NO CHANGES-REAFFIRMED	--	JC	TPM	MDJ	08/06/2015	D						



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 2

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

CUSTOMER-OWNED SERVICE & METER POLE
WITH MULTIPLE METERS
PERMANENT OR TEMPORARY INSTALLATION

SG206.2

SCOPE: THIS SERVICE GUIDE DESCRIBES THE INSTALLATION OF CUSTOMER OWNED PERMANENT OR TEMPORARY UNDERGROUND SERVICE WITH MULTIPLE METERS.

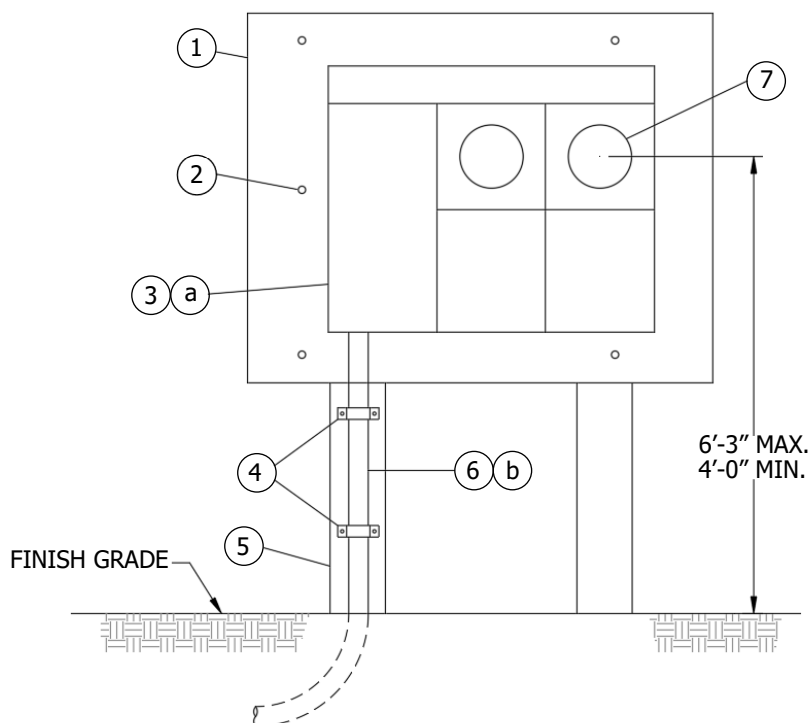


FIGURE 1

INSTALLATION: NONE

BILL OF MATERIALS:

ITEM	DESCRIPTION	QUANTITY	STANDARD PAGE	STOCK NUMBER	DESIGN UNITS
1	PLYWOOD BACKBOARD, EXTERIOR GRADE, 3/4" MIN.	AS REQ'D	--	--	--
2	THRU BOLT, NUT & BOLT ASSY, 1/2" (TYP)	AS REQ'D	--	--	--
3	PULL CAN	AS REQ'D	--	--	--
4	STRAP, PIPE	AS REQ'D	--	--	--
5	WOOD, TREATED, 4" X 4"	AS REQ'D	--	--	--
6	CONDUIT, PVC, SCHEDULE 80	AS REQ'D	--	--	--
7	METER	AS REQ'D	--	--	--

NOTES:

- I. CUSTOMER SHALL FURNISH, INSTALL, OWN AND MAINTAIN AT THEIR EXPENSE:
 - a. POST, TERMINATING AND METER ENCLOSURE, TRENCH, CONDUIT AND CONDUIT RISER TO SDG&E'S EQUIPMENT, OR AS DIRECTED BY THE SDG&E INSPECTOR.
 - b. PROVIDE SHADE MATERIAL AND BACKFILL TO FINISHED GRADE AFTER CONDUIT HAS BEEN INSTALLED, INSPECTED, AND APPROVED BY THE SDG&E INSPECTOR.

REFERENCE:

- (a) REFER TO SECTION 700; **ELECTRIC TERMINATING ENCLOSURES.**
- (b) REFER TO SG309; **UNDERGROUND ELECTRIC SERVICE LATERAL CONDUIT REQUIREMENTS.**

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	FORMATTING	EDM	JK	--	--	12/07/2020	F						
B	EDITORIAL CHANGES	--	LSM	IPJ	TPM	11/01/2017	E						
A	NO CHANGES-REAFFIRMED	--	JC	TPM	MDJ	08/06/2015	D						



Indicates Latest Revision

Completely Revised

New Page

Information Removed

**SHEET
1 OF 1**

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

**CUSTOMER-OWNED SERVICE WITH MULTIPLE METERS FOR
UNDERGROUND PERMANENT OR TEMPORARY INSTALLATION**

SG207.1

SCOPE: THIS SERVICE GUIDE DESCRIBES THE INSTALLATION OF TEMPORARY SERVICE FROM SDG&E HANDHOLES TO CUSTOMER-OWNED SERVICE AND METERS.

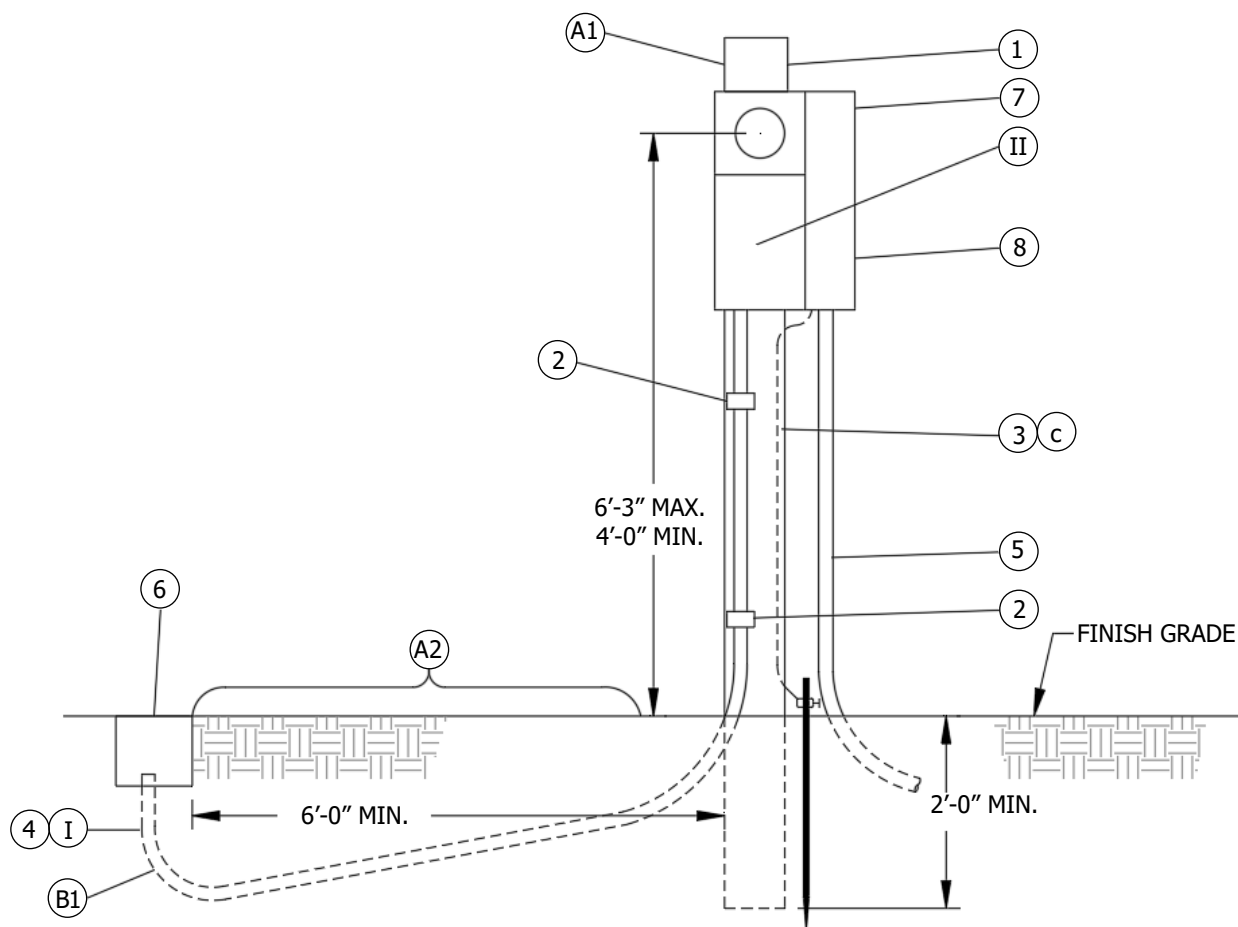


FIGURE 1

INSTALLATION:

A. CUSTOMER SHALL FURNISH, INSTALL, OWN AND MAINTAIN AT THEIR EXPENSE:

- ① POST, TERMINATING AND METER ENCLOSURE, TRENCH, CONDUIT AND CONDUIT RISER TO SDG&E'S SECONDARY HANDHOLE AS ILLUSTRATED ABOVE.
- ② PROVIDE SHADE MATERIAL AND BACKFILL TO FINISHED GRADE AFTER CONDUIT HAS BEEN INSTALLED, INSPECTED AND APPROVED BY SDG&E'S INSPECTOR.

B. SDG&E WILL FURNISH AND INSTALL AT CUSTOMER'S EXPENSE:

- ① SERVICE LATERAL CONDUCTORS FROM CUSTOMER'S METER PANEL ON POST TO SDG&E'S SECONDARY HANDHOLE AND REMOVE SERVICE LATERAL CONDUCTORS AT DISCONTINUANCE OF SERVICE.

C. SERVICE AND METER INSTALLATION SHALL COMPLY WITH LOCAL CODES AND STATE OF CALIFORNIA DIVISION OF INDUSTRIAL SAFETY REGULATIONS, AND SHALL BE SUBJECT TO INSPECTION CLEARANCE BY THE GOVERNMENTAL AUTHORITY HAVING JURISDICTION (AHJ).

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	FORMATTING	EDM	JK	--	--	12/07/2020	F						
B	EDITORIAL CHANGES	--	LSM	IPJ	TPM	11/01/2017	E						
A	EDITORIAL CHANGES	--	JC	BRB	MDJ	08/06/2015	D						



Indicates Latest Revision

Completely Revised

New Page

Information Removed

**SHEET
1 OF 2**

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

TEMPORARY SERVICE FROM SDG&E HANDHOLE TO CUSTOMER-OWNED SERVICE & METER INSTALLATION

SG208.1

BILL OF MATERIALS:

ITEM	DESCRIPTION	QUANTITY	STANDARD PAGE	STOCK NUMBER	DESIGN UNITS
1	POST, 4" X 4" MIN.	AS REQ'D	--	--	--
2	STRAP, PIPE	AS REQ'D	--	--	--
3	SERVICE GROUND	AS REQ'D	--	--	--
4	CONDUIT, BEND AND RISERS	AS REQ'D	--	--	--
5	CONDUCTOR, LOAD, CUSTOMER OWNED	AS REQ'D	--	--	--
6	HANDHOLE, SECONDARY, SDG&E OWNED	AS REQ'D	--	--	--
7	SAFETY SOCKET CAN WITH TEST-BYPASS FACILITIES	AS REQ'D	--	--	--
8	MAIN	AS REQ'D	--	--	--

NOTES:

- I FOR SINGLE-PHASE, 2" CONDUIT WITH 2'-0" MIN. RADIUS REQUIRED. FOR THREE-PHASE, 3" CONDUIT WITH 3'-0" RADIUS REQUIRED. (a)
- II REQUIRED FOR ALL TEMPORARY SERVICE UP TO 200A. (b)
- III. SERVICE METHOD SHOWN IS FOR A MAXIMUM OF 200A. FOR GREATER CAPACITY, CONTACT THE SDG&E PLANNER.
- IV. CONTACT THE PLANNER AT THE NEAREST SDG&E REGIONAL PROJECT MANAGEMENT OFFICE FOR AN ELECTRIC METER AND SERVICE LOCATION FORM AND NEGOTIATION OF TEMPORARY SERVICE CHARGES. (d)
- V. WHERE THE CUSTOMER PROPOSES TO EXTEND TEMPORARY OVERHEAD CONDUCTORS VIA CUSTOMER-OWNED LINES, A 6" X 6" X 20'-0" MINIMUM SELF-SUPPORTING POLE SHALL BE SUBSTITUTED FOR THE 4" X 4" MINIMUM POST SHOWN.

REFERENCE:

- (a) REFER TO SG309 NOTE C.
- (b) REFER TO SG210 FOR TSPB AND SG513.1 FOR TSPB EXCEPTION.
- (c) SERVICE GROUND TO COMPLY WITH CALIFORNIA ELECTRICAL CODE.
- (d) REFER TO **SG021**.

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	FORMATTING	EDM	JKI	--	--	12/07/2020	F						
B	EDITORIAL CHANGES	--	LSM	IPJ	TPM	11/01/2017	E						
A	EDITORIAL CHANGES	--	JC	BRB	MDJ	8/06/2015	D						



Indicates Latest Revision

Completely Revised

New Page


Information Removed

SHEET
2 OF 2

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

TEMPORARY SERVICE FROM SDG&E HANDHOLE TO CUSTOMER-OWNED SERVICE & METER INSTALLATION

SG208.2

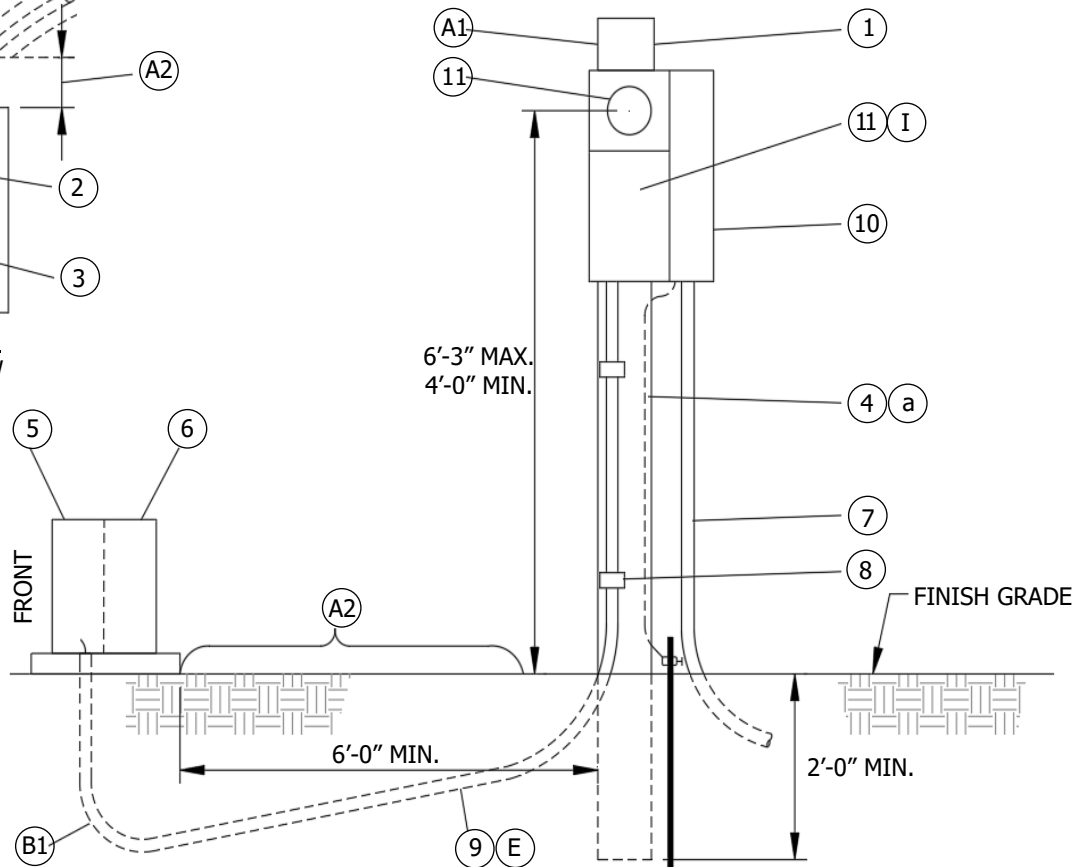

- Ⓓ ALTERNATE DIRECTION OF SERVICE TRENCH. TERMINATE TRENCH AT LOCATION THAT WILL PERMIT SERVICE TO ENTER SIDE OF SECONDARY COMPARTMENT.
- Ⓔ 24-INCH MINIMUM RADIUS BEND REQUIRED.

BILL OF MATERIALS:

ITEM	DESCRIPTION	QUANTITY	STANDARD PAGE	STOCK NUMBER	DESIGN UNITS
1	POST, 4" X 4" MIN.	AS REQ'D	--	--	--
2	DEADFRONT SINGLE-PHASE PADMOUNT TRANSFORMER SECONDARY AREA	AS REQ'D	--	--	--
3	LIVEFRONT OR THREE-PHASE PADMOUNT TRANSFORMER SECONDARY AREA	AS REQ'D	--	--	--
4	SERVICE GROUND	AS REQ'D	--	--	--
5	COMPARTMENT, SECONDARY	AS REQ'D	--	--	--
6	PADMOUNT TRANSFORMER OR POLE, SDG&E-OWNED	AS REQ'D	--	--	--
7	CONDUCTOR, LOAD, CUSTOMER-OWNED	AS REQ'D	--	--	--
8	STRAP, PIPE	AS REQ'D	--	--	--
9	CONDUIT, 2", BEND AND RISER	AS REQ'D	--	--	--
10	MAIN	1	--	--	--
11	SAFETY SOCKET CAN WITH TEST BY-PASS FACILITIES	AS REQ'D	--	--	--

NOTES:

- Ⓘ SAFETY SOCKET CAN WITH TEST BY-PASS FACILITIES REQUIRED FOR ALL TEMPORARY SERVICES.
- II. THE SERVICE METHOD SHOWN IS FOR A MAXIMUM OF 200 AMPS. FOR GREATER CAPACITY, CONTACT THE SDG&E PLANNER.
- III. WHERE THE CUSTOMER PROPOSES TO EXTEND TEMPORARY OVERHEAD CONDUCTORS VIA CUSTOMER-OWNED LINES, A 6-INCH X 6-INCH X 20-FOOT MINIMUM SELF-SUPPORTING POLE SHALL BE SUBSTITUTED FOR THE 4-INCH X 4-INCH MINIMUM POST SHOWN.
- IV. CONTACT THE PLANNER AT THE NEAREST SDG&E REGIONAL PROJECT MANAGEMENT OFFICE FOR AN ELECTRIC METER AND SERVICE LOCATION FORM AND NEGOTIATION OF TEMPORARY SERVICE CHARGES. ⓑ

REFERENCE:

- ⓐ SERVICE GROUND TO COMPLY WITH CALIFORNIA ELECTRICAL CODE.
- ⓑ REFER TO **SG021**.
- c. WHEN SERVICE IS PROVIDED FROM AN OVERHEAD POLE, SEE **SG315** FOR CABLE POLE RISER INSTALLATION.

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	FORMATTING	EDM	JIK	--	--	12/07/2020	F						
B	EDITORIAL CHANGES	--	LSM	IPJ	TPM	11/01/2017	E						
A	EDITORIAL CHANGES	--	JC	BRB	MDJ	08/06/2015	D						



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

**SHEET
2 OF 2**

**TEMPORARY SERVICE FROM SDG&E POLE OR PADMOUNT
TRANSFORMER TO CUSTOMER-OWNED SERVICE & METER
INSTALLATION**

SG209.2

SCOPE: THIS STANDARD DESCRIBES THE INSTALLATION OF TEMPORARY SERVICE TO PERMANENT SERVICE & METERING EQUIPMENT (TSPB).

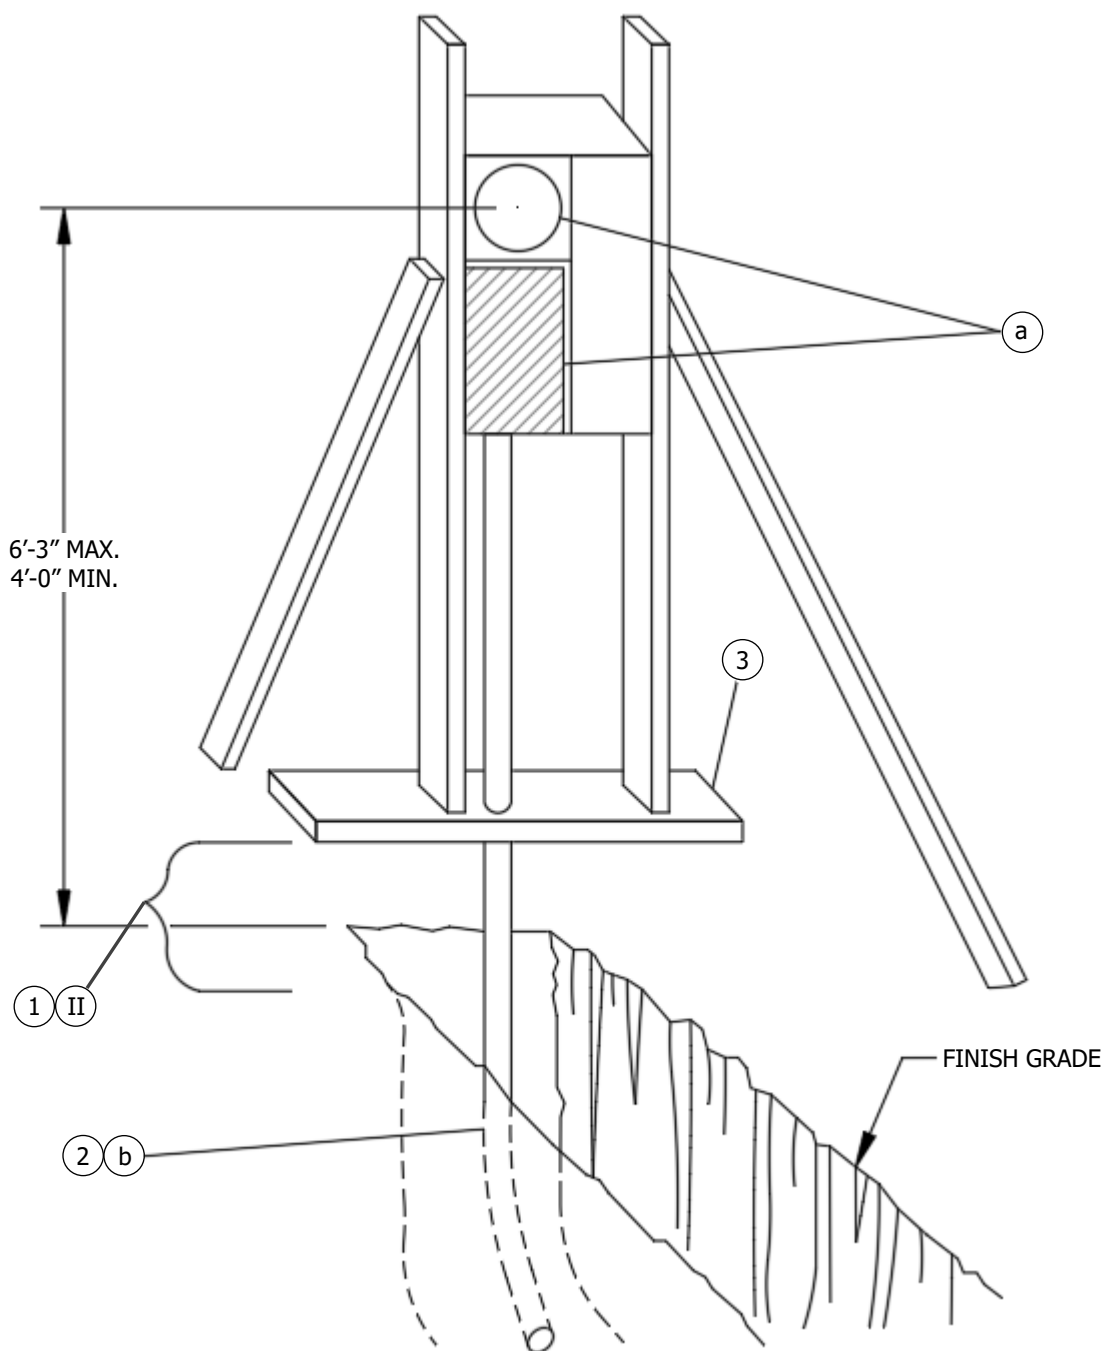


FIGURE 1
TSPB (TEMPORARY SERVICE PERMANENT BASE)

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	FORMATTING	EDM	JKI	--	--	12/07/2020	F						
B	EDITORIAL CHANGES	--	LSM	IPJ	TPM	11/01/2017	E						
A	NO CHANGES-REAFFIRMED	--	JC	BRB	MDJ	08/06/2015	D						



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 2

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES
TEMPORARY SERVICE TO PERMANENT
SERVICE & METERING EQUIPMENT (TSPB)

SG210.1

INSTALLATION:

- A. FOUNDATION TO BE INSTALLED PRIOR TO SERVICE CONNECTION AND METER SET.
- B. THE TERMINATING ENCLOSURE SHALL BE MOUNTED ON PERMANENT STUDDING OR ON TEMPORARY 2" X 4" SUPPORTING STRUCTURE. BRACES SHOWN, AND ANY ADDITIONAL BRACES, SHALL BE PROVIDED AS NECESSARY TO SUBSTANTIALLY SUPPORT THE PERMANENT FACILITIES. SERVICE CONNECTION AND METER SET IS SUBJECT TO THE AHJ'S (AUTHORITIES HAVING JURISDICTION) AND SDG&E'S APPROVAL OF THE SUITABILITY OF THE SUPPORTING STRUCTURE AND BRACING.
- C. SERVICE LATERAL CONDUIT TO BE CONNECTED TO TERMINATING ENCLOSURE WITH HUB OR SUPPORTED WITH REINFORCEMENT PLATE TO PREVENT BREAK AWAY OF KNOCKOUT RINGS.
- D. BONDING AND GROUNDING PROVISIONS SHALL BE INSTALLED PRIOR TO INSTALLATION OF UNDERGROUND SERVICE LATERAL CONDUCTORS. (c)

BILL OF MATERIALS:

ITEM	DESCRIPTION	QUANTITY	STANDARD PAGE	STOCK NUMBER	DESIGN UNITS
1	FOUNDATION AREA	AS REQ'D	--	--	--
2	CONDUIT, SERVICE, PERMANENT	AS REQ'D	--	--	--
3	SILL	AS REQ'D	--	--	--

NOTES:

- I. RESIDENTIAL METER PANEL IS ACCEPTABLE FOR USE IN TSPB APPLICATIONS.
- (II) VARIABLE FOUNDATION DETAILS NOT SHOWN.
- III. THIS INSTALLATION IS SUBJECT TO THE APPROVAL OF THE GOVERNMENTAL AUTHORITY HAVING JURISDICTION (AHJ).
- IV. TEMPORARY SERVICE SUPPLIED IN ACCORDANCE WITH THIS STANDARD IS SUBJECT TO THE CONTINUING APPROVAL OF THE AHJ THROUGHOUT THE BUILDING CONSTRUCTION PERIOD.
- V. USE OF THIS SERVICE IS NOT INTENDED FOR DWELLING OR COMMERCIAL PURPOSES PRIOR TO FINAL INSPECTION CLEARANCE. SERVICE IS SUBJECT TO DISCONNECTION AND METER REMOVAL IF USED FOR OTHER THAN TEMPORARY CONSTRUCTION POWER.
- VI. THE UTILITY WILL FURNISH AND INSTALL THE SERVICE LATERAL CONDUCTORS AND CONNECT DIRECTLY TO THE LANDING LUGS.
- VII. CONTACT THE PLANNER AT THE NEAREST SDG&E REGIONAL PROJECT MANAGEMENT OFFICE TO THE JOB LOCATION FOR AN ELECTRIC METER AND SERVICE LOCATION FORM. (d)
- VIII. TEMPORARY SERVICE ON A PERMANENT BASE (TSPB) IS NOT PERMITTED WHEN THE METER PANEL IS TO BE LOCATED IN A METER CABINET, METER ROOM OR NON-RESIDENTIAL INSTALLATIONS.

REFERENCE:

- (a) SEE SECTION 500 FOR APPROVED COMBINATION PULL AND METER CANS.
- (b) REFER TO SG309 FOR CUSTOMER-OWNED RIGID SERVICE CONDUIT REQUIREMENTS.
- (c) REFER TO CALIFORNIA ELECTRICAL CODE.
- (d) SEE **SG021**.
- e. FOR TRENCH INFORMATION, SEE UG3370 FOR SAN DIEGO COUNTY AND UG3371 FOR ORANGE COUNTY.

© 1998 - 2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	FORMATTING	EDM	JKI	--	--	12/07/2020	F						
B	EDITORIAL CHANGES	--	LSM	IPJ	TPM	11/01/2017	E						
A	NO CHANGES-REAFFIRMED	--	JC	BRB	MDJ	08/06/2015	D						



Indicates Latest Revision

Completely Revised

New Page

Information Removed

**SHEET
2 OF 2**

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

**TEMPORARY SERVICE TO PERMANENT
SERVICE & METERING EQUIPMENT (TSPB)**

SG210.2

**300 - UNDERGROUND
ELECTRIC SERVICE**

**300 - UNDERGROUND
ELECTRIC SERVICE**

PAGE**SUBJECT**

302.1 – 302.2	ALPHABETICAL SUBJECT INDEX
303	CUSTOMER & UTILITY RESPONSIBILITIES FOR UNDERGROUND INSTALLATION TO REPLACE OVERHEAD ELECTRIC SERVICE
304.1 – 304.2	ACCEPTABLE METHODS FOR RESIDENTIAL ELECTRIC SERVICE CONVERSION
305.1 – 305.2	OVERHEAD TO UNDERGROUND SERVICE CONVERSION – CONTRACTOR & SDG&E CREW COORDINATION METHODS
306	FIELD HEATING SERVICE LATERAL CONDUITS
307	SAFETY OVERFLOW FITTING FOR INDOOR USE ONLY ON WALL-MOUNTED SERVICE EQUIPMENT
309.1 – 309.3	UNDERGROUND ELECTRIC SERVICE LATERAL CONDUIT REQUIREMENTS
310.1 – 310.2	UNDERGROUND SERVICE FROM OVERHEAD FACILITIES (LOW VOLTAGE)
311.1 – 311.2	PRIMARY & SECONDARY VOLTAGE UNDERGROUND SYSTEM ON CUSTOMER PREMISES FROM CABLE POLE
312.1 – 312.2	CUSTOMER-OWNED CONDUIT BEND & RISER AT BUILDING
313.1 – 313.2	STANDARD JOINT CABLE POLE RISER POSITION USING LADDER ARM BRACKET & SINGLE RISER
314.1 – 314.3	CABLE POLE QUADRANT & RISER IDENTIFICATION
315.1 – 315.5	UNDERGROUND ELECTRIC CABLE POLE RISER INSTALLATION
316	UNDERGROUND ELECTRIC SERVICE LATERAL GASOLINE DISPENSING & SERVICE STATIONS
317.1 – 317.2	UNDERGROUND ELECTRIC SERVICE LATERAL & METER PANELS IN PROXIMITY TO PROPANE TANKS
318	UNDERGROUND ELECTRIC SERVICE NEAR GASOLINE DISPENSING EQUIPMENT & PROPANE TANKS
319	UNDERGROUND ELECTRIC SERVICE LATERAL FROM LEACH FIELDS
320	EXISTING SIDA SERVICE FOR PANEL REWIRES, UPGRADES, AND RELOCATIONS

© 1998 - 2021 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	DR	BY	DSN	APV	DATE	REV	CHANGE	DR	BY	DSN	APV	DATE
C	SG308 MOVED TO FMO	EDM	JKI	IPJ	CZH	02/08/2021	F						
B	ADDED SG 320	--	CSE	IPJ	CZH	04/13/2020	E						
A	NEW PAGE	--	LSM	LSM	TPM	11/01/2017	D						

**SHEET
1 OF 1**

 Indicates Latest Revision

 Completely Revised

 New Page



 Information Removed

SDG&E ELECTRIC SERVICE STANDARDS & GUIDES

**UNDERGROUND ELECTRIC SERVICE
TABLE OF CONTENTS**

SG301.1

SUBJECTPAGE #

Acceptable Methods for Residential Electric Service Conversion.....	SG 304.1 – 304.2
Cable Pole Quadrant & Riser Identification.....	SG 314.1 – 314.3
Cable Pole Riser Installation.....	SG 315.1 – 315.5
Cable Pole Riser Position Using Ladder Arm Bracket & Single Riser.....	SG 313.1 – 313.2
Conduit Bend & Riser at Building, Customer-Owned	SG 312.1 – 312.2
Conduit Sealing.....	SG 308.1 – 308.2
Conduit, Safety Overflow Fitting.....	SG 307
Conversions	SG 303, SG 304.1 – 304.2, SG 305.1 – 305.2
Customer & Utility Responsibilities for Underground Installation to Replace Overhead Electric Service	SG 303
Customer-Owned Conduit Bend & Riser at Building	SG 312.1 – 312.2
Field Heating Service Lateral Conduits	SG 306
Gasoline Dispensing & Service Stations, Underground Electric Service Lateral Clearances ..	SG 316, SG 318
Leach Fields, Underground Electric Service Lateral Clearances	SG 319
Overhead to Underground Service Conversion Contractor & SDG&E Crew Coordination Methods	SG 305.1 – 305.2
Primary and Secondary Voltage Underground System on Customer Premises from Cable Pole	SG 311.1 – 311.2
Propane Tanks, Underground Electric Service Lateral & Meter Panel Clearances.....	SG 317.1 – 317.2, SG 318
Residential Electric Service Conversion	SG 304.1 – 304.2
Safety Overflow Fitting for Indoor Use Only on Wall-Mounted Service Equipment.....	SG 307
Standard Joint Cable Pole Riser Position Using Ladder Arm Bracket & Single Riser	SG 313.1 – 313.2
Underground Electric Cable Pole Riser Installation.....	SG 315.1 – 315.5
Underground Electric Service Lateral & Meter Panels In Proximity to Propane Tanks	SG 317.1 – 317.2
Underground Electric Service Lateral from Leach Fields	SG 319

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 2	Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	New Page	Information Removed	SG 302.1
	SDG&E SERVICE STANDARDS & GUIDE				
	UNDERGROUND ELECTRIC SERVICE ALPHABETICAL SUBJECT INDEX				

SUBJECTPAGE #


Underground Electric Service Lateral Gasoline Dispensing & Service Stations	SG 316
Underground Electric Service Lateral Residential or Commercial.....	SG 309.1 – 309.3
Underground Electric Service Near Gasoline Dispensing Equipment & Propane Tanks.....	SG 318
Underground Primary System from Cable Pole to Padmount Transformer	SG 311.1 – 311.2
Underground Service from Overhead Facilities (Low Voltage)	SG 310.1 – 310.2

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 2	<div>Indicates Latest Revision</div>	<div>X Completely Revised</div>	<div>New Page</div>	<div>Information Removed</div>	SG 302.2
	SDG&E SERVICE STANDARDS & GUIDE				
	UNDERGROUND ELECTRIC SERVICE ALPHABETICAL SUBJECT INDEX				

Special Instructions: Contact the Service Planner at the Regional Project Management Office closest to the project location for an "Electric Meter & Service Location" form before starting construction.
(See page SG 2.)

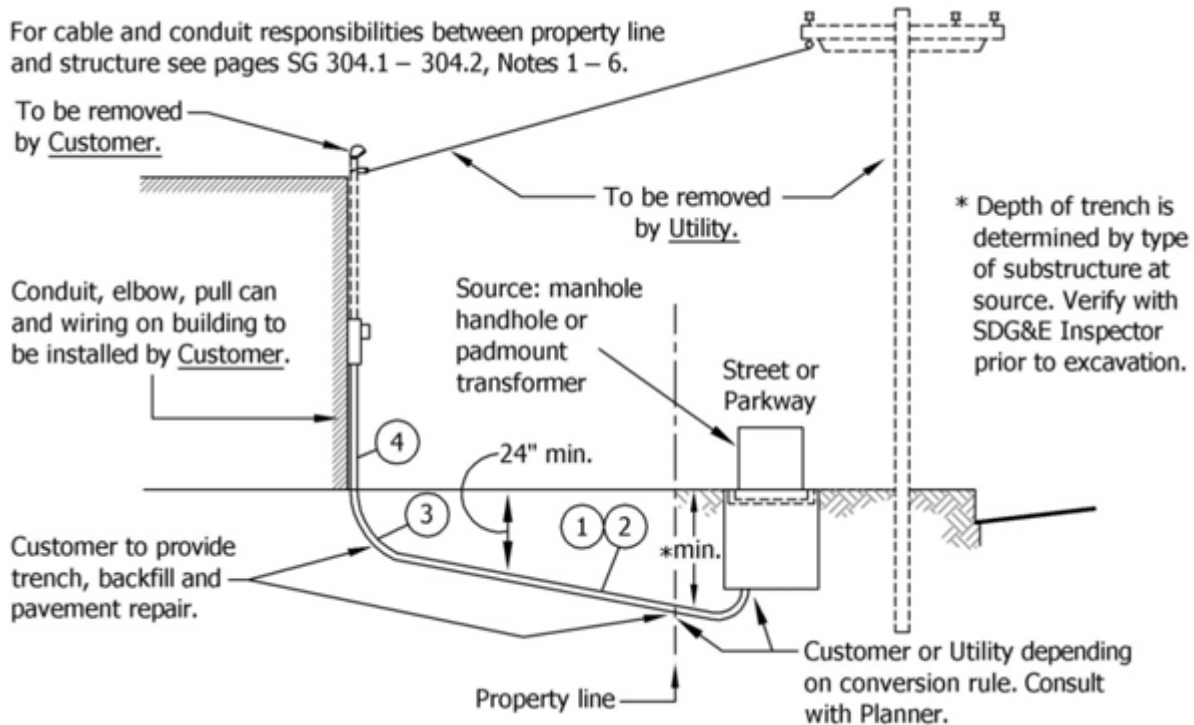

Customer to furnish, install, own and maintain:

- ① Conduit size and number of conduit runs to be designed by SDG&E. Conduit manufacturer must be SDG&E-approved.
- ② Trench per SDG&E standards. Backfill shall be compacted in accordance with SDG&E and local governmental requirements.

Conduit Riser Bend Size	Minimum Bending Radius
2"	24"
3"	36"
4"	36"
5"	36"

- ③ Conduit riser bends size and minimum bending radius shown in table above. Minimum schedule 40 PVC required. **DO NOT CUT BENDS.**
- ④ Type & Schedule of conduit per the Building Inspector's requirements. Normally, schedule 40 PVC is allowed inside the building wall, and schedule 80 PVC is required when exposed on an exterior wall. Consult with the appropriate Building Inspector. Flex conduit is not permitted. See page SG 306 for field heating service lateral conduit.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

New Page

Information Removed

SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

**CUSTOMER & UTILITY RESPONSIBILITIES
FOR UNDERGROUND INSTALLATION TO
REPLACE OVERHEAD ELECTRIC SERVICE**

SG 303

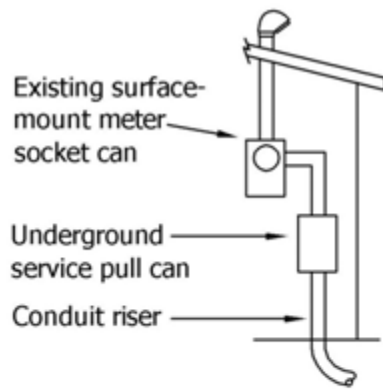


FIGURE 1
RISER

Conduit riser size
based on service
equipment ampacity.
(2" min.)

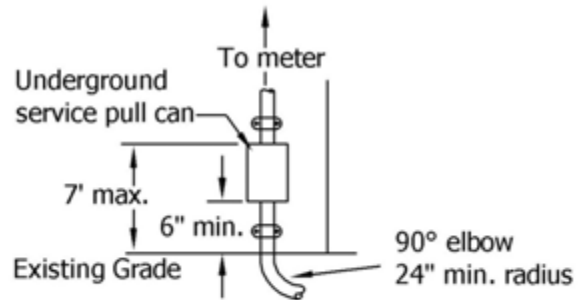


FIGURE 2
RISER AND PULL CAN DETAIL (See Note 6.)

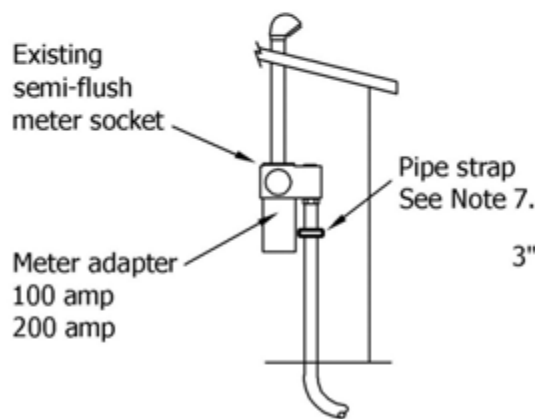


FIGURE 3
METER ADAPTER

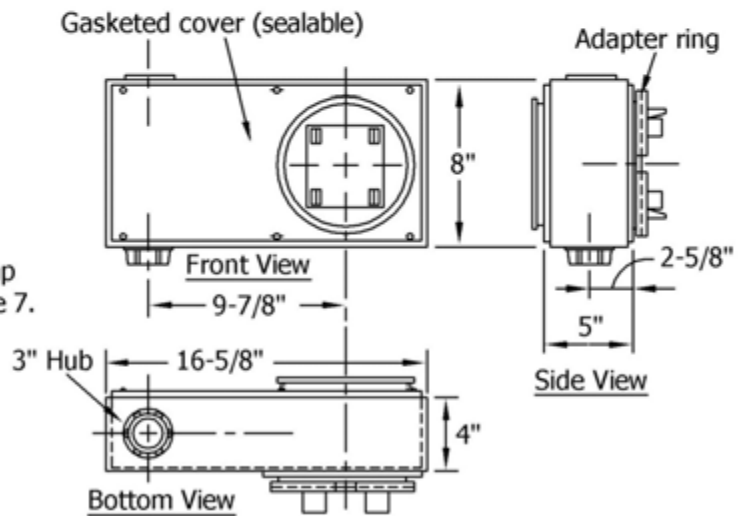


FIGURE 4
METER ADAPTER DETAIL

Notes:

1. The customer will provide a suitable trench from the conduit riser to the property line, or source. Consult with a Planner. See Underground Standard pages UG 3370.1 – 3370.6 (San Diego County) or UG 3371.1 – 3371.5 (Orange County) for trench and Utility positioning details.
2. The customer will provide and install a suitable conduit from the elbow to the property line, or source. Consult with a Planner.
3. The customer will provide and install all equipment needed to modify the service entrance when changing from overhead to underground service. The customer will also remove all their existing service equipment no longer required upon completion of service conversion to underground.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

New Page

Information Removed

SHEET
1 OF 2

SDG&E SERVICE STANDARDS & GUIDE

**ACCEPTABLE METHODS FOR RESIDENTIAL
ELECTRIC SERVICE CONVERSION**

SG 304.1

4. SDG&E (Utility) will furnish and install UG service lateral conductors and make connections at the service pull can.
5. The meter adapter shown in Figure 3 is approved for single-meter residential equipment installations only. Multiple meter conversions will require use of a line gutter or multiple meter service equipment.
6. If service entrance conductors are energized, the contractor is responsible to identify as energized or "hot".
7. Meter adapter installations require the riser to be secured to the wall with a heavy duty two-hole pipe strap placed 3" below bottom of meter adapter with $\frac{3}{8}$ " x 3" lag screws into plate. $\frac{1}{4}$ " toggle bolts may be used in lieu of lag screws. A Zamac nail head $\frac{1}{4}$ " x 1.875" (mushroom) may be used in place of a lag screw when attaching it to a cinder block or concrete wall. Install cross-bracing (unistrut) as required to fit to wall studs. Tighten the pipe strap firmly over the riser to secure it from shifting downward as the trench settles over time.
8. An inspection and release from the governmental Authority Having Jurisdiction (AHJ) is not required for installation of a meter adapter. When the meter adapter is installed, the electrical contractor must reroute the existing neutral conductor into the meter adapter and connect to the neutral lug supplied by the manufacturer. The Utility's service crew will check the neutral connections in the new meter adapter and in the existing service equipment for tightness.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

New Page

Information Removed

SHEET
2 OF 2

SDG&E SERVICE STANDARDS & GUIDE

ACCEPTABLE METHODS FOR RESIDENTIAL ELECTRIC SERVICE CONVERSION

SG 304.2

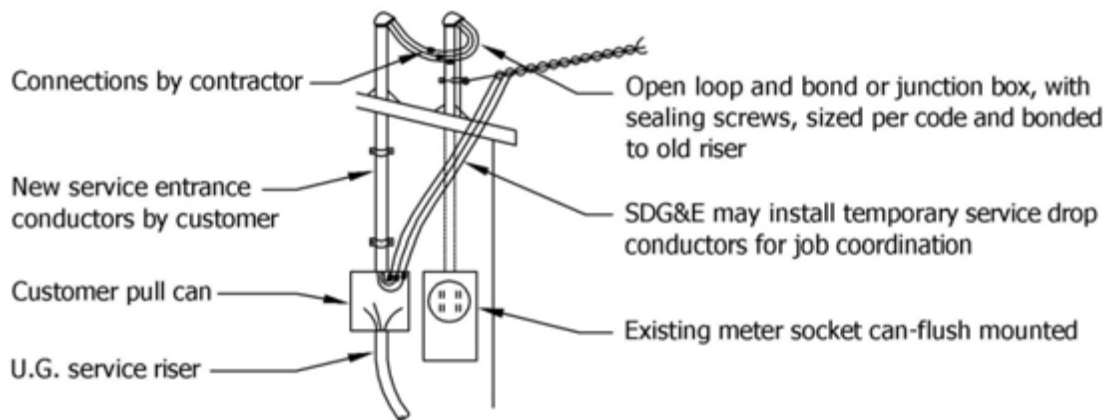


FIGURE 1

Junction Box Connection:

1. The contractor completes installation of UG pull can, UG riser, riser, conduit, junction box, wire from junction box to pull can, and connects temporary jumpers to service drop and landing lugs. If the service entrance conductors are energized, the contractor is to identify them as energized or "hot".
2. SDG&E (Utility) installs new UG service lateral conductors to the pull can. On inspection, the Utility removes temporary jumpers and the OH service drop, connects wires in the pull can, seals the pull can and junction box, and resets or reseals the meter as required.

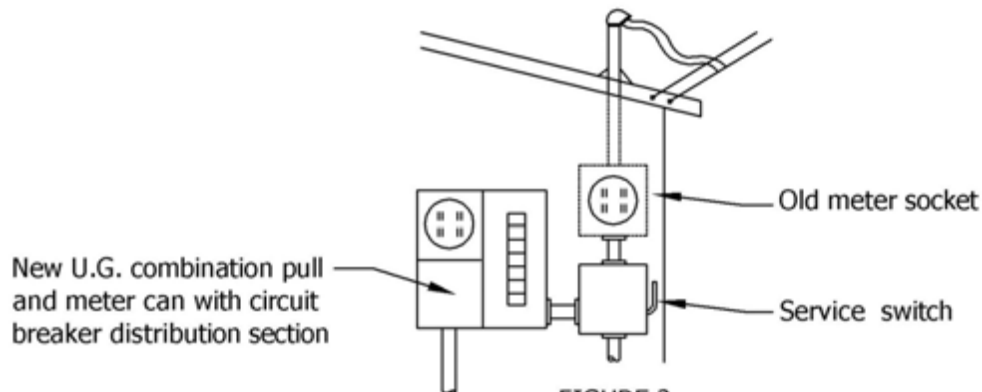


FIGURE 2

Old 2-Wire Meter Connection:

1. The contractor installs the new meter panel, UG riser, wire and nipple from the breaker panel to the service switch. The new circuit breaker is to be locked or taped in the off position.
2. The Utility will install UG service lateral conductors. On inspection and release by the governmental Authority Having Jurisdiction (AHJ), the Utility disconnects the OH service at the weatherhead, connects new conductors to those on the load-side of service switch, connects the new UG service, and sets the meter.
3. The contractor is to follow up with the removal of the service conduit, meter base, service switch-blades, etc.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SDG&E SERVICE STANDARDS & GUIDE

SHEET
1 OF 2

**OVERHEAD TO UNDERGROUND SERVICE
CONVERSION – CONTRACTOR & SDG&E
CREW COORDINATION METHODS**

SG 305.1

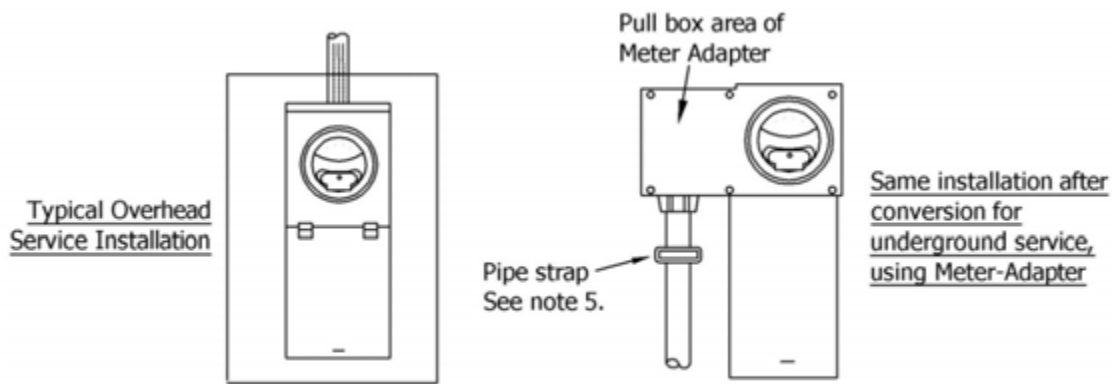


FIGURE 3

Meter Adapter Connection:

1. The meter adapter may be installed either for left or right hand feed by simply reversing the direction of insertion into the existing meter socket.
2. On request, permission is granted by the Planner for the contractor to break the meter seal, pull meter and insert in the adapter. The meter adapter is bussed through so the unit may be inserted into the existing meter socket, the screw type sealing ring furnished with the unit installed in the groove of the adapter ring and over the existing socket ring, and when securely in place, the existing meter inserted in the adapter will operate correctly still connected to the overhead service. See Note 8 on page SG 304.2.
3. After the contractor installs the underground service lateral conduit and trench, and the Utility's Inspector approves, a joint meet will be scheduled and the following work is to be performed:
Utility Crew will: Pull the meter and install service lateral conductors into the pull box of the meter adapter. Cut overhead service at the drip loop. Swing the meter adapter out from the meter socket.
Contractor will: Pull enough neutral service entrance conductor down from the service conduit riser to reach through the slot in the meter socket to the neutral lug landing in the pull box of the meter adapter (approximately 18"). Remove the phase wires from the existing meter socket line terminals.
Utility Crew will: Re-insert the meter adapter into the existing meter socket (feeding the neutral conductor through the slot in the adapter ring).
Contractor will: Connect the neutral conductor to the neutral terminal in the pull box of the meter adapter.
Utility Crew will: Connect the underground phase wires to the upper terminals of the meter adapter socket. (No connection is made to the lower terminals). Insert the meter in the meter adapter and energize underground service. Reseal the meter and seal the meter adapter.
4. The conversion is completed with the Utility's removal of the overhead service drop and the contractor's removal of the overhead service entrance conductors and conduit riser.
5. The meter adapter installations require the riser to be secured to the wall with a heavy duty two-hole pipe strap placed 3" below the bottom of the meter adapter with $\frac{3}{8}$ " x 3" lag screws into the plate. $\frac{1}{4}$ " toggle bolts may be used in lieu of lag screws. A Zanic nail head $\frac{1}{4}$ " x 1.875" (mushroom) may be used in place of a lag screw when attaching it to a cinder block or concrete walls. Install cross-bracing (unistrut) as required to fit to the wall studs. Tighten the pipe strap firmly over the riser to secure it from shifting downward as the trench settles over time.


© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 2	X Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 305.2
	SDG&E SERVICE STANDARDS & GUIDE				
	OVERHEAD TO UNDERGROUND SERVICE CONVERSION – CONTRACTOR & SDG&E CREW COORDINATION METHODS				

SCOPE: This standard provides the requirements and conditions allowing field heating of service lateral conduits installed above grade only.

This standard provides a means to avoid excavating into an existing building footing when converting existing overhead services to underground (see Figure 1). It also applies to existing or new services when a horizontal offset is required due to field conditions (see Figure 2). This standard is not intended to correct poor workmanship. Care should be taken to install service equipment in a manner allowing the service lateral conduit riser to exit the ground and run straight up into the terminating enclosure except where pre-existing field conditions exist.

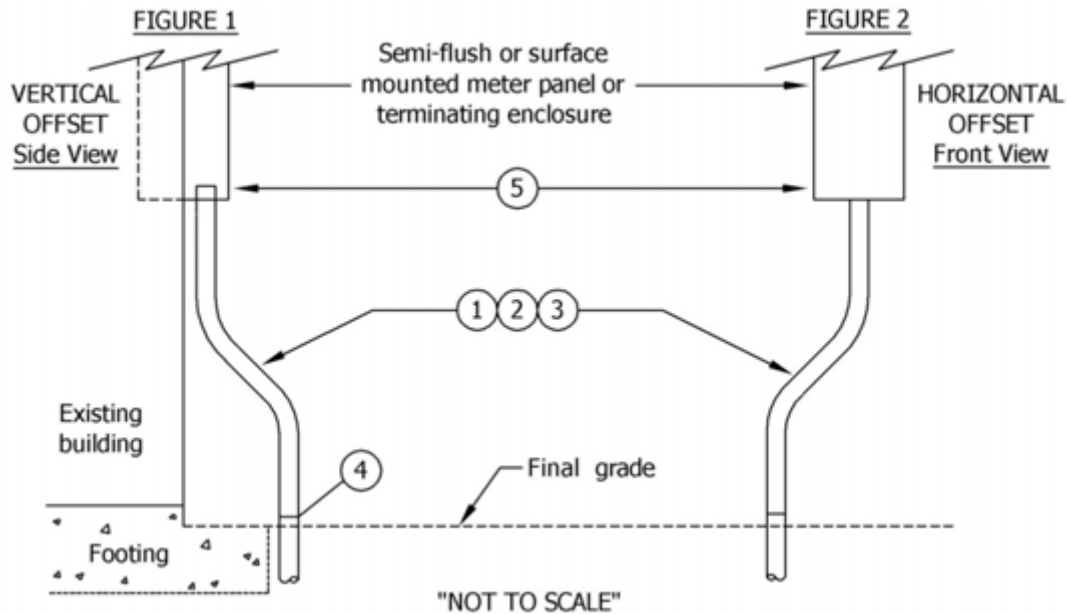

Installation:

- ① This standard applies to 2", 3" and 4" conduit sizes only.
- ② Only manufacturer's recognized field conduit heating equipment shall be used. Degradation of the conduit's shape, wrinkles, discoloration, burn marks, or paint is not allowed. SDG&E's Inspector will determine if the heated conduit is acceptable.
- ③ 45 degrees is the maximum allowable deflection on the riser. The deflection in the riser is included in the maximum 270 degree total deflection in the service lateral conduit run. Refer to page SG 309.3, Installation item B, for additional information.
- ④ When converting an existing service to underground, mandrel new conduit to the top of the elbow extending to grade prior to connecting the riser conduit. Allow enough pull rope to extend through the riser, with a minimum 12" tail to be left in the terminating enclosure.
- ⑤ New services require mandreling of all new conduits, including the conduit riser.

Reference UG 3950.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed


SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

FIELD HEATING SERVICE LATERAL CONDUITS

SG 306

This standard provides instructions for installing a safety overflow fitting for flush or semi-flush mounted service equipment where the SDG&E source is at a higher elevation than the service equipment. This fitting is recommended, but not required by SDG&E. The purpose of installing this device is that it may help prevent water entry into the service equipment. This fitting is for indoor use only.

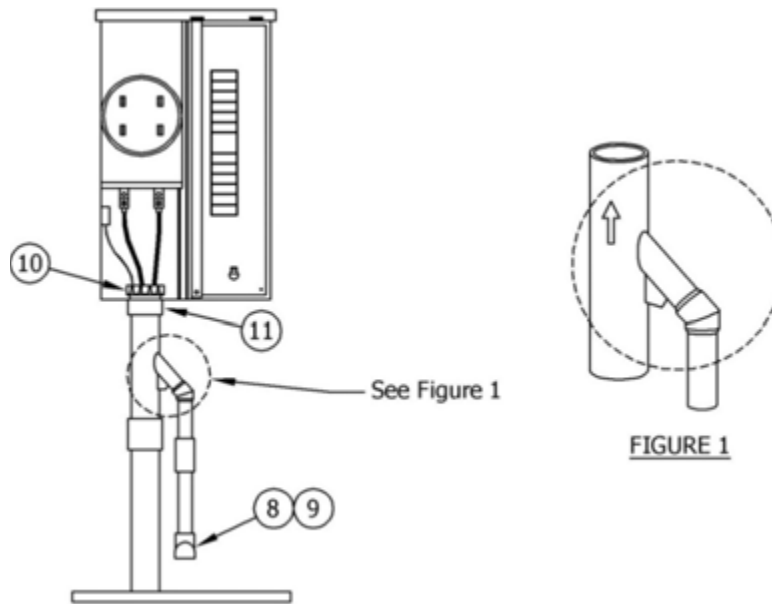

Installation:

1. This fitting is for conduits installed inside building walls only. Use listed electrical rigid PVC Schedule 40 conduit and fittings for extending the drain fitting outside the wall or foundation. It is the installer's responsibility to comply with all applicable building and electrical codes.
2. Assemble the drain by means of cement that is, or contains, a solvent for polyvinyl chloride.
3. Ensure the arrow on the 2' fitting is pointing "up" when installing. Do not cut or modify the safety overflow fitting.
4. Clean the safety overflow fitting approximately 2" from each end thoroughly with cleaning fluid. Let the fitting dry completely.
5. The drain must be fully inserted into the body and extended in the downward position.
6. After using the cement solvent, make a quarter turn and then let dry completely.
7. Repeat the cleaning and gluing process at each joint.
- ⑧ Extend the 1" fitting until it is outside the wall or foundation at least 1-½" to 2".
- ⑨ After extending the conduit outside the wall or foundation, install a 90-degree elbow pointing down and a minimum of 18" above ground. Install a mesh screen to prevent dirt or insects from entering conduit. Do not connect the 1" fitting to any outside water drains.
- ⑩ Use the proper end coupling and locking nut inside the cable termination can.
- ⑪ SDG&E crew will seal the service lateral conduit in the terminating enclosure.
12. Refer to pages 3960 – 3960.2 in the Underground Standards section of this manual for requirements relating to elevation of customer facilities and water entry prevention.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

**SAFETY OVERFLOW FITTING FOR INDOOR USE ONLY
ON WALL-MOUNTED SERVICE EQUIPMENT**

SG 307

This standard provides requirements for customer-installed conduit and additional requirements for a residential or commercial service lateral.


TABLE 1

Customer-Installed Service Equipment or Bus Ampacity (B)	Customer-Installed Service Riser Bend & Service Lateral Conduit Size For 3 or 4-Wire Run (3)(6)(7)(K)	
	Residential & Multi-Family Service (C)	Commercial & Industrial Service (C)
0 – 200 amps (a)	1-3" (C)	1-3" (C)
201 – 400 amps (single-phase)	1-3" (d)	1-3"
201 – 400 amps (three-phase)	1-4"	1-4"
401 – 800 amps	2-4" (e) (f)	2-4"
801 – 1,200 amps	3-4"	3-5"
1,201 – 1,600 amps	3-4"	4-5"
1,601 – 2,000 amps	4-4"	5-5"
2,001 – 2,500 amps	5-4"	6-5"
2,501 – 3,000 amps	4-5"	7-5"
3,001 – 3,500 amps	5-5"	8-5"
3,501 – 4,000 amps	7-5"	10-5"

TABLE 2

Conduit Riser Bend Size	Minimum Bending Radius (6)(7)
2" (C)	24"
3"	36"
4"	36"
5"	36"

* Depth of trench is determined by type of substructure at source. Verify with SDG&E Inspector prior to excavation.

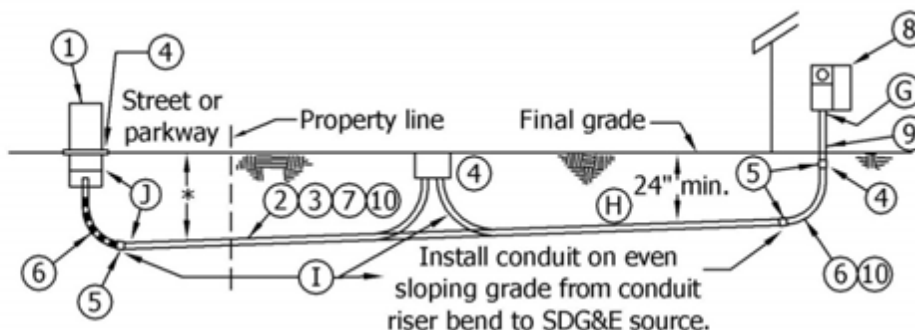

Reference UG 3942.1.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 3

SDG&E SERVICE STANDARDS & GUIDE

**UNDERGROUND ELECTRIC SERVICE LATERAL
CONDUIT REQUIREMENTS**

SG 309.1

Notes:

- (a) 225 amp residential service equipment.
- (b) Ampacity range based on 75 degree C aluminum wire.
- (c) These are minimum requirements. Conduit requirements may increase with different estimated demands and length of service, due to voltage drop and/or flicker (inrush current). Future loads should also be considered.
- (d) Includes 300 amp residential service equipment. Refer to page SG 512.6.
- (e) See pages SG 707.1 – 707.2 for Special Application.
- (f) 2-3" conduits minimum for multi-family 600 amp services.

SDG&E will furnish, install own and maintain, subject to installation charges:

- ① Source: manhole, handhole or padmount transformer.
- ② Service lateral conductors and connectors from SDG&E underground distribution system (Item 1) to customer's service terminating facility (Item 8). SDG&E will make connections.

Customer shall furnish, install, own and maintain at their expense:

- ③ A clear route on any private property, that is clear of obstructions which would inhibit the construction of service facilities. Service lateral conduit from Source (Item 1) to terminating facility (Item 8). Conduit size shall be based on the nameplate rating of the service equipment and distance from transformer to the terminating facility. Conduit material from Item 1 to Item 8 shall be approved non-metallic conduit in accordance with UG Standard page 3373.1. Between Item 6 and Item 8 the conduit installer must provide a ¾" pulling and measuring tape in each conduit. The pulling tape must be approved by SDG&E, have a minimum average tensile strength of 2,500 lbs. and be woven polyester high strength, continuous filament, pre-lubricated with footage marking. Pulling tape tails of 24" shall be secured at each end of the conduit. The pulling tape shall be pulled in behind the mandrel. When the pulling and measuring tape is installed it shall be one continuous length without knots for the accurate measurement for conductor installation and the pulling of conductors or winch lines. Leave at least 2' beyond each end of conduit run. Flex conduit is not permitted.
- ④ Trench, backfill, pavement repair, and structures shall be in accordance with SDG&E and the governmental Authority Having Jurisdiction (AHJ) requirements. If the customer installs a secondary handhole on private property, the lid shall be marked "SDG&E". The customer is to obtain an excavation permit for trenching in street right-of-way as required by the governmental AHJ. SDG&E inspection is required prior to shading and backfilling trench.
- ⑤ Adapter couplings for connecting bends to straight conduit.
- ⑥ Conduit riser bend. See Table 2 on SG 309.1.
- ⑦ Size and number of conduit runs to be designated by SDG&E. See Table 1 on SG 309.1.
- ⑧ Service terminating enclosure per Section 700.
- ⑨ Type and schedule of conduit on or within a building or structure to be installed per Building Inspector's requirements and must be listed and labeled. Normally Schedule 40 PVC is allowed inside a building wall and Schedule 80 PVC is required when exposed on an exterior wall. Consult with the appropriate AHJ. Flex conduit is not permitted.
- ⑩ Conduit manufacturer and material must be SDG&E-approved. Asbestos-Containing Material (ACM) is not approved.

Reference UG 3942.1.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 3

SDG&E SERVICE STANDARDS & GUIDE

**UNDERGROUND ELECTRIC SERVICE LATERAL
CONDUIT REQUIREMENTS**

SG 309.2

Installation:

- A. Contact Project Management at the nearest SDG&E Regional Office closest to the job site for an Electric Meter & Service Location form prior to the start of construction. See page SG 2.
- B. The service lateral conduit specified in the conduit table is limited to 150' in length, with not more than three 90 degree horizontal or vertical bends or 270 degrees total deflection through the service run. If greater than 150', refer to UG Standard 4003. Planner and Electric Construction Supervisor approval is required if limitations are exceeded.
- C A 3-wire, 100 amp, single-phase service and meter panel can be served by a 2" conduit. A 3-wire, 200 amp, or less, single-phase service and meter panel for temporary construction power can be served by a 2" conduit. Item 3 shall be the same size and type material stocked by SDG&E as shown on UG Standard page 3373.2
- D. Engineers' and Architects' proposals for all switchboards rated 1,000 amperes, or larger, shall be submitted by the manufacturer to the SDG&E Service Standards Section for review and approval. Refer to page SG 517.1 for further information on the Manufacturer's Drawings for Approval process.
- F. Replacement or enlargement of service lateral conduits due to relocation or increased load will be accomplished by the customer under the provisions of Items 3 through 10 on page SG 309.2. Maintenance of the customer's service lateral conduits outside the building wall will be undertaken by SDG&E under emergency conditions and may be done at the customer's expense. Consult with the SDG&E Planner.
- G Conduits shall be sealed per UG Standard pages 3948.1 – 3948.4 (G.O. 128, Rule 31.6).
- H A 24" minimum cover over the conduit is required for all normal installations on private property and a 30" minimum cover is required in right-of-way or public property. In all installations where the minimum cover cannot be met, G.O. 128 requires one of the following: 1) Schedule 40 PVC or Schedule 80 PVC conduit with a minimum wall thickness of 0.15 inches, or 2) at least a 3" layer of concrete above (2 sack $\frac{3}{8}$ " rock) and 2" on each side of the conduit. Reduced depths must be approved by the SDG&E Planner and Inspector.
- I The trench must have an even sloping grade to allow room for a 90 degree bend into the bottom of any customer-owned or SDG&E facility. Do not cut bends. The trench depth is to be determined at the Preconstruction Meeting.
- J When trenching to an existing SDG&E facility, the applicant/contractor shall complete the trench and installation of conduit up to the existing facility unless it is determined by an authorized SDG&E employee that such an installation performed by the applicant/contractor would expose workers to, or create, a hazard. In this case, SDG&E would perform trenching as indicated on the construction work order. Digging under energized padmounted equipment and installation of conduit into energized padmounted equipment will always be the responsibility of SDG&E.
- K A service conduit will only be allowed underneath the building being served by the cable in the conduit. No conduit is allowed under one building to serve another building.

Standard References:

- M. See UG Standard 3367 for trench paralleling foundations.
- N. See UG Standard 3372 for conduit sizing and UG Standard 3373 for conduit and fittings.
- P. See UG Standard 3376 for concrete slurry requirements.
- Q. See UG Standard 3421, 3425, 3426 and 3427 for conduit placement.
- R. See UG Standard 3941 for residential riser and conduit and UG Standard 3948 for conduit sealing.
- S. See UG Standard 3944 for material requirements of an UG service from OH facilities.
- T. See OH Standard 1404.2 & UG Standard 4204.2 for cable pole conduit requirements.

Reference UG 3942.2.


Items E, L & O have been intentionally omitted.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 3 OF 3	<div>X</div> Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 309.3
	SDG&E SERVICE STANDARDS & GUIDE				
	UNDERGROUND ELECTRIC SERVICE LATERAL CONDUIT REQUIREMENTS				

SCOPE: This standard provides requirements for installation, ownership and maintenance of a single low-voltage underground service fed from overhead facilities.

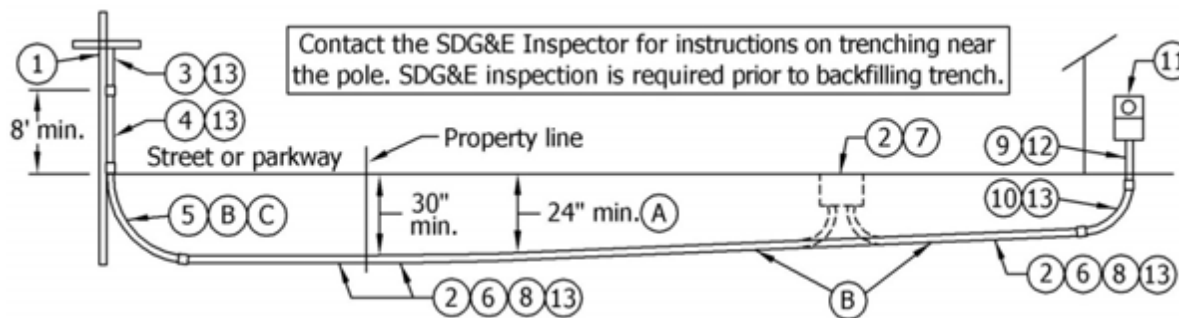

SDG&E Overhead Distribution System:

- ① Source pole as designated by SDG&E Planner. Contact Project Management at the nearest SDG&E Regional Office closest to the job site for an Electric Meter & Service Location form prior to the start of construction. (See page SG 2.)

SDG&E to furnish, install, own and maintain, subject to installation charges:

- ② Service lateral conductors and connectors.

Customer to provide, SDG&E to install, own and maintain:

- ③ Schedule 40 PVC conduit
- ④ Schedule 80 PVC conduit

Customer shall furnish, install, own and maintain at their expense:

- ⑤ Schedule 80 PVC conduit bend. Minimum radius of bend: 36" radius for 3" conduit, 48" radius for 4" and 5" conduit. The larger radius at the poles is necessary to allow for vertical cable pulling tension.
- ⑥ A clear route on any private property, that is clear of obstructions which would inhibit the construction of service facilities. Service lateral conduit from source (Item 1) to terminating facility (Item 11). Conduit size shall be based on the nameplate rating of the service equipment and distance from transformer to the terminating facility.
- ⑦ Secondary handhole. Verify if it is required with the SDG&E Planner. If a handhole is required, the lid shall be marked "SDG&E".
- ⑧ Trench, backfill, pavement repair and structures shall be in accordance with SDG&E's and the governmental Authority Having Jurisdiction's (AHJ) requirements. Special Note: Contact the SDG&E Inspector for instructions for trenching near the SDG&E pole. The customer is to obtain an excavation permit for trenching in the street right-of-way as required by the AHJ. SDG&E inspection is required prior to shading and backfilling the trench.
- ⑨ Items 3, 4, 5 and 6 shall be non-metallic conduit per UG Standard page 3373 and 4204.2. Between Item 5 and Item 9 the conduit installer shall provide a 3/4" pulling and measuring tape in each conduit. The pulling tape must be approved by SDG&E, have a minimum average tensile strength of

Reference UG 3944.1

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 2

SDG&E SERVICE STANDARDS & GUIDE

**UNDERGROUND SERVICE FROM OVERHEAD FACILITIES
(LOW VOLTAGE)**

SG 310.1

2,500 lbs. and be woven polyester high strength, continuous filament, pre-lubricated with footage marking. Pulling tape tails of 24" shall be secured at each end of the conduit. The pulling tape shall be pulled in behind the mandrel. When the pulling and measuring tape is installed it shall be one continuous length without knots for the accurate measurement for conductor installation and the pulling of conductors or winch lines. Leave at least 2' beyond each end of the conduit run. Flex conduit is not permitted.

- ⑩ Conduit riser bend. Minimum bending radius per page SG 309.1.
- ⑪ Service terminating enclosure per Section 700 requirements.
- ⑫ Type and schedule of conduit on or within a building or structure shall be installed per the AHJ's requirements and must be listed and labeled. Normally Schedule 40 PVC is allowed inside a building wall, and Schedule 80 PVC is required when exposed on an exterior wall. Consult with the appropriate AHJ. Flex conduit is not permitted.
- ⑬ Conduit manufacturer must be SDG&E-approved.

Installation:

- Ⓐ A 24" minimum cover over the conduit is required for all normal installations on private property, and a 30" minimum cover is required in right-of-way or on public property. In all installations where the minimum cover cannot be met, G.O. 128 requires one of the following alternatives that are acceptable to SDG&E: 1) Schedule 40 PVC or Schedule 80 PVC conduit with a minimum wall thickness of 0.15", or 2) at least a 3" layer of concrete (2 sack $\frac{3}{8}$ " rock) above and 2" on each side of the conduit. Reduced depths must be approved by the SDG&E Planner and Inspector.
- Ⓑ The trench must have an even sloping grade to allow room for a 90 degree bend into the bottom of any customer-owned or SDG&E facility. Do not cut bends. The trench depth is to be determined at the pre-construction meeting.
- Ⓒ When trenching to an existing SDG&E facility, the applicant/contractor shall complete the trench and installation of conduit up to the existing facility unless it is determined by an authorized SDG&E employee that such an installation performed by the applicant/contractor would expose workers to, or create a potential hazard. In this case, SDG&E would perform trenching as indicated on the construction work order. Digging under energized padmounted equipment and installation of conduit into energized padmounted equipment will always be the responsibility of SDG&E.

Standard References:

- D. See UG Standard 3367 for trench paralleling foundations.
- E. See UG Standard 3373 for SDG&E conduit and fittings.
- F. See UG Standard 3376 for concrete slurry requirements.
- G. See UG Standard 3941 for residential riser and conduit.
- H. See UG Standard 3944 for material requirements of an UG service from OH facilities.
- I. See UG Standard 3948 for sealing conduits.
- J. See OH Standard 1404.2 and UG Standard 4204.2 for cable pole conduit requirements.
- K. See UG Standard 3950 for field heating service lateral conduits.


Reference UG 3944.1 & 3944.2

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 2	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 310.2
	SDG&E SERVICE STANDARDS & GUIDE					
	UNDERGROUND SERVICE FROM OVERHEAD FACILITIES (LOW VOLTAGE)					

This standard provides requirements for installation, ownership and maintenance of a primary and secondary voltage underground system fed from a new cable pole.

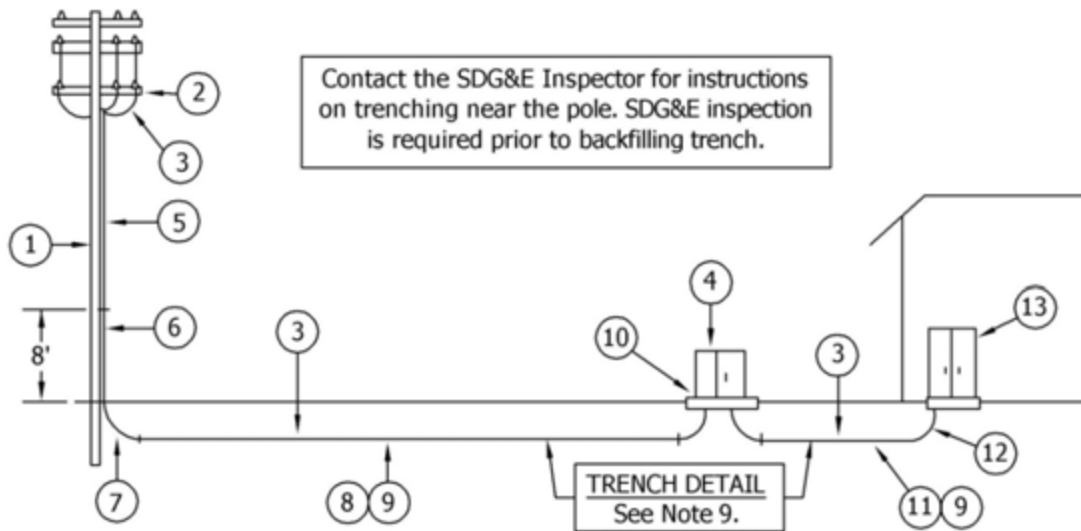

SDG&E Overhead Distribution System:

- ① Source pole as designated by SDG&E Planner. Contact Project Management at the nearest SDG&E Regional Office closest to the job site for an Electric Meter & Service Location form prior to the start of construction. (See page SG 2.)

SDG&E to furnish, install, own and maintain subject to installation charges:

- ② Medium-voltage terminals
- ③ Medium-voltage and low voltage cable and connections
- ④ Transformer
- ⑤ Schedule 40 PVC conduit
- ⑥ Schedule 80 PVC conduit

Customer shall furnish, install, own and maintain at their expense:

- ⑦ Schedule 80 PVC conduit bend. A 36" minimum radius is required for 2" and 3" conduit. A minimum 48" radius is required for 4" and 5" conduit. The larger radius at the poles is necessary to allow for vertical cable pulling tension.
- ⑧ Primary conduit sized and specified by SDG&E on the construction work order. The conduit manufacturer must be SDG&E-approved. Between Item 7 and Item 12, the conduit installer shall provide a $\frac{3}{4}$ " pulling and measuring tape in each conduit. The pulling tape must be approved by SDG&E, have a minimum average tensile strength of 2,500 lbs., and be woven polyester high strength, continuous filament, pre-lubricated with footage marking. Pulling tape tails of 24" shall be secured at each end of the conduit. The pulling tape shall be pulled in behind the mandrel. When the pulling and measuring tape is installed it shall be one continuous length without knots for the accurate measurement for conductor installation and the pulling of conductors or winch lines. Leave at least 2' beyond each end of conduit run. Flex conduit is not permitted.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 2	<div></div>	Indicates Latest Revision	X Completely Revised	New Page	Information Removed	SG 311.1
	SDG&E SERVICE STANDARDS & GUIDE					
	PRIMARY & SECONDARY VOLTAGE UNDERGROUND SYSTEM ON CUSTOMER PREMISES FROM CABLE POLE					

- ⑨ A clear route on any private property, that is clear of obstructions which would inhibit the construction of primary and service facilities. Trench, backfill, pavement repair and structures shall be in accordance with SDG&E and the local Authority Having Jurisdiction (AHJ) requirements.
Special Note: Contact the SDG&E Inspector for instructions on trenching near the SDG&E pole. The customer is to obtain an excavation permit for trenching in street right-of-way as required by the AHJ. SDG&E inspection is required prior to shading and backfilling the trench.
- ⑩ Transformer pad and grounding. See UG Standards Section 4500 for grounding specifications. The pad size is specified on the construction work order.
- ⑪ Service lateral conduit sized and specified by SDG&E on the construction work order or on a separate service order. Refer to pages SG 309.1 – 309.3 for additional information. Conduit manufacturer must be SDG&E-approved.
- ⑫ Type and schedule of conduit on or within a building or structure to be installed per the AHJ's requirements and must be listed and labeled. Normally, Schedule 40 PVC is allowed inside a building wall, and Schedule 80 PVC is required when exposed on an exterior wall. Consult with the appropriate AHJ. Flex conduit is not permitted.
- ⑬ Service terminating enclosure per Section 700 requirements.
- ⑭ If a secondary handhole is required between the new transformer and the service and metering equipment, the lid shall be marked "SDG&E". (Handhole not shown in illustration on page SG 311.1.)

Installation Notes:

- Ⓐ A 24" minimum cover over the conduit is required for all normal installations on private property and a 30" minimum cover is required in right-of-way or on public property. In all installations where the minimum cover cannot be met, G.O. 128 requires one of the following: (1) steel conduit, (2) Schedule 40 PVC or Schedule 80 PVC conduit with a minimum wall thickness of 0.15 inches, or (3) at least a 3" layer of concrete (2 sack $\frac{3}{8}$ " rock) above and 2" on each side of the conduit. Reduced depths must be approved by the SDG&E Planner and Inspector.
- Ⓑ The trench must have an even sloping grade to allow room for a 90 degree bend into the bottom of any customer-owned or SDG&E facility. Do not cut bends. The trench depth is to be determined at the pre-construction meeting.
- Ⓒ When trenching to an existing SDG&E facility, the applicant/contractor shall complete the trench and installation of conduit up to the existing facility unless it is determined by an authorized SDG&E employee that such an installation performed by the applicant/contractor would expose workers to, or create, a potential hazard. In this case, SDG&E would perform trenching as indicated on the construction work order. Digging under energized padmounted equipment and installation of conduit into energized padmounted equipment will always be the responsibility of SDG&E.

Standard References:


- D. See UG Standard 3373 for SDG&E conduit and fittings.
- E. See UG Standard 3376 for concrete slurry requirements.
- F. See UG Standard 3941 for residential riser and conduit.
- G. See UG Standard 3948 for sealing conduits.
- H. See OH Standard 1404.2 and UG Standard 4204.2 for cable pole conduit requirements.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 2	Indicates Latest Revision	X	Completely Revised	New Page	Information Removed	SG 311.2
	SDG&E SERVICE STANDARDS & GUIDE					
	PRIMARY & SECONDARY VOLTAGE UNDERGROUND SYSTEM ON CUSTOMER PREMISES FROM CABLE POLE					

SCOPE: This standard shows a termination of a customer-owned 2" or 3" conduit bend and riser at a building.

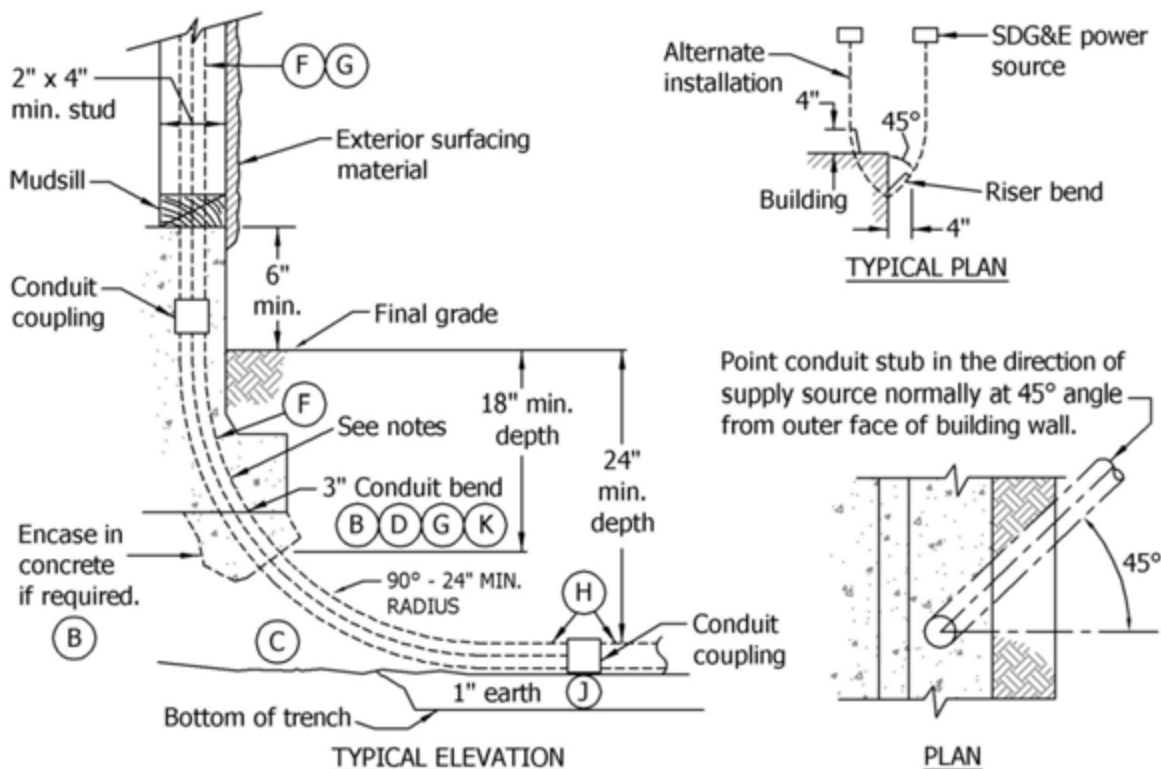

Notes:

A straight piece of 3" conduit and a 90 degree bend with a 36-inch minimum radius is required. Refer to UG Standard 3942.2, Note C for 2" conduit installations.

Installation:

- A. Contact Project Management at the nearest SDG&E Regional Office closest to the job site for an Electric Meter & Service Location form prior to the start of construction. (See page SG 2.)
- B. G.O. 128 Rule 33.4-D requires one of the following down to an 18" depth on private property: (a) steel conduit, (b) Schedule 40 PVC or Schedule 80 PVC conduit with a minimum wall thickness of 0.15", or (c) at least a 3" layer of concrete above and 2" on each side of the conduit.
- C. When the trench is butted against the building, the end of the trench shall be excavated at a one-to-one slope if undermining is suspected at the building.

Reference UG 3941.1.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 2

SDG&E SERVICE STANDARDS & GUIDE

**CUSTOMER-OWNED CONDUIT
BEND & RISER AT BUILDING**

SG 312.1

- Ⓓ The 90 degree bend must be installed deep enough to connect to the conduit on the bottom of the trench.
- Ⓕ Type and schedule of conduit on or within a building or structure to be installed per the Building Inspector's requirements and must be listed and labeled. Normally Schedule 40 PVC is allowed inside a building wall and Schedule 80 PVC is required when exposed on an exterior wall. Consult with the appropriate inspection Authority Having Jurisdiction (AHJ). Flex conduit is not permitted.
- Ⓖ Service lateral conduit sized and specified by SDG&E. Consult with the SDG&E Planner. Refer to pages SG 309.1 – 309.3 for additional information.
- Ⓗ Conduit manufacturer must be SDG&E-approved.

Standard References:

- I. See UG Standard 3367 for trench paralleling foundations.
- Ⓙ See UG Standard 3370 (San Diego County) or 3371 (Orange County) for trench depths, shading and backfill requirements.
- Ⓚ See UG Standard 3942 for minimum bending radius.
- L. See UG Standard 3948 for sealing conduits.
- M. See UG Standard 3950 for field heating service lateral conduits.

Reference UG 3941.1.

Item E has been intentionally omitted.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X	Indicates Latest Revision	Completely Revised	New Page	Information Removed
----------	---------------------------	--------------------	----------	---------------------


SHEET
2 OF 2

SDG&E SERVICE STANDARDS & GUIDE

**CUSTOMER-OWNED CONDUIT
BEND & RISER AT BUILDING**

SG 312.2

SCOPE: This standard shows typical cable pole riser positions for SDG&E and communication companies.



Notes:

1. ½ pole climbing space applies to a level 4' below the lowest level of facilities (communications, secondary, primary, etc.). See Overhead Standard pages 251 – 261 for climbing space requirements.
2. Changes to these standard riser positions must not reduce the climbing space to less than ½ pole.
3. Conduit riser at base of pole not to infringe on curb or sidewalk positions.
4. Spare conduits are not considered as risers.

Reference UG 4202.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 2	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 313.1
	SDG&E SERVICE STANDARDS & GUIDE					
	STANDARD JOINT CABLE POLE RISER POSITION USING LADDER ARM BRACKET & SINGLE RISER					

Bill of Material:

Item	Description
1	SDG&E Primary Riser
2	SDG&E Secondary Riser
3	SDG&E (Existing Riser)
4	SDG&E Electric Ground
5	Bracket, Ladder Arm Assembly
6	Communication Riser Position
7	Communication Tangent (Thru) Position
8	Communication Ground

Installation:

- (A) Communications only point of attachment for ladder arm bracket construction shall be on the backside of ladder arm bracket assembly. Galvanized unistrut pipe clamps shall be used to secure the conduit. Communications may attach on the back of the ladder arm assembly alongside SDG&E's riser. Ladder arms may be installed by communications companies provided they are installed per SDG&E construction standards and meet SDG&E material specifications.
- (B) For new construction with an existing SDG&E riser on the pole (Figure 3), one 3" riser maximum on the pole and one 3" riser maximum on the backside of the ladder arm bracket are permitted back-to-back.
- (C) When a ladder arm is existing, and the back of ladder arm positions and pole positions on communications side of pole are occupied, additional communications risers must be placed on another pole.

Standard References:

- F. PVC risers are not permitted within the climbing space per OH Standard 1414 / UG Standard 4214.
- G. No CATV or Telco jumpers allowed in climbing space per G.O. 95 Rule 84.7.
- H. See Overhead Standards Section 200 for allowable G.O. 95 climbing space obstructions.
- I. See OH Standard 363 / UG Standard 4205 for installation of pole steps.
- J. See OH Standard 1403 / UG Standard 4203 for pole quadrant and riser identification.
- K. See OH Standard 1404 / UG Standard 4204 when installing a single riser, modifying existing cable pole to include second riser, or for multiple conduit runs and joint pole installation.
- L. See UG Standard 4620 for telecommunications installation.

Reference UG 4202.

Items D & E have been intentionally omitted.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 2

SDG&E SERVICE STANDARDS & GUIDE

**STANDARD JOINT CABLE POLE RISER POSITION USING
LADDER ARM BRACKET & SINGLE RISER**

SG 313.2

SCOPE: This standard shows cable pole riser locations, SDG&E quadrant and sign for marking pole riser installations.

IDENTIFYING CABLE POLE RISER LOCATION

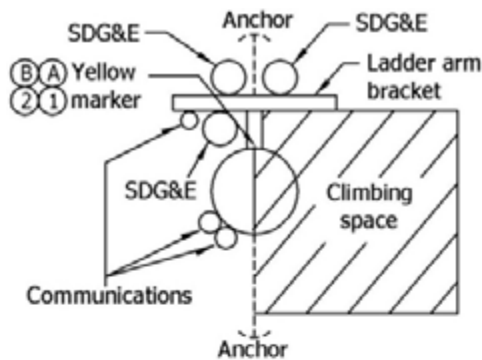


FIGURE 1

DEAD END CONSTRUCTION MULTIPLE POWER RISER

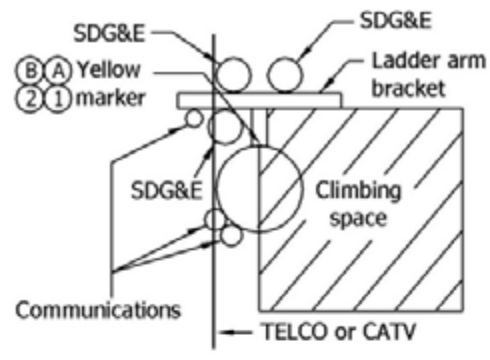


FIGURE 2

THROUGH CONSTRUCTION MULTIPLE POWER RISER

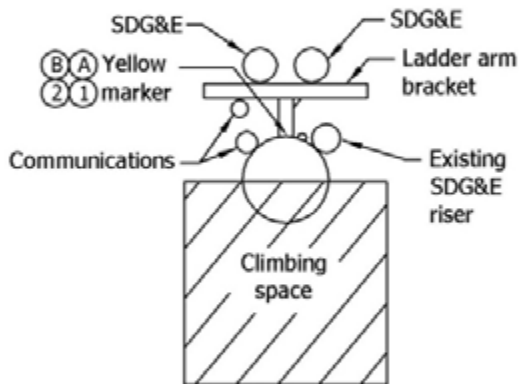


FIGURE 3

THROUGH CONSTRUCTION MULTIPLE POWER RISER

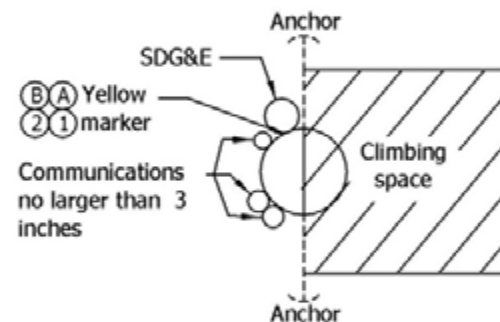


FIGURE 4

DEAD END CONSTRUCTION SINGLE POWER RISER

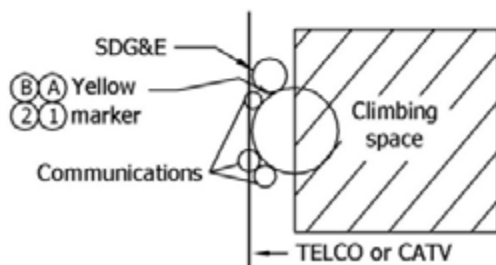


FIGURE 5

THROUGH CONSTRUCTION SINGLE POWER RISER

Reference UG 4203.1.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 3

SDG&E SERVICE STANDARDS & GUIDE

CABLE POLE QUADRANT & RISER IDENTIFICATION

SG 314.1

Bill of Material:

Item	Description	Quantity	OH / UG Standard Page Number	Stock Number
1	Marker, Yellow Plastic Sign	1	1403.2 / 4203.2	476312
2	Nails, Galv. 1-3/4"	As Required	---	492192

Installation:

- Ⓐ Nail the sign to the riser pole approximately 5' above ground with the proper side showing.
- Ⓑ Use one marker to show SDG&E riser location.

Standard References:

- C. See OH Standard 1402 / UG Standard 4202 for standard joint cable pole riser positions.
- D. See OH Standard 1404 / UG Standard 4204 for cable pole riser installation.


Reference UG 4203.1.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 3	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 314.2
	SDG&E SERVICE STANDARDS & GUIDE					
	CABLE POLE QUADRANT & RISER IDENTIFICATION					

SCOPE: This standard shows the sign used for marking pole riser installations.

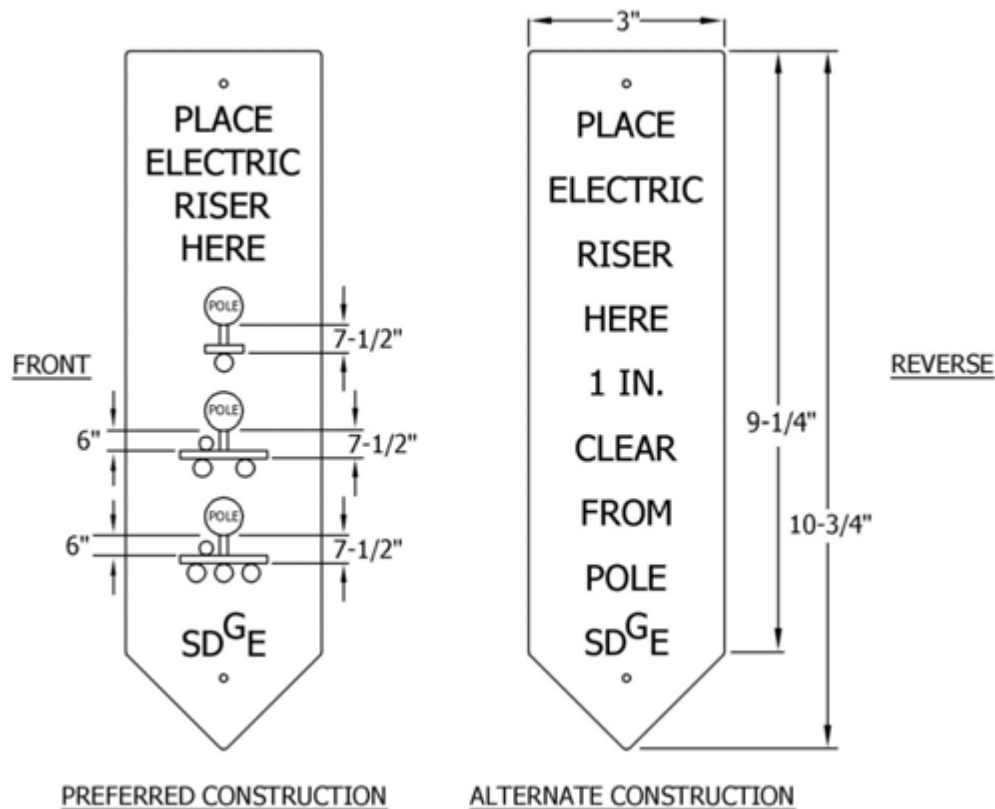

Notes:

1. A sign is available to mark SDG&E riser locations on the cable pole. The sign is made of flexible plastic, with raised lettering on each side. Signs are to be attached to poles with 1-3/4" nails. See Bill of Material table on SG 314.2 for stock numbers.
2. "PLACE ELECTRIC RISER HERE, SDGE" is printed on the front side, showing 3 pole riser positions, with "PLACE ELECTRIC RISER HERE 1 IN. CLEAR FROM POLE, SDGE" printed on the reverse side.
3. When the riser location has been determined, the signs are to be placed on the pole, approximately 5' above ground level by the Customer Project Planner, Project Coordinator, Electric Supervisor, Inspector, or Working Foreman setting the pole.

Installation:

- A. Use the side of the sign stating "PLACE ELECTRIC RISER HERE"(front), when ladder arm brackets are installed.
- B. For alternate construction, use the side of the sign stating "PLACE ELECTRIC RISER HERE 1 IN. CLEAR FROM POLE" (reverse), when a single SDG&E conduit is installed.
- C. Remove sign when pole riser(s) is/are installed.

See Standard References on page SG 314.2.



Reference UG 4203.2.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 3 OF 3	X Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 314.3
	SDG&E SERVICE STANDARDS & GUIDE				
	CABLE POLE QUADRANT & RISER IDENTIFICATION				

SCOPE: This standard shows new construction for single and multiple conduit risers.

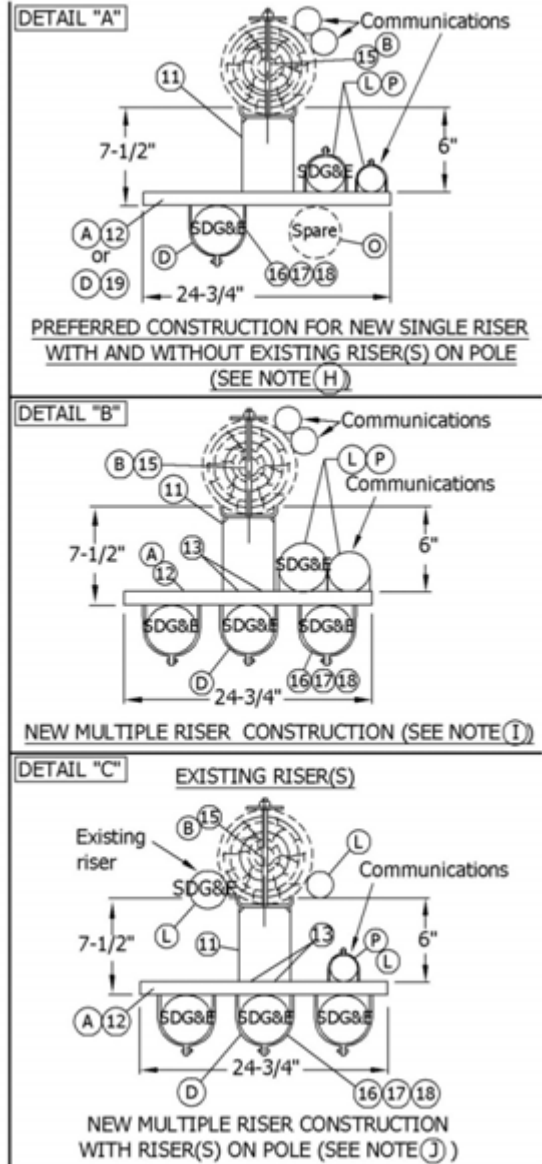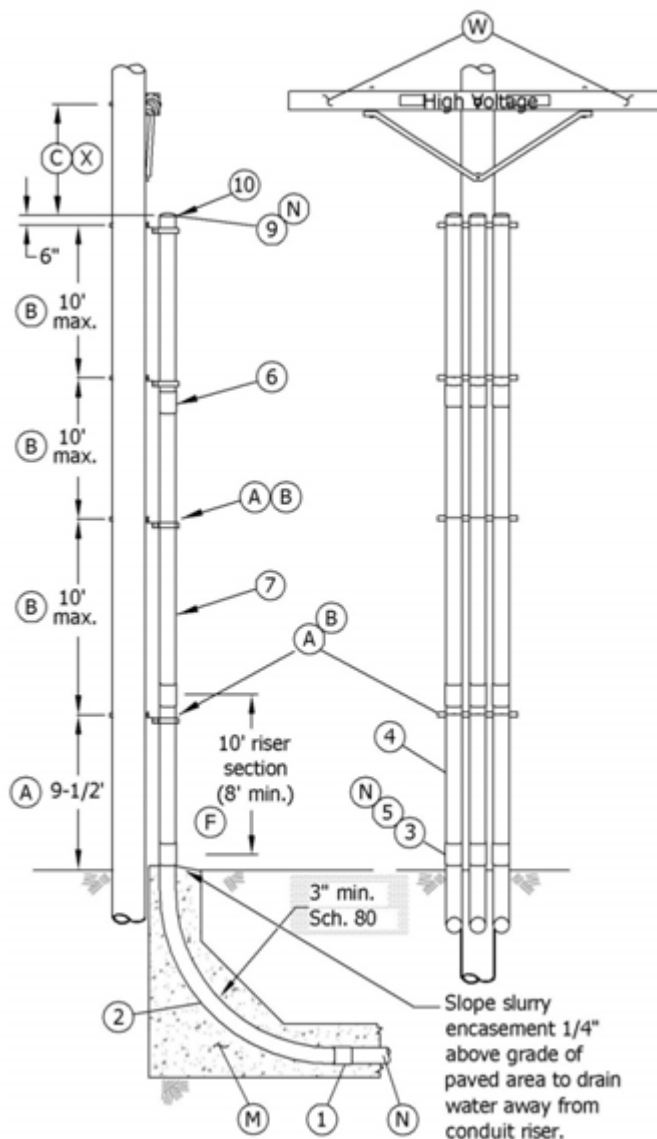

Notes:

1. All cable pole risers, primary and secondary, shall be 3" minimum conduit.
2. This construction is limited to a maximum of four SDG&E risers (no more than two primary risers).
3. When possible, the riser should be installed on the side of the pole opposite traffic flow towards the sidewalk. This includes single riser installations.
4. Spare conduits shall be capped just above ground level to prevent moisture or wire entry and to keep out debris. Spare conduits are not to be considered a riser.

Reference UG 4204.1.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.


REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
1 OF 5

SDG&E SERVICE STANDARDS & GUIDE
**UNDERGROUND ELECTRIC
CABLE POLE RISER INSTALLATION**

SG 315.1

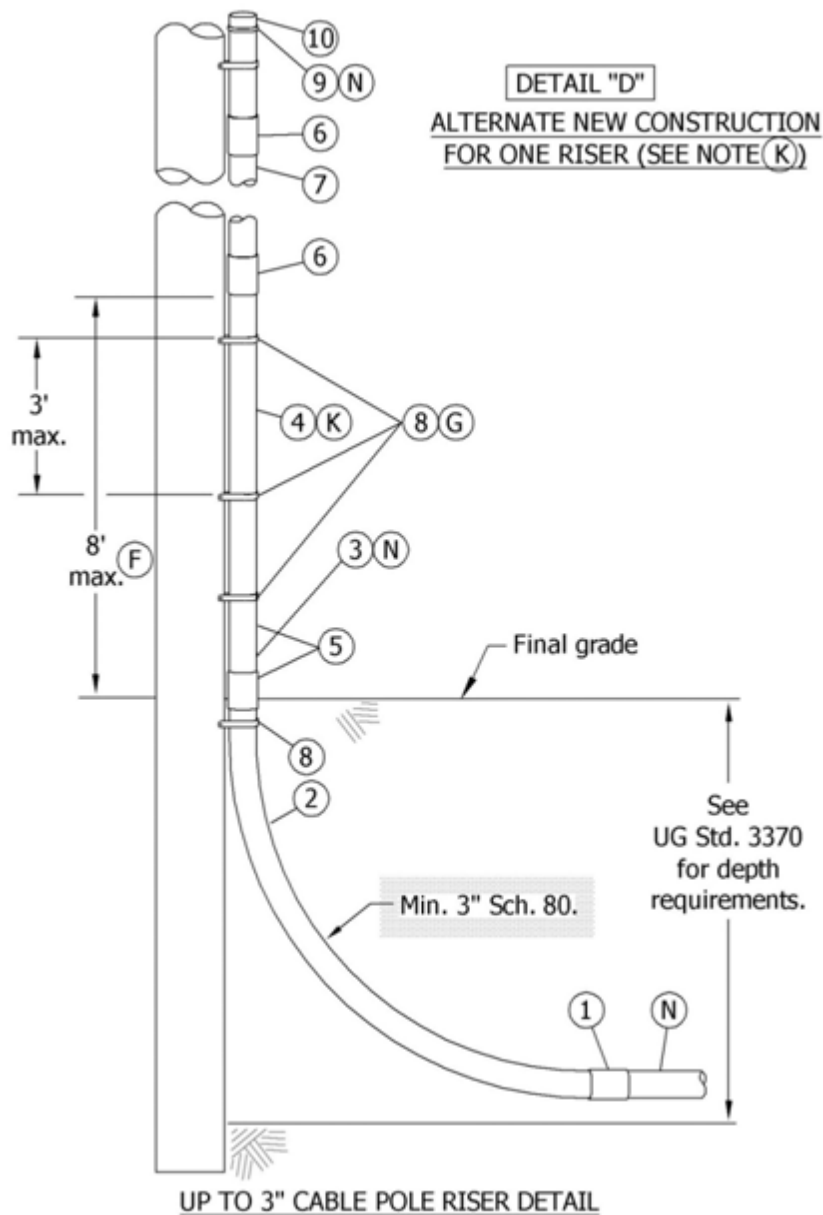

Notes:

1. All cable pole risers, primary and secondary, shall be 3" minimum conduit.
2. When possible, riser should be installed on the side of the pole opposite traffic flow towards the sidewalk. This includes single riser installations.
3. Spare conduits shall be capped just above ground level to prevent moisture or wire entry and to keep out debris. Spare conduits are not to be considered a riser.

Reference UG 4204.2.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
2 OF 5

SDG&E SERVICE STANDARDS & GUIDE
**UNDERGROUND ELECTRIC
 CABLE POLE RISER INSTALLATION**

SG 315.2

BILL OF MATERIAL:																																											
ITEM	DESCRIPTION	QUANTITY	STOCK NUMBER	ASSEMBLY UNITS																																							
1	Coupling, (Size as Required)	As Req'd	3" _S279904 4" _S279936 5" _S280032	- - -																																							
2	Conduit Riser Bend, Schedule 80 (Size as Required)	As Req'd	3" _36" R_S322472 4" _48" R_S322480 5" _48" R_S322488	3"CP-B 4"CP-B 5"CP-B																																							
3	Reducer, PVC, Schedule 80, (Size as Required)	As Req'd	4" _TO 3" _S573408 5" _TO 4" _S573424	4-3RED 5-4RED																																							
4	Conduit Riser, PVC, Schedule 80, (Size as Required)	As Req'd	3" _S251552 4" _S251584 5" _S251592	S80-3" S80-4" S80-5"																																							
5	Coupling, PVC, Schedule 80	As Req'd	3" _S280544 4" _S280576 5" _S280592	- - -																																							
6	Coupling, PVC, Schedule 40, (Size as Required)	As Req'd	3" _S280448 4" _S280480 5" _S280496	- - -																																							
7	Conduit, PVC, Schedule 40, (Size as Required)	As Req'd	3" _S251360 4" _S251392 5" _S251408	S40-3" S40-4" S40-5"																																							
8	Strap, Pipe, Galvanized, 2-16d Nails, Galvanized (Single Riser Construction, 4" and Smaller)	As Req'd	3" _S697920 4" _S697952 5" _S697984	- - -																																							
9	Grip, Cable Size as Required for Primary Risers Only. (Grips Are Not Required on Secondary Risers) (N)	As Req'd	<table><tr><th>CONDUIT</th><th>AL CABLE</th><th>GRIP STOCK NO.</th></tr><tr><td>3"</td><td>1/C#2 SOL</td><td>S393984</td></tr><tr><td>3"</td><td>2-1/C#2 SOL</td><td>S394048</td></tr><tr><td>3"</td><td>3-1/C#2 SOL</td><td>S394048</td></tr><tr><td>4"</td><td>3-1/C#2 SOL</td><td>S394104</td></tr><tr><td>4"</td><td>3-1/C#2 SOL</td><td>S394080</td></tr><tr><td>4"</td><td>350KCMIL</td><td>S394100</td></tr><tr><td>5"</td><td>350KCMIL</td><td>S394102</td></tr><tr><td>5"</td><td>750 KCMIL</td><td>S394096</td></tr><tr><td>5"</td><td>1000 KCMIL</td><td>S394098</td></tr><tr><th>CONDUIT</th><th>CU CABLE</th><th>GRIP STOCK NO.</th></tr><tr><td>4"</td><td>4/0</td><td>S394080</td></tr><tr><td>5"</td><td>500 KCMIL</td><td>S394096</td></tr></table>	CONDUIT	AL CABLE	GRIP STOCK NO.	3"	1/C#2 SOL	S393984	3"	2-1/C#2 SOL	S394048	3"	3-1/C#2 SOL	S394048	4"	3-1/C#2 SOL	S394104	4"	3-1/C#2 SOL	S394080	4"	350KCMIL	S394100	5"	350KCMIL	S394102	5"	750 KCMIL	S394096	5"	1000 KCMIL	S394098	CONDUIT	CU CABLE	GRIP STOCK NO.	4"	4/0	S394080	5"	500 KCMIL	S394096	2G1#2A 3G2#2A 3G3#2A 4G3#2A 4G#2/0 4G-350 5G-350 5G-750 5G1000 4G4/0C 5G500C
CONDUIT	AL CABLE	GRIP STOCK NO.																																									
3"	1/C#2 SOL	S393984																																									
3"	2-1/C#2 SOL	S394048																																									
3"	3-1/C#2 SOL	S394048																																									
4"	3-1/C#2 SOL	S394104																																									
4"	3-1/C#2 SOL	S394080																																									
4"	350KCMIL	S394100																																									
5"	350KCMIL	S394102																																									
5"	750 KCMIL	S394096																																									
5"	1000 KCMIL	S394098																																									
CONDUIT	CU CABLE	GRIP STOCK NO.																																									
4"	4/0	S394080																																									
5"	500 KCMIL	S394096																																									
10	Protector, Nylon Cable	As Req'd	S558720	-																																							
11	Bracket, Ladder Arm (B)	As Req'd	S167184	LA-ARM																																							
12	Channel, Double, Galv. 24-3/4" x 7/8" x 2-3/4" (B)	As Req'd	S216700	-																																							
13	Nut, Clamping Channel, W/Spring, 1/2"	As Req'd	S503488	-																																							
14	Clamp, Pipe, Steel, Galv., Unistrut, 2"	As Req'd	S229536	CL-2IN																																							
15	Bolt, Machine, Galv, 5/8" x (Length as Req'd), 1-Square Washer & Double Coil Spring Washer (B)	As Req'd	OVERHEAD STD. 392	-																																							
16	Clamp, Pipe, Steel, Galv., Unistrut, 4"	As Req'd	S229664	CL-4IN																																							
17	Clamp, Pipe, Steel, Galv., Unistrut, 5"	As Req'd	S229668	CL-5IN																																							
18	Clamp, Pipe, Steel, Galv., Unistrut, 3"	As Req'd	S229632	CL-3IN																																							
19	Channel, Galv., 8" (D)	As Req'd	S216840	-																																							

Reference UG 4204.3.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 3 OF 5	<div>X Indicates Latest Revision</div>	Completely Revised	New Page	Information Removed	SG 315.3
	SDG&E SERVICE STANDARDS & GUIDE				
	UNDERGROUND ELECTRIC CABLE POLE RISER INSTALLATION				

Installation:

- (A) Mount first bracket ladder arm no lower than 9-½'. If the first bracket extends toward a street or driveway, offset the unistrut channel to clear large vehicles.
- (B) Install at least one ladder arm bracket for each coupling joint of conduit, with a maximum 10' distance between brackets. All ladder arm brackets to be attached to the pole with bolts, not lag screws.
- (C) Refer to individual cable pole standard for correct measurement.
- (D) Center conduit position shall be used for multiple SDG&E secondary runs or SDG&E telecommunication conduit. Other conduit positions on the front of the bracket shall be used for a single or double conduit. The 8" unistrut channel (Item 19) may be installed for a single riser where no communications are anticipated.
- (F) Risers of plastic conduit shall be EPC-80 PVC Schedule 80, from the ground line to a level not less than 8' above the ground line per G.O. 95 Rule 54.6-E and SDG&E conduit sizing requirements.
- (G) For single riser construction, separation of pipe straps (Item 8) shall be 3' maximum.
- (H) Use Detail "A" on page SG 315.1 (OH 1404.1 / UG 4204.1), Preferred Construction for a Single Riser:
 - 1. When installing a single riser.
 - 2. When adding a single riser to an existing riser pole. An existing single SDG&E riser would remain on the pole unless it is creating a G.O. 95 infraction. If an infraction exists, move the existing riser to the ladder arm bracket along with the new riser shown in Detail "B".
- (I) Use Detail "B" on page SG 315.1 (OH 1404.1 / UG 4204.1), when installing more than one riser.
- (J) Use Detail "C" on page SG 315.1 (OH 1404.1 / UG 4204.1), when adding a riser(s) to an existing SDG&E riser pole. An existing single SDG&E riser would remain on the pole unless it is creating a G.O. 95 infraction. If an infraction exists, move the existing riser to the ladder arm bracket.
- (K) Use Detail "D" on page SG 315.2 (OH 1404.2 / UG 4204.2), Alternate Construction for a Single Riser when:
 - 1. Field conditions do not allow room for ladder arm brackets (i.e., conduit would extend into the street, sidewalk, driveway, etc.). This installation would be limited to one SDG&E riser, up to 3". (No other riser(s) larger than 3" would be on the pole.) One half of the pole must remain clear for climbing space, and G.O. 95 requirements must be followed.
 - 2. An existing riser is already on the pole and it may be re-used (i.e., removing a street light fuse box from a pole, and new conduit will connect to the existing conduit where the fuse box was located, customer re-wire job, etc.).

Reference UG 4204.4.

Item E has been intentionally omitted.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
4 OF 5

SDG&E SERVICE STANDARDS & GUIDE

**UNDERGROUND ELECTRIC
CABLE POLE RISER INSTALLATION**

SG 315.4

- (L) One riser on the pole 3" maximum and one riser on the back side of the ladder arm bracket 3" maximum are permitted back-to-back. A maximum of two 4" communications risers are permitted on the back side of a ladder arm assembly. The adjacent pole quadrant must be vacant to install any 4" riser on the back of the ladder arm bracket, and must remain vacant after installation.
- (M) Concrete encasement is required around the elbow(s) for 5" primary conduit(s).
- (N) Each conduit run between substructures, pads, customer service risers, etc., shall be one size conduit continuously, i.e. no reducers are allowed within a conduit run except where the conduit enters a substructure or above ground level on a riser pole. If a 3" riser is already installed, and the grip size requires a 2" riser, a 2" to 3" reducer may be used to accommodate the grip. The same would apply to other size conduits as has been described. Grips are not required on secondary risers.
- (O) Spare Conduits: The term "spare conduit" refers to an empty conduit that is specified by the Planner for operating and maintenance requirements. Spare conduits should be considered or installed:
1. When requested by a customer at their own expense, but not to exceed conduit limitations in this standard.
 2. When it is economical to install conduit in lieu of concrete, but not to exceed conduit limitations of this standard.
 3. Based on future construction limitations such as beneath bridges, roadways and railroad tracks, but not to exceed conduit limitations in this standard.
 4. In conversion or new business projects to allow easy bypass of the pole during removal. Conduits installed for this purpose shall not go up the pole but shall extend past the pole a minimum of 6'.
- Future Spare Conduits: The term "future spare conduit" refers to an empty conduit specified by either the Planner or Distribution Planning for areas with growth potential. Future feeder conduit specified by Distribution Planning must be supported by the long term feeder arrangement plan.
- (P) Communications only point of attachment for ladder arm bracket construction shall be on the back side of the ladder arm bracket assembly. Galvanized unistrut pipe clamps shall be used to secure the conduit. Communications may attach on the back of the assembly alongside SDG&E's riser.

Standard References:

- T. See OH Standard 363 / UG Standard 4205 for pole steps.
- U. See UG Standard 3944 for UG service from OH facilities, material requirements, etc.
- V. See OH Standard 1402 / UG Standard 4202 for positioning of risers involving more than one utility.
- (W) See OH Standard 1407 / UG Standard 4207 for non-porcelain terminal mounting bracket installation and materials.
- (X) See OH Standard 1414 / UG Standard 4214 for 0 – 750 volts underground service from an overhead line.
- Y. See UG Standard 4620 for telecommunications installation.
- Z. PVC risers are not permitted within the climbing space per G.O. 95 Rule 22.2C.

Reference UG 4205.4 & 4205.5.

Items Q, R & S have been intentionally omitted.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 5 OF 5	X Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 315.5
	SDG&E SERVICE STANDARDS & GUIDE				
	UNDERGROUND ELECTRIC CABLE POLE RISER INSTALLATION				

This standard shows requirements for installing an underground electric service lateral to gasoline dispensing and service stations. A gasoline dispensing and service station is defined as a location where gasoline or other volatile flammable liquids or liquefied flammable gases are transferred to fuel tanks (including auxiliary fuel tanks) or self-propelled vehicles.


The shaded areas in Figures 1 and 2 below are classified as either:

Class 1, Division 1 – Flammable gases or vapors, highly hazardous, i.e. ignitable concentrations confined in a pit.

Class 1, Division 2 – Liquid, vapor or gases will normally be confined within closed containers or closed systems.

Utility-owned underground facilities are not allowed below the surface of a Class 1, Division 1 or Class 1, Division 2 location.

See installation notes on page SG 318.

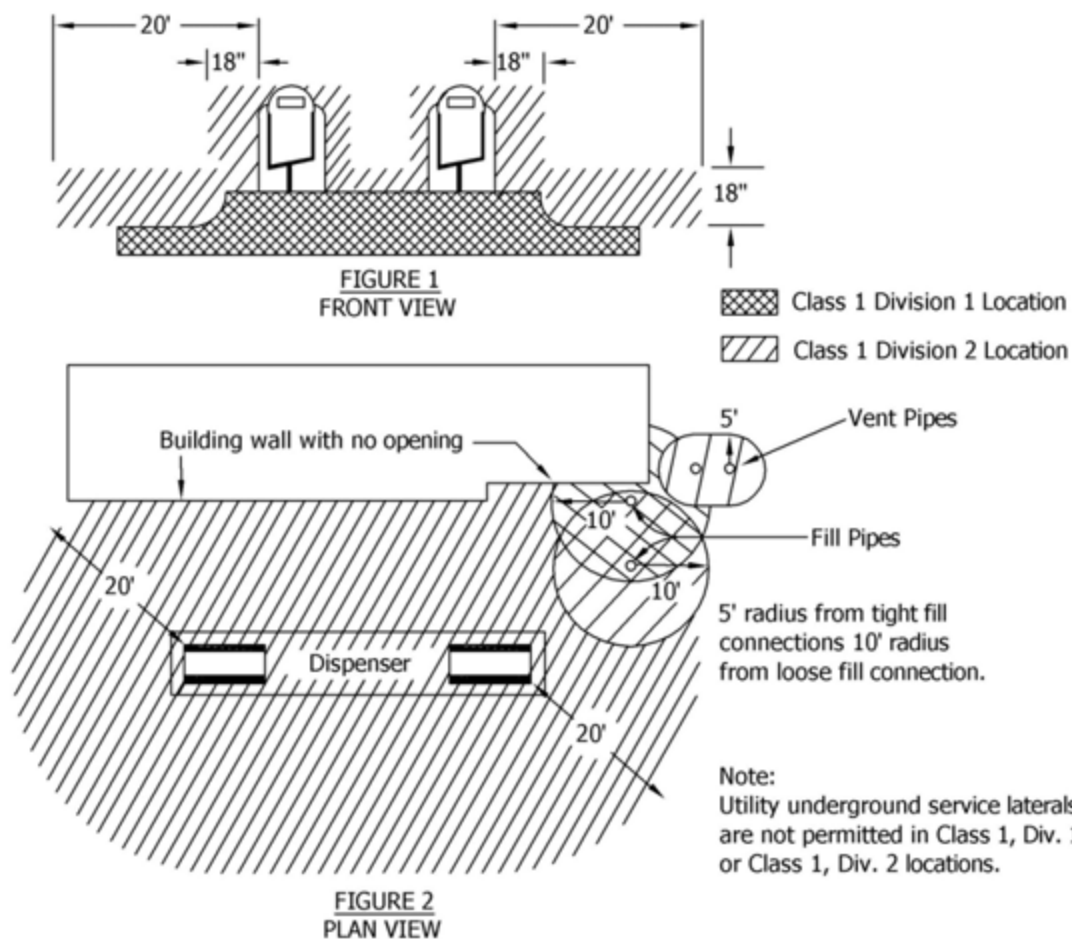

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

**UNDERGROUND ELECTRIC SERVICE LATERAL
GASOLINE DISPENSING & SERVICE STATIONS**

SG 316


This standard shows requirements for installing underground electric service laterals and electric meter panels in proximity to propane tanks.

Above Ground Propane Tanks:

Propane tanks come in three main sizes: 330, 500 and 1,000 gallons. The size selected normally depends on the propane requirements and the size of the structure using the fuel.

Electric meter panels are a source of ignition for propane gas and shall be installed in compliance with the following clearance requirements:

1. The radial horizontal clearance requirement around tanks up to 500 gallons is 10' minimum.
2. The radial clearance requirement around tanks ranging from 501 to 2,000 gallons is 25' minimum.

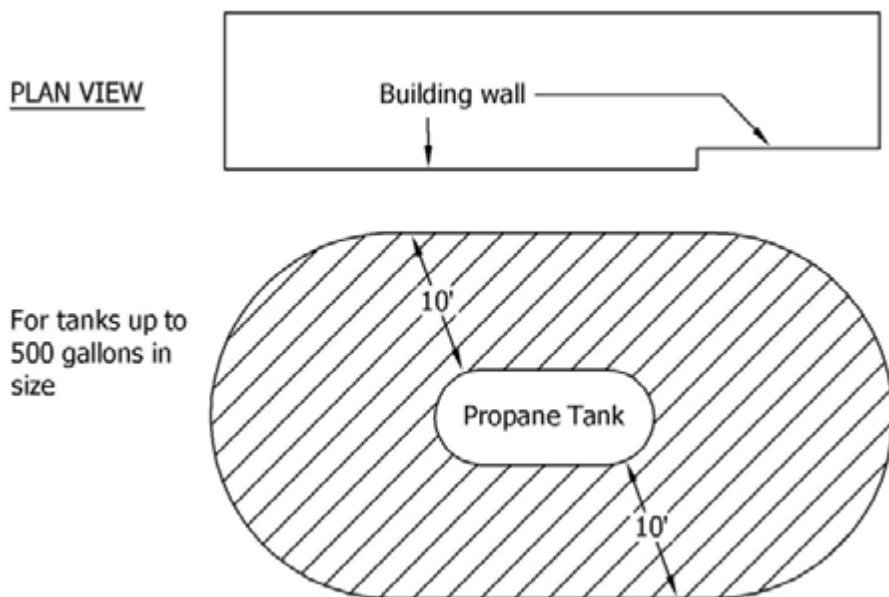

Notes:

1. Underground electric service laterals are not to pass within the 10' clearance area around the propane tanks up to 500 gallons whether it is above ground or subterranean (25' for above ground tanks ranging from 501 to 2,000 gallons).
2. For tanks larger than 2,000 gallons, consult SDG&E Service Standards. Utility-owned underground facilities are not allowed below the surface of a Class 1, Division 1 or Class 1 Division 2 location.

See installation notes on page SG 318.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 2

SDG&E SERVICE STANDARDS & GUIDE


UNDERGROUND ELECTRIC SERVICE LATERAL & METER PANELS IN PROXIMITY TO PROPANE TANKS

SG 317.1

Subterranean Propane Tanks:

Subterranean tanks up to 2,000 gallons require a 10' minimum horizontal clearance from sources of ignition. The only visible part of these tanks is the riser cover, which is about 1' high and 1' in diameter.

For the purposes of planning the placement of an underground electric service lateral and meter location, the customer is responsible for providing the tank size and dimension specifications for subterranean tanks, and marking out the foot print of the tank at the job site. The 10' clearance requirement will be measured from the outside edge of the marked out foot print.

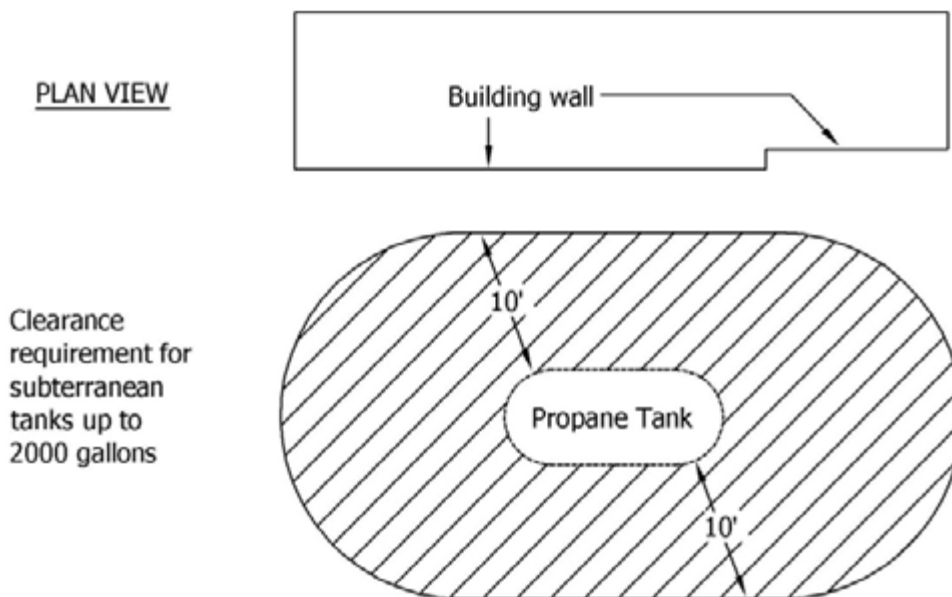

Notes:

1. Underground electric service laterals are not to pass within the 10' clearance area around the propane tank whether it is above ground or subterranean
2. For tanks larger than 2,000 gallons, consult SDG&E Service Standards.

See installation notes on page SG 318.

Standard References:

1. NFPA 58: Liquefied Petroleum Gas Code
2. California Fire Code: Liquefied Petroleum Gases, Chapter 38

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 2

SDG&E SERVICE STANDARDS & GUIDE

UNDERGROUND ELECTRIC SERVICE LATERAL & METER PANELS IN PROXIMITY TO PROPANE TANKS

SG 317.2

This standard provides requirements for installing underground electric service laterals and service and metering equipment near gasoline dispensing equipment and propane tanks.

Installation Notes:

1. If the service lateral, using the shortest practicable route, will not extend through a "hazardous (classified) location", the service and metering equipment may be located on the building.
2. If the service lateral, using the shortest practicable route, would extend through a "hazardous (classified) location", the service and metering equipment must be grouped and located outside, and prior to, the "hazardous (classified) location". The customer would then extend their metered conductors as premises wiring in accordance with requirements of the governmental Authority Having Jurisdiction (AHJ).
3. If there is an acceptable location on the building for the service and metering equipment which is "outside the hazardous (classified) location", and additional facilities could be installed so the service lateral would not encroach in the "hazardous (classified) location", but would not be the shortest practicable route for the service lateral from the SDG&E closest source, the customer may be given the option to:
 - a. Locate their equipment as stated in Note 2, or
 - b. Pay the total estimated Rule 2, I, Special Facilities and Maintenance, charges for the additional service lateral conductors required to avoid the "hazardous (classified) location".

Caution: Confirm that the future expansion of tanks, pumps, etc., will not encroach into the area of SDG&E's service lateral conductors installed within the customer's conduit.

Refer to page SG 019 for minimum clearance and separation requirements of energized overhead conductors from containers of flammable or explosive mixtures, such as propane tanks.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed


SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

**UNDERGROUND ELECTRIC SERVICE NEAR GASOLINE
DISPENSING EQUIPMENT & PROPANE TANKS**

SG 318

This standard provides clearance requirements for customer-owned underground electric service lateral conduit, and substructure(s) when required, from leach fields.

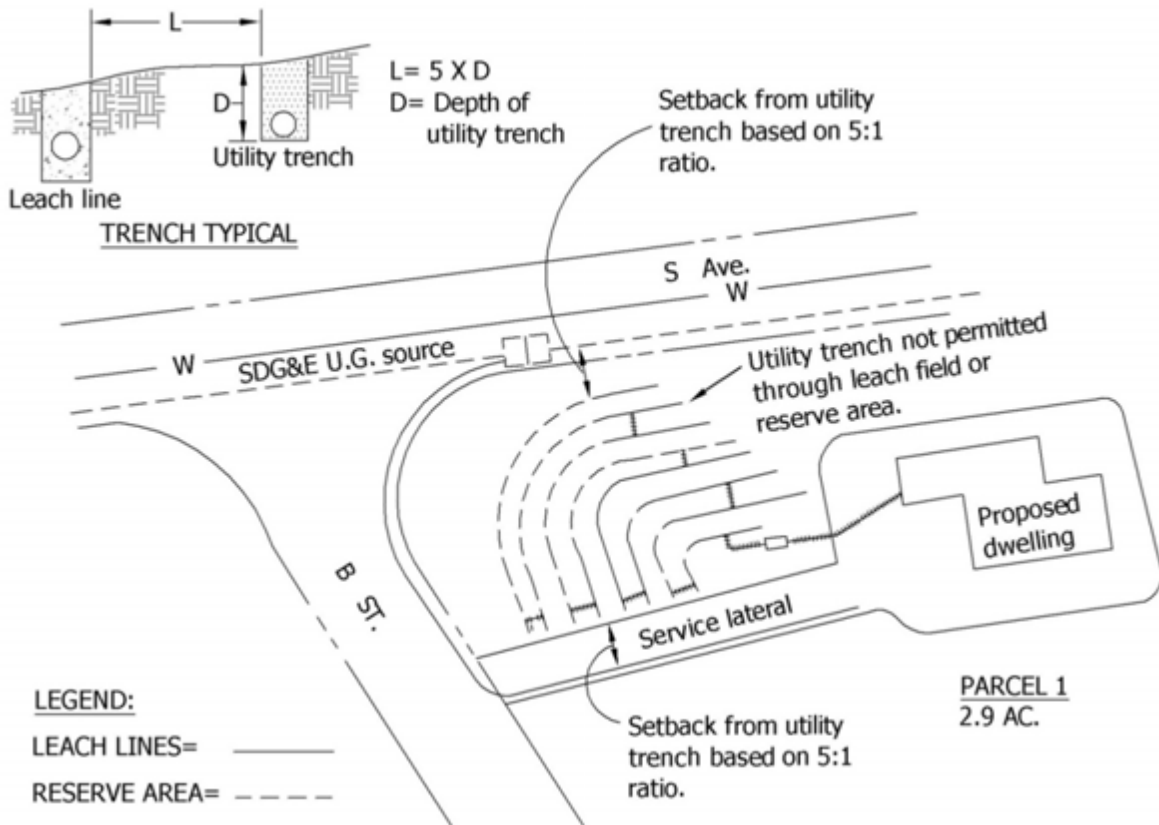

Notes:

1. San Diego County Department of Health Services establishes the standard for the proximity of leach lines and seepage pits to Utility trenches. This standard may affect the route and position of customer gas and electric service laterals.
2. There shall be a five (5) to one (1) setback required from all Utility trenches to the tile lines (leach lines) or seepage pit. The setback shall be measured from the top of the Utility trenches to the closest edge of the tile line or seepage pit. The depth of the Utility trench shall be measured from the ground surface to the bottom of the trench.
3. A 2' minimum separation is required between service lateral conduits and septic tanks and tight lines.
4. Although the customer or their contractor has the ultimate responsibility for adhering to these requirements, the Planner should be aware of the location of the leach lines in order to avoid establishing service routes through these areas.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

UNDERGROUND ELECTRIC SERVICE
LATERAL FROM LEACH FIELDS

SG 319

SIDA Description: Secondary-in-Duct Aluminum (SIDA) and Cable In Conduit (CIC) is a cable assembly that included insulated conductors within flexible duct. Both names refer to the same product. This product was put in production in 1968 and discontinued the use around 1978.

Customers re-wiring, upgrading, and/or relocating their service panel must adhere to current SDG&E Underground Construction Standards (including conduit); however, if SIDA service exists, it may remain provided the following conditions are met:

1. Maximum Panel Size is not exceeded by SIDA cable size as shown on the on the SIDA TABLE.
2. Extending or Splicing from existing SIDA is not allowed; new termination points must be at or below existing points.
3. The existing SIDA service appears to be in good condition, free of defects and imperfections which may impact safety and reliability.
4. If, for any reason, the existing SIDA service cannot be utilized, the customer must provide new trench and conduit to the existing source per current SDG&E standards (SG 309.1 - 309.3).

SIDA TABLE

Existing SIDA Table	Existing Conduit Size	Maximum Panel Replacement
#2 AL	1 1/4"	125 Amps
1/0 AL	1 1/2"	150 Amps
3/0 AL	2"	200 Amps
350 AL	2 1/2"	225 Amps

Notes:

1. Electric service panel relocations require trenching and new conduit from new panel location to SDG&E source.
2. Intercepting SIDA service with a handhole, or another substructure is not allowed.
3. Non-plastic conduit, such as steel conduit does not meet current SDG&E construction standards.
4. The planner will determine whether the customer must pothole existing service to determine whether SIDA exists. Potholes are the customer's responsibility and DigAlert notification is required prior to digging.

© 1998-2020 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	New Page	IPJ	SSH	TPM	08/20/19	D					
B	Revision	CSE	IPJ	CZH	04/13/20	E					
C						F					

SHEET 1 OF 1	X Indicates Latest Revision	Completely Revised	New Page	Information Removed
	SDG&E SERVICE STANDARDS & GUIDE			
	EXISTING SIDA SERVICE - PANEL REWIRES, UPGRADES, AND RELOCATIONS			

SSG 320

**500 - ELECTRIC SERVICE
& METER EQUIPMENT**

**500 - ELECTRIC SERVICE
& METER EQUIPMENT**

<u>PAGE #</u>	<u>SUBJECT</u>
SG 501	Table of Contents
SG 502.1 – 502.4	Alphabetical Subject Index
SG 503	General Information
SG 504.1 – 504.5	Electric Meter & Service Location – Commercial & Residential Premises
SG 505	Barriers for Service & Metering Equipment
SG 506.1 – 506.4	Electric Meter Room
SG 507.1 – 507.2	Single or Multiple Meter Installations – Commercial or Residential Applications
SG 508.1 – 508.2	Meter Cabinet Recess – Single Meter Residential Application Only
SG 509.1 – 509.4	Electric Meter Cabinet – Commercial or Residential Multi-Meter Installations
SG 510.1 – 510.5	Electric Metering in Mid-Rise & High-Rise Buildings
SG 511.1 – 511.3	Electric Service Disconnects & Meter Service Disconnects
SG 512.1 – 512.8	Residential Self-Contained Service & Metering Equipment
SG 513.1 – 513.3	Test-Bypass Facilities for Safety Sockets
SG 514.1 – 514.5	Safety Socket Meter Cans
SG 515.1 – 515.6	Transformer Rated Meters & Wall-Mounted Service & Metering Equipment
SG 516	Meter Type & Socket Clip Arrangement
SG 517.1 – 517.20	Standard Switchboard Service Sections
SG 518.1 – 518.3	Mobile Home Park Service & Meter Pedestals
SG 519.1 – 519.5	Commercial Meter Pedestals
SG 520.1 – 520.2	Field Replacement of Existing 120-Volt Meter Pedestal
SG 522.1 – 522.2	Wireless Communications on Private Property
SG 523.1 – 523.3	Wireless Communications Provider – Metered Electric Service
SG 524.1 – 524.10	Unmetered Electric Service
SG 525	Metering Communications

Note: SG 521 has been intentionally omitted.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	New Page	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 1	<div></div>	Indicates Latest Revision	Completely Revised	<input checked="" type="checkbox"/> New Page	Information Removed	SG 501
	SDG&E SERVICE STANDARDS & GUIDE					
	ELECTRIC SERVICE & METERING EQUIPMENT TABLE OF CONTENTS					

SUBJECTPAGE #

Electric Service Disconnects & Meter Service Disconnects	SG 511.1 – 511.3
General Information	SG 503
Additions, Alterations or Renewal of Existing Service & Metering Equipment	SG 504.1
Electric Meter & Service Location Request	SG 503, SG 504.1
Existing Gas Meter below Electric Service & Metering	SG 504.1
Ingress & Egress to Electric Service & Metering Equipment.....	SG 504.2
Meter Heights	SG 504.1
Meter Marking	SG 504.1
Metered & Unmetered Conductors	SG 503
Meter Socket Sealing Rings.....	SG 503
Readily Accessible Definition	SG 503
Sealing of Meters & Metering Equipment	SG 503
Sealing Requirements.....	SG 503
Service Entrance Limitations	SG 503
Meter Locations	
Barriers for Service & Metering Equipment.....	SG 505
Commercial & Industrial	SG 504.2 – 504.3
Electric Meter Cabinets	SG 509.1 – 509.4
Electric Meter Cabinet Recess, Single Meter Residential Application	SG 508.1 – 508.2
Electric Meter Rooms.....	SG 506.1 – 506.4
Meter Heights	SG 504.1
Meter Markings	SG 504.1
Meter Pedestal, Commercial 0 – 200 Amps	SG 519.1 – 519.2
Meter Pedestal, Commercial 600 Amps Maximum, Multi-Meter	SG 519.3 – 519.4

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 4	<input type="checkbox"/> Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	<input type="checkbox"/> New Page	<input type="checkbox"/> Information Removed	SG 502.1
	SDG&E SERVICE STANDARDS & GUIDE				
	ELECTRIC SERVICE & METERING EQUIPMENT ALPHABETICAL SUBJECT INDEX				

SUBJECTPAGE #

Meter Pedestal, Field Replacement of Existing 120-Volt Meter Pedestal	SG 520.1 – 520.2
Meter Pedestal Foundation Details	SG 519.5
Meter Pedestal, Residential.....	SG 518.2 – 518.3
Mid-Rise & High-Rise Buildings.....	SG 510.1 – 510.5
Residential.....	SG 504.2
Unacceptable Meter Locations.....	SG 504.3 – 504.4
Meter Type & Socket Clip Arrangement	SG 516
Metering Communications	SG 525
Mobile Home Park Service & Metering Equipment	SG 518.1 – 518.3
Residential Self-Contained Service & Metering Equipment	
Combination Pull & Meter Cans for UG or OH Service	SG 512.1 – 512.3, SG 512.8
Combination Pull & Meter Cans for UG Service.....	SG 512.1, 512.4 – 512.7
Equipment Connected Ahead of a Main Service Disconnect.....	SG 512.1
Meter Socket Closing Devices.....	SG 512.1
Meter Socket Connections	SG 512.1
Self-Contained Meter Sockets Defined	SG 512.1
Self-Contained Meter Sockets	SG 512.1
Safety Socket Meter Cans	SG 514.1 – 514.5
Aluminum Conductors in Safety Socket Meter Cans	SG 514.1
Neutral or Ground Conductor in Safety Socket Meter Cans.....	SG 514.1
Multiple Safety Socket Can Grouping Arrangements for	
Commercial Installations with Self-Contained Meters	SG 514.4
Safety Socket Can 100 Amps (Standard Duty)	SG 514.2
Safety Socket Can 200 Amps (Heavy Duty).....	SG 514.3

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 4	<div><div></div>Indicates Latest Revision</div>	<div><input checked="" type="checkbox"/> Completely Revised</div>	<div><input type="checkbox"/> New Page</div>	<div><input type="checkbox"/> Information Removed</div>	SG 502.2
	SDG&E SERVICE STANDARDS & GUIDE				
	<div>ELECTRIC SERVICE & METERING EQUIPMENT</div> <div>ALPHABETICAL SUBJECT INDEX</div>				

SUBJECTPAGE #

Safety Socket Meter Can Used for Underground Service	SG 514.5
Wiring of Safety Socket Meter Cans.....	SG 514.1
Standard Switchboard Service Sections	SG 517.1 – 517.20
Bus Tap Drawings for Approval	SG 517.1
Electric Utility Service Equipment Requirement Committee (EUSERC)	SG 517.1
Manufacturer's Drawings for Approval	SG 517.1
Meter Socket & Test Switch Panel Layout	SG 517.8 – 517.9
Switchboard Service Section Defined	SG 517.1
Switchboard Service Sections Pictured.....	SG 517.2
Standard Switchboard Service Section 0 – 600 Volts	SG 517.3 – 517.5
Standard Switchboard Service Section 0 – 600 Volts Outdoor/Raintight Enclosure.....	SG 517.6 – 517.7
Standard Switchboard Service Section 0 – 600 Volts Self-Contained Metering, 200 Amp Maximum Meter Socket Capacity	SG 517.10 – 517.11
Standard Switchboard Service Section, 0 – 600 Volts, Instrument Transformer Compartment 201 – 400 Amps Single-Phase Service.....	SG 517.12
Standard Switchboard Service Section, 0 – 600 Volts, Instrument Transformer Compartment 201 – 1,000 Amps Three-Phase Service	SG 517.13 – 517.14
Standard Switchboard Service Section, 0 – 600 Volts, Instrument Transformer Compartment 1,001 – 3,000 Amps, Three-Phase Service.....	SG 517.15 – 517.16
Standard Switchboard Service Section, 0 – 600 Volts, 1,001 – 3,000 Amps, Removable Link & CT Support for Instrument Transformer Compartments with 4" Bus.....	SG 517.17
Standard Switchboard Service Section, 0 – 600 Volts, Instrument Transformer Compartment 3,001 – 4,000 Amps, Three-Phase Service.....	SG 517.18 – 517.19
Standard Switchboard Service Section, 0 – 600 Volts, 3,001 Amps & Larger, Removable Link & CT Support for Instrument Transformer Compartments with 5" Bus.....	SG 517.20
Test-Bypass Facilities for Safety Sockets.....	SG 513.1 – 513.3
Ventilation	SG 517.2

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 3 OF 4	Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	<input type="checkbox"/> New Page	<input type="checkbox"/> Information Removed	SG 502.3
	SDG&E SERVICE STANDARDS & GUIDE				
	ELECTRIC SERVICE & METERING EQUIPMENT ALPHABETICAL SUBJECT INDEX				

PAGE #

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 4 OF 4	Indicates Latest Revision	X	Completely Revised	New Page	Information Removed	SG 502.4
	SDG&E SERVICE STANDARDS & GUIDE					
	ELECTRIC SERVICE & METERING EQUIPMENT ALPHABETICAL SUBJECT INDEX					

ELECTRIC METER & SERVICE LOCATION REQUEST

Contact the Service Planner at the Regional Project Management Office closest to the job location for an "Electric Meter & Service Location" form before starting construction. See page SG 2. You may also request via the Internet at: <http://www2.sdge.com/serviceform/mainpage.htm>

METERED & UNMETERED CONDUCTORS

Line side (unmetered) and load side (metered) conductors are prohibited from occupying the same raceway or enclosure by both SDG&E (Utility) policy and the California Electrical Code. Exception: Meter sockets and safety socket cans.

METER SOCKET SEALING RINGS

Meter sockets shall be equipped with approved sealing rings as a part of the meter socket installation and shall be provided by the manufacturer.

READILY ACCESSIBLE DEFINITION

Capable of being reached quickly and conveniently 24-hours a day for construction, operation, maintenance, inspection, testing, or meter reading without requiring those seeking access to climb over or remove obstacles; or to obtain special permission or security clearances. Truck access may be required.

SEALING OF METERS & METERING EQUIPMENT

All meters and enclosures for meters, metering equipment, and service entrance equipment on the line side of the meter, except as approved for access to replace fuses used for over-current protection, will be sealed by the Utility. The Utility seal shall not be broken except by an authorized representative of the Utility, or with the Utility's permission granted in response to a request warranting approval. No person is permitted to tamper, or in any way interfere, with a meter or its connections as placed by the Utility. All removable access covers for compartments containing unmetered conductors shall be sealable. When a raceway, conduit or conduit is necessary for unmetered conductors, it shall be sealable. No removable panel or cover requiring sealing shall be located behind other panels, covers or doors (except NEMA 3R outdoor raintight enclosure doors). All 400 amp, and above, service switches or breakers shall have provisions for locking in the open/off positions.

SEALING REQUIREMENTS

Sealing latches, stud and wing-nuts, or sealing screws shall be provided as the means of sealing removable or hinged access covers. Studs and wing-nut assemblies shall consist of a 1/4" x 20 (minimum) stud and an associated wing-nut, each drilled 0.0635" (minimum) for sealing purposes. Sealing screws shall be drilled 0.0635" (minimum) for sealing purposes. Latching devices shall be designed to permit positive locking and be made of a durable corrosion resistant material.

SERVICE ENTRANCE LIMITATIONS

Single-phase service is normally limited to 400 amps maximum. Individual three-phase switchboards are limited to 4,000 amps maximum. Refer to the Switchboard Service Section on pages SG 517.1 – 517.20 for further information.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

GENERAL INFORMATION

SG 503

GENERAL INFORMATION

1. On new installations, it is necessary that the location for the meter and its related service disconnect be approved in writing by an SDG&E (Utility) Planner. This can be accomplished by the customer or contractor calling the Utility's nearest Regional Office (see page SG 2) and requesting an Electric Meter & Service Location form, or via the Internet at:
<http://www2.sdge.com/serviceform/mainpage.htm>
2. The location for the meter and service disconnect shall comply with applicable codes, laws and ordinances of the governmental Authority Having Jurisdiction (AHJ), and with the requirements of the Utility's Service Standards & Guide.
3. Meter Heights
 - a. When meters are located in a meter room or when fully enclosed in a cabinet, the minimum height of the meter socket may be 3' and the maximum height shall not exceed 6'-3". These heights are measured from the standing surface to the centerline of the meter socket. Cabinets shall not impair working space.
 - b. When meters are wall- or surface-mounted, but not located in a meter room or cabinet, the minimum height of the meter socket shall be 4' and maximum height shall not exceed 6'-3". These heights are measured from the standing surface to the centerline of the meter socket. Exception: for multi-meter panels located on an exterior wall, the minimum meter height may be reduced to 36". See Figure 2 on page SG 507.1.
4. Meter Marking
 - a. Each meter socket and its related service disconnect shall be clearly and permanently marked with minimum 1/2" number/letters by the contractor or customer to indicate the occupancy or load served. Marking with felt pen or fingernail polish is not acceptable.
 - b. Examples of permanent marking are:
 - 1) An identification plate secured by screws, rivets or equivalent secure adhesive
 - 2) Weatherproof paint applied with stencil or legible lettering
 - 3) Commercially available decals
 - c. Identification means a street, apartment or suite number.

Exceptions: In a multi-metering section where the service disconnect is located immediately adjacent to the meter socket (to the side), it is acceptable to mark only the service disconnect. At the option of the Utility, marking may be omitted or done in other manners for a single-family residence.
5. Whenever any addition, alteration or renewal is contemplated in existing service lateral conduits, service entrance conductors or metering equipment, the customer or contractor shall contact the area Planner for an approved Electric Meter & Service Location form. This is imperative to provide advice regarding correction of any existing unacceptable conditions.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 5	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 504.1
	SDG&E SERVICE STANDARDS & GUIDE					
	ELECTRIC METER & SERVICE LOCATION COMMERCIAL & RESIDENTIAL PREMISES					

6. Existing electrical service and metering equipment located above existing gas meter set assembly (GMA) are considered non-compliant with current standards but may remain as is. Any upgrades and/or rewires of the electrical service and metering equipment will require the relocation of either the electric or gas service.
7. Additional meters may be grouped with those already in service provided the existing service and meter location is acceptable to the Utility. The added service equipment must be located and installed in conformance with applicable codes, laws and ordinances enforced by the AHJ, and with the requirements of the Utility.
8. All meters serving multiple buildings or other remote loads must be grouped on or at the building or structure where the Utility's service connection is made. See examples on pages SG 008.1 – 008.6.
9. Meter locations and service connections on exterior walls of bedrooms or normally occupied spaces should be avoided whenever possible.
10. The minimum ingress and egress to service equipment and meter locations is 24" in width. This requirement allows a safe access and exit route for installation, testing and maintenance of the service and metering equipment.

METER LOCATIONS – RESIDENTIAL

1. For single and multi-family residential buildings, meters and metering equipment may be installed:
 - a. Outdoors and mounted on, or recessed in, an exterior building wall. See Note 7 above, SG 504.1 and pages SG 507.1 – 508.2.
 - b. In a room within a building, approved by the Utility for the location of electric meters, with provision for proper illumination, and with access only by a door opening to the outside of the building. See pages SG 506.1 – 506.4 for additional electric meter room and locking requirements.
2. For multi-family residential buildings less than three floors, meters and metering equipment are to be grouped in one central location that is readily accessible to the Utility 24-hours a day in accordance with 1a or 1b above. Refer to pages SG 011.1 – 012.3 for Electric Service Policies.
3. Refer to pages SG 510.1 – 510.5 for Electrical Metering in Mid-Rise and High-Rise Buildings. Consult with the Utility Planner for approval of meter and metering equipment locations in the early planning phases of the project to avoid re-engineering and possible delays.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------

**SHEET
2 OF 5**

SDG&E SERVICE STANDARDS & GUIDE

ELECTRIC METER & SERVICE LOCATION COMMERCIAL & RESIDENTIAL PREMISES

SG 504.2

METER LOCATIONS – COMMERCIAL & INDUSTRIAL

1. For single-occupancy buildings, meters and metering equipment may be installed:
 - a. Outdoors and mounted on, or recessed in, an exterior building wall. See pages SG 507.1 – 507.2.
 - b. In a room within a building, approved by the Utility for the location of electric meters, with provision for proper illumination, and with access only by a door opening to the outside of the building. See pages SG 506.1 – 506.4 for additional electric meter room requirements.
2. For multi-occupancy buildings not exceeding two floors, meters and metering equipment are to be grouped in one central location that is readily accessible 24-hours a day to Utility personnel in accordance with the conditions prescribed by 1a or 1b above. Refer to pages SG 011.1 – 012.3 for Electric Service Policies.
3. Refer to pages SG 510.1 – 510.5 for Electrical Metering in Mid-Rise and High-Rise Buildings. Consult with the Utility's Planner for approval of meter and metering equipment locations in the early planning phases of the project to avoid re-engineering and possible delays.
4. For service stations, the Utility's underground service lateral conductors may not extend through a hazardous (classified) Class 1 location as defined by Article 514 of the California Electrical Code. The underground service and metering equipment shall be located outside, and prior to, the hazardous area at a location approved by the Utility's Planner. See pages SG 316 and SG 318.

UNACCEPTABLE METER LOCATIONS

For reasons of public safety, maintenance of service, and reliability of metering, it is not permissible to install meters and metering equipment:

1. Inside any building, unless located within an acceptable electric meter room. See pages SG 506.1 – 506.4 for requirements of an electric meter room.
2. In commercial or residential carports or garages, or under a patio cover.
3. In a location not readily accessible 24-hours a day for reading, maintenance, or replacement of the metering equipment by the Utility. See definition of "readily accessible" on page SG 503.
4. In a substation area or in a transformer vault containing transformer(s) or medium-voltage equipment.
5. In any location which is hazardous or unsuitable for entry by meter readers or service personnel, i.e. uncontrolled or unrestrained animals, etc.
6. On any surface subject to excessive vibration.
7. In rest, bath, shower, powder or toilet room.
8. In an elevated area (such as balcony or mezzanine) or a depressed area (such as basement, cellar or underground room) that does not have access by means of a stairway of normal rise (4" to 7") and

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
3 OF 5

SDG&E SERVICE STANDARDS & GUIDE


ELECTRIC METER & SERVICE LOCATION COMMERCIAL & RESIDENTIAL PREMISES

SG 504.3

run (11" minimum) conforming to building code requirements. Shipboard ladders are unacceptable for ingress and egress. Minimum headroom of 6'-6" must be maintained in all cases.

9. In a place where excessive moisture, fumes, dust or similar deteriorating agents will interfere with its operation, unless it is enclosed in a manner approved by the Utility. For example, at a carwash in an area exposed to excessive moisture and deteriorating agents, service and metering equipment is not allowed.
10. In a room which does not meet the requirements of an electric meter room. See pages SG 506.1 – 506.4.
11. On poles owned by the Utility. See pages SG 203.1 – 205.4 for customer-owned meter pole requirements.
12. On buildings or other structures that are not directly served by the Utility's service connection.
13. Medium-voltage installations that do not have vehicle access to the service and metering equipment.
14. Directly over any stairway, ramp or steps.
15. In any area protected by alarm systems, security gates or doors, guard dogs, etc., unless approved by the Utility. See definition of "readily accessible" on page SG 503.
16. On any portion of a building where future landscaping, fencing or other building construction will make the meter(s) inaccessible.

WORKING SPACE – ELECTRIC SERVICE & METERING EQUIPMENT, 0 – 600 VOLTS

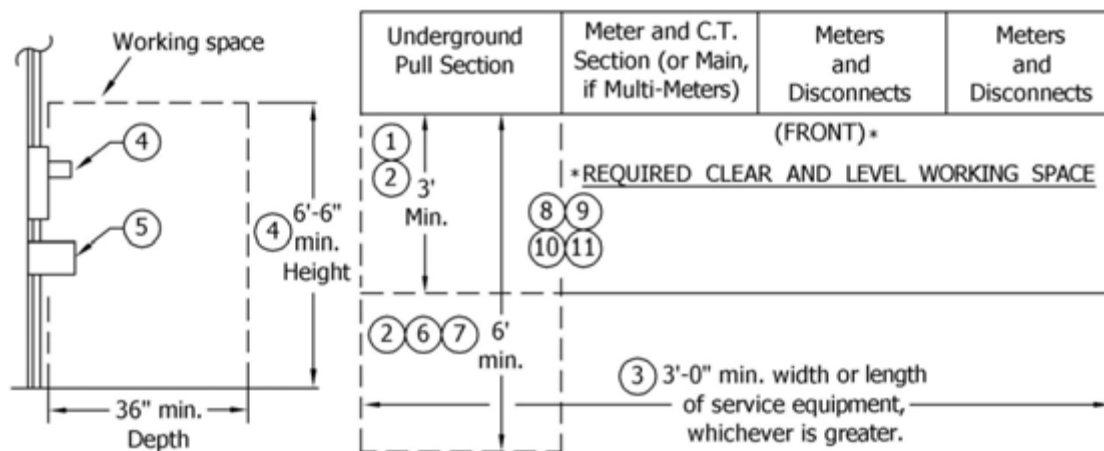

Notes:

- ① To permit access to the metering installation and to provide safe working conditions for personnel, a working and standing space entirely on the property of the customer is to be provided in front of all service and metering equipment. (See page SG 505 for barrier requirements.)

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
4 OF 5

SDG&E SERVICE STANDARDS & GUIDE

ELECTRIC METER & SERVICE LOCATION COMMERCIAL & RESIDENTIAL PREMISES

SG 504.4

- ② A minimum of 3' clear and level work space is required for underground pull sections, current transformer metering sections, and metering equipment. Pull cans/sections requiring 5" conduits must allow a minimum of 6' clear and level working space in front of the pull can/section. Verify location of pull sections with the SDG&E Planner prior to installation. The working space is to be kept clear and unobstructed.
- ③ The width and depth of the working space must allow ready access to complete the service and metering installation, and in no case be less than 3'. Refer to Note 10 on page SG 504.2 for minimum ingress and egress requirements.
- ④ Meter height will be measured from the standing surface of the working space to the centerline of the meter socket. The height clearances for the working space must be no less than 6'-6" as measured from the clear and level working surface to any overhead obstruction. Refer to meter heights on page SG 504.1.
- ⑤ Equipment associated with the electrical equipment and installed below the meter panel(s) may extend into the working space up to 6".
- ⑥ When non-raintight service equipment is installed within a building on an elevated portion of the floor, or "housekeeping pad", **the pad must be flush with the service equipment.**

CAUTION: If a switchboard is installed on a housekeeping pad or slab greater than 2-1/2" thick, a meter height problem could result. The 6'-3" maximum allowable meter height applies to all installations.

- ⑦ When outdoor raintight service equipment is installed on a housekeeping pad, the housekeeping pad must be level and extend a minimum of 3' measured from the face of the meter panel, or 6' when 5" conduit is required. If the enclosure doors are wider than 3', the housekeeping pad shall extend 1" beyond the outer edge of the equipment doors when opened at 90 degrees. See pages SG 517.6 – 517.7 for outdoor raintight enclosure (NEMA 3R) requirements.
- ⑧ For 480-volt service, consult with the AHJ for their requirements.
- ⑨ For medium-voltage switchgear, refer to Section 600.
- ⑩ To maintain a safe, clear, and level working area in front of new or existing non-residential meter and service equipment, a concrete slab acceptable to the Utility Inspector is required. This also applies to residential living units exceeding two in number on the same premises, which are classified as a commercial enterprise and premises.
- ⑪ In addition, the concrete slab is to extend a minimum of 6' clear and level for working space in front of service cable terminating pull sections when 5" service conduit is required. For drainage purposes, the slope of the working space is not to exceed 1/4" per foot sloping away from the equipment.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
5 OF 5


SDG&E SERVICE STANDARDS & GUIDE

**ELECTRIC METER & SERVICE LOCATION
COMMERCIAL & RESIDENTIAL PREMISES**

SG 504.5

The customer will provide and install "non-removable" barriers to provide the clearances where working space is exposed to vehicle or hazardous conditions. Service and metering equipment located on public or private property must be installed a minimum of 5' back from face of curb or is considered subject to vehicular contact and requires barriers. An SDG&E Inspector will determine if a barrier can be omitted when existing structures can protect personnel and equipment. Meters will not be set until the barriers are installed.

Barrier posts are used to protect meter and service equipment and personnel from vehicular contact and to prohibit encroachment into the working space. For example: Loading zones, driveways, congested areas, alleys, off street parking, etc.

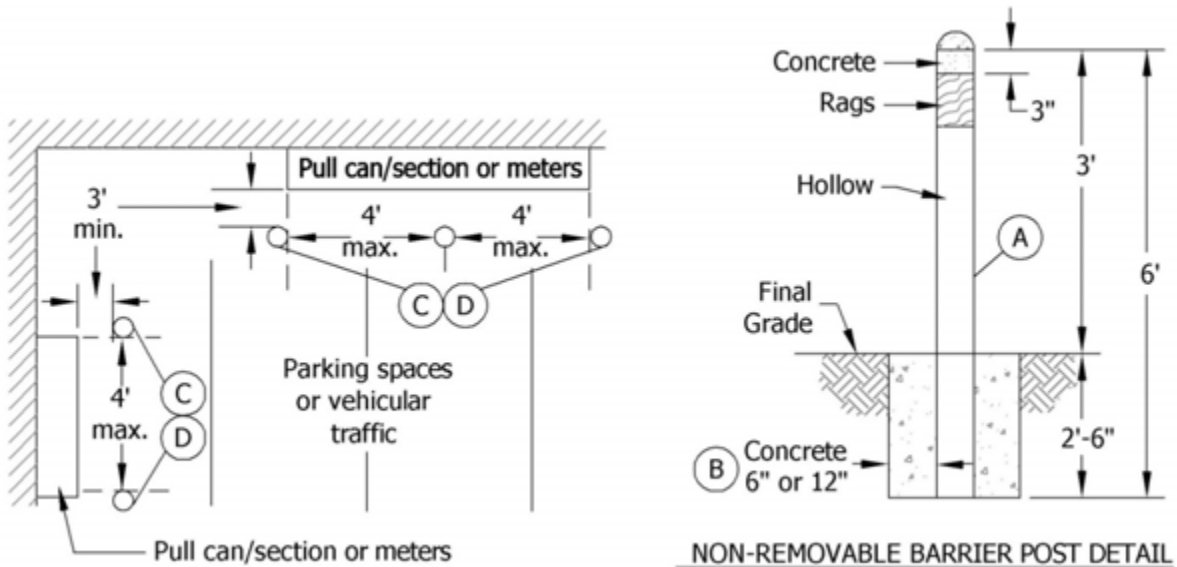

Note: Meters located on a wall adjacent to any parking area or area accessible to vehicular traffic must be protected by non-removable barriers. Wheel stops and removable barriers are not acceptable substitutes. Maintain a minimum of 3' clear and level working space in front of the cabinets or enclosures. Barriers must be so positioned to allow the doors to be opened 90 degrees.

Installation:

- (A) Use 4" steel pipe, black or galvanized steel, with a minimum wall thickness of 0.188".
- (B) The concrete encasement shall be a minimum of 6" thick in stable soil and 12" thick in sandy or unstable soil.
- (C) Barriers must be installed in line with each end of service equipment to prevent vehicle contact. Distance between barriers may not exceed 4'.
- (D) Refer to SG 504.4 – 504.5 for working space clearances. Barriers are not allowed in the required working space.
- E. Before you install barriers, call DigAlert at 811 and/or visit <http://www.digalert.org/> for markout service at least two working days prior to excavating.

© 1998- 2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

BARRIERS FOR SERVICE & METERING EQUIPMENT

SG 505

ELECTRIC METER ROOM DEFINITION – An electric meter room is a weatherproof, illuminated room provided by the customer at their option and approved by SDG&E (Utility) for the location of the electric service and/or metering equipment. Chain link fence is not acceptable as a separating wall. All requirements of this standard shall apply.

ACCESS – Access must be through a door on the building exterior to provide immediate 24 hour-a-day access. The door shall open out of the electric meter room in the direction of egress. If the door is to be locked, the lock must be keyed to SDG&E's Restricted VTQP Schlage Quad Section keyway. A lockbox for customer keys is not acceptable. If a second door or opening in the electric meter room permits access to the building interior, the building owner, and other parties as determined by the Utility, will be required to sign a Meter Access Easement which will release the Utility from any loss or injury arising from the access. This door shall swing out of the meter room in the direction of egress.

COMMUNICATION EQUIPMENT – Telephone, CATV, data processing equipment and other types of communication equipment are not permitted in an electric meter room. A single conduit containing communication wiring or cables may be installed in a straight, continuous section, running vertically through an electric meter room provided the conduit is not located in the dedicated electrical space and it does not encroach into the working space. Conduit should not be run horizontally through an electric meter room because it may encumber space needed for future expansion of the customer's electrical system. Access to communication equipment rooms or spaces through an electric meter room is not permitted.

Exceptions:

1. Communication equipment is allowed in a meter room serving a single family residence.
2. Communication conduit, wiring and other related devices for automated meter reading are allowed in electric meter rooms.

DEDICATED ELECTRICAL SPACE – The space equal to the width and depth of the equipment and extending from the floor to a height of 6' (1.8 m) above the equipment or to the structural ceiling, whichever is lower, shall be dedicated to the electrical installation. No piping ducts, leak protection apparatus, or other equipment foreign to the electrical installation shall be located in this zone.

Exception: Suspended ceilings with removable panels shall be permitted within the 6' (1.8m) zone.

DOORS – The entrance to the electric meter room shall be through a vertical doorway not less than 3'-0" wide or the width of the pull section, whichever is greater, and 6'-6" high. The door shall open out in the direction of egress, and shall utilize lever operated" hardware. Lever-operated hardware is a type that permits the door to be opened from inside the room without the use of hands. For electric meter rooms containing services rated 800 amps or more, the door shall be equipped with panic bars, pressure plates, or other devices that are normally latched but open under simple pressure. When the pull section is not directly in front of the meter room door, a double-door assembly is required. If two doors are required by code for emergency egress, both doors must be equipped with panic hardware. On double-door assemblies, both doors must be equipped with panic hardware. The maximum allowable doorsill height is 2". Security alarm systems may be connected to a meter room access door provided the alarm is deactivated Monday through Saturday between the hours of 7:00 a.m. and 9:00 p.m., excluding holidays.

This will enable Utility personnel to access Utility-owned equipment during our normal business hours without activating the alarm. Should Utility employees, or their agents, activate the alarm while

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 4	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 506.1
	SDG&E SERVICE STANDARDS & GUIDE					
	ELECTRIC METER ROOM					

performing their duties; the Utility will not be responsible for the cost of law enforcement or security company response calls.

FOREIGN SYSTEMS – The following equipment is not permitted within the electrical equipment room. Such equipment includes, but is not limited to, the following:

1. Gas equipment, including customer gas piping.
2. Water heaters, boilers and other mechanical equipment.
3. Communications equipment. See Communications Equipment information on page SG 506.1.
4. Storage of any materials, liquids, paints, etc.
5. Fire and security alarm systems.
6. Wet filled batteries and battery charging equipment. Note: Batteries that are part of a UPS system that are a sealed type, non-gassing and non-venting, are allowed in an electric meter room provided they do not encroach in the working space or the minimum 24" access and exit route.
7. Irrigation and sprinkler controllers.
8. Diesel and combustible fuel tanks.
9. Refrigerant pipe lines.

Exception: Lighting controllers are allowed in an electric meter room when the branch circuit over current device for the lighting is located in the meter room.

Sprinkler Protection: Sprinkler protection shall be permitted for the dedicated space where the piping is installed in compliance with the "Dedicated Electrical Space" and "Foreign Systems" requirements noted above. Note: Only sprinkler supply piping and heads required per State and local fire and building codes to protect the room itself are allowed. A "Main Fire Sprinkler" line is not allowed to pass through an electric meter room unless a sprinkler head serving the room is connected directly to the main line. Placement of sprinkler heads and shielding requirements are the responsibility of the Fire Marshall or Building Inspector, not the Utility.

HEADROOM – The minimum headroom in an electric meter room shall be 6'-6" high. The actual height of the room will be determined by the customer in order to obtain the 8" clearance required from centerline of the highest meter socket.

IDENTIFICATION/MARKING REQUIREMENTS – Each meter socket/base and its related meter service disconnect shall be clearly and permanently marked by the contractor or customer to indicate the occupancy or load served, i.e. unit or suite number, fire alarm, house meter, etc. Examples of permanent marking are as follows: (1) an identification plate secured by screws, rivets, or equivalent secure adhesive, (2) weatherproof paint applied with stencil or clear lettering, or (3) commercially available decals. Identification means a street, apartment, or suite number. Felt pen or fingernail polish is not acceptable. At the option of the Utility, marking may be omitted or identified differently for a single-family residence. Exception: In a multi-metering section where the meter service disconnects are located immediately adjacent to the meter sockets (to the side, above or below) it is acceptable to mark only the service disconnects.

ILLUMINATION – The light must be controlled by an on-off wall switch. Timers or motion detectors are not allowed to control the light. For the safety of electrical workers, the Utility recommends 30" candles measured at the floor as the minimum lighting level in an electric meter room.

METER CLEARANCES – All meter installations must provide minimum clearances as shown on page SG 506.4.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 4	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 506.2
	SDG&E SERVICE STANDARDS & GUIDE					
	ELECTRIC METER ROOM					

METER HEIGHTS – The minimum height of the meter shall be 3' and the maximum height shall be 6'-3" as measured from the standing surface to the centerline of the meter socket.

ROOF ACCESS LADDERS – Ladders used for roof access are allowed in a meter room provided they are located outside the required working space area. The Utility does not recommend roof access through an opening in an electric room due to roof hatches being inadvertently left open allowing water entry during rain storms.

PULL SECTIONS – The position of a pull section in a meter room is subject to approval by the Utility.

1. Pull sections should be positioned:
 - a) Opposite the access door to allow use of the doorway as additional working space for cable pulling equipment; or
 - b) On a wall perpendicular to the access door.Note: Do not locate on the same wall as the access door.
2. Pull sections that require 2", 3" or 4" conduits must allow a minimum of 3' clear and level working space in front of the section. For medium voltage pull section clearances, refer to pages SG 608.1 – 608.3.
3. Pull sections requiring 5" conduits must allow a minimum of 6' clear and level working space in front of the section.
4. Refer to page SG 309.1 for required conduit size.
5. Additional clearances may be required by the local Authority Having Jurisdiction (AHJ) for 480 volt services.

READILY ACCESSIBLE – Capable of being reached quickly and conveniently 24 hours a day for construction, operation, maintenance, inspection, testing or reading, without requiring those seeking access to climb over or remove obstacles; or to obtain special permission or security clearances. A stairway of normal rise (4" to 7") and run (11" minimum) conforming to building code requirements is acceptable. Shipboard ladders are unacceptable.

ROOM & SUITE IDENTIFICATION – The meter room must be permanently identified on the exterior of the door as shown in the example on page SG 506.4. Decals are available from the Utility but must be installed by customer. When a building has more than one meter room, a plaque identifying the room and the suites served from the service in the room must be secured to the exterior of the door. See pages SG 017.1 – 017.3 for plaque requirements.

STRUCTURAL CEILING – Drop, suspended and similar ceilings not intended to add strength to the building structure are not structural ceilings.

VEHICLE ACCESS – Permanent vehicle access to the meter room is required for the installation and maintenance of the service lateral conductors and metering equipment. Under some conditions, as determined by the Utility, the vehicle access requirement may be waived. See pages SG 016.1 – 016.2 for Pulling Devices for Installation of Service Lateral Conductors in Parking Structures.

VENTILATION – The Utility does not have a requirement for ventilation of electric meter rooms. The AHJ is responsible for enforcement of ventilation in electrical meter rooms, when required, for compliance with the California Electric Code, Building Code or Mechanical Code.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 3 OF 4	X	Indicates Latest Revision		Completely Revised		New Page		Information Removed	SG 506.3
	SDG&E SERVICE STANDARDS & GUIDE								
	ELECTRIC METER ROOM								

SG 506.4

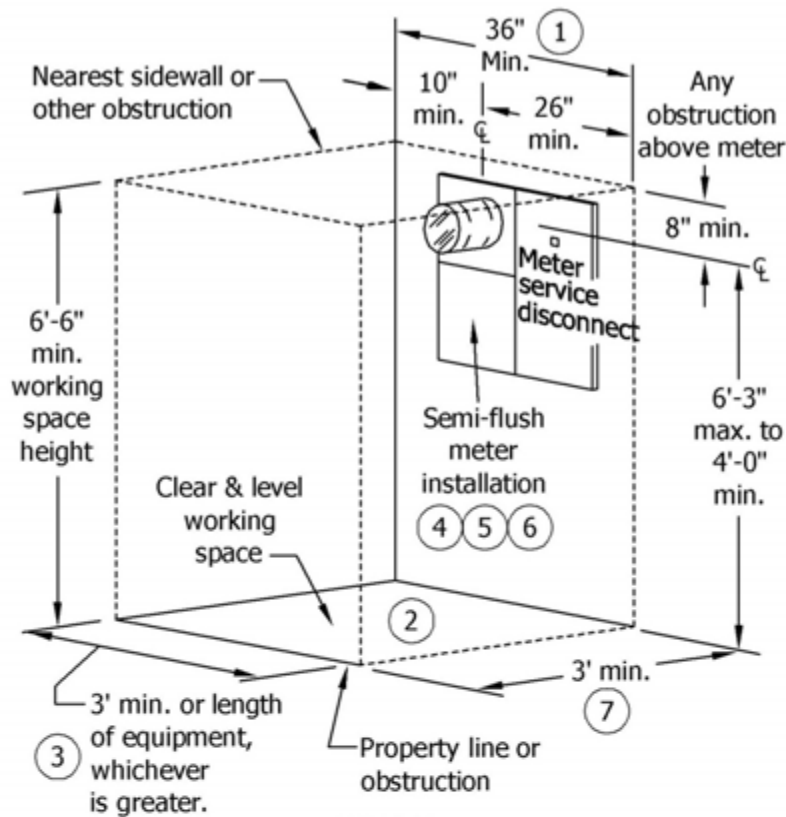


FIGURE 1
Semi-Flush Exterior Meter Installation

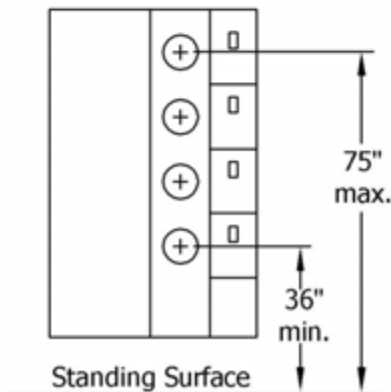


FIGURE 2
Multiple Meter Installation for Exterior Locations Commercial or Residential

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 2

SDG&E SERVICE STANDARDS & GUIDE

**SINGLE OR MULTIPLE METER INSTALLATIONS
COMMERCIAL OR RESIDENTIAL APPLICATIONS**

SG 507.1

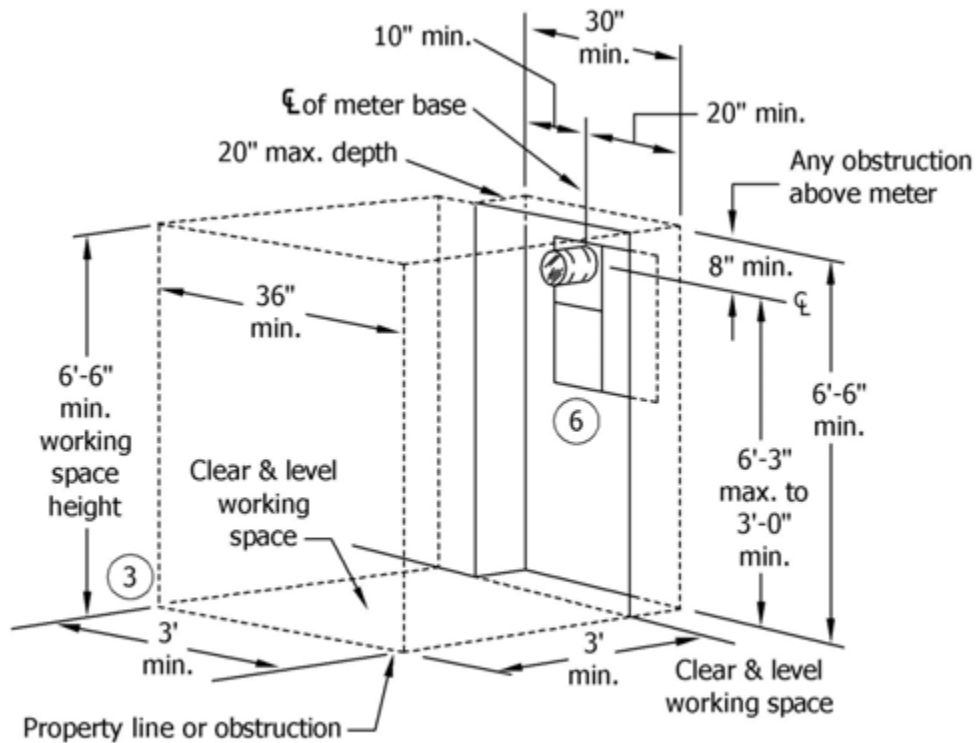


FIGURE 3
Recess Single Meter "Residential Application Only"

Notes to Figures 1 – 3:

- ① The 10" and 26" dimensions may vary depending on site conditions and equipment configuration, but in no case shall the left or right side clearance from centerline of the meter socket to an obstruction be less than 10", and the overall width of working space must be 36" minimum.
- ② For hardscape working space requirements, refer to Notes 6, 7, 10 and 11 on page SG 504.5.
- ③ For barrier requirements see page SG 505.
- ④ Residential equipment shown, however, this standard is also applicable to commercial equipment (not shown).
- ⑤ This standard also applies to wall-mounted and free-standing switchboards (not shown).
- ⑥ See pages SG 508.1 – 508.2 for additional Meter Cabinet Recess requirements.
- ⑦ See page SG 504.5, Note 8 for 480-volt service, and Note 9 for medium-voltage switchgear.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 2

SDG&E SERVICE STANDARDS & GUIDE

SINGLE OR MULTIPLE METER INSTALLATIONS
COMMERCIAL OR RESIDENTIAL APPLICATIONS

SG 507.2

GENERAL INFORMATION

A meter cabinet recess is allowed for a single meter residential application only and is limited to single-phase service.

The meter cabinet recess must have sufficient depth to provide clearance for the meter in addition to the depth required for the meter panel. All clearances must be met to insure the meter can be installed safely.

DEPTH OF RECESS

A 7" minimum clearance is required from face of meter panel to inside of cabinet door. 11" maximum from face of meter panel to the outside of cabinet door and the exterior building wall is required. See Figure 1 and Figure 3 page SG 508.2.

WIDTH OF RECESS

A 10" minimum clearance measured from the vertical centerline of the meter socket to the hinged door side is required. A 20" minimum clearance measured from the vertical centerline of the meter socket to the side opposite the hinged door is required. See Figure 2 and Figure 3 on page SG 508.2.

DOOR REQUIREMENTS

The door must be a minimum of 6'-6" high, full length, side-hinged, and designed to secure in the open position at 90 degrees or more. Should the door, when opened to 90 degrees obstruct the exit route, it must be hinged to allow the door to open between 90 and 180 degrees to obtain the minimum 24" exit route. See Figure 3 on page SG 508.2. It is not permissible to cut an opening in the door through which the meter will protrude. The meter could be hit causing a person to be injured or damage to the meter. An opening may be cut and covered with a hinged polycarbonate viewing window for meter reading purposes.

The illustrations on page SG 508.2 are for 125 – 225 amp socket-based meter installations. This standard may also be applied to 400 amp (class 320) residential meter panels (not pictured), and 600 amp Current Transformer (CT) rated commercial meter panels used for residential application (not pictured).

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page



Information Removed

SHEET
1 OF 2

SDG&E SERVICE STANDARDS & GUIDE

METER CABINET RECESS FOR SINGLE METER RESIDENTIAL APPLICATION ONLY

SG 508.1

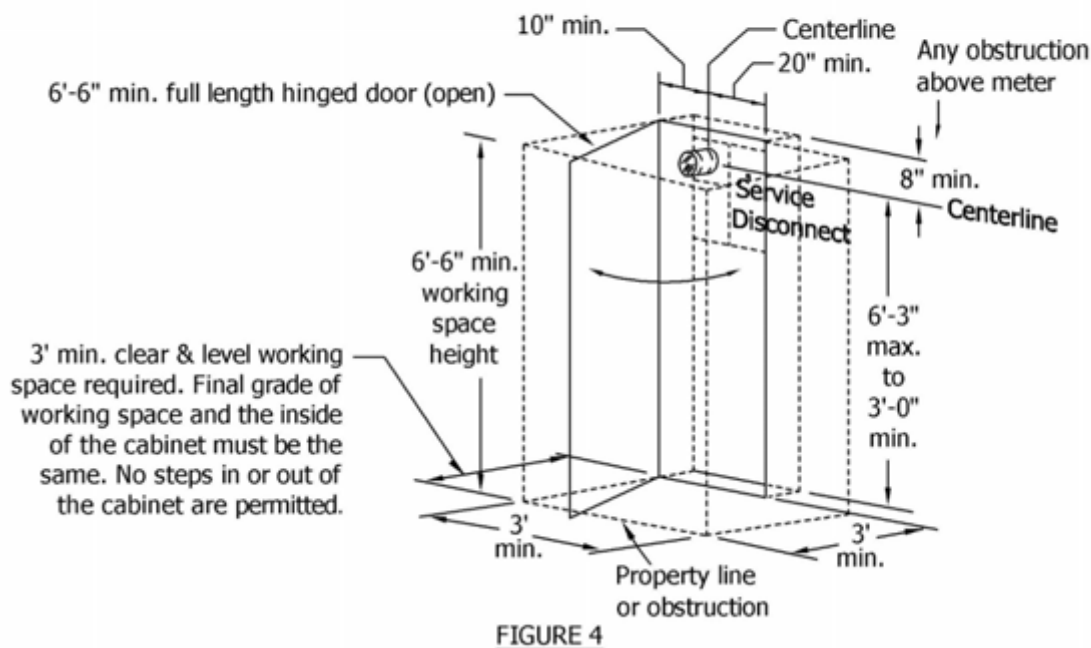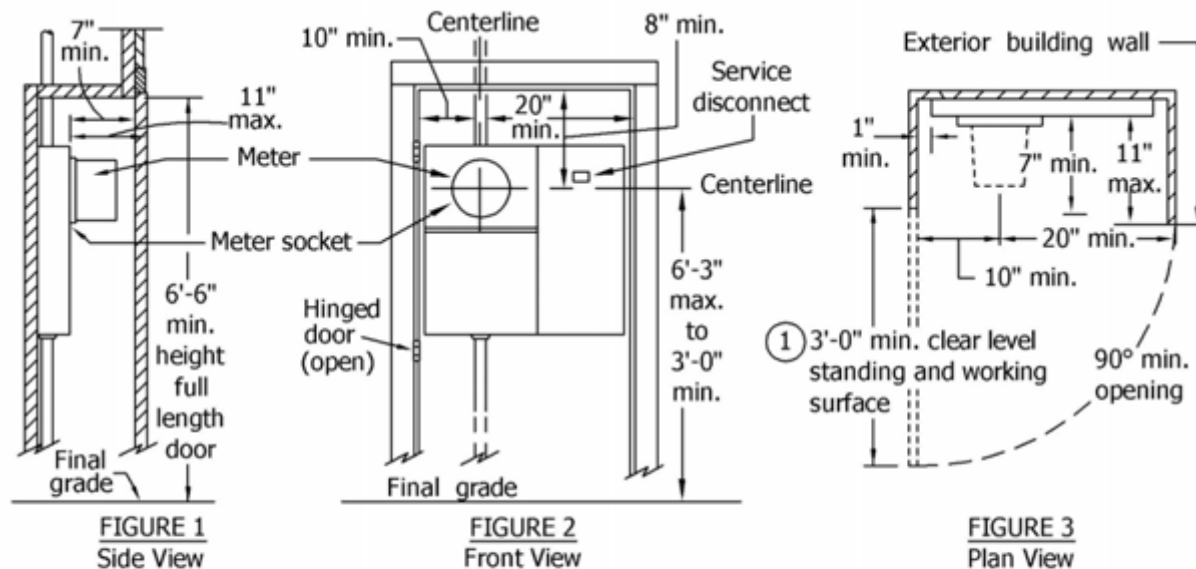

Notes:

- ① If the interior width of the cabinet is 36", or greater, the working space can be measured from the face of the meter panel provided the grade does not exceed a 1/4" drop per foot sloping away from the panel.
- ② For barrier requirements, see page SG 505.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
2 OF 2

SDG&E SERVICE STANDARDS & GUIDE

**METER CABINET RECESS FOR SINGLE METER
RESIDENTIAL APPLICATION ONLY**

SG 508.2

GENERAL REQUIREMENTS – A meter cabinet is allowed for a commercial or residential multi-metered installation provided it meets all of the following requirements.

No obstructions such as door jams, vertical posts, etc. are permitted within the cabinet opening. Communication equipment is allowed in the same cabinet with electrical but may not encroach in the working space. No other equipment foreign to the electrical or communication systems is allowed within the cabinet.

DEPTH OF CABINET – 11" minimum, 35" maximum, measured from the face of meter panel to inside of cabinet door. The change in elevation within the required working space shall not exceed ¼" per foot sloping away from the meter panel, and the illumination requirements shown below are met. Cabinets with a depth greater than 35" will be considered a meter room and all requirements for electric meter rooms shall be met.

WIDTH OF CABINET – A 36" width is required with 10" minimum side clearance measured from the vertical centerline of the meter socket. If electrical equipment is equipped with hinged doors, the cabinet opening must allow for equipment doors to be opened a minimum of 90 degrees.

NOTE: When an electric meter cabinet is constructed deeper than 18", measured from the face of the meter panel to the inside of the cabinet door(s), but less than 36", the illumination requirements of an electric meter room shall be met. If the distance when measured from the face of the meter panel to the inside of the door(s) is 36" or more, this is no longer a meter cabinet, it is an electric meter room. Reference pages SG 506.1 – 506.4 for electric meter room standards. Refer to pages SG 510.1 – 510.5 for additional requirements in mid- and high-rise buildings.

DOOR REQUIREMENTS – Meter cabinet doors must be side-hinged. The door must be designed to secure in the open position at 90 degrees, or more. Should the doors, when opened to 90 degrees, obstruct the 24" minimum exit route, they must be hinged to 180 degrees. See page SG 509.4, Figure 3. Doors must be a minimum of 6'-6" in height. ROLL UP DOORS AND SLIDING DOORS ARE NOT ACCEPTABLE due to injuries to SDG&E (Utility) personnel resulting from improper installation and lack of proper maintenance. If existing roll up or sliding doors require replacement, new side hinged doors are required. The maximum allowable door sill height is 2".

ILLUMINATION REQUIREMENTS – Illumination is required in meter cabinets installed in mid-rise and high-rise buildings, and in outdoor locations without direct sunlight. Meter cabinets constructed with a depth of 18", or greater, are required to be illuminated. Meter cabinets located outside of a building in an area of direct sunlight are not required to have illumination.

LOCKING REQUIREMENTS – The Utility does not require meter cabinets to be locked. If the customer chooses to lock the doors, a locking device approved by the Utility is required.

MINIMUM CLEAR & LEVEL STANDING & WORKING SPACE – The following requirements apply:

1. Shall not be less than 6'-6" high measured vertically from the floor, permanent platform, or final grade.
2. Shall not be less than 3'-0" measured from the face of the meter cabinet to the nearest obstruction or property line.
3. Shall extend the full width of the cabinet opening which shall not be less than 3'-0".

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 4


SDG&E SERVICE STANDARDS & GUIDE

**ELECTRIC METER CABINET – COMMERCIAL OR
RESIDENTIAL MULTI-METER INSTALLATIONS**

SG 509.1

CABINET & SUITE IDENTIFICATION

The meter cabinet must be permanently identified on the exterior of the door as shown in example below. Decals are available from the Utility but must be installed by customer. When a building has more than one meter cabinet, a plaque identifying the cabinet and the suites served from the service in the cabinet must be secured to the exterior of the cabinet door. See pages SG 017.1 – 017.3 for plaque requirements.

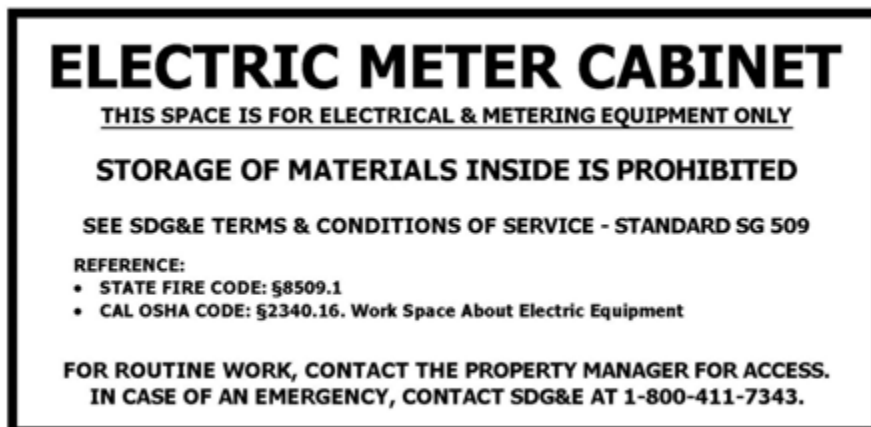

Example of Identification Plaque

IDENTIFICATION/MARKING REQUIREMENTS

Each meter socket/base and its related metered service disconnect shall be clearly and permanently marked by the contractor or customer to indicate the occupancy or load served, i.e. unit or suite number, fire alarm, house meter, etc. Examples of permanent marking are: (1) an identification plate secured by screws, rivets or equivalent secure adhesive; (2) weatherproof paint applied with stencil or clear lettering; or (3) commercially available decals. Identification means a street, apartment or suite number. Felt pen or fingernail polish is not acceptable. At the option of the Utility, marking may be omitted or identified differently for a single-family residence.

Exception: In a multi-metering section where the service disconnect is located immediately adjacent to the meter socket (to the side, above or below), it is acceptable to mark only the service disconnect or the meter socket.

VENTILATION

SDG&E does not have a requirement for ventilation of electric meter cabinets. The Authority Having Jurisdiction (AHJ) is responsible for enforcement of ventilation in electrical meter cabinets, when required, for compliance with the California Electric Code, Building Code or Mechanical Code.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 4	X Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 509.2
	SDG&E SERVICE STANDARDS & GUIDE				
	ELECTRIC METER CABINET – COMMERCIAL OR RESIDENTIAL MULTI-METER INSTALLATIONS				

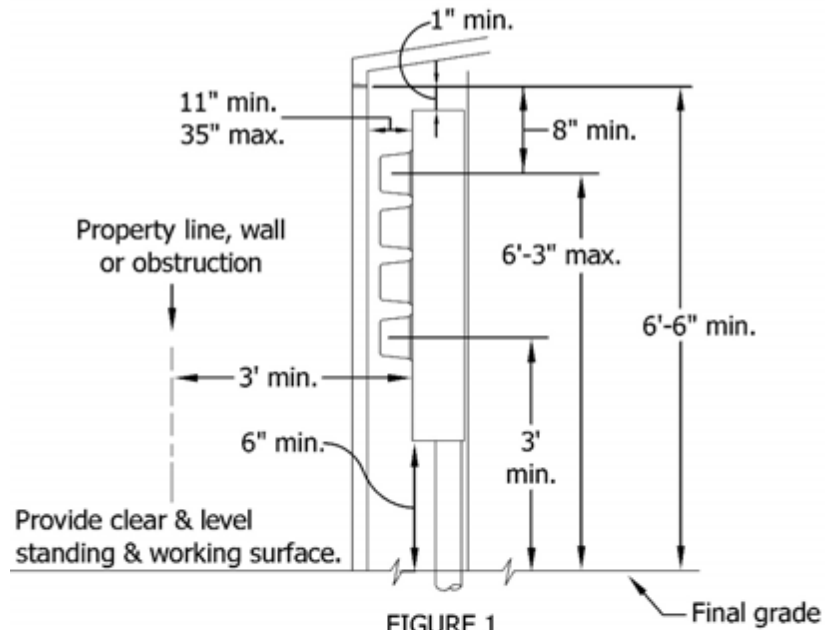


FIGURE 1
Side View

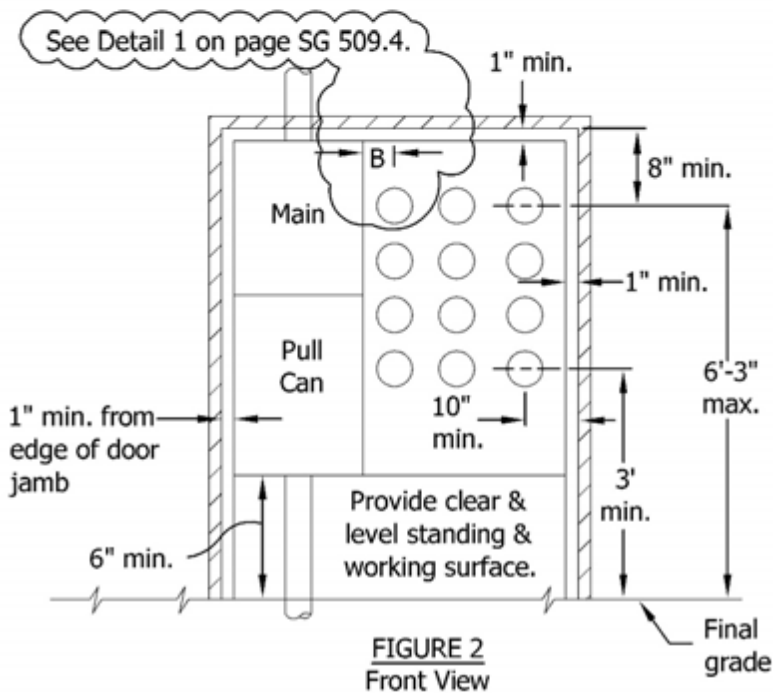


FIGURE 2
Front View

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
3 OF 4

SDG&E SERVICE STANDARDS & GUIDE

**ELECTRIC METER CABINET – COMMERCIAL OR
RESIDENTIAL MULTI-METER INSTALLATIONS**

SG 509.3


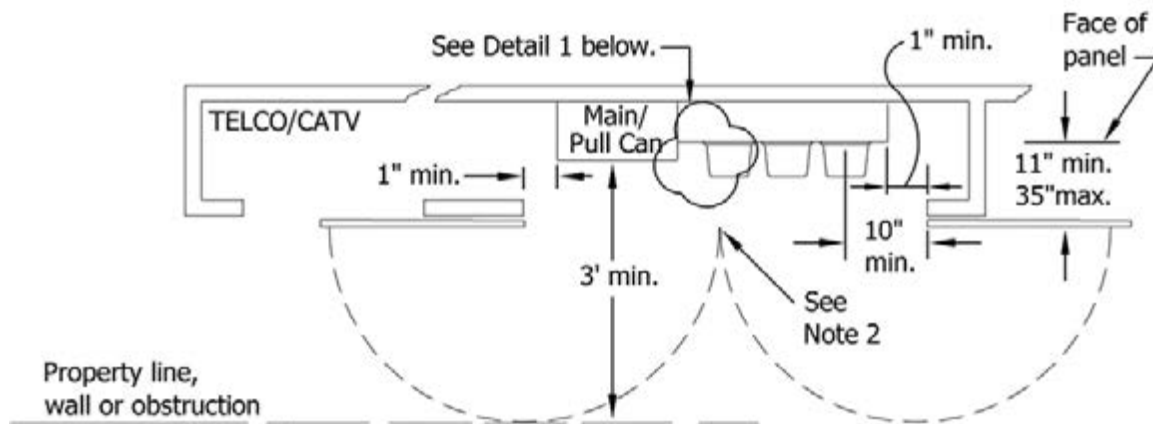


FIGURE 3 - TOP VIEW

Note: Hinged doors when opened, may not block the 24" min. exit route.

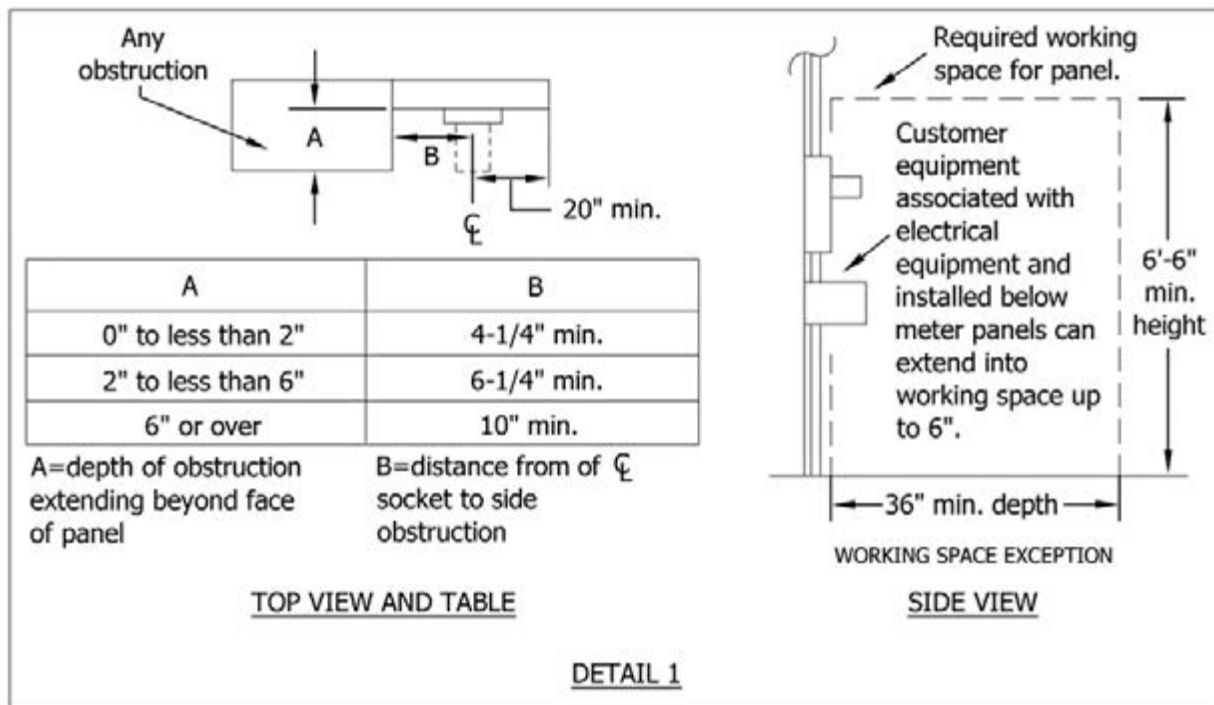

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
4 OF 4

SDG&E SERVICE STANDARDS & GUIDE

**ELECTRIC METER CABINET – COMMERCIAL OR
RESIDENTIAL MULTI-METER INSTALLATIONS**

SG 509.4

GENERAL INFORMATION

This standard provides the policy and requirements for electric metering in buildings or structures three stories, and above, in height. The purposes of the standard are to establish requirements for an electrical system with individual metering located on multiple floors in a manner that will provide for safe access, operations, and maintenance of the electrical system and help ensure reliable service to the occupants for the life of the building.

This standard applies to buildings or structures used for commercial and residential use, including mixed-use buildings, such as, but not limited to, a hotel with residential dwelling units located on the upper floors of the building, or a building with commercial space on the lower floors and residential dwelling units located on the upper floors.

Each dwelling unit in a mid- or high-rise building must be individually metered by SDG&E (Utility). (Reference Public Utilities Code Section 780.5.)

Non-residential enterprises must be individually metered by the Utility in mid-rise buildings. The customer has the option of installing a master meter to serve all non-residential enterprises in high-rise buildings where the non-residential enterprises are located on or above the sixth floor used for human occupancy, or requesting individual meters by the Utility for each separate enterprise. The Utility's filed Electric Rule 19 prohibits submetering of non-residential service. A customer shall not charge others for electricity received through a single meter except where the cost of electricity is absorbed in the rent for each individual tenant. The rent shall not vary with electric consumption. A separate identifiable charge to the tenants for electricity is not allowed.

DEFINITIONS

High-Rise Building: For the purpose of this standard, a high-rise building is a structure having floors used for human occupancy located more than 75' above the lowest level of fire department vehicle access.

Mid-Rise Building: For the purpose of this standard, a mid-rise building is a structure having a minimum of three floors used for human occupancy and constructed at a height less than is required to meet the definition of a high-rise building.

REMOTE ELECTRIC METER ROOM & CABINET SPECIFICATIONS

All Utility-owned meters shall be located in an electric meter room or cabinet approved by the Utility. In addition to the requirements shown on pages SG 506.1 – 506.4 for meter rooms, or SG 509.1 – 509.4 for meter cabinets, each remote meter room/cabinet shall have emergency lighting, a telephone with a dedicated phone line for use in an emergency, and an information plaque placed at eye level on the inside of the door containing the following information:

1. 24-hour property management emergency contact telephone number
2. Total number of meters for that particular location
3. Floor number and nearest elevator of all other meter room/cabinet locations in the building
4. Map showing the following:
 - a. Present location
 - b. Exits (elevators and stairs) from present location to the outside of the building
 - c. All meter rooms and cabinets in relationship to the elevators.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B	No Changes-Reaffirmed	JC	IJ	TPM	10/15/15	E					
C	Editorial Changes	JC	BRB	MDJ	08/06/15	F					

SHEET 1 OF 5	<div>X</div> Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 510.1
	SDG&E SERVICE STANDARDS & GUIDE				
	ELECTRICAL METERING IN MID-RISE & HIGH-RISE BUILDINGS				

Meter cabinets normally require two safety cones to be placed inside the cabinet for use by individuals when work is being performed. Refer to page SG 510.5 for safety cone specifications.

Refer to the metering communication requirements shown on page SG 525.

METER ACCESS EASEMENT

The building owner shall execute a "Meter Access Easement" provided by SDG&E, at the owner's expense, and return to the Utility during the planning phase of the project.

SERVICE & METERING POLICIES

Refer to the Electric Service Policies on pages SG 011.1 – 013.3 for additional information.

MID-RISE & HIGH-RISE BUILDING REQUIREMENTS

Electric meter rooms or meter cabinets may be located on every floor. The electric meter rooms/cabinets should be located as close as practical to the elevator that will be used by SDG&E employees to access the floors, but in no case further than 50 feet walking distance from the elevator. The elevator must be equipped with an SDG&E approved Schlage VTQP Quad Section key way and key switch wired to the control panel to allow 24-hour access to the floors where Utility meters are located. SDG&E will not check in with a security guard during our normal business hours.

The customer has the option of installing multiple meter locations on the same floor and omitting meter locations on every floor provided:

1. The total number of meter locations does not exceed the total number of occupied building floors.
2. All meter locations are within 50 feet walking distance from the elevator that will be used by SDG&E employees to access the floors. Meter location entrances shall be located directly off the common corridor used to access the elevator. It is not acceptable to enter another space or room before entering the meter room/cabinet.
3. The customer may provide access to multiple meter rooms/cabinets located on the same floor from different elevators. This is more common in high-rise podium construction projects.

MID-RISE BUILDING EXCEPTION

An exception may be granted to allow multiple meter rooms in a subterranean parking structure in lieu of meter rooms/cabinets located on the occupied floors provided all SDG&E applicable standards are met. The customer should consult with SDG&E's Planner to use this exception in the conceptual design phase of the project.

SERVICE STANDARDS REVIEW

The SDG&E Planner shall have Service Standards, in Electric Distribution Engineering, review the building project plans for mid- and high-rise building to ensure the grounding electrode conductor is appropriately placed and other engineering related issues are resolved during the design phase of the project.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.


REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B	No Changes-Reaffirmed	JC	IJ	TPM	10/15/15	E					
C	Editorial Changes	JC	BRB	MDJ	08/06/15	F					

SHEET 2 OF 5	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 510.2
	SDG&E SERVICE STANDARDS & GUIDE					
	ELECTRICAL METERING IN MID-RISE & HIGH-RISE BUILDINGS					

APPROVAL PROCESS

The local Project Management office shall be contacted to approve the mid- or high-rise building main service and meter room location and the remote electric meter room or cabinet locations. The Utility's approval shall be obtained prior to the installation of the electrical service and metering equipment. Any service and metering equipment that has been installed without the Utility's approval shall be modified or relocated at the customer's/contractor's expense as necessary to meet all Utility Standards.

Mid-Rise & High-Rise Electric Metering Schematic

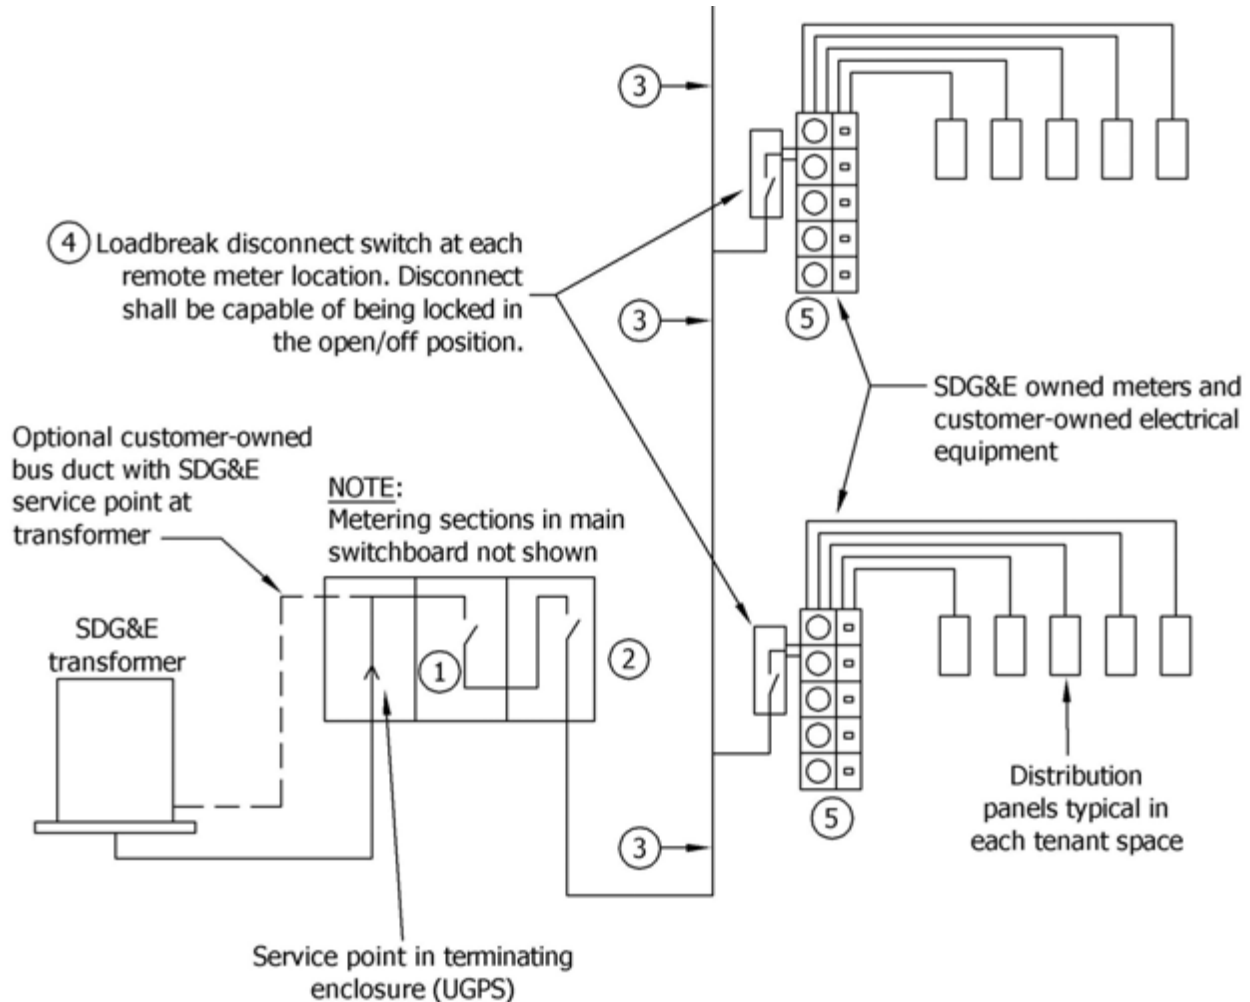

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B	No Changes-Reaffirmed	JC	IJ	TPM	10/15/15	E					
C	Editorial Changes	JC	BRB	MDJ	08/06/15	F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
3 OF 5

SDG&E SERVICE STANDARDS & GUIDE

ELECTRICAL METERING IN MID-RISE & HIGH-RISE BUILDINGS

SG 510.3

Notes:

- ① The main electric room shall contain a master directory showing all meter locations within the building. This directory may be located on the interior or exterior of the meter room door, or mounted on a wall within the room in a conspicuous location. Refer to page SG 017.1 for plaque specifications, with the exception that all letter sizes may be reduced to 1/8". It is acceptable to mount a site map denoting the meter locations and access route between Plexiglas in lieu of a plaque.

Each main service disconnect shall meet the requirements on pages SG 511.1 – 511.2.

Example 1 Plaque is required at the service point and is to be located on the exterior panel cover of the terminating enclosure where SDG&E conductors terminate. If the service point is at SDG&E's transformer, Example 2 Plaque shall be installed on the exterior panel cover at the main service disconnect location. See plaque examples on page SG 510.5. Refer to Page SG 017.1 for plaque specifications, with the exception that all letter sizes may be reduced to 1/8".

- ② Feeder disconnects controlling electricity to remote meter locations shall have a permanent plaque affixed to each of the feeder disconnects stating:

THIS DISCONNECT CONTROLS POWER TO METERS LOCATED IN REMOTE LOCATIONS ON FLOORS _____. SEE DIAGRAM ON WALL/DOOR INDICATING THE LOCATION AND ACCESS ROUTE TO THE REMOTE METER LOCATIONS.

- ③ Feed conductors (cable or busway) shall be installed per the California Electrical Code and approved by the Authority Having Jurisdiction (AHJ). When cable is installed in a raceway containing a conduit and/or junction box, they shall be located no higher than 9' feet above standing surface and shall provide a means for installation of Utility seals. Bus duct housing or concealed raceways containing unmetered conductors are not required to be sealed.
- ④ A load-break disconnect switch, capable of being locked in the open/off position, is required within sight of each group of meters controlled by a feed originating from the main electric meter room.
- ⑤ Each meter socket and its related meter service disconnect shall meet all of the Utility's Standards.

Metering Communications:

For metering communication requirements, refer to page SG 525, and consult with SDG&E's Smart Meter Operations via Email: networkdevice@semptrautilities.com

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B	No Changes-Reaffirmed	JC	IJ	TPM	10/15/15	E					
C	Editorial Changes	JC	BRB	MDJ	08/06/15	F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
4 OF 5

SDG&E SERVICE STANDARDS & GUIDE

**ELECTRICAL METERING IN
MID-RISE & HIGH-RISE BUILDINGS**

SG 510.4

CAUTION: ENERGIZED EQUIPMENT – DO NOT OPEN

THE "SERVICE POINT" IS IN THIS ENCLOSURE AT THE CABLE TERMINATIONS. ALL ELECTRICAL WIRING AND EQUIPMENT BEYOND THE SERVICE POINT, EXCEPT SDG&E SERVICE AND METERING EQUIPMENT, ARE CUSTOMER-OWNED, CONTROLLED, SECURED, SAFEGUARDED AND MAINTAINED BY THE CUSTOMER. ONLY AUTHORIZED SDG&E EMPLOYEES ARE ALLOWED ACCESS INTO UTILITY-SEALED ENCLOSURES OR COMPARTMENTS. ALL UTILITY SEALS ARE TO REMAIN INTACT WITHOUT BEING CUT OR REMOVED.


Example 1 Plaque

CAUTION: ENERGIZED EQUIPMENT – DO NOT OPEN

THE "SERVICE POINT" IS AT THE SECONDARY OF UTILITY'S TRANSFORMER. ALL CONDUCTORS IN THIS ENCLOSURE ARE CUSTOMER-OWNED. ALL ELECTRICAL WIRING AND EQUIPMENT BEYOND THE SERVICE POINT, EXCEPT SDG&E SERVICE AND METERING EQUIPMENT, ARE CUSTOMER-OWNED, CONTROLLED, SECURED, SAFEGUARDED AND MAINTAINED BY THE CUSTOMER. ONLY AUTHORIZED SDG&E EMPLOYEES ARE ALLOWED ACCESS INTO UTILITY-SEALED ENCLOSURES OR COMPARTMENTS. ALL UTILITY SEALS ARE TO REMAIN INTACT WITHOUT BEING CUT OR REMOVED.

Example 2 Plaque

Safety cones constructed of rugged plastic are required for electric meter cabinets. The safety cones are to be placed inside the cabinet prior to the Utility energizing the main service to the building, unless the cabinet has not been constructed at the time the service is energized. Two safety cones are required for each meter cabinet unless the position of the cabinet is such that foot traffic is limited to one direction, in which case, upon approval by the Utility's Inspector, only one safety cone is required.

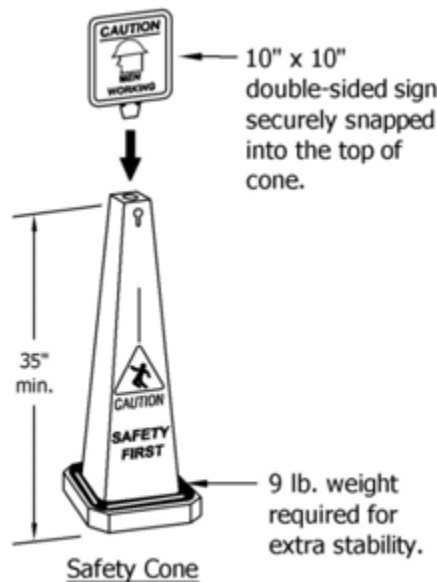

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B	No Changes-Reaffirmed	JC	IJ	TPM	10/15/15	E					
C	Editorial Changes	JC	BRB	MDJ	08/06/15	F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
5 OF 5

SDG&E SERVICE STANDARDS & GUIDE
**ELECTRICAL METERING IN
MID-RISE & HIGH-RISE BUILDINGS**

SG 510.5

GENERAL INFORMATION

A service disconnect is a device, or group of devices, or other means by which the conductors of a circuit can be disconnected from their source of supply.

All service equipment other than that provided by SDG&E (Utility) is to be provided and installed by the customer in compliance with the requirements of the governmental Authority Having Jurisdiction (AHJ). See page SG 004.4 for equipment provided by the customer.

DISCONNECT AMPACITY & AMPERE INTERRUPTING CAPACITY (AIC) RATING

The meter service disconnect and main service disconnect shall meet all code requirements as determined by the AHJ.

Refer to pages SG 006.1 – 006.2 for information on the Utility's contribution to fault current when determining the necessary short circuit current rating and AIC rating for a service or meter service disconnect device.

METER SERVICE DISCONNECT

For each meter installed on a service of 600 volts, or less, a single fusible switch(s), circuit breaker(s), or other approved disconnecting means shall be located on the load side of the meter and shall control all of and only the energy registered by that meter.

Exception 1: Two meter service disconnects are acceptable in 300 or 400 amp residential service equipment. 300 amp service equipment is limited to one 200 amp main breaker and one 100 amp main breaker. 400 amp service equipment is limited to two 200 amp main breakers.

Exception 2: Multiple meter service disconnects are acceptable for Current Transformer (CT) metering applications.

The meter service disconnect must be located at or immediately adjacent to the meter. For example, the meter service disconnect may not be located inside the building served if the meter is located outside.

MAIN SERVICE DISCONNECT

For multi-meter installations, electrical codes, enforced by the AHJ, may require the installation of a main service disconnect located on the supply (line) side of the meters. When a main service disconnect is installed, each meter will also be required to have its own meter service disconnect.

If multiple meter locations within a building have been approved by the Utility and AHJ, each group of meters will be required to have a feeder disconnect grouped with the main service disconnect(s). A permanent plaque must be affixed to each feeder disconnect stating:

"THIS DISCONNECT SERVES METERS LOCATED ON FLOORS(S) _____ /IN ROOMS _____.
SEE DIAGRAM ON WALL TO THE LEFT/RIGHT FOR LOCATIONS OF METERS."

The diagram indicating the meter locations must be a permanent plaque affixed to the wall. See page SG 017.1 for plaque specifications and installation requirements. The main service will not be energized until this requirement is complete.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 3	X Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 511.1
	SDG&E SERVICE STANDARDS & GUIDE				
	ELECTRIC SERVICE DISCONNECTS & METER SERVICE DISCONNECTS				

For single meter installations, a main service disconnect is not permitted on the supply (line) side of the meter.

Refer to pages SG 510.1 – 510.5 for specific requirements in mid-rise and high-rise buildings.

Service Disconnect Location with Respect to Meter & Meter Service Disconnect

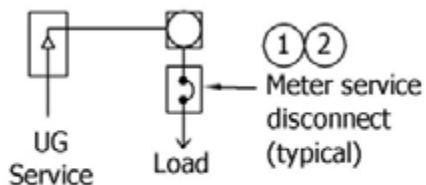


FIGURE 1
Single meter installation

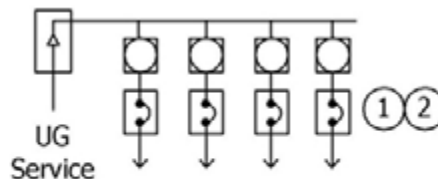


FIGURE 2
Multi-meter installation 2 to 6 meters without main disconnect

Notes:

- ① Meter service disconnect(s) on load side of meter.
- ② Ampacity and AIC ratings of meter service disconnect proper for protection of load conductors and available fault current.

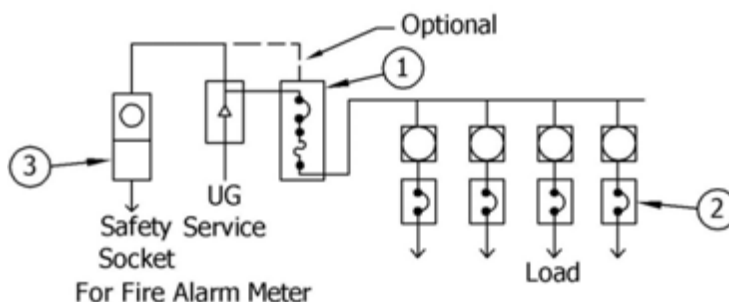


FIGURE 3
Multi-Meter Installation, 2 to 6 Meters with Main Disconnect

Notes:

- ① Main disconnect ahead of 2 to 6 meters, either fusible switch or circuit breaker.
- ② Ampacity rating of meter service disconnect proper for protection of load conductors; AIC rating coordinated with let-through current of current-limiting fuse device ahead of meters, or a series-rated system.
- ③ A safety socket can with test-bypass facilities is required in all cases, whether separately metered or served through a house meter. Alarm meter source may be connected on the line side of a main disconnect. Consult with the AHJ for point of connection.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 3

SDG&E SERVICE STANDARDS & GUIDE

**ELECTRIC SERVICE DISCONNECTS
& METER SERVICE DISCONNECTS**

SG 511.2

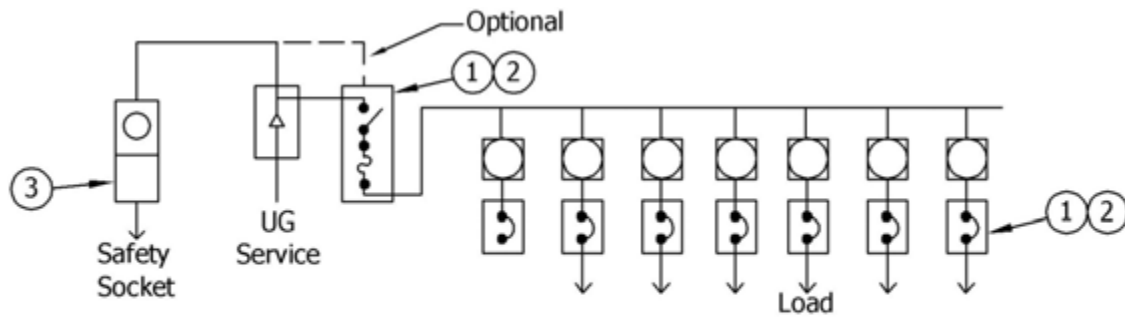


FIGURE 4
Multi-meter installation, numbering 7 or more meters.

Notes:

- ① A main disconnect located ahead of more than 6 meter service disconnects is required per the California Electric Code.
- ② Ampacity and AIC ratings of main service disconnect and meter service disconnects shall meet all electrical code requirements enforced by the AHJ.
- ③ A safety socket can with test-bypass facilities is required in all cases, whether separately metered or served through a house meter. Alarm meter source may be connected on the line side of the main disconnect. Consult with the AHJ for acceptable point of connection.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

**SHEET
3 OF 3**

SDG&E SERVICE STANDARDS & GUIDE
**ELECTRIC SERVICE DISCONNECTS
& METER SERVICE DISCONNECTS**

SG 511.3

METER SOCKET CONNECTIONS

Meter sockets for all self-contained meters shall be connected to the service entrance conductors by the contractor. Connection diagrams for the various types of service equipment are shown on succeeding pages in this manual.

An SDG&E (Utility) employee will provide and install the wiring used in meter sockets located in Current Transformer (CT) compartments.

SELF-CONTAINED METERS DEFINED

A self-contained meter is one which is capable of carrying the total current and voltage of the electric service supplied to the customer. This type of meter is connected directly to the service entrance conductors when it is inserted into the meter socket.

SELF-CONTAINED METER SOCKETS

Sockets for use with self-contained meters are available in two approved ratings. When connected to properly sized service entrance conductors, the approved standard-duty socket has a nominal capacity of 100 amps commercial and 125 amps residential. The approved heavy-duty socket has a nominal capacity of 200 amps commercial and residential.

METER SOCKET CLOSING DEVICES

Meter sockets may not be equipped with circuit closing or by-pass devices which automatically close when the meter is removed from the meter socket.

EQUIPMENT CONNECTED AHEAD OF A MAIN SERVICE DISCONNECT

Circuits supplying fire alarms, fire sprinklers, fire pumps, and exit lighting may be connected on the line side of the main service disconnect through suitable protection. All such circuits must be metered, either through a house meter or a separate meter. See page SG 511.2, Figure 3, and page SG 511.3, Figure 4.

COMBINATION PULL & METER CANS FOR UNDERGROUND OR OVERHEAD RESIDENTIAL SERVICE

Residential service equipment is manufactured with a combination pull section and terminating section, designed for the Utility to install their service lateral conductors and terminate on the factory provided termination lugs, a self-contained meter socket, and a distribution section for the customer's main breaker (also referred to as the meter service disconnect) and feeder/branch circuit breakers. See illustrations of this type of service equipment and installation notes on pages SG 512.2 – 512.8.

Refer to pages SG 518.2 – 518.3 for residential meter pedestals.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed


SHEET
1 OF 8

SDG&E SERVICE STANDARDS & GUIDE

**RESIDENTIAL SELF-CONTAINED
SERVICE & METERING EQUIPMENT**

SG 512.1

**Combination Pull & Meter Cans for Underground or Overhead Residential Service
225 Amps Maximum, Single-Phase, 3-Wire, 0 – 600 Volts**

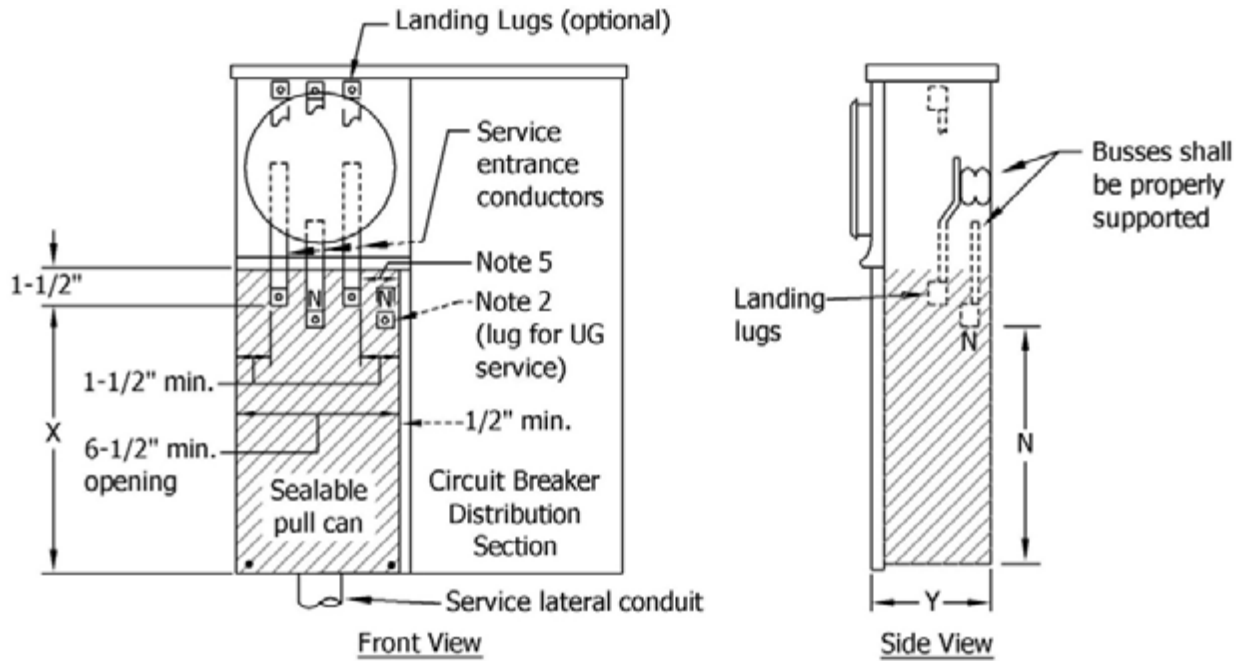

Service Entrance Nominal Current Capacity	Service Lateral Conduit Size		Minimum Pull Section Dimensions			Utility Maximum Wire Size Allowed Without Pin Adapters	Utility Maximum Wire Size Allowed With Pin Adapters
	Min.	Max.	"X"	"N"	"Y"		
125 AMPS	2" See 309.2 ©	3"	8"	6"	4"	#1/0 kCMIL	#3/0 kCMIL
225 AMPS	3"	3"	11"	8-1/2"	5-1/2"	#3/0 kCMIL	#350 kCMIL

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 8

SDG&E SERVICE STANDARDS & GUIDE
**RESIDENTIAL SELF-CONTAINED
SERVICE & METERING EQUIPMENT**

SG 512.2

Installation Notes:

1. This equipment may be constructed for OH, UG or for combination overhead/underground service applications. When constructed as an OH/UG device, a yellow caution label (2" x 3" minimum) shall be installed below the terminations in the pull section reading:

"CAUTION: BUS ENERGIZED AT ALL TIMES"

2. Terminals for service conductors shall be aluminum bodied range taking lugs with a range of No. 6 through No. 1/0 AWG for the 125 amp device and No. 4 through No. 250 kCMIL for the 225 amp device. The Utility may install a maximum No. 3/0 kCMIL using pin adapters in 125 amp devices and No. 350 kCMIL using pin adapters in 225 amp devices. The Utility Planner shall note if pin adapters are required on the Electric Meter and Service Location form as follows: "Pin adapters required per UG Standard 4171.3."
3. Bonding according to the California Electrical Code shall be installed prior to installation of underground service conductors. Bonding connections for service lateral conduits only is permitted at bottom of can. Any other bonding or grounding connection must be made above the pull can area and no grounding or bonding conductor is permitted to pass through the pull can area. The pull can area will be under Utility seal, therefore, it is deemed inaccessible to the Authority Having Jurisdiction (AHJ) for inspection. Provide a bonding screw or jumper if the neutral is insulated from the enclosure.
4. Service lateral conduit shall enter the bottom of the pull section.
5. A minimum radial clearance of 1-1/2" shall be provided between hot bus terminals and grounded surfaces or the neutral bus or termination lug.
6. Residential pull cans shall be accessible without entering the building, and when exposed to the weather, shall be raintight.
7. This device cannot supply other meters.

Reference UG 4171.3.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X	Indicates Latest Revision	Completely Revised	New Page	Information Removed
----------	---------------------------	--------------------	----------	---------------------


SHEET
3 OF 8

SDG&E SERVICE STANDARDS & GUIDE

**RESIDENTIAL SELF-CONTAINED
SERVICE & METERING EQUIPMENT**

SG 512.3

Combination Pull & Meter Cans for Underground Residential Service Only
225 Amps Maximum, Single-Phase, 3-Wire, 0 – 600 Volts

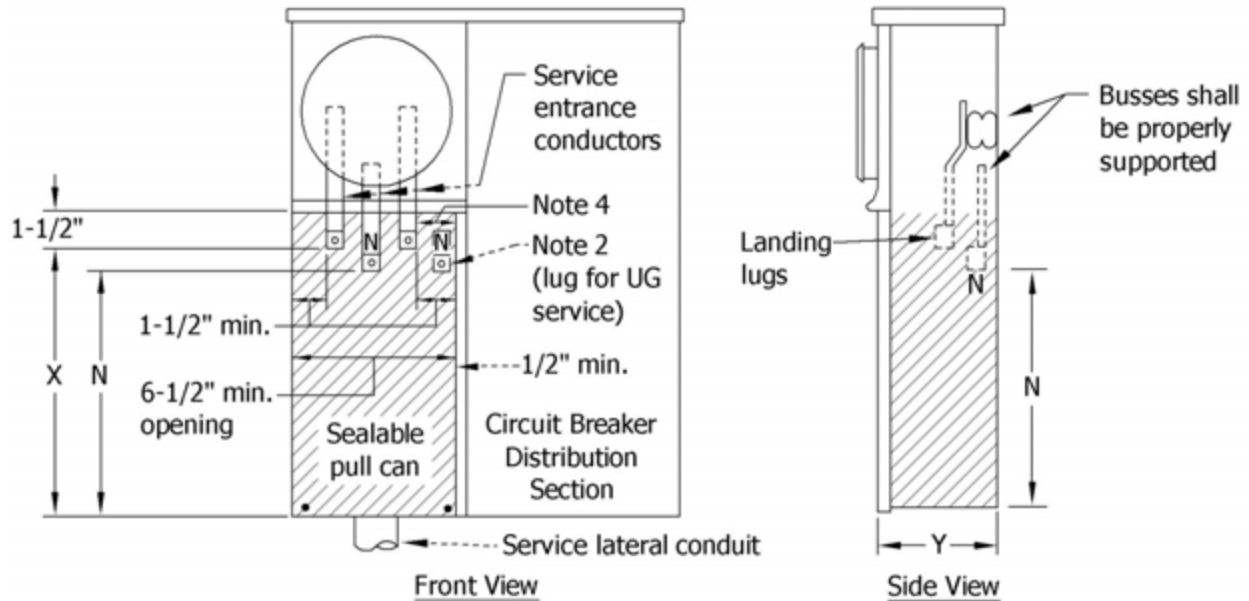

Service Entrance Nominal Current Capacity	Service Lateral Conduit Size		Minimum Pull Section Dimensions			Utility Maximum Wire Size Allowed Without Pin Adapters	Utility Maximum Wire Size Allowed Using Pin Adapters
	Min.	Max.	"X"	"N"	"Y"		
125 AMPS	2" See 309.3 C	3"	8"	6"	4"	#1/0 kCMIL	#3/0 kCMIL
225 AMPS	3"	3"	11"	8-1/2"	5-1/2"	#3/0 kCMIL	#350 kCMIL

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
4 OF 8

SDG&E SERVICE STANDARDS & GUIDE
**RESIDENTIAL SELF-CONTAINED
SERVICE & METERING EQUIPMENT**

SG 512.4

Installation Notes:

1. Terminals for service conductors shall be aluminum bodied range taking lugs with a range of No. 6 through No. 1/0 AWG for the 125 amp device and No. 4 through No. 250 kCMIL for the 225 amp device. The Utility may install a maximum No. 3/0 kCMIL using pin adapters in 125 amp devices and No. 350 kCMIL using pin adapters in 225 amp devices. The Utility Planner shall note if pin adapters are required on the Electric Meter and Service Location form as follows: "Pin adapters required per UG Standard 4171.3."
2. Bonding according to the California Electrical Code shall be installed prior to the installation of underground service conductors. Bonding connections for service lateral conduits only is permitted at the bottom of the can. Any other bonding or grounding connection must be made above the pull can area and no grounding or bonding conductor is permitted to pass through the pull can area. The pull can area will be under Utility seal, therefore, it is deemed inaccessible to the AHJ for inspection. Provide a bonding screw or jumper if the neutral is insulated from the enclosure.
3. Service lateral conduit shall enter the bottom of the pull section.
4. A minimum radial clearance of 1-1/2" shall be provided between hot bus terminals and grounded surfaces or the neutral bus or termination lug.
5. Residential pull cans shall be accessible without entering the building, and when exposed to the weather, shall be raintight.
6. This device cannot supply other meters.

Reference UG 4171.3.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed


SHEET
5 OF 8

SDG&E SERVICE STANDARDS & GUIDE

**RESIDENTIAL SELF-CONTAINED
SERVICE & METERING EQUIPMENT**

SG 512.5

Combination Pull & Meter Cans for Underground Residential Service Only
300 – 400 Amps, Single-Phase, 3-Wire, 120/240 Volts

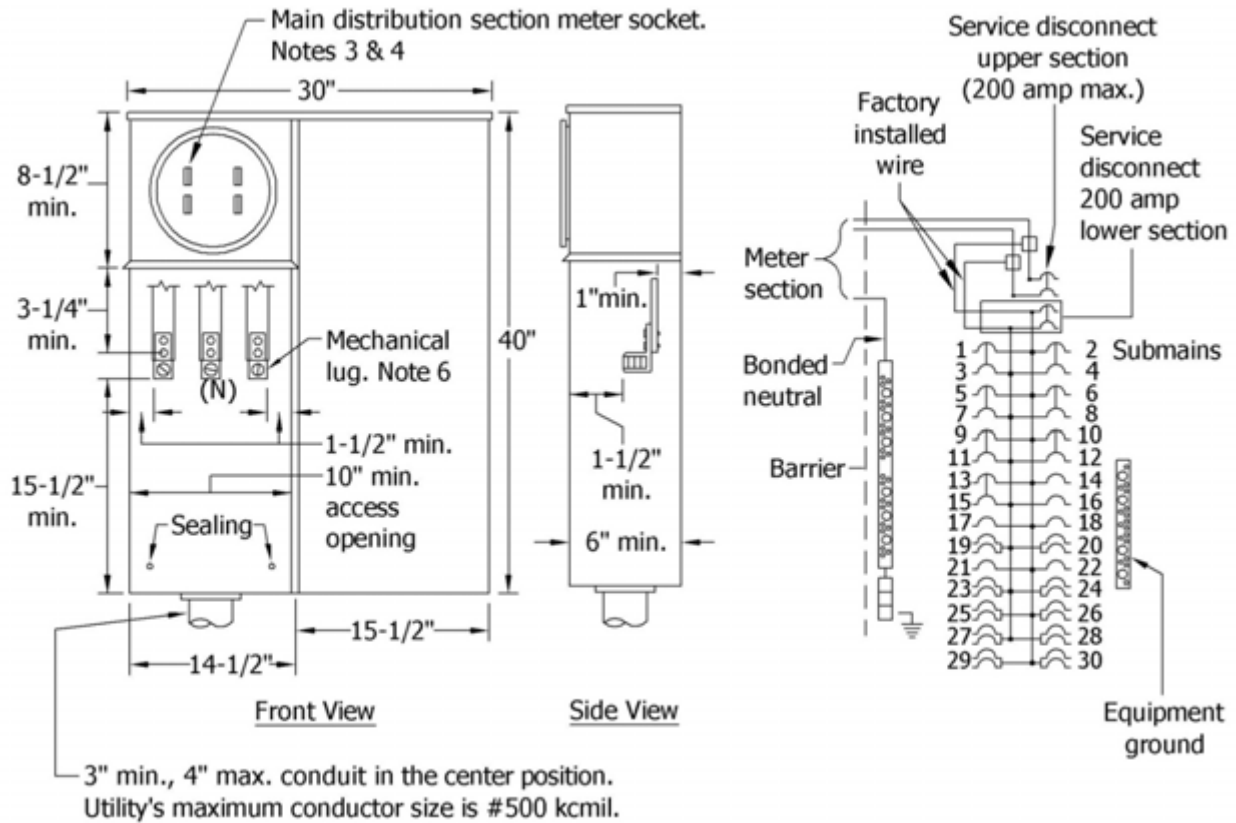

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
6 OF 8

SDG&E SERVICE STANDARDS & GUIDE
**RESIDENTIAL SELF-CONTAINED
 SERVICE & METERING EQUIPMENT**

SG 512.6

Installation Notes:

1. The panel shown is a combination device having both a Utility Section (i.e. pull section and metering section) and a customer section.
2. The panel shall be marked with either a rating of "320 amperes continuous" or "400 amperes maximum (320 continuous)".
3. A ring-type socket is required. The panel shall be provided with a sealing ring and the meter socket shall be rigidly mounted on a support and attached to the meter panel.
4. The meter socket may be located above, to the left or right of the terminating pull section.
5. Pull section cover panels shall be removable, sealable and provided with two lifting handles.
6. The 10" minimum access opening dimension shown is measured between the return flanges. When viewed from the front of the pull section area, return flanges shall not extend closer than $\frac{3}{4}$ " from the outside edge of the mechanical lugs.
7. Terminations for service conductors shall be aluminum-bodied mechanical lugs with a range of No. 1 AWG through 600 kCMIL. The lugs shall be secured to assure vertical alignment. A minimum radial clearance of 1- $\frac{1}{2}$ " shall be provided between hot bus terminals and grounded surfaces or neutral bus or termination lug. The 1- $\frac{1}{2}$ " dimension may be less if insulating material is provided.
8. When an overhead service drop will supply power to this equipment, the customer's service entrance conductors must enter the lower left side of the underground service section and connect to the mechanical lugs referred to in Note 7 above. A conduit will be required and shall be visible and sealable. See "Detail for Surface-Mounted or Semi-Flush Installations Only" on page SG 512.8.
9. Refer to pages SG 508.1 – 508.2 for Meter Cabinet Recess specifications.
10. This device cannot supply other meters.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X	Indicates Latest Revision	Completely Revised	New Page	Information Removed
----------	---------------------------	--------------------	----------	---------------------


SHEET
7 OF 8

SDG&E SERVICE STANDARDS & GUIDE

**RESIDENTIAL SELF-CONTAINED
SERVICE & METERING EQUIPMENT**

SG 512.7

Combination Pull & Meter Cans for Overhead Residential Service Only
Using Service Equipment per Pages SG 512.6 – 512.7
300 – 400 Amps, Single-Phase, 3-Wire, 120/240 Volts

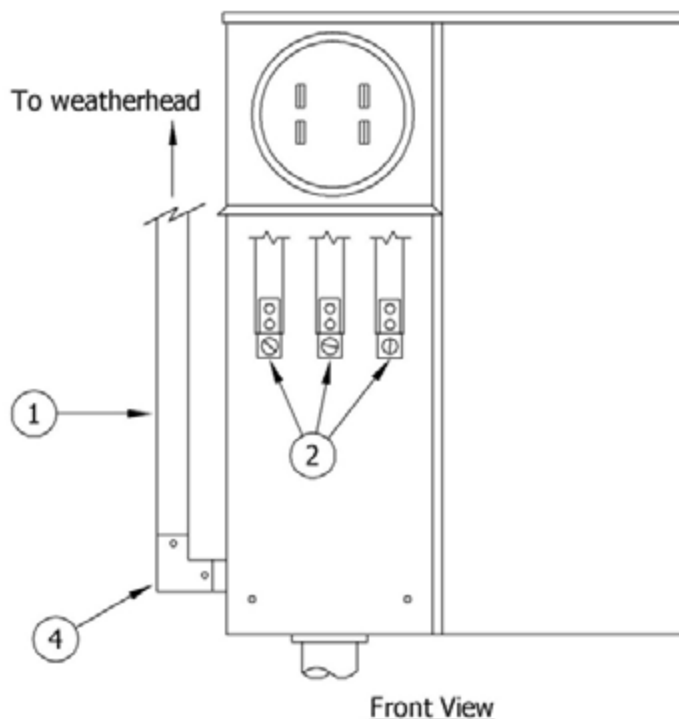

THIS IS AN ACCEPTABLE METHOD FOR OVERHEAD SERVICE CONNECTION
 FOR SURFACE-MOUNTED OR SEMI-FLUSH INSTALLATIONS ONLY.

Installation Notes:

- ① Refer to pages SG 105.1 – 105.2 for metallic conduit riser requirements.
- ② Service entrance conductors to be connected to the lugs in the pull can by the contractor.
3. The installation shall be inspected by the AHJ prior to the Utility energizing their service drop conductors and installing the meter. Once the service is energized, the pull can cover will be sealed by the Utility and will no longer be accessible to the AHJ Inspector.
- ④ A visible and sealable conduit for surface-mounted and semi-flush installations only is required.
5. For “flush-mounted” installations, a solid one-piece riser acceptable to the Utility and the AHJ is required.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
8 OF 8

SDG&E SERVICE STANDARDS & GUIDE
**RESIDENTIAL SELF-CONTAINED
 SERVICE & METERING EQUIPMENT**

SG 512.8

TEST-BYPASS REQUIREMENTS

1. The general text and illustrations for safety socket cans and test-bypass facilities are shown in this standard.
2. Bussed test-bypass facilities are to be factory-installed for installations of safety socket cans up to 200 amps.
3. These devices isolate the meter socket from the electric source, and are a safety measure to protect SDG&E personnel involved in metering work.
4. Additionally, the devices permit testing or replacement of meters without interrupting the customer's electric service. This avoids problems such as loss of computer data, resetting time controls, loss of perishable food or material process, etc.
5. Test-bypass facilities must be installed for all non-residential meter installations. Minimal loads such as fire alarms, landscape sprinkler, controls or sign boards are not exempt from this requirement.
6. Test-bypass facilities are required on temporary service for construction power to build residential single-family dwellings and duplexes, on single lots or in subdivisions, with single-phase, 120/240-volts, 200 amps maximum.
Exception: Residential meter panels are acceptable for Temporary Service in a Permanent Base (TSPB). Refer to page SG 210.
7. A meter and service installation to a gate for a single family residence also requires test-bypass facilities. This also applies to gates to access gated communities.
8. Service used in common for residential purposes in a multi-family dwelling development located on a single parcel of land qualifies for the domestic residential DR Rate Schedule (reference Special Condition 8). For example, service to a recreation building in a condominium or apartment complex. Test-bypass facilities are not required. All three-phase installations must be equipped with test-bypass facilities.
9. The safety socket meter can may be used as a combination pull and meter can for underground service, either residential or commercial. Refer to pages SG 514.2 – 514.5 for details.
10. An agricultural well used for irrigation only regardless of type of ownership may be served on a general service "Commercial" or "Agricultural" Rate Schedule regardless of the phase of service. This equipment must be equipped with test-bypass facilities.
11. An individual private domestic well which is solely-owned and primarily used for domestic purposes will be served on the A or PA Rate Schedule. Test-bypass facilities are required.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed


SHEET
1 OF 3

SDG&E SERVICE STANDARDS & GUIDE

TEST-BYPASS FACILITIES FOR SAFETY SOCKETS

SG 513.1

Test-Bypass Facilities for Safety Sockets 100 & 200 Amps, 0 – 600 Volts

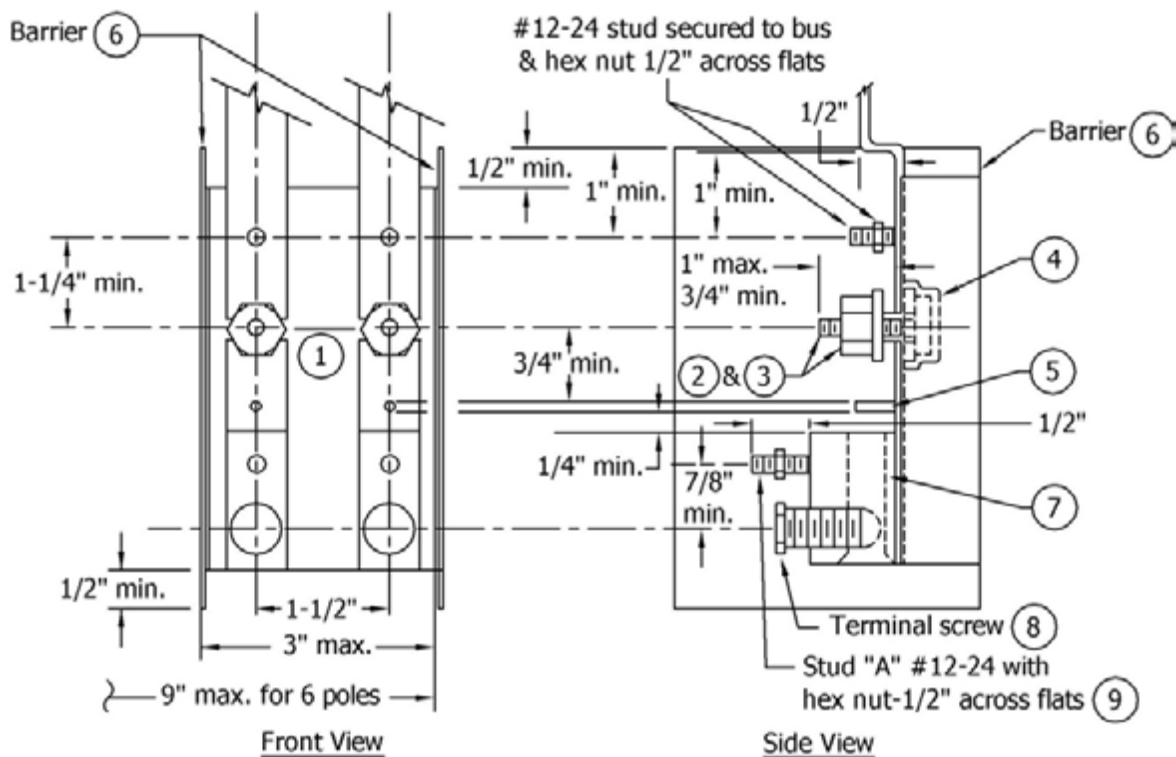

Notes:

- ① Strike distance between upper and lower bus sections shall not be less than $\frac{1}{4}$ " when the circuit-closing nut is backed off.
- ② Circuit-closing nut shall be a hex nut $\frac{5}{8}$ " across flats with plated copper washer attached and have threads counter-bored at bottom to facilitate re-installation. Bolt head shall be secured in place to prevent turning and backout.
- ③ Circuit-closing nut and bolt assembly shall maintain the applied contact pressure between the plated copper washer and the bus members of the test-bypass block.
- ④ Insulating washer shall be made from dimensionally stable, non-tracking material and shall provide a minimum of $\frac{1}{8}$ " creep distance between the bolt and the bus sections. Bus sections shall be plated.
- ⑤ Wire stops shall extend to center of terminal opening or beyond.
- ⑥ Rigid insulating barriers shall project at least $\frac{1}{4}$ " beyond any energized parts when the maximum wire size is installed.
- ⑦ Terminals shall be aluminum bodied. For required conductor range, see pages SG 514.1 – 514.3. The opening shall extend through the terminal body and, if wire hole is round, shall be chamfered as necessary to facilitate installation of the largest size wire.
- ⑧ The terminal screw may be Allen type ($\frac{3}{16}$ " across flats for 100 amp, $\frac{5}{16}$ " across flats for 200 amp).
- ⑨ Stud "A" may be located either on the terminal body, on the bus member between the circuit-closing nut, and the wire stop or incorporated as part of the wire stop.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed


SHEET
2 OF 3

SDG&E SERVICE STANDARDS & GUIDE

TEST-BYPASS FACILITIES FOR SAFETY SOCKETS

SG 513.2

**Test-Bypass Facilities for Safety Sockets, 100 & 200 Amps, 0 – 600 Volts
Bussted &/or Cable Terminations**

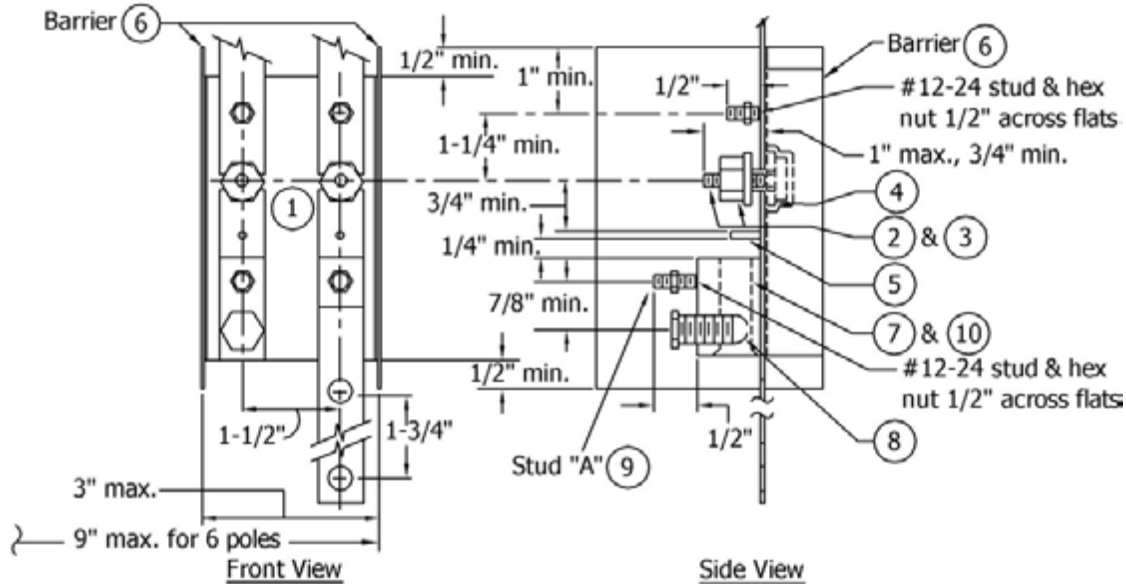

Notes:

- ① Strike distance between upper and lower bus sections shall not be less than 1/4" when the circuit-closing nut is backed off.
- ② Circuit-closing nut shall be a hex nut 5/8" across flats with plated copper washer attached and have threads counter-bored at bottom to facilitate re-installation. Bolt head shall be secured in place to prevent turning and backout.
- ③ Circuit-closing nut and bolt assembly shall maintain the applied contact pressure between the plated copper washer and the bus members of the test-bypass block.
- ④ Insulating washer shall be made from dimensionally stable, non-tracking material and shall provide a minimum of 1/8" creep distance between the bolt and the bus sections. Bus sections shall be plated.
- ⑤ Wire stops are not required if line and/or loads are connected with bus bar. If cable terminals are used, page SG 513.2 construction requirements shall apply.
- ⑥ Rigid insulating barriers shall project at least 1/4" beyond any energized parts when the maximum wire size is installed.
- ⑦ Termination of bus bar and cable line or load conductors may be cable or bus. If bus and cable terminations are used together, proper locations and alignment of stud "A" must be maintained to facilitate the installation of bypass jumper.
- ⑧ The terminal screw may be Allen type (3/16" across flats for 100 amp, 5/16" across flats for 200 amp).
- ⑨ Stud "A" may be located either on the terminal body, on the bus member between the circuit-closing nut, and the wire stop or incorporated as part of the wire stop.
- ⑩ For serviceability purposes, the line and/or load bus is to be connected to the bus block member in a manner which will allow ready replacement of the test-bypass block assembly.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

**SHEET
3 OF 3**

SDG&E SERVICE STANDARDS & GUIDE

TEST-BYPASS FACILITIES FOR SAFETY SOCKETS

SG 513.3

WIRING OF SAFETY SOCKET METER CANS

1. Service entrance and load conductors installed in separate raceways may enter or exit the safety socket meter can at either the top, bottom, side or rear. The electrical contractor shall connect those conductors to the factory-installed test-bypass facilities.
2. No connections may be made in a safety socket meter can to supply any other meter, and not more than one load circuit may leave the can.
3. In multi-meter installations of safety socket meter cans, a main switch or breaker can only be installed on the supply side of two or more meters, except when required by the governmental Authority Having Jurisdiction (AHJ).
4. When used to terminate SDG&E (Utility) service lateral conductors, the service conduit shall enter the bottom of the can. The load conductors may not exit the rear of the can behind the test-bypass facilities.
5. The Utility will not supply 2-wire, 120-volt service or metering without approval from Service Standards. See Character of Service on page SG 004.3. Single-phase service will be 3-wire regardless of the voltage, i.e. 120/208 volt or 120/240 volt.

NEUTRAL OR GROUND CONDUCTOR IN SAFETY SOCKET METER CANS

1. The neutral service entrance conductor for a self-contained meter shall connect in the safety socket meter can and may be continuous.
2. On overhead service installations the service ground conductor, provided as the redundant 4th wire corner-ground conductor of a 480-volt delta service, will be connected to the customer's identified equipment grounding conductor at the point of service connection (drip loop). See page SG 516. The customer shall identify B-phase red in color.

ALUMINUM CONDUCTORS IN SAFETY SOCKET METER CANS

1. Test-bypass facilities with aluminum bodied lugs will be provided and installed by the manufacturer. The contractor will make the connections to the bypass facilities, unless the equipment is used as a pull can, in which case the Utility will terminate their service lateral conductors to the line side lug of each test block.
2. Customer maximum conductor sizes in aluminum shall not exceed No. 1/0 AWG for use in the standard duty can and No. 250 MCM in the heavy duty can. The Utility may use a maximum No. 3/0 AWG in a standard duty can and No. 350 MCM in the heavy duty can using pin adapters.
3. The use of a joint compound or oxidation inhibitor is recommended for all aluminum connections. However, the use of oxidation inhibitors is no substitute to having an approved aluminum wire terminal.


Reference UG 4171.3.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 5	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 514.1
	SDG&E SERVICE STANDARDS & GUIDE					
	SAFETY SOCKET METER CANS					

Safety Socket Can with Factory-Installed Test-Bypass Facilities 100 Amps (Standard Duty)

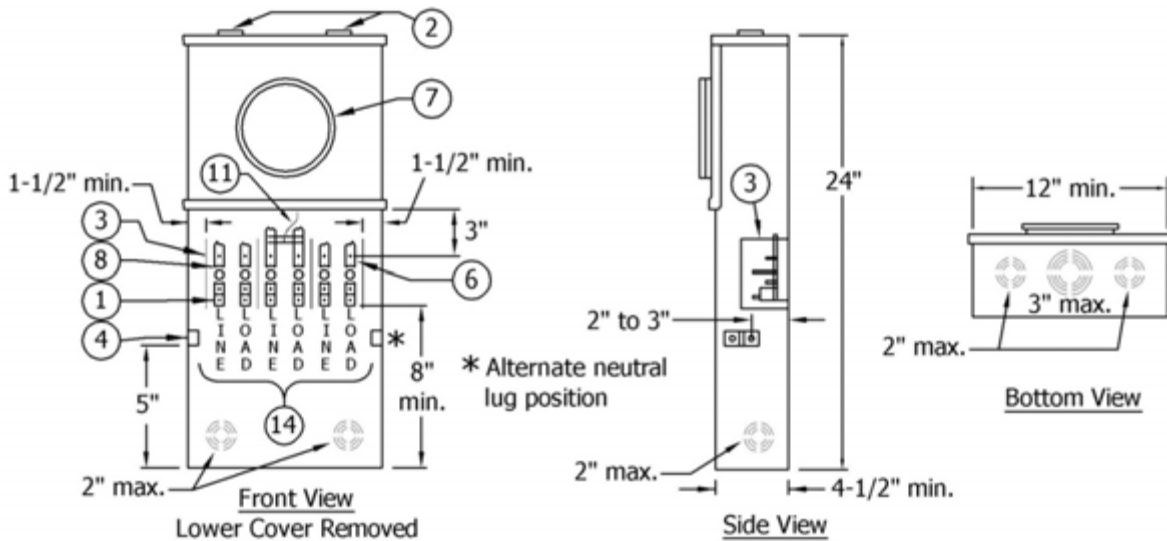

Notes:

- ① Aluminum bodied terminals for No. 6 through No. 1/0 MCM CU-AL wire. The Utility may install a maximum No. 3/0 wire using pin adapters.
- ② Hubs capped off if used for underground feed.
- ③ Rigid insulating barriers. See page SG 513.2.
- ④ Vertical lay-in, double neutral lug with No. 1/0 MCM CU-AL wire capacity, mounted on either sidewall.
5. Test-bypass blocks shall be bussed or wired to socket jaws or terminals. See page SG 516 for meter socket clip requirements.
- ⑥ Upper test connector studs.
- ⑦ All covers shall be independently removable. Upper cover shall be non-removable when meter is in place. Meter socket shall be mounted on support and attached to panel. Lower cover shall be sealable and permanently labeled: "**DO NOT BREAK SEALS. NO FUSES INSIDE.**" See page SG 503 for sealing requirements.
- ⑧ Test-bypass block detail on separate drawing located on page SG 513.2.
9. For 3-phase, 4-wire, connect 7th jaw to body of neutral lug with No. 12 copper wire, white in color.
10. For 3-phase, 4-wire delta, identify right hand test-bypass block (2 poles) as power leg, orange in color (C phase).
- ⑪ For 3-phase, 3-wire, install bus to connect line and load poles together at top of center test-bypass block and connect 5th jaw to this bus using No. 12 wire, red in color.
12. For single-phase, 3-wire, provide 2 test-bypass blocks mounted in the outer positions and a 4-jaw socket.
13. For single-phase, 3-wire, 120/208 volts, provide 2 test-bypass blocks mounted in the outer positions and a 5-jaw socket. Connect 5th jaw of meter socket to body of neutral lug with No. 12 copper wire, white in color.
- ⑬ Permanent labels on inside back of enclosure in 3/4" (minimum) high block letters.

Reference UG 4171.3.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed


SHEET
2 OF 5

SDG&E SERVICE STANDARDS & GUIDE

SAFETY SOCKET METER CANS

SG 514.2

Safety Socket Can with Factory-Installed Test-Bypass Facilities 200 Amps (Heavy Duty)

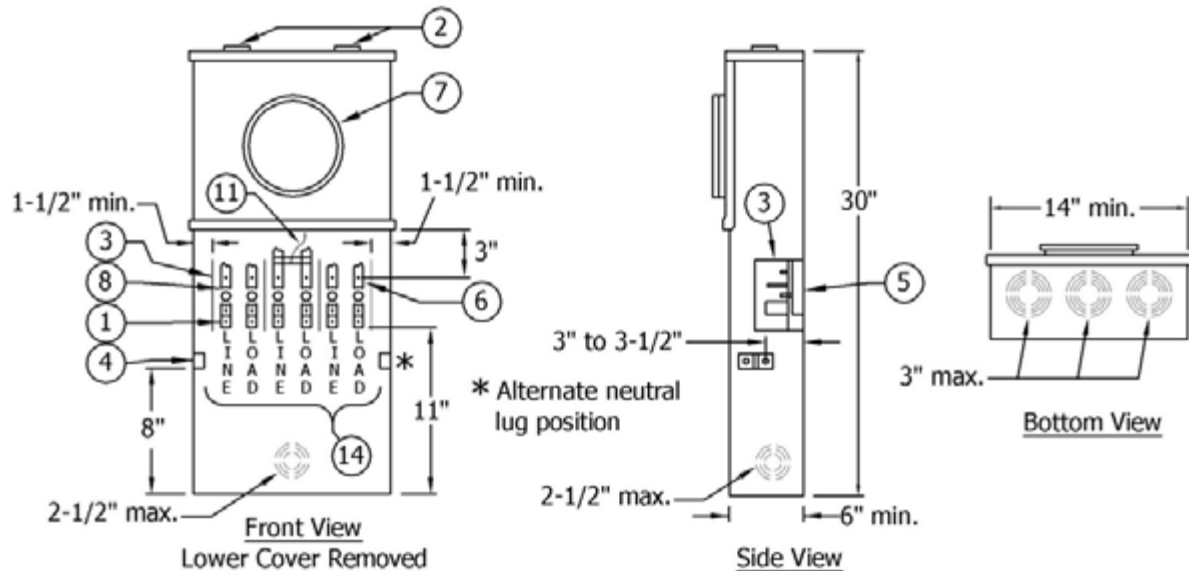

Notes:

- ① Aluminum bodied terminals for No. 1/0 through No. 250 MCM CU-AL wire. The Utility may install a maximum No. 350 wire using pin adapters.
- ② Hubs capped off if used for underground feed.
- ③ Rigid insulating barriers. See page SG 513.2.
- ④ Vertical lay-in, double neutral lug with No. 250 MCM CU-AL wire capacity, mounted on either sidewall.
- ⑤ Test-bypass blocks shall be bussed or wired to socket jaws or terminals. See page SG 516 for meter socket clip requirements.
- ⑥ Upper test connector studs.
- ⑦ All covers shall be independently removable. Upper cover shall be non-removable when meter is in place. Meter socket shall be mounted on support and attached to panel. Lower cover shall be sealable and permanently labeled: "DO NOT BREAK SEALS. NO FUSES INSIDE." See page SG 503 for sealing requirements.
- ⑧ Test-bypass block detail on separate drawing located on page SG 513.2.
9. For 3-phase, 4-wire, connect 7th jaw to body of neutral lug with No. 12 copper wire, white in color.
10. For 3-phase, 4-wire delta, identify right hand test-bypass block (2 poles) as power leg, orange in color (C phase).
- ⑪ For 3-phase, 3-wire, install bus to connect line and load poles together at top of center test-bypass block and connect 5th jaw to this bus using No. 12 wire, red in color.
12. For single-phase, 3-wire, provide 2 test-bypass blocks mounted in the outer positions and a 4-jaw socket.
13. For single-phase, 3-wire, 120/208 volts, provide 2 test-bypass blocks mounted in the outer positions and a 5-jaw socket. Connect 5th jaw of meter socket to body of neutral lug with No. 12 copper wire, white in color.
- ⑬ Permanent labels on inside back of enclosure in 3/4" (minimum) high block letters.

Reference UG 4171.3.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
3 OF 5

SDG&E SERVICE STANDARDS & GUIDE
SAFETY SOCKET METER CANS

SG 514.3

**Typical Multiple Safety Socket Can Grouping Arrangements for
Commercial Installations with Self-Contained Meters**

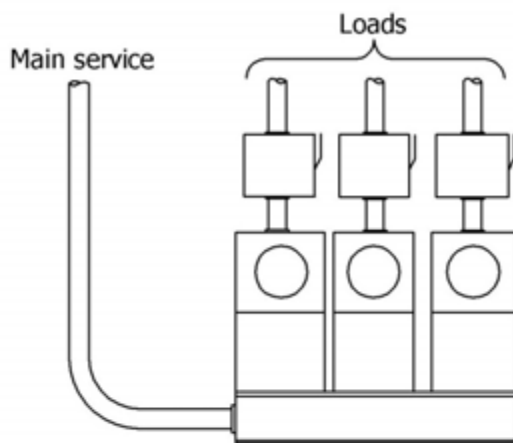


FIGURE 1
Six Meters and Switches or Less

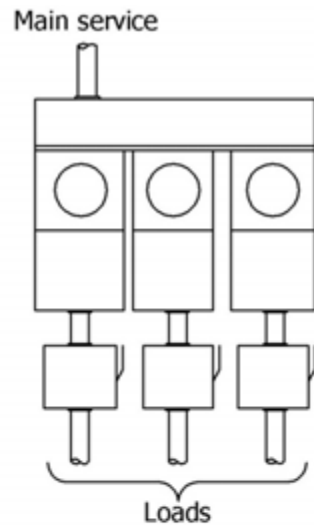


FIGURE 2
Six Meters and Switches or Less

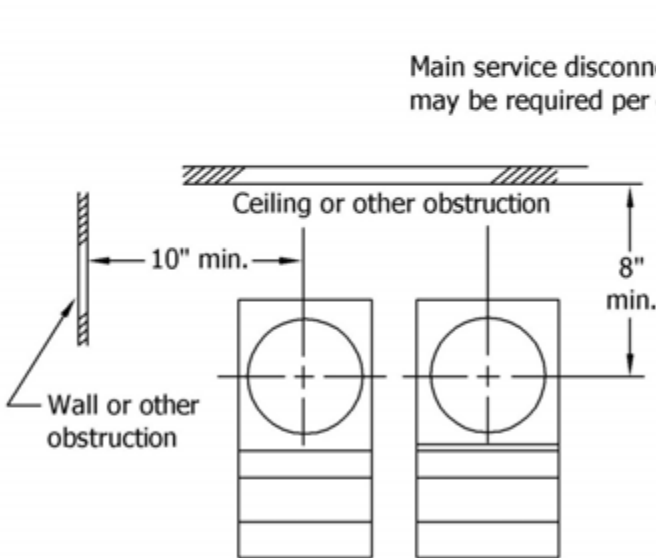


FIGURE 3
Self Contained Meters

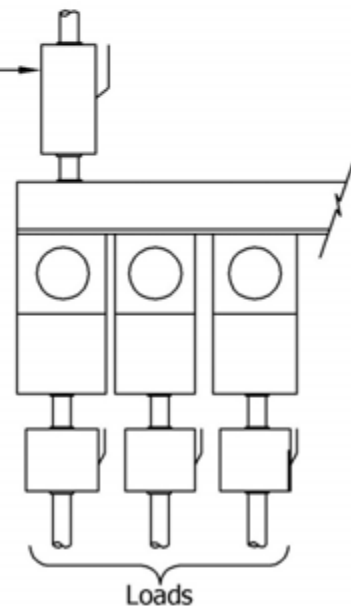


FIGURE 4
More Than Six Meters and Switches

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed



**SHEET
4 OF 5**

SDG&E SERVICE STANDARDS & GUIDE
SAFETY SOCKET METER CANS


SG 514.4

Safety Socket Meter Can Used for Underground Service

The safety socket meter can may be used as a combination service terminating pull and meter can for an underground service, either residential or commercial/industrial. The underground service riser shall enter the bottom of the can as shown in Figure 1. See page SG 514.1 for wiring of safety socket meter cans.

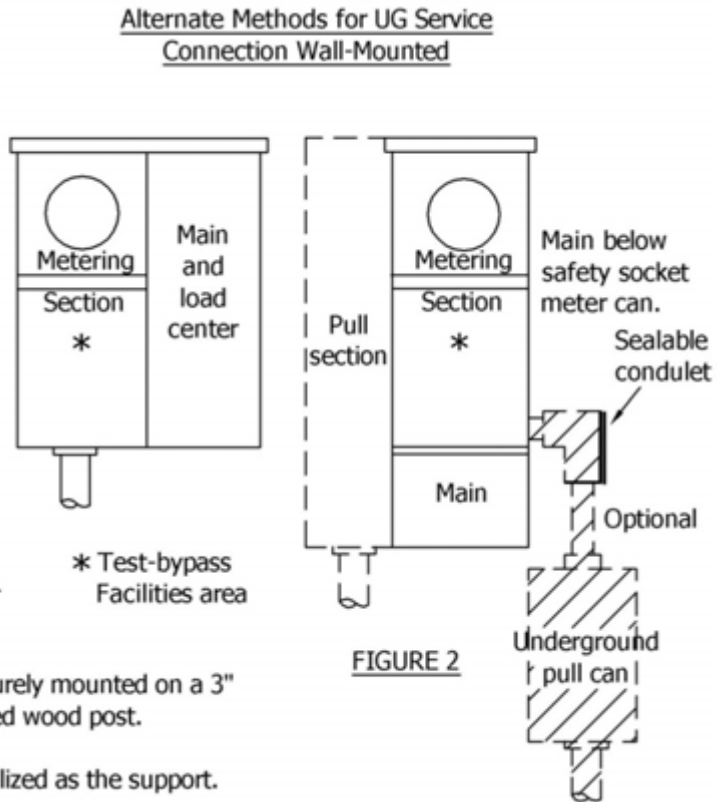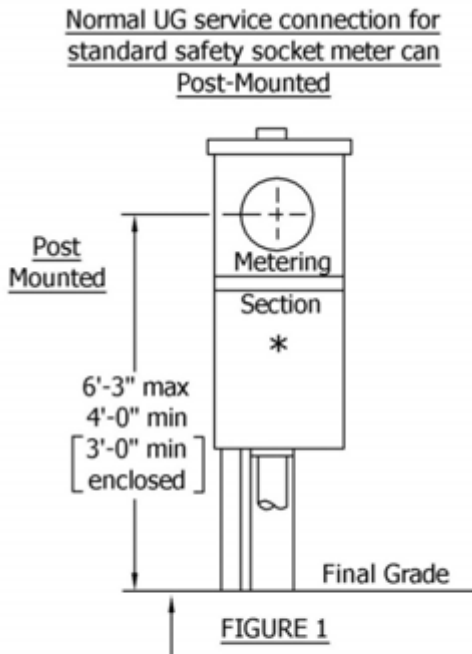

The safety socket meter can must be securely mounted on a 3" minimum rigid metal pipe or 4" x 4" treated wood post.
The pipe or post must be firmly set.
The underground conduit may NOT be utilized as the support.

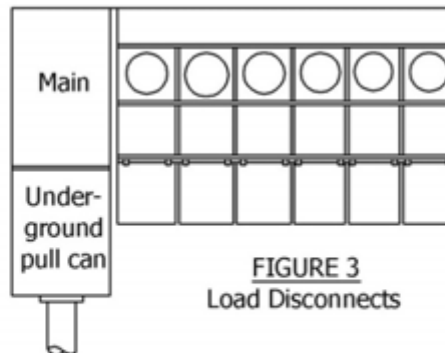

Ganged installation of safety socket meter cans. Main ahead of 7 or more meter service disconnects is required per code.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
5 OF 5

SDG&E SERVICE STANDARDS & GUIDE

SAFETY SOCKET METER CANS

SG 514.5

TRANSFORMER RATED METERS

When the electrical supply needs of the customer exceeds the 200 amp capacity of the self-contained meter and its heavy duty socket, Current Transformers (CTs), which connect to the service entrance conductors, must be used. A transformer rated meter is installed to measure the energy delivered to the customer. A CT capacity multiplier is applied to the billing register on the meter. Both the CTs and the meter are furnished and installed by SDG&E (Utility).

The transformer rated meter, when inserted in its socket, is wired to the CT. The CTs must be located behind the meter and test switch panel cover(s). Customer-owned equipment and wiring is not allowed within the Utility-sealed CT and metering compartment.

The customer furnishes and installs an approved CT enclosure and meter socket. See pages SG 512.6 – 512.8 for special 400 amp residential installation.

SOCKETS FOR TRANSFORMER RATED METERS

A CT rated socket is used with transformer rated meters. The socket is furnished and installed by the customer. The Utility will furnish, install, own and maintain the necessary instrument transformers, test facilities and meters.

COMBINATION CURRENT TRANSFORMER & METER SOCKET CAN – OVERHEAD SERVICE

When the electric service is 201 – 800 amps, a combination can (see page SG 515.4) is one type of approved enclosure which the customer may furnish to house and support the CTs and meter. In this case, a CT mounting base, with amperage capacity of 400 amps, is also furnished. The service entrance conductors are connected to the CT mounting base by the contractor.

No connections shall be made in the CT can to supply any other meter.

COMBINATION CURRENT TRANSFORMER & METER SOCKET CAN – UNDERGROUND SERVICE

When the electric service is rated 201 – 800 amps, a combination can (see page SG 515.5) may be used for residential or commercial service.

No connections shall be made in the CT can to supply any other meter.

The contractor shall furnish and install a CT mounting base and conductors of the proper type and shall connect the conductors from the termination section of the CT mounting base.

Refer to page SG 515.6 for 400 – 800 amp, three-phase, 4-wire, wall-mounted underground pull can with CT, meter socket and main disconnect(s) in adjacent section.

METER SERVICE DISCONNECT

All meter service disconnects on transformer rated meter installations shall have a provision for locking in the open/off position.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed


SHEET
1 OF 6

SDG&E SERVICE STANDARDS & GUIDE

**TRANSFORMER RATED METERS & WALL-MOUNTED
SERVICE & METERING EQUIPMENT**

SG 515.1

Current Transformer Mounting Base for Installation in Current Transformer Enclosure
0 – 400 Amps Maximum, 0 – 600 Volts, Single-Phase, Three-Wire Service

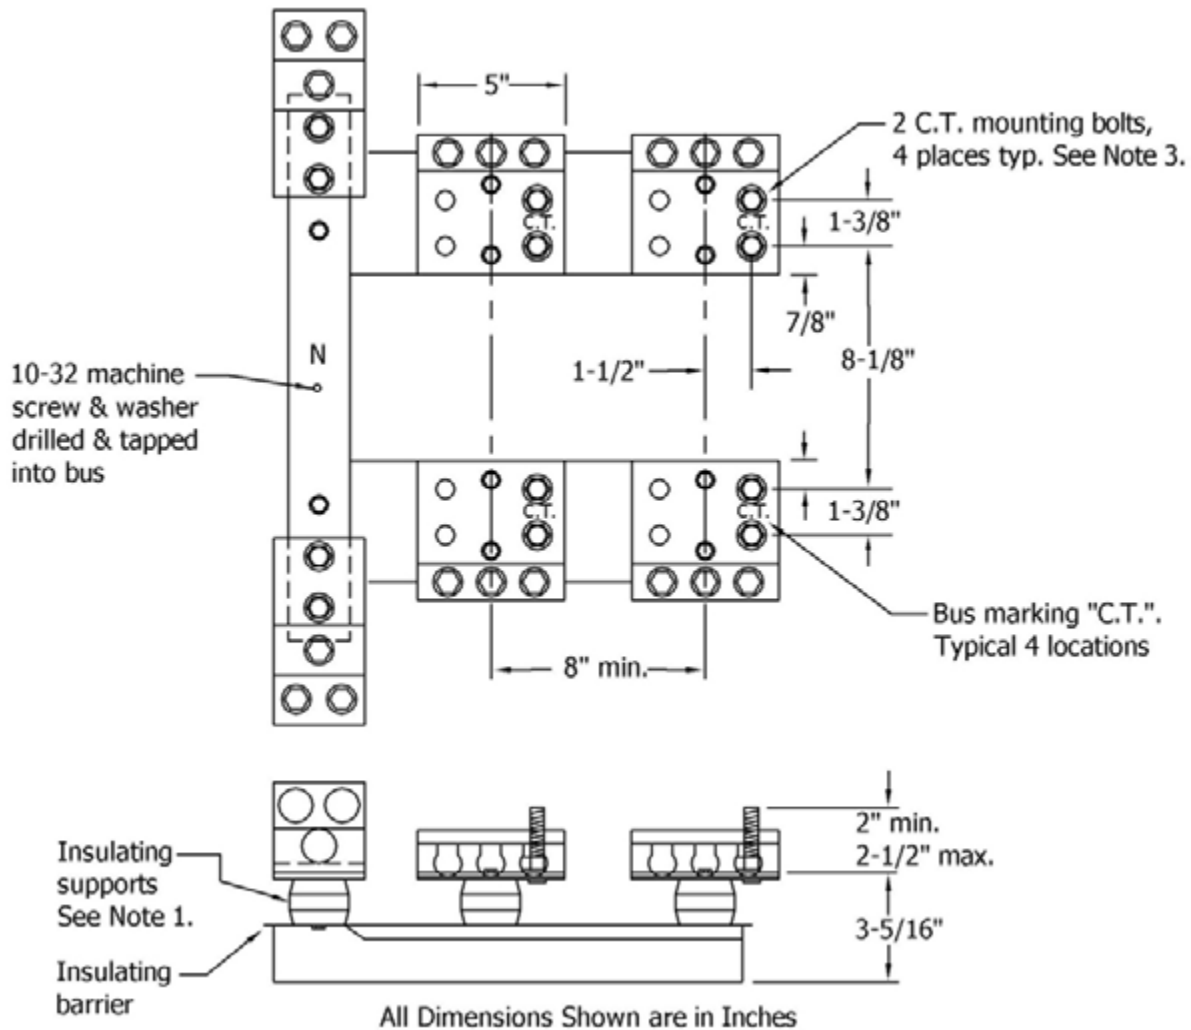

Notes:

1. Mounting base accepts bar type CTs only.
2. Two 1/2" steel bolts shall be provided for each CT mounting position. Each bolt shall be secured in place and furnished with a spring washer and a nut. The spring washers may be either a cone-type (Belleville) or a split-ring washer and a flat washer. All parts shall be plated to prevent corrosion.
3. Terminations for service conductors shall be three-position, aluminum-bodied mechanical lugs with a range accepting one No. 4 AWG through No. 500 kCMIL conductor.
4. For applications, see pages SG 515.4 – 515.6.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 6

SDG&E SERVICE STANDARDS & GUIDE

**TRANSFORMER RATED METERS & WALL-MOUNTED
SERVICE & METERING EQUIPMENT**

SG 515.2

Current Transformer Mounting Base for Installation in Current Transformer Enclosure
201 – 800 Amps Maximum, 0 – 600 Volts
Three-Phase, Three-Wire or Four-Wire, Wye or Delta-Connected Service

Notes:

1. Mounting base accepts bar type CTs only. CT center phase position shall be bussed straight through for 3-phase, 3-wire, service voltage installations.
2. Two ½" steel bolts shall be provided for each current-transformer mounting position. Each bolt shall be secured in place and furnished with a spring washer and a nut. The spring washers may be either a cone-type (Belleville) or a split-ring washer and a flat washer. All parts shall be plated to prevent corrosion.
3. Terminations for service conductors shall be three-position, aluminum-bodied mechanical lugs with a range accepting one No. 4 AWG through No. 500 kCMIL conductor.
4. For applications, see pages SG 515.4 – 515.6.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					


X Indicates Latest Revision Completely Revised New Page Information Removed

**SHEET
3 OF 6**

SDG&E SERVICE STANDARDS & GUIDE
**TRANSFORMER RATED METERS & WALL-MOUNTED
SERVICE & METERING EQUIPMENT**

SG 515.3

**Wall-Mounted Underground Pull Can Equipped with Mechanical Lugs with Current Transformer Compartment, Meter Socket & Main Disconnect(s) in Adjacent Section
0 – 600 Volts, 400 – 800 Amps Maximum, 3-Phase, 4-Wire Service**

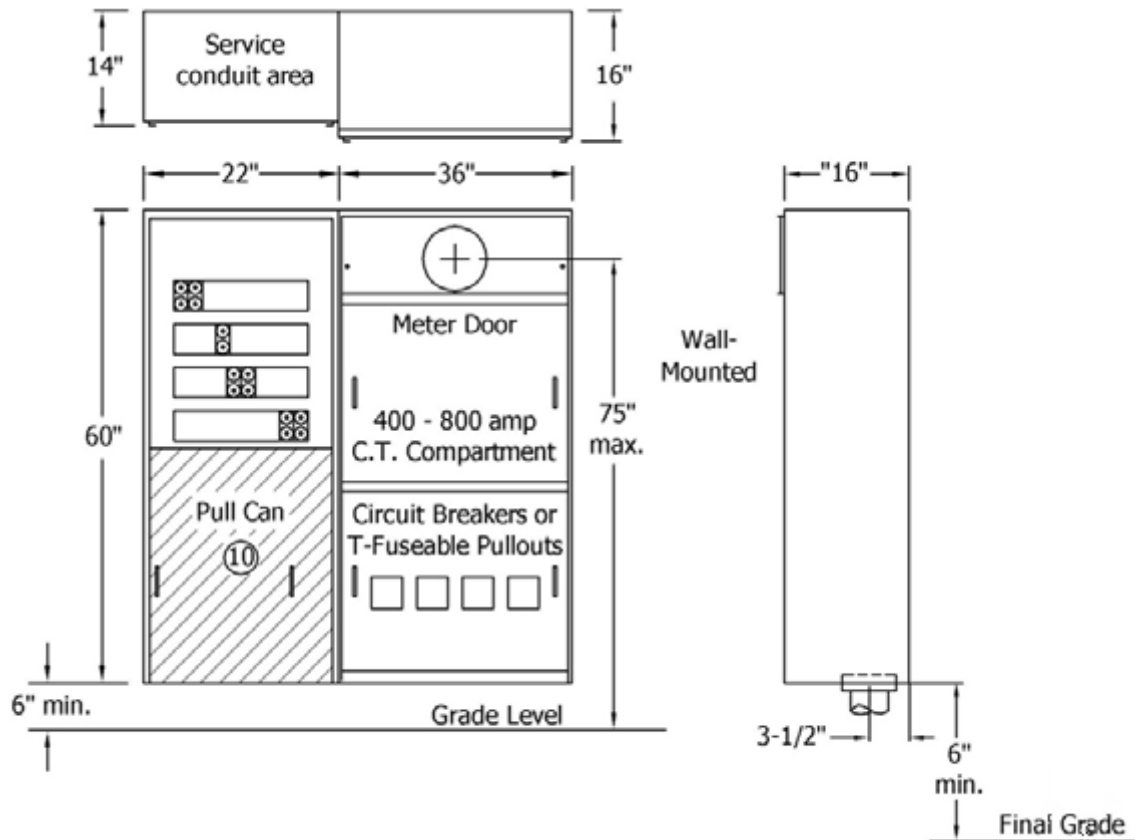

Notes:

1. Service lateral conduits, firmly secured with locknut, hub or bushing, must enter bottom of pull can. Maximum conduit intrusion inside can is 1". Load conduits must exit above shaded area.
2. Bonding connection for service lateral conduits only is permitted at bottom of can. Any other bonding or grounding connection must be made above the shaded area and no grounding or bonding conductor is permitted to pass through shaded area.
3. Removable test switch perch shall be drilled and tapped as per pages SG 517.8 – 517.9.
4. CT compartment cover shall have two lifting handles, be a maximum of 9 square feet, and a caution sign reading: "DO NOT BREAK SEALS, NO FUSES INSIDE."
5. All securing screws shall be captive. All panels and covers shall be sealable.
6. See page SG 515.3 for Transformer Base Details.
7. The minimum distance from base of pull can to the lowest mechanical lug is 26".
8. See page SG 504.1 for meter height requirements.
9. See page SG 515.1 for additional Transformer Rated Metering information.
- ⑩ Shaded area is for Utility service lateral conductors only.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

**SHEET
6 OF 6**

SDG&E SERVICE STANDARDS & GUIDE

**TRANSFORMER RATED METERS & WALL-MOUNTED
SERVICE & METERING EQUIPMENT**

SG 515.6

The meter type and number of socket clips and their arrangement varies with the phase and voltage of service supplied to the customer. The following table lists these requirements:

S = Socket Meter, N = Network 120/208 Meter, P = Poly Phase Autoranging 120-480

SELF-CONTAINED METER				
Type of Service	Meter Forms	Socket (Amps)	Meter Clips	Smart Meter Type
1 Phase 2 Wire 120 Volt ④	1S CL200	200 or Less	4	C2SODL1
1 Phase 3 Wire 120/208 Volt ⑥	12S Network CL200	200 or Less	5	CN2SODL12
1 Phase 3 Wire 120/240 Volt	2S CL200	200 or Less	4	C2SODL2
1 Phase 3 Wire 120/240 Volt	2S CL320	400	4	C2SOL2E
1 Phase 3 Wire 240/480 Volt	2S CL200	200 or Less	4	CP2SOL2
3 Phase 4 Wire 120/208 Volt WYE	16S CL200	200 or Less	7	CP1SOL16
3 Phase 4 Wire 120/240 DELTA	16S CL200	200 or Less	7	CP1SOL16
3 Phase 4 Wire 277/480 Volt WYE	16S CL200	200 or Less	7	CP1SOL16
3 Phase 3 Wire (4 th wire grounding conductor required) 240 VOLT Corner GRD ②④ 480 corner GRD ②⑤	12S CL200	200 or Less	5	CP1SOL12

CURRENT TRANSFORMER RATED METER			
Type of Service	Meter Forms	Meter Clips ①	Smart Meter Type
1 Phase 3 Wire 120/240 Volt	4S	6	C2SOL4
3 Phase 4 Wire 120/208 Volt WYE	9S	15	CP1SAL9
3 Phase 4 Wire 120/240 DELTA	9S	15	CP1SAL9
3 Phase 4 Wire 277/480 Volt WYE	9S	15	CP1SAL9
3 Phase 3 Wire (4 th wire grounding conductor required) 240 VOLT Corner GRD ②④ 480 corner GRD ②⑤	5S	15	CP1SAL5
3 Phase 3 Wire 12 KV	5S	15	CP1SAL5
3 Phase 4 Wire 12 KV	9S	15	CP1SAL9



4 CLIP
Applicable to
Smart Meter
Types:
C2SOL1
C2SODL1
C2SOL2
C2SODL2
C2SOL2E



5 CLIP
Self-contained
meters ③
Applicable to
Smart Meter
Types:
CNSOL12
CNSODL12
CPSOL12



6 CLIP
Trans rated
meters
Applicable to
Smart Meter
Types:
C2SOL4



7 CLIP
Applicable to
Smart Meter
Types:
CP1SOL16



8 CLIP
Not for new
installations.
Not longer an
acceptable
meter use



15 CLIP
Applicable to
Smart Meter
Types:
CP1SAL9
CP1SAL5
CP1SOL9
CP1SOL5
CP2SA29

- ① All meter socket terminal clips must be back connected. (Except pages SG 515.4 and SG 515.5.)
- ② 4th wire (redundant grounding conductor only – not a neutral), delta-connected with B phase.
- ③ The required position of the 5th clip for self-contained meter sockets is 9 o'clock (270 degrees).
- ④ Not acceptable for new installations or old sets, or for any vacant existing single-phase, 2-wire 210-volt meter bases. FIELD MAINTENANCE ONLY.
- ⑤ ONLY APPLICABLE WHEN FED FROM AN OVERHEAD TRANSFORMER STATION.
- ⑥ Reference page SG 004.4 for multi-family residential requirement for single-phase metering.
7. Effective with Smart Meter implementation, Form 16 meters will also replace all Form 14s and 15s.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

METER TYPE & SOCKET CLIP ARRANGEMENT

SG 516

ELECTRIC UTILITY SERVICE EQUIPMENT REQUIREMENTS COMMITTEE (EUSERC)

EUSERC is an organization comprised of Utility representatives from the Western region of the United States which works to promote the standardization of electric service requirements and the design and engineering of metering and service requirement. Switchboard service sections, approved for use in the area served by SDG&E (Utility), are generally built to the requirements developed by EUSERC, and are available to the customer and contractor through electrical wholesale distributors.

SWITCHBOARD SERVICE SECTION DEFINED

A standard switchboard service section is a free-standing unit of service equipment which contains bussing for the termination of service entrance or service lateral conductors, bussing for the connection and mounting of Current Transformers (CTs), factory installed test-bypass devices, meter socket, and a service main disconnect switch or breaker, and in many cases, distribution feeder breakers or switches.

The standard switchboard service section is usually built to serve the customer with heavy electrical supply needs, and is available with service main switch or breaker ratings from 201 – 4,000 amps.

Standards for service switchboards have also been developed for self-contained meters, both residential and commercial, and with either standard-duty or heavy-duty meter sockets. These sections of switchboards are normally built on special order to meet the needs of the customer's electric service.

MANUFACTURER'S DRAWINGS FOR APPROVAL

The manufacturer of the secondary (0 – 600 volts) electrical equipment rated 1,000 amps and above shall submit four (4) copies of the drawings prior to fabrication to:

SDG&E Service Standards
8316 Century Park Court, CP52F
San Diego, CA 92123-1582

The address of the job must be shown on drawings in order to process. One copy will be returned to the sender with approvals or corrections as needed. When a parallel, stand-by or emergency generation system is existing or is to be installed in connection with new service equipment, a one-line electrical diagram showing the relationship of the generator with the service equipment, including the transfer device and its sequence of operation, is to be submitted with the switchboard drawings. The electrical one-line diagram submittal requirement applies to all systems regardless of size.

This practice will ensure the Utility's requirements are met and the service equipment will be acceptable to the Utility.

SWITCHBOARD BUS/WIRE TAP DRAWINGS FOR APPROVAL

If there are adequate factory-installed existing customer side mechanical lugs available in the Underground Pull Section (UGPS) for new service entrance conductors to be added, tap drawings are not required. If mechanical lugs must be added to an existing bus, or manufacturer installed wire conductors are to be tapped, bus tap drawings prepared by a qualified engineer are required. Submit four (4) copies of the drawings prior to fabrication to SDG&E Service Standards. See mailing address above under Manufacturer's Drawings for Approval.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 20

SDG&E SERVICE STANDARDS & GUIDE

STANDARD SWITCHBOARD SERVICE SECTIONS

SG 517.1

The address of the job must be shown on drawings in order to process. One copy will be returned to the sender with approvals or corrections as needed. Both the governmental Authority Having Jurisdiction (AHJ) and the Utility will inspect the bus tap, and the Utility must receive the inspection clearance from the AHJ as a condition of energizing.

VENTILATION

All switchboard sections containing unmetered conductors shall comply with UL 891 (8.5.3) for protection of energized parts. The Utility's Inspectors do not inspect for this requirement. It is the equipment manufacturer's responsibility to ensure compliance with the UL Standard.

SWITCHBOARD SERVICE SECTIONS OUTLINE

The following information has been included to help you visualize the appearance of standard switchboard service sections.

1. The standard switchboard sections as shown may be used for single-phase service.
 - a. The switchboard bussing arrangement in the instrument transformer compartment for single-phase service capacity in the range of 201 – 400 amps is shown on page SG 517.12.
 - b. The 6-clip meter socket for a single-phase, 120/240 volt, 3-wire transformer rated meter will be provided as shown on page SG 516.
 - c. Refer to pages SG 517.3 – 517.20 for Standard Switchboard Section details.
2. The Standard Switchboard Sections as shown may be used for three-phase service.
 - a. The switchboard bussing arrangement in the instrument transformer compartment for service capacity in the range of 201 – 1,000 amps is shown on pages SG 517.13 – 517.14.
 - b. The switchboard bussing arrangement in the instrument transformer compartment for service capacity in the range of 1,001 – 3,000 amps is shown on pages SG 517.15 – 517.17.
 - c. The switchboard bussing arrangement in the instrument transformer compartment for service capacity in the range of 3,001 – 4,000 amps is shown on pages SG 517.18 – 517.20.
 - d. The 15-clip meter socket is required for all three-phase transformer rated installations, as shown on page SG 516.
 - e. For Standard Switchboard Section details, refer to pages SG 517.6 – 517.7, SG 517.10 – 517.11, and SG 517.13 – 517.20.
3. Multiple metering switchboards for residential service may use either standard-duty meter sockets, with nominal capacity of 125 amps, or heavy-duty meter sockets, with nominal capacity of 200 amps.

When mounted in switchboards, preferably one but not more than two meter sockets may be mounted on any single front panel.

When the installation is complete, all meter panels must be removable for inspection of wiring. Panel design shall permit convenient replacement of any meter socket without interruption of service to other meters.


4. Multiple meter switchboards for commercial service, either for single or multiple metering, must have factory-installed test-bypass facilities.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 20	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 517.2
	SDG&E SERVICE STANDARDS & GUIDE					
	STANDARD SWITCHBOARD SERVICE SECTIONS					

Standard Switchboard Service Section, 0 – 600 Volts

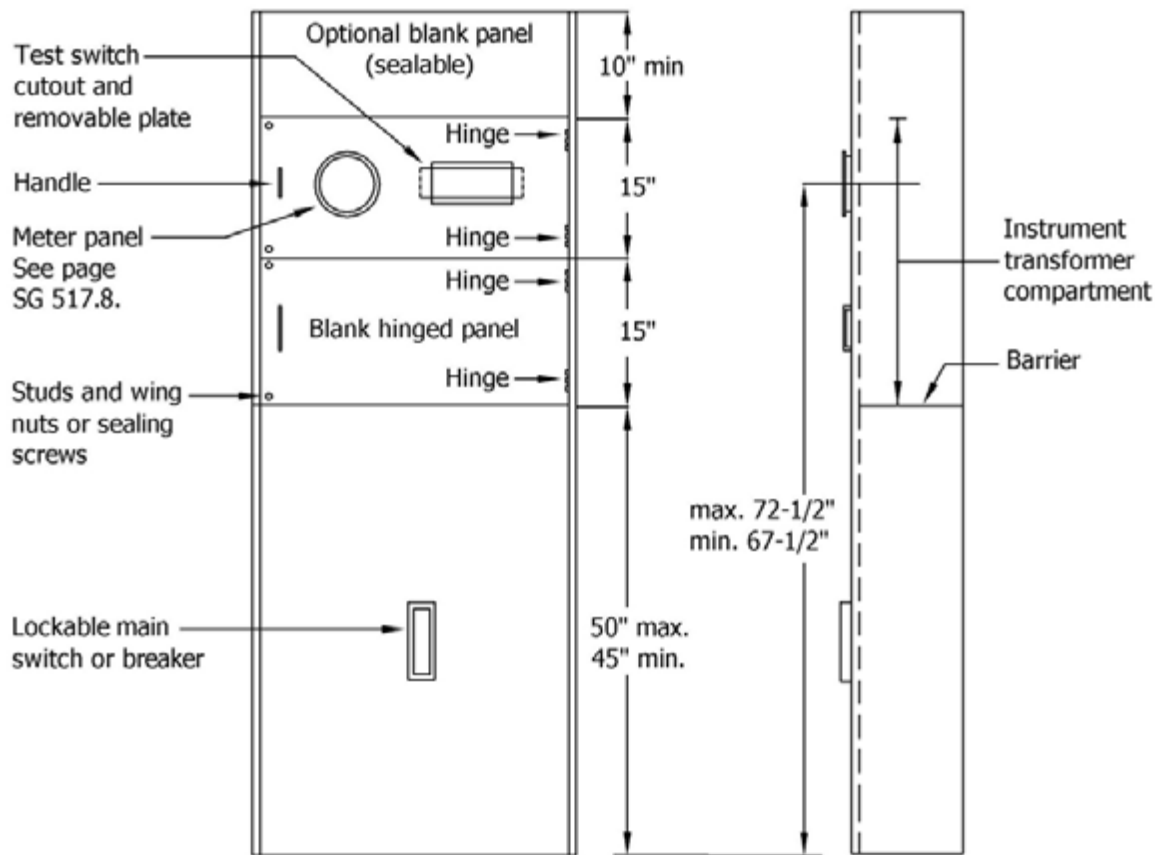

Notes:

1. The width and depth are determined by type and amperage of service.
2. For outdoor/raintight (NEMA 3R) enclosures, see pages SG 517.6 – 517.7.
3. Instrument transformer compartments shall be bussed with rectangular bus bar.
4. The grounding connection shall be made in the main switch or breaker compartment.
5. Meter panels shall be constructed of 12-gauge steel (minimum) and shall be reversible, sealable, hinged and interchangeable.
6. The meter panel shall be mounted in the upper position and have a handle attached at the unsupported end.
7. Hinges shall be readily interchangeable, right or left, on the job site.
8. Width of meter panels may in some cases require the service section to be wider than the minimum allowable width of transformer compartment. For minimum dimensions of instrument transformer compartments, refer to page SG 517.2, Notes 1 and 2, for page references.
9. All panels and covers shall be sealable.
10. See pages SG 504.4 – 504.5 for working space and clearance requirements, 0 – 600 volts.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed


SHEET
3 OF 20

SDG&E SERVICE STANDARDS & GUIDE

STANDARD SWITCHBOARD SERVICE SECTIONS

SG 517.3

Standard Switchboard Service Section, 0 – 600 Volts

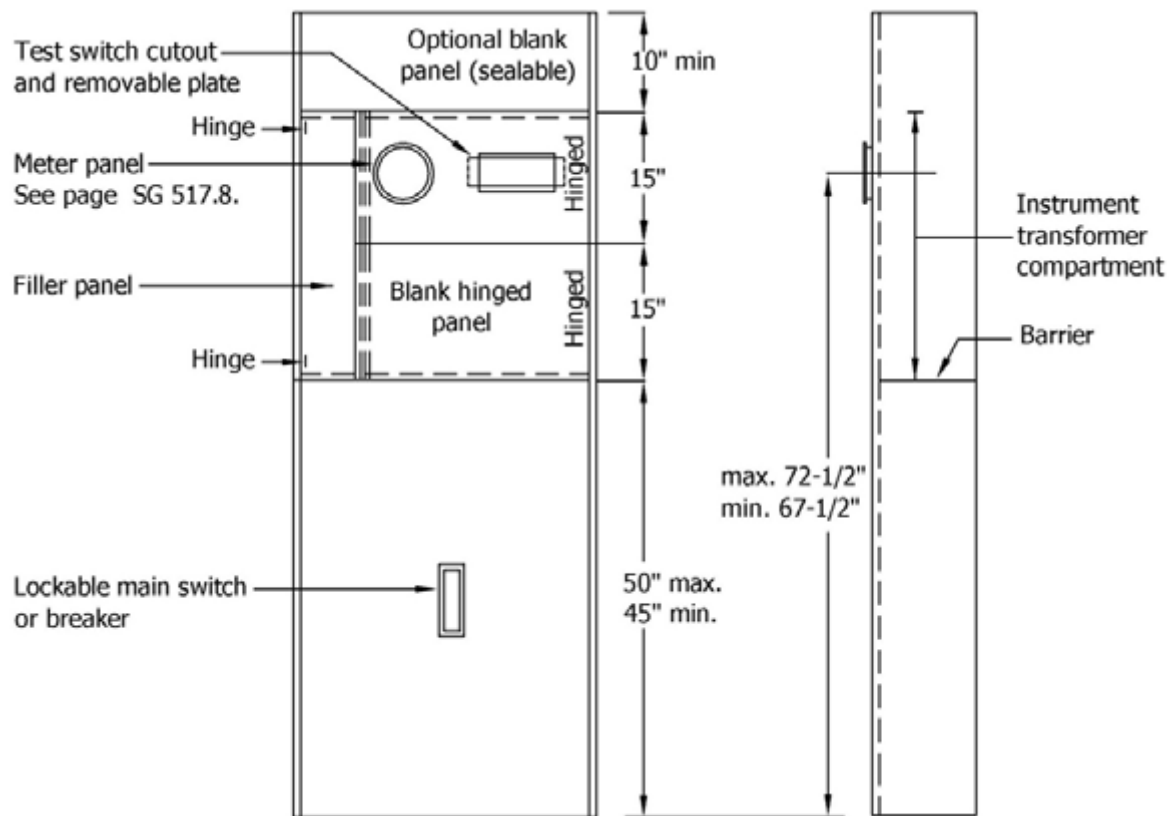

Notes:

1. The width and depth are determined by type and amperage of service.
2. Instrument transformer compartments shall be bussed with rectangular bus bar.
3. Filler panels shall be used where switchboard width exceeds maximum allowable meter panel width.
4. The grounding connection shall be made in the main switch or breaker compartment.
5. Meter panels shall be constructed of 12-gauge steel (minimum) and shall be reversible, sealable, hinged and interchangeable.
6. The meter panel shall be mounted in the upper position and have a handle attached at the unsupported end.
7. Hinges shall be readily interchangeable, right or left, on the job site.
8. Width of meter panels may in some cases require the service section to be wider than the minimum allowable width of transformer compartment. For minimum dimensions of instrument transformer compartments refer to page SG 517.2, Notes 1 and 2, for page references.
9. All panels and covers shall be sealable.
10. See pages SG 504.4 – 504.5 for working space and clearance requirements, 0 – 600 volts.
11. For outdoor/raintight (NEMA 3R) enclosure, see pages SG 517.6 – 517.7.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
4 OF 20


SDG&E SERVICE STANDARDS & GUIDE

STANDARD SWITCHBOARD SERVICE SECTIONS

SG 517.4

Standard Switchboard Service Section, 0 – 600 Volts

This drawing shows a separate barrier creating a load wireway at the upper right side of the switchboard in order to route the load conductors out the top. Load conductors may not be routed through the instrument transformer compartment in order to exit the switchboard.

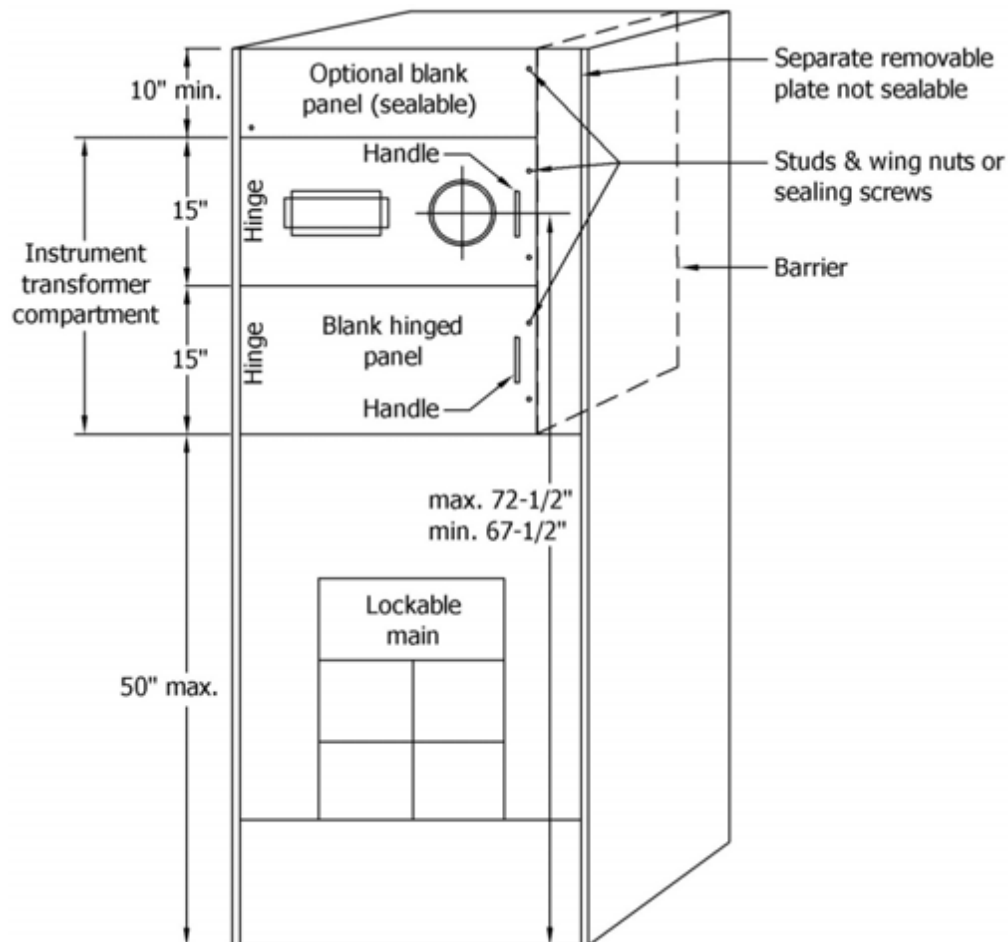

Notes:

1. The width and depth are determined by type and amperage of service.
2. Refer to page SG 517.3 for additional dimensions and details.
3. Access to customer's distribution wireways shall not require opening or removing sealable panels.
4. All panels and covers shall be sealable.
5. See pages SG 504.4 – 504.5 for working space and clearance requirements, 0 – 600 volts.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
5 OF 20

SDG&E SERVICE STANDARDS & GUIDE

STANDARD SWITCHBOARD SERVICE SECTIONS

SG 517.5

Standard Switchboard Service Section, 0 – 600 Volts
Outdoor/Raintight Enclosure (NEMA 3R)

This drawing shows the construction for an outdoor raintight unit with enclosed meter panels and main disconnect switch or breaker.

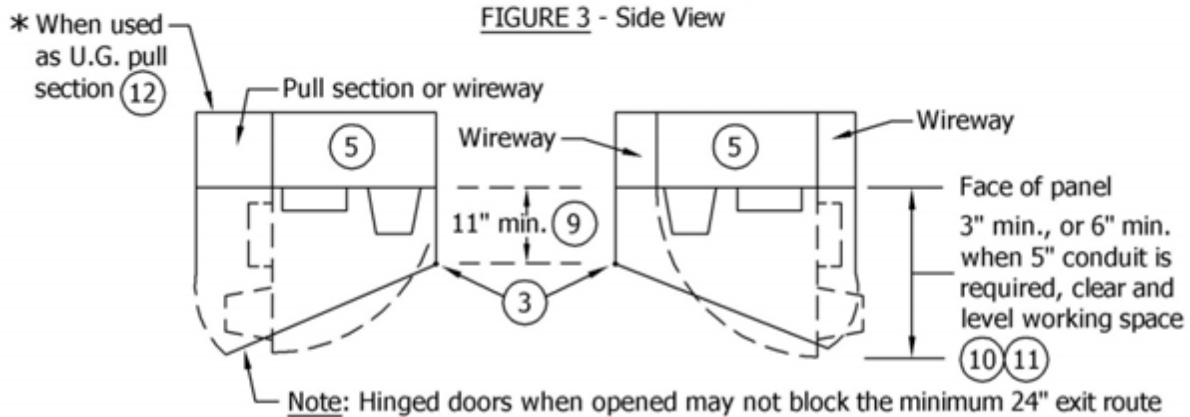
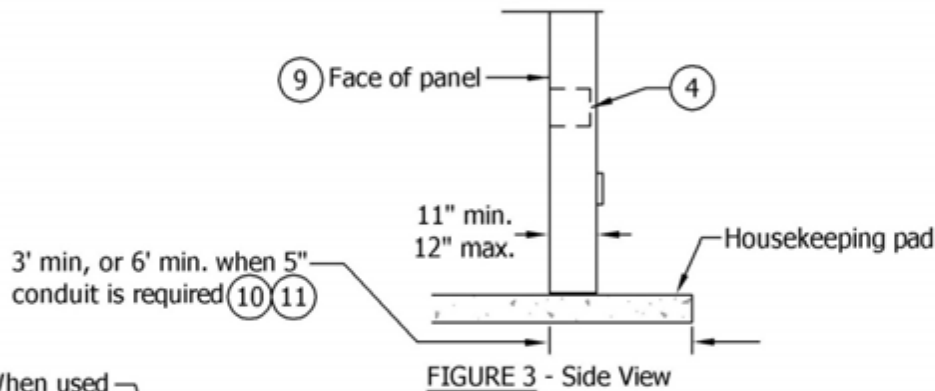
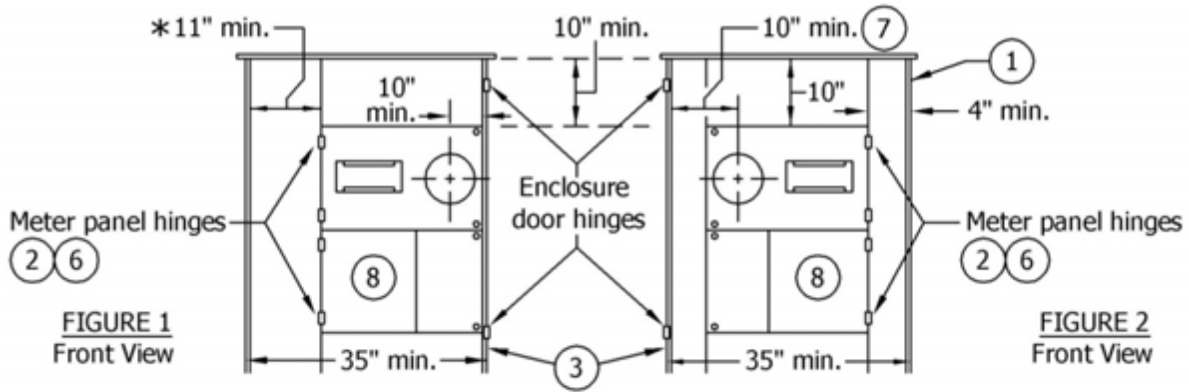


FIGURE 4 - Top Views

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
6 OF 20

SDG&E SERVICE STANDARDS & GUIDE

STANDARD SWITCHBOARD SERVICE SECTIONS

SG 517.6

Standard Switchboard Service Section, 0 – 600 Volts
Outdoor/Raintight Enclosure (NEMA 3R)

Notes to Figures 1-4:

- ① The width and depth are determined by type and ampacity of service.
- ② Hinged meter panels shall be capable of being opened 90 degrees with meter and test facilities in place. The hinges shall be readily interchangeable right or left on the job sight. For other details, see pages SG 517.8 – 517.9. All meter panels must be hinged from the test switch side.
- ③ The enclosure door shall be hinged opposite from the meter panel door when necessary to allow 90 degree opening of the meter panel door with Utility equipment in place. When enclosure door(s) is locked, a double hasp is required. The enclosure door(s) shall be designed to secure in the open position at 90 degrees or more. A full height hinged door with a three-point locking mechanism and provision for a Utility furnished padlock is required.
- ④ The meter heights specified on page SG 504.1 apply in full switchboard height meter enclosures.
- ⑤ For meter socket and test switch panel layout, see pages SG 517.8 – 517.9. For instrument transformer compartment information, see pages SG 517.12 – 517.20.
- ⑥ If the panel is hinged at the side wall of the NEMA 3R recess, the edge of the test switch slots shall be 1" plus the depth of the recess from the hinged side.
- ⑦ Where an adjacent obstruction extends 11" or more perpendicular from the face of the meter socket, a 10" minimum dimension to centerline of meter is required. This also applies to multi-meter installations. See pages SG 509.1 – 509.4 for meter cabinet requirements.
- ⑧ All panels and covers shall be sealable.
- ⑨ The 11" clearance from meter panel to inside of door is required for all types of meters.
- ⑩ When outdoor raintight service equipment is installed on a "housekeeping pad", that pad must be level and extend a minimum of 3' measured from the face of the meter panel, or a minimum of 6' when 5" conduit is required. See Figures 3 and 4 on page SG 517.6. If the enclosure doors are wider than 3', the housekeeping pad shall extend 1" beyond the outer edge of the equipment doors when opened at 90 degrees.
- ⑪ See pages SG 504.4 – 504.5 for working space and clearance requirements, 0 – 600 volts.
- ⑫ See Section 700 for terminating enclosure UGPS requirements.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------



SHEET
7 OF 20

SDG&E SERVICE STANDARDS & GUIDE

STANDARD SWITCHBOARD SERVICE SECTIONS

SG 517.7

Standard Switchboard Service Section, 0 – 600 Volts
Meter Socket & Test Switch Panel Layout

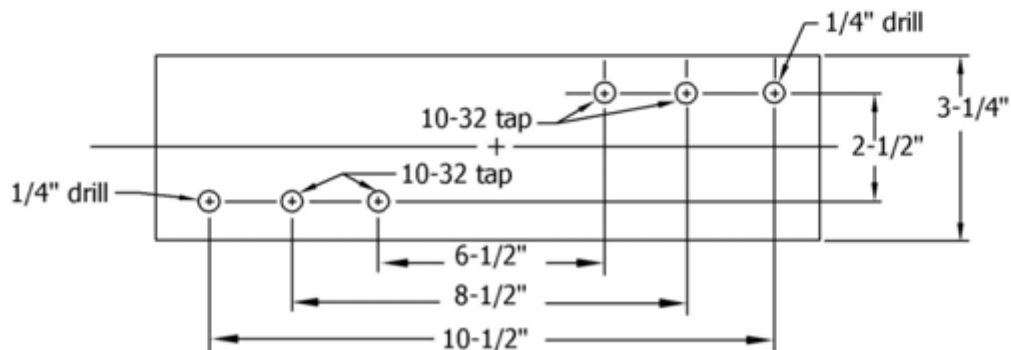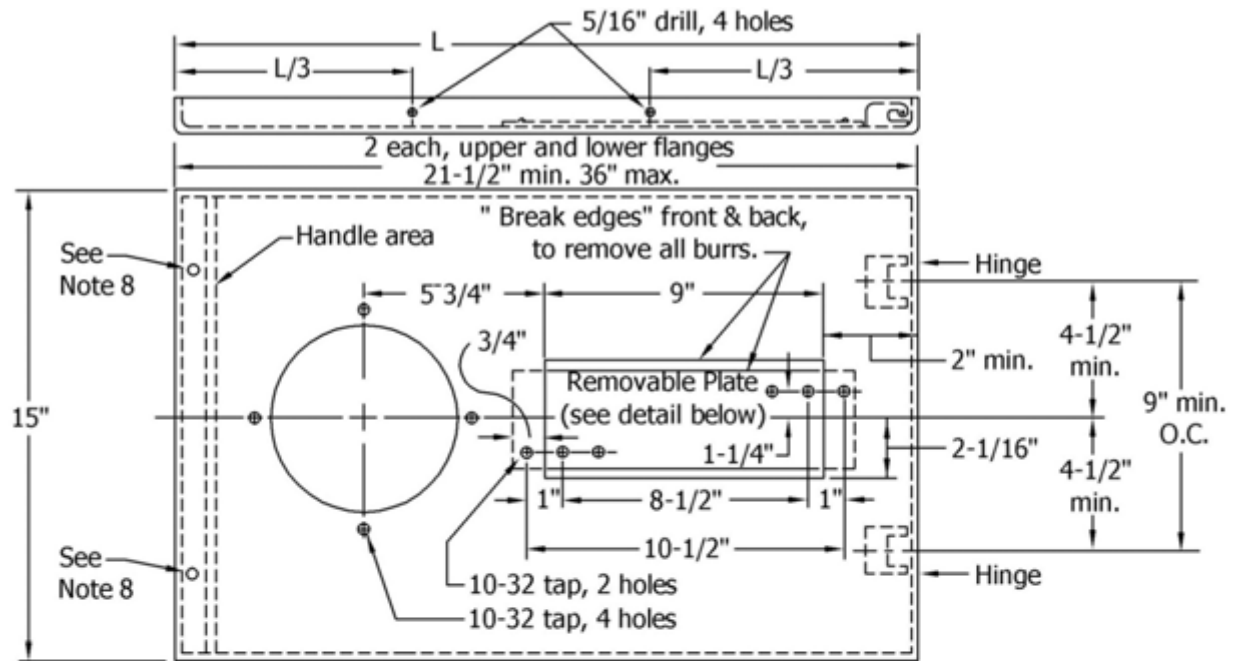

Removable Plate

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
8 OF 20

SDG&E SERVICE STANDARDS & GUIDE

STANDARD SWITCHBOARD SERVICE SECTIONS

SG 517.8

Notes:

1. The switchboard manufacturer shall drill, tap and slot the panel as shown for secondary test switches and shall furnish and install sockets complete with sealing rings.
2. Meter panels shall be constructed of 12-gauge steel (minimum) and shall be hinged at the test switch side by the manufacturer. Meter panels shall be sealable, and must be reversible and interchangeable if field conditions require such change.
3. Meter panels shall have a handle attached at the unsupported end.
4. Hinges must support a 25-pound load applied at the unsupported end with 1/8" maximum sag when open.
5. Hinges shall be readily interchangeable, right or left, on the job site.
6. Removable plate shall be secured to rear of panel by screws of such length so as not to protrude through face of panel.
7. Meter panels shall be capable of being opened 90 degrees with meter and test facilities in place.
8. All securing screws and sealing screws on panels shall be captive. Studs and wing nuts shall be sealable when used.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X	Indicates Latest Revision	Completely Revised	New Page	Information Removed
----------	---------------------------	--------------------	----------	---------------------




SHEET
9 OF 20

SDG&E SERVICE STANDARDS & GUIDE

STANDARD SWITCHBOARD SERVICE SECTIONS

SG 517.9

Standard Switchboard Service Section, 0 – 600 Volts
For Self-Contained Metering, 200 Amp Maximum Meter Socket Capacity
Single-Phase, 3-Wire & Three-Phase, 4-Wire Services

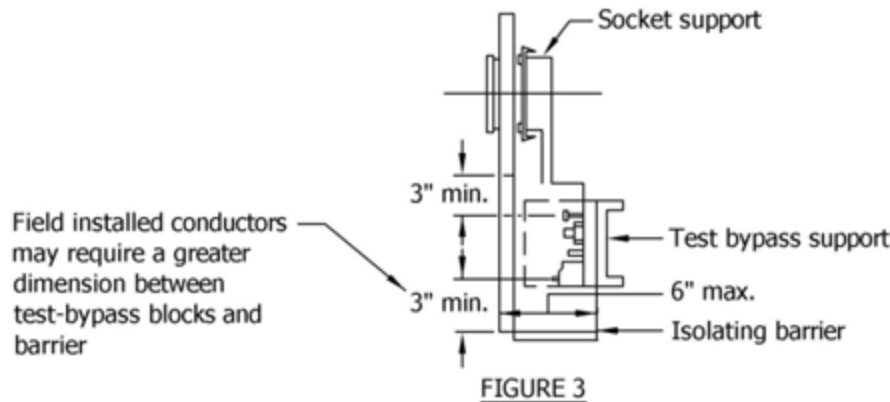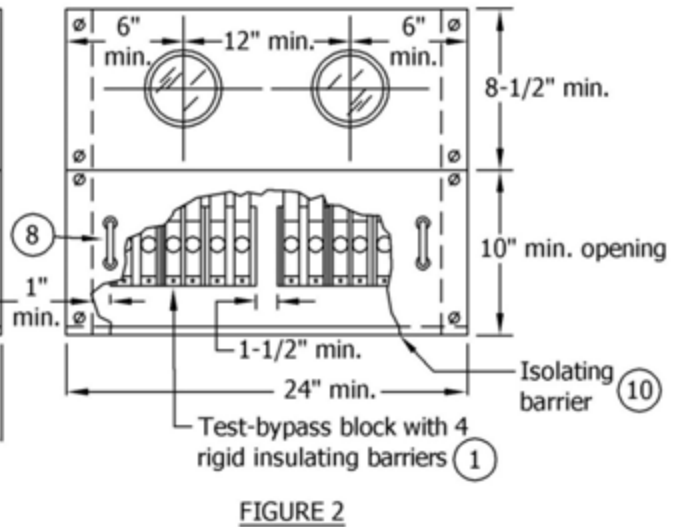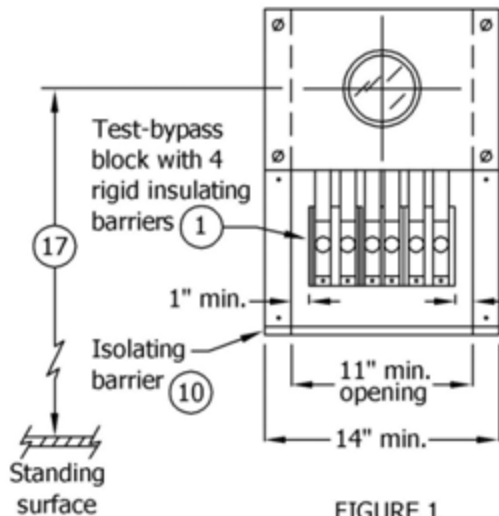

Notes:

- ① Test-bypass facilities with rigid insulating barriers shall be furnished, installed, and wired or bussed to the meter socket by the manufacturer. Blocks and barriers shall conform to page SG 513.2 requirements with physical arrangement conforming to pages SG 514.2 – 514.3. Connection sequence is line-load, line-load, line-load from left to right.
2. Separate line and load conductors shall be installed and connected by the contractor or manufacturer for each test-bypass position.
3. Metered conductors shall not pass through adjacent metering compartments except in closed wireways. To ensure proper identification of cables in factory cabled equipment, metered cables

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
10 OF 20

SDG&E SERVICE STANDARDS & GUIDE

STANDARD SWITCHBOARD SERVICE SECTIONS

SG 517.10

(except in the test-bypass area), shall be either physically barriered or bundled so as to separate them from unmetered cable or permanently marked and isolated from unmetered cables. Physical barriers will not be required if the unmetered conductors are bus.

4. Minimum access opening to test-bypass blocks shall be 11" x 10" for Figure 1 and 21-½" x 10" for Figure 2.
5. Rigid insulating barriers shall be installed as shown.
6. Upper test connector stud shall be a minimum of 3" below upper panel.
7. Meter panels shall be removable, but shall be non-removable when the meter is in place. The meter socket shall be supported independent of, and attached to, the meter panel. When mounted in switchboards, preferably one but not more than two sockets may be mounted on any single front panel.
- ⑧ Test-bypass cover panels shall be sealable and fitted with a lifting handle. All panels exceeding 16" in width shall require two lifting handles.
9. When a neutral is required for metering or testing, an insulated neutral terminal shall be provided behind each test-bypass cover panel. The terminal shall be readily accessible when the cover panel is removed and shall be individually connected to the neutral bus with a minimum No. 12 copper wire.
- ⑩ Factory-installed full-width insulating barriers with a maximum deflection of ½" from an applied force of 25 pounds downward, shall be located at the bottom of each test-bypass compartment. In addition, a full width and depth isolating barrier shall be located below the bottom test-bypass compartments and above the load terminals of the meter disconnect devices. If a factory-installed rear-load wireway is provided, the isolating barrier shall extend back to that wireway. Ventilation openings, when provided, shall not exceed a maximum diameter of ⅜". A slot in the isolating barrier provided for the load conductors supplied from the test-bypass blocks shall be a maximum of 1-½" in depth and may extend to the width of the meter disconnect devices. The slot may not be located in the front 6" of the test by-pass compartment insulating barrier.
11. For three-phase, 4-wire, connect 7th jaw to neutral terminal with a white No. 12 copper wire.
12. For three-phase, 4-wire, delta, identify right hand test-bypass block (2 poles) as power leg, orange in color (C phase).
13. For single-phase, 3-wire, omit center test-bypass block.
14. For single-phase, 3-wire, 208Y/120 volts, omit center test-bypass block. Connect 5th jaw to neutral terminal with a white No. 12 copper wire.
15. All securing screws shall be captive. All panels and covers shall be sealable.
16. Each line and load position shall be clearly identified by ¾" MINIMUM block letter labeling.
- ⑪ See page SG 504.1 for meter mounting heights.
18. Enclosures must allow a minimum of 11" to a maximum of 12" from the face of the meter panel to the inside of the door, and 10" measured from the vertical centerline of the socket to any side obstruction including the door-jamb or flange. This 10" side clearance extends a minimum of 3' from the face of the meter panel. See pages SG 509.1 – 509.4 for meter cabinet details and SG 517.6 – 517.7 for outdoor/raintight enclosure details.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------


SHEET
11 OF 20

SDG&E SERVICE STANDARDS & GUIDE

STANDARD SWITCHBOARD SERVICE SECTIONS

SG 517.11

Standard Switchboard Service Section, 0 – 600 Volts
Instrument Transformer Compartment
201 – 400 Amps Single-Phase Service

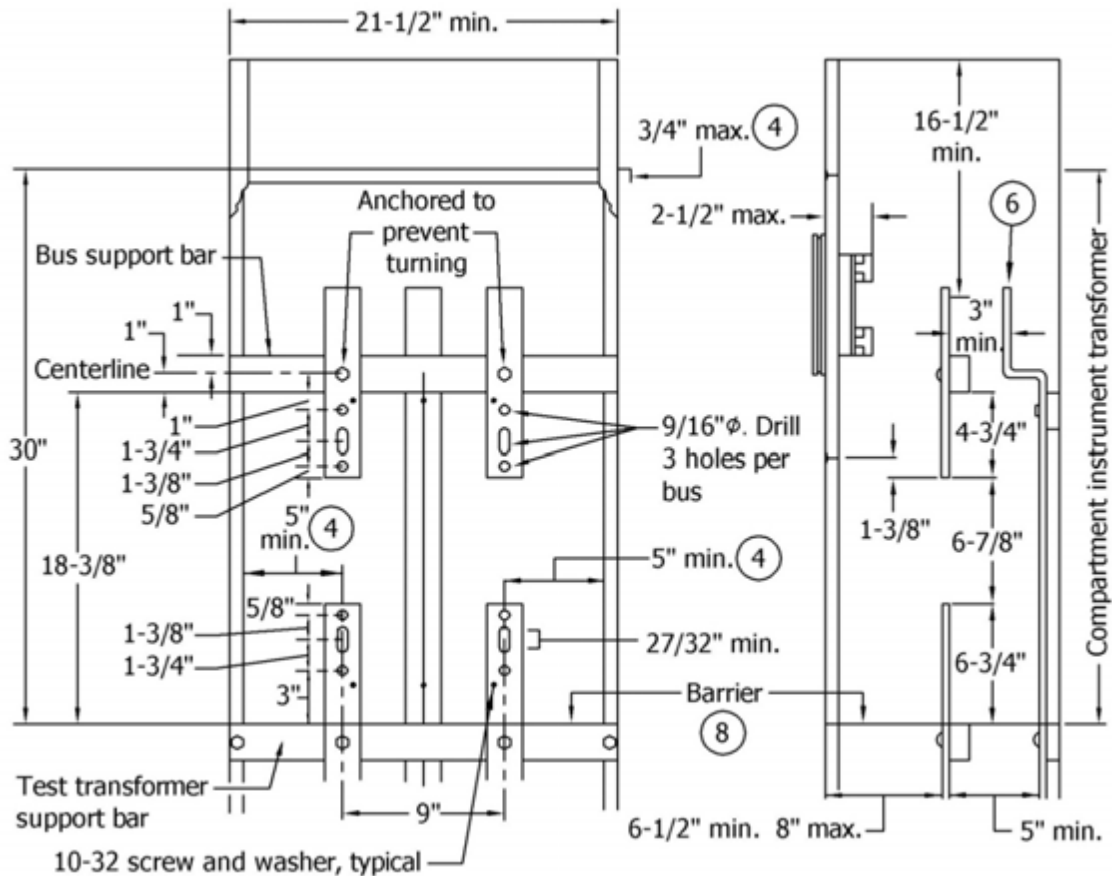

Notes:

1. Bus arrangement and supports are required as shown above, except that neutral may be located on the side wall or at either side.
2. Compartment shall be on the supply side of the main switch or breaker.
3. Direction of feed may be from top or bottom. No other conductors shall pass through this compartment.
- ④ Return flanges for lower and upper meter panel support shall not project more than $\frac{3}{4}$ " up or down from adjacent switchboard panels.
5. When main switch is over 400 amps and for all underground services, see pages SG 708.1 – 708.2 and consult the Utility's Planner. See page SG 2 for contact information.
- ⑥ When a laminated bus is used, there shall be no space between laminations in the compartment.
7. Bus dimensions: Maximum - $\frac{3}{4}$ " x 2"; Minimum - $\frac{1}{4}$ " x 2".
- ⑧ The barrier shall be of insulating material and have a minimum of 24 vent holes of $\frac{3}{8}$ " diameter.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed


SHEET
12 OF 20

SDG&E SERVICE STANDARDS & GUIDE

STANDARD SWITCHBOARD SERVICE SECTIONS

SG 517.12

**Standard Switchboard Service Section, 0 – 600 Volts
Instrument Transformer Compartment
201 – 1,000 Amps, Three-Phase, 3 & 4-Wire Services**

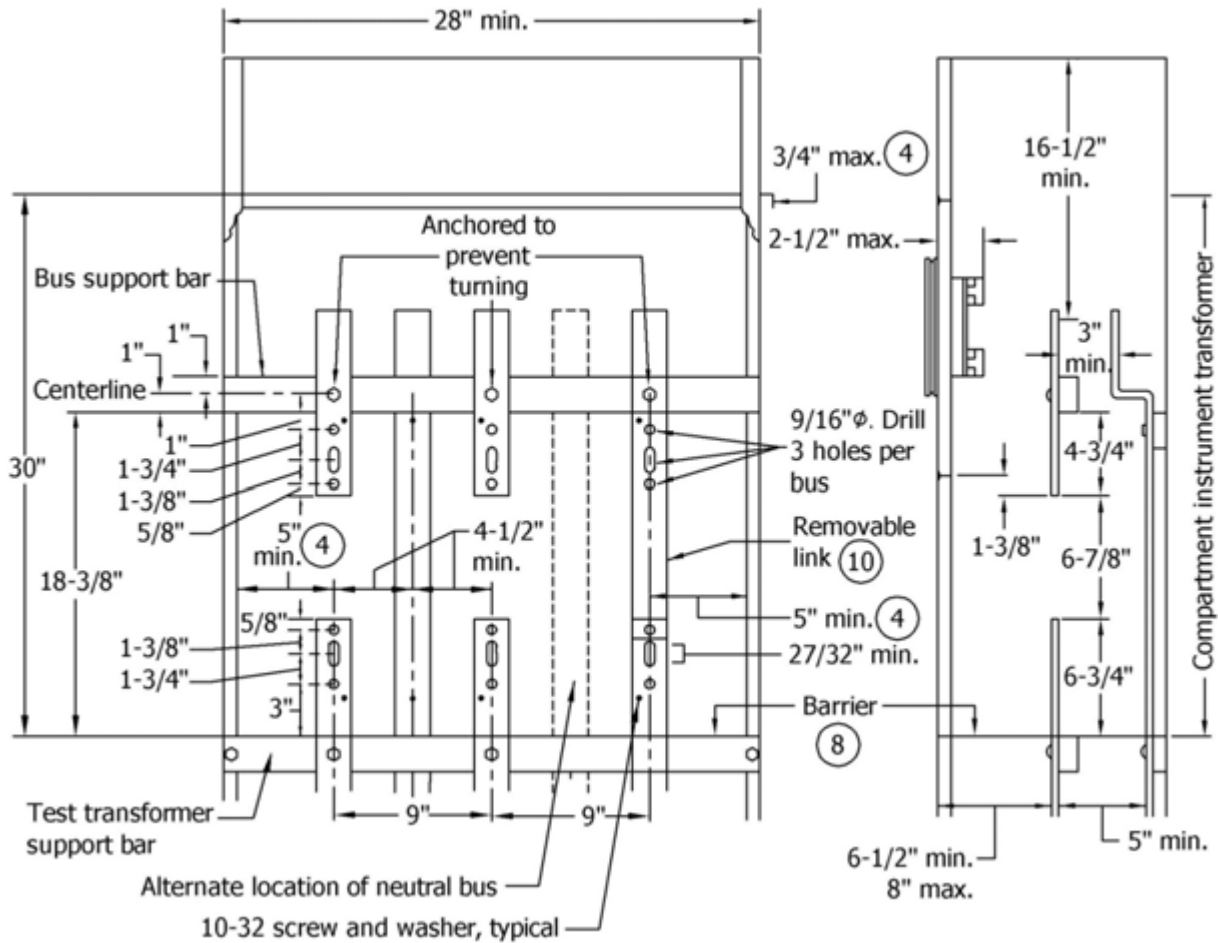

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
13 OF 20

SDG&E SERVICE STANDARDS & GUIDE

STANDARD SWITCHBOARD SERVICE SECTIONS

SG 517.13

Notes:

1. Bus arrangement and supports are required as shown above, except that the neutral may be located on the side wall or at either side.
2. The compartment shall be on the supply side of the main switch or breaker.
3. The direction of feed may be from the top or bottom. No other conductors shall pass through this compartment. A neutral bus bar extension shall be provided in the instrument transformer compartment above the lower CT bus support when the service section phase busses are supplied from horizontal cross bussing.
- ④ Return flanges for lower and upper meter panel support shall not project more than ¾" up or down from adjacent switchboard panels.
5. When main switch is over 400 amps and for all underground services, see pages SG 708.1 – 708.2 and consult the Utility's Planner. See page SG 2 for contact information.
6. When laminated bus is used, there shall be no space between laminations in the compartment.
7. Bus dimensions: Maximum - ¾" x 2"; Minimum - ¼" X 2".
- ⑧ The barrier shall be of insulating material and have a minimum of 24 vent holes of ⅜" diameter.
9. The power leg (high leg) for a four-wire delta service shall be identified by an outer finish that is orange in color or by tagging or by other effective means acceptable to the Utility and the AHJ on the right of C Phase.
- ⑩ A removable link shall be installed in the right side phase bus.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X	Indicates Latest Revision	Completely Revised	New Page	Information Removed
----------	---------------------------	--------------------	----------	---------------------



SHEET
14 OF 20

SDG&E SERVICE STANDARDS & GUIDE

STANDARD SWITCHBOARD SERVICE SECTIONS

SG 517.14

**Standard Switchboard Service Section, 0 – 600 Volts
Instrument Transformer Compartment
1,001 – 3,000 Amps, Three-Phase, 3 & 4-Wire Services**

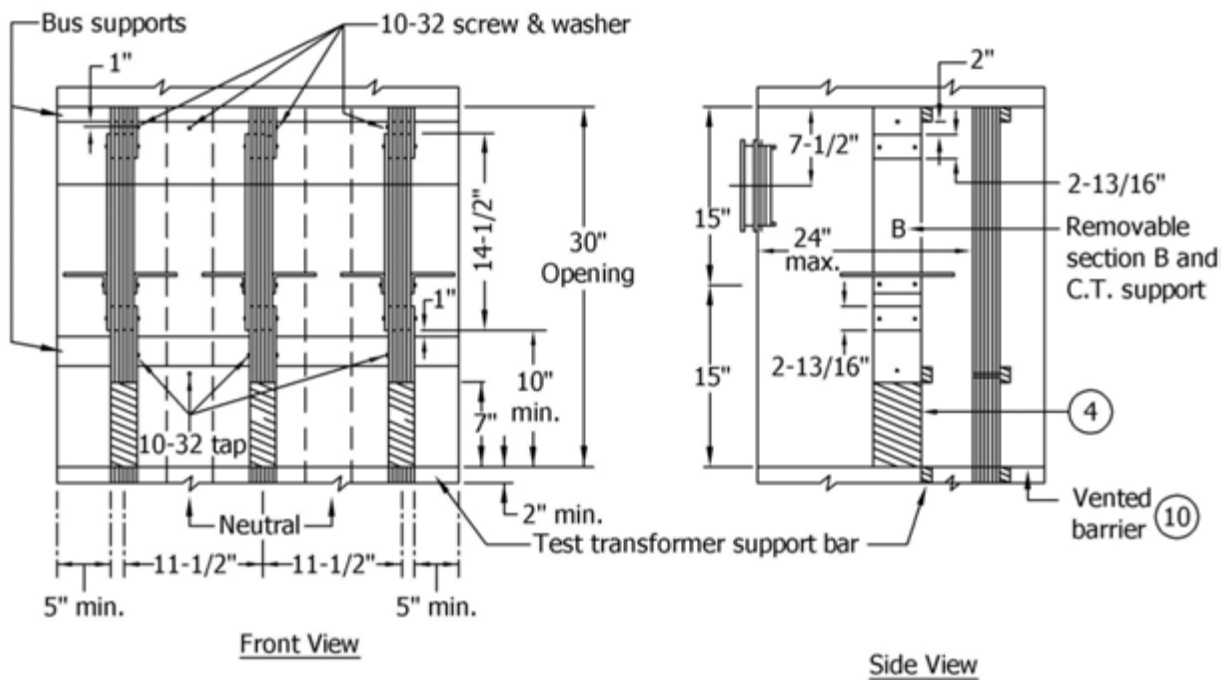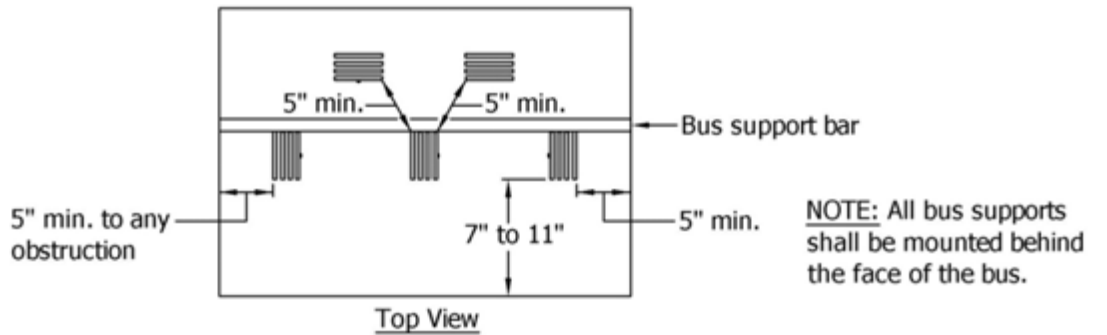

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
15 OF 20

SDG&E SERVICE STANDARDS & GUIDE

STANDARD SWITCHBOARD SERVICE SECTIONS

SG 517.15

Notes:

1. The bus anchorage shall be such that busses will remain in position when removable section "B" is out.
2. The direction of feed may be from the top or bottom. No other conductors shall pass through this compartment.
3. The instrument transformer compartment shall be on the supply side of the main switch or breaker.
- ④ Round bus corners as necessary to prevent damage to insulation. Bus insulation to be adequate for the voltage involved.
5. For underground services installed by the Utility, the busses shall extend into the UGPS per pages SG 708.1 – 708.2. Consult the Utility's Planner. See page SG 2 for contact information.
6. The maximum permissible bus unit shall consist of four ¼" X 4" bars spaced ¼".
7. The barrier should not be less than 45" and shall not be more than 50" above the standing surface.
8. Clearance to the side of the compartment shall be increased by the amount by which the corner angle exceeds 1".
9. Return flanges for lower and upper meter panel support shall not project more than ¾" up or down from adjacent switchboard panels.
- ⑩ The barrier shall be of insulating material and have a minimum of 24 vent holes of ⅜" diameter.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed


SHEET
16 OF 20

SDG&E SERVICE STANDARDS & GUIDE

STANDARD SWITCHBOARD SERVICE SECTIONS

SG 517.16

Standard Switchboard Service Section, 0 – 600 Volts
1,001 – 3,000 Amps Removable Link & Current-Transformer Support for
Instrument Transformer Compartments with 4" Bus

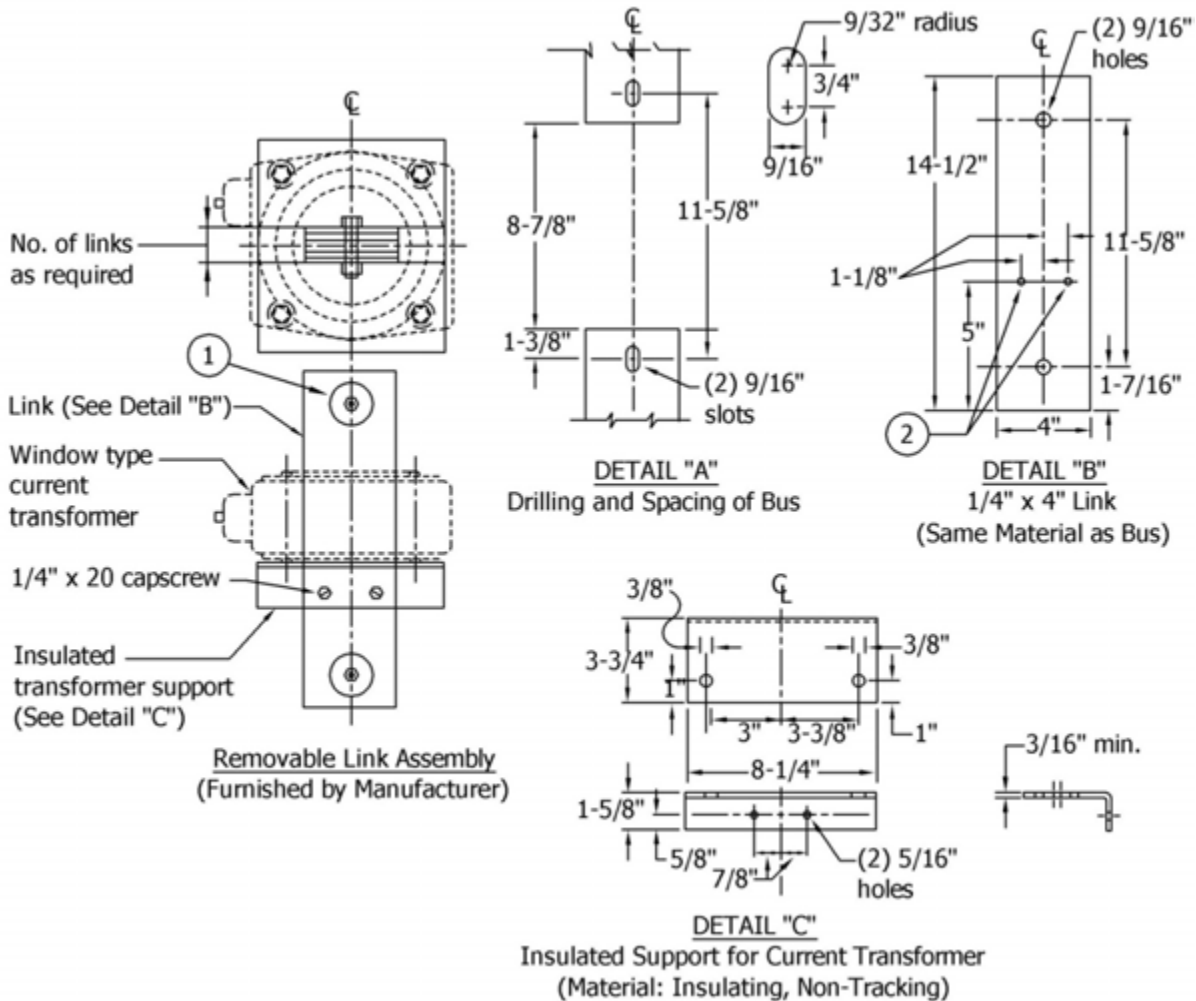

Notes:

- ① The manufacturer shall secure the removable bus link to the upper and lower CT bus units using 1/2" hex-head steel bolts, nuts (as shown) with a spring washer and a nut. The spring washer may be either a cone-type (Belleville) or a split ring washer with a flat washer. Bolts shall be grade 5 (min.), and long enough to extend a minimum of 1/2" beyond the nut. Washers (Belleville or flat) shall be 2- 1/4" (min.).
- ② Drill and tap two holes as shown on the outer units for 1/4" x 20 capscrows.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed


SHEET
17 OF 20

SDG&E SERVICE STANDARDS & GUIDE

STANDARD SWITCHBOARD SERVICE SECTIONS

SG 517.17

**Standard Switchboard Service Section, 0 – 600 Volts
Instrument Transformer Compartment
3,001 – 4,000 Amps, Three-Phase, 3 & 4-Wire Services**

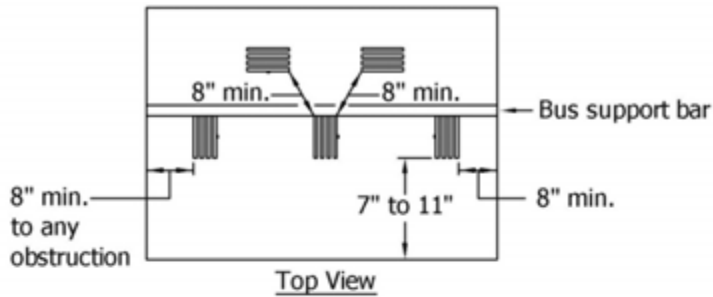

Maximum number of bus bars:



4-1/4" x 4" spaced 1/4"

6-1/4" x 5" spaced 1/4"

4-3/8" x 5" spaced 3/8"

5-3/8" x 5" spaced 1/4"

NOTE: All bus supports shall be mounted behind the face of the bus.

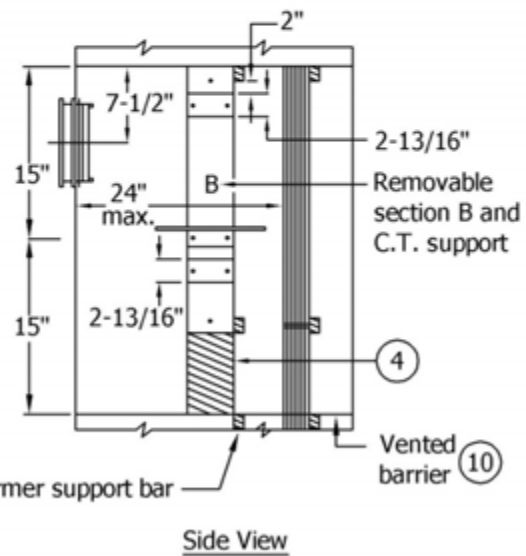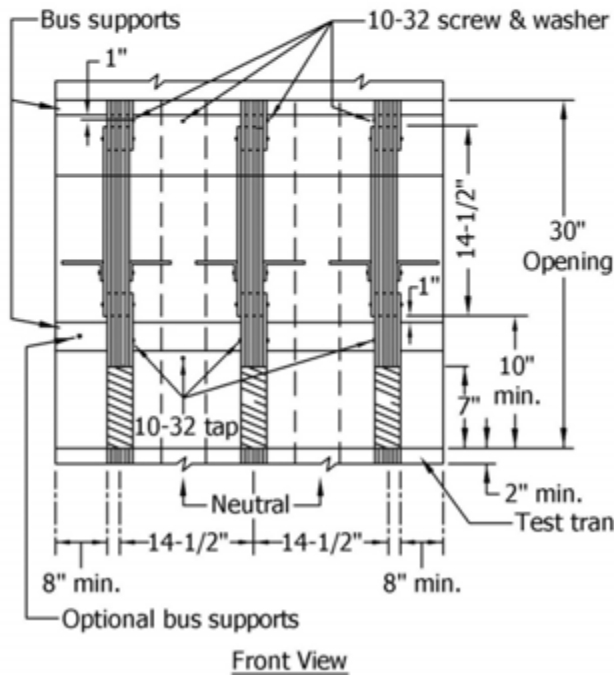

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
18 OF 20

SDG&E SERVICE STANDARDS & GUIDE

STANDARD SWITCHBOARD SERVICE SECTIONS

SG 517.18

Notes:

1. The bus anchorage shall be such that busses will remain in position when removable section "B" is out.
2. The direction of feed may be from the top or bottom. No other conductors shall pass through this compartment.
3. The instrument transformer compartment shall be on the supply side of the main switch or breaker.
- ④ Round bus corners as necessary to prevent damage to insulation. Bus insulation to be adequate for the voltage involved.
5. For underground services installed by the Utility, the busses shall extend into the UGPS per pages SG 708.1 – 708.2. Consult the Utility's Planner. See page SG 2 for contact information.
6. The maximum permissible bus unit shall consist of six ¼" X 5" bars spaced ¼".
7. The barrier should not be less than 45" and shall not be more than 50" above the standing surface.
8. Clearance to the side of the compartment shall be increased by the amount by which the corner angle exceeds 1".
9. Return flanges for lower and upper meter panel support shall not project more than ¾" up or down from adjacent switchboard panels.
- ⑩ Barrier shall be of insulating material and have minimum of 40 vent holes of ⅜" diameter.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed


SHEET
19 OF 20

SDG&E SERVICE STANDARDS & GUIDE

STANDARD SWITCHBOARD SERVICE SECTIONS

SG 517.19

Standard Switchboard Service Section, 0-600 Volts
3,001 Amps & Larger Removable Link & Current-Transformer Support for
Instrument Transformer Compartments with 5" Bus

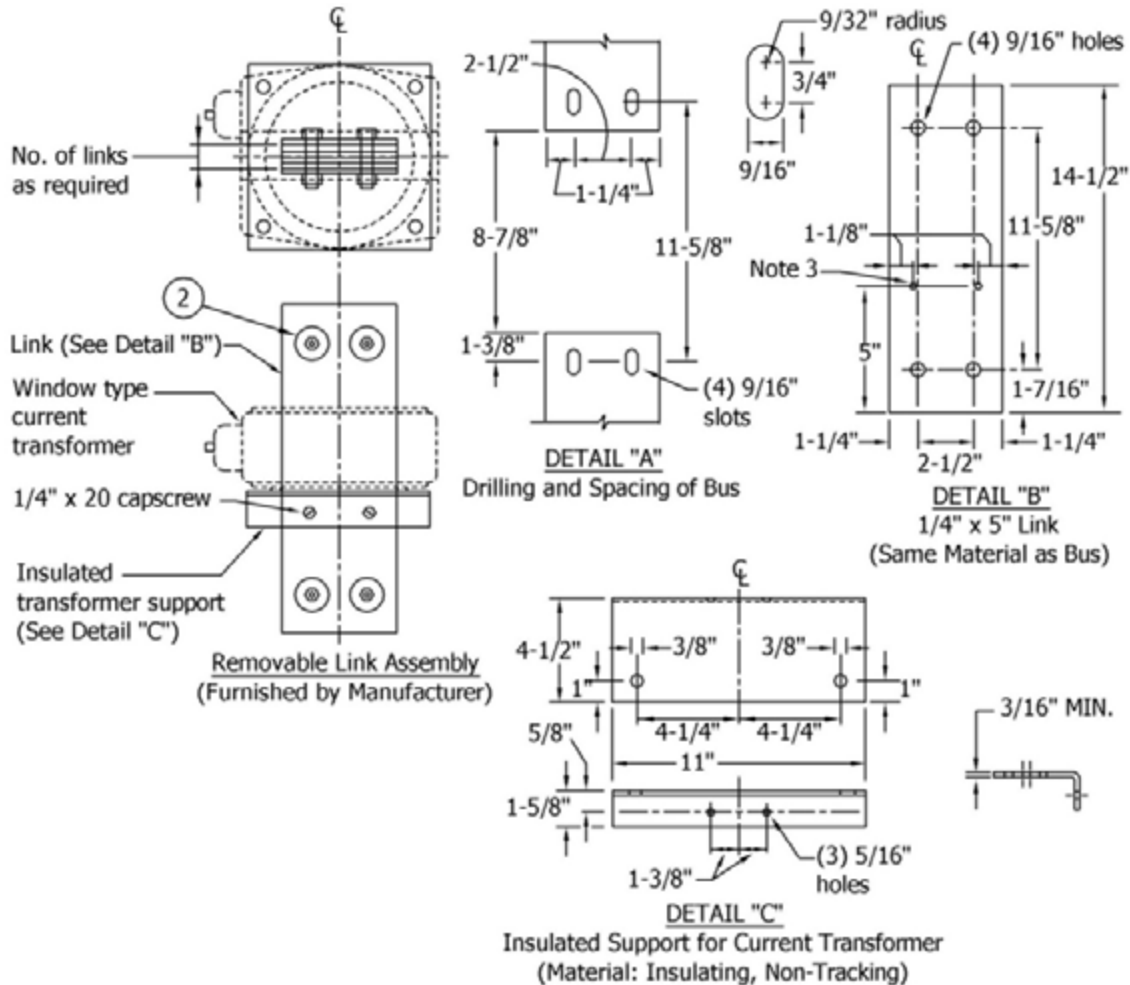

Notes:

1. The manufacturer shall secure the removable bus link to the upper and lower CT bus units using 1/2" hex-head steel bolts, nuts (as shown) with a spring washer and a nut. The spring washer may be either a cone-type (Belleville) or a split ring washer with a flat washer. Bolts shall be grade 5 (min.), and long enough to extend a minimum of 1/2" beyond the nut. Washers (Belleville or flat) shall be 2-1/4" (min.).
2. Drill and tap two holes as shown on the outer units for 1/4" x 20 capscrews.
3. Consult the Utility for the use of bus bars larger than 5".

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
20 OF 20

SDG&E SERVICE STANDARDS & GUIDE

STANDARD SWITCHBOARD SERVICE SECTIONS

SG 517.20

ELECTRIC SERVICE REQUIREMENTS FOR MOBILE HOME PARKS

Underground electric service to a mobile home lot is to be installed along the shortest, most practical route from the SDG&E (Utility) source to the nearest meter and service location acceptable to the Utility.

This location may be:

1. On a permanently installed structure located near the lot line of the mobile home lot closest to the Utility's source.
2. A Utility-approved meter post/pedestal located at or near the closest corner of the mobile home lot to the Utility's source.
3. In accordance with Title 25, Article 7, Sections 1322, 1333 and 1333.5, mobile homes, manufactured homes, or commercial coaches, installed on foundation systems are permitted to be served by the Utility in a manner applicable to buildings. The location of the meter and service equipment will be determined by the Utility's Planner.
4. Each mobile home park space/unit constructed after January 1, 1997, must be individually served by the Utility.
5. Public Utilities Code Sections 2791 through 2799 is a result of Assembly Bill 622 and outlines the process whereby the owner of a mobile home park may transfer ownership of the park's distribution system to the Utility. Contact the Project Management Regional Office nearest to the mobile home park location and request information for transfer of ownership to the Utility. See page SG 2 for a listing of the Regional Offices.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X	Indicates Latest Revision	Completely Revised	New Page	Information Removed
----------	---------------------------	--------------------	----------	---------------------

SHEET
1 OF 3


SDG&E SERVICE STANDARDS & GUIDE

**MOBILE HOME PARK SERVICE
& METER PEDESTALS**

SG 518.1

Typical Underground Service & Meter Post/Pedestal

This standard applies to single-family or mobile home residential services rated 100 amps minimum, 225 amps maximum, single-phase, 120/208 volts or 120/240 volts.

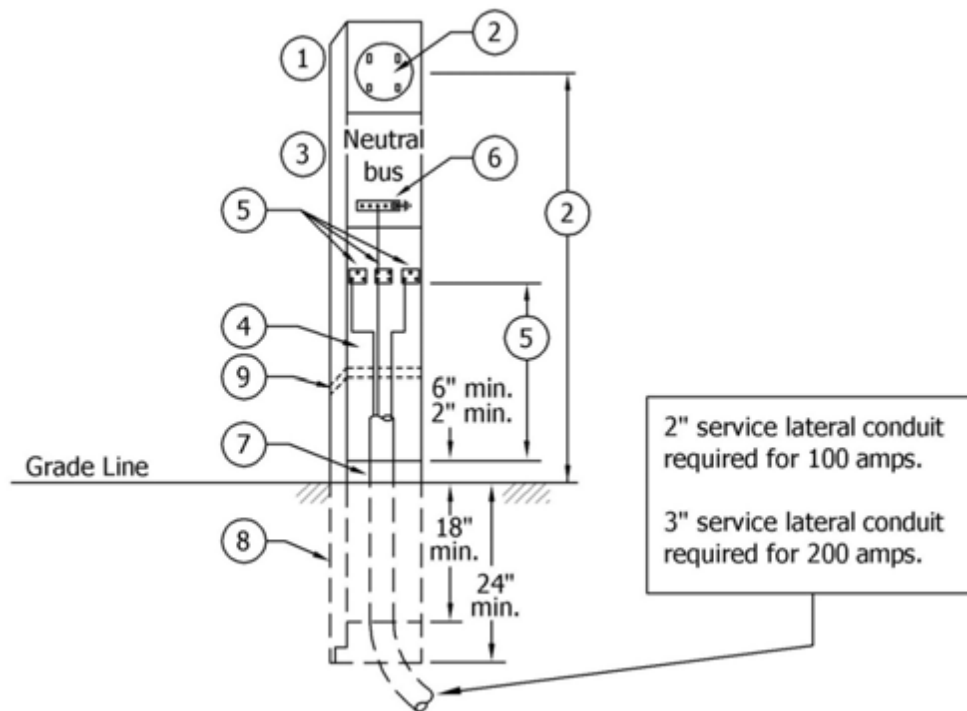

Notes:

- ① The service and metering equipment shall be tested, listed and labeled by a nationally recognized testing laboratory. This service and metering equipment shall be installed per the manufacturer's installation instructions and Utility standards. An electrical inspection clearance from the governmental Authority Having Jurisdiction (AHJ) must be given to the Utility before service can be established and a meter set.
- ② The meter socket shall be provided with a sealing ring. The meter socket shall be mounted on a support and attached to the meter panel. The socket shall be factory-wired with the conductors in a separate or barriered raceway from the service terminating lugs to the meter socket. These conductors shall be inaccessible from the main disconnect and power outlet section. The conductors which extend to the meter socket shall be connected at the service terminating lugs independently of the connection for the service lateral conductors. The minimum meter height is 36" above grade line when the meter is enclosed, or 48" minimum if exposed. Meter panels shall be removable, but shall be non-removable when the meter is in place. If the meter is enclosed, the enclosing cover shall be hinged and self-supporting, equipped with a reading window, and be removable for meter testing or inspection.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
2 OF 3

SDG&E SERVICE STANDARDS & GUIDE

MOBILE HOME PARK SERVICE & METER PEDESTALS

SG 518.2

- ③ The service main disconnect and power outlet section shall have barriers installed to prevent access to the service cable pull and terminating section and to unmetered conductors which connect to the socket.
- ④ The service cable pull and terminating section shall be covered with a sealable and removable panel or panels, extending from 2" to 6" above grade, and when removed, give full access to the service terminating lugs. Access to the service terminating lugs may be either the front or the rear of the pedestal. Access shall be unrestricted by load conduits or raceways.
- ⑤ A minimum 12" opening shall be maintained from the terminating lugs to any fixed panel below the lugs. The minimum lug height is 17" above grade line, the maximum is 48". The service terminating lugs shall be No. 2 to 250 kCMIL aluminum bodied pressure type for connection of the service lateral conductors. A single terminating lug per phase and neutral is preferred. If two terminating lugs are provided per phase, the Utility requires one of the lug's set screw to be removed and the hole to be filled with a compound acceptable to the manufacturer. This requirement is necessary to avoid energy diversion. The space between terminating lugs, from lugs to sides of post, or from lugs to panel above, shall be 1-1/2" minimum. Rigid insulating barriers are required and shall project 1/4" minimum beyond any energized parts when this space is reduced. Terminating lugs may be positioned either in-line or staggered, and access shall be unobstructed when all service conductors are in place. The neutral terminating lug shall be bonded to the post/pedestal.
- ⑥ An acceptable grounding terminal shall be provided to accommodate the range of grounding conductor sizing as specified by California Electrical Code for the size of the service equipment.
- ⑦ The post/pedestal shall have a minimum cross sectional dimension of 4" x 8" ID. A fixed panel shall extend 2" minimum and 6" maximum above grade and 18" minimum below grade.
- ⑧ The minimum depth of the post/pedestal in the ground shall be 24" with openings at the base to permit the service lateral conduit to enter into the post/pedestal without cutting the 24" minimum radius bend.
- ⑨ A moisture barrier, located below all terminals and other live parts, or adequate ventilation, shall be provided to inhibit the condensation of moisture.

10. For authorization to attach telephone and cable TV terminating facilities, consult the Utility.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------

SHEET
3 OF 3

SDG&E SERVICE STANDARDS & GUIDE

**MOBILE HOME PARK SERVICE
& METER PEDESTALS**

SG 518.3

Commercial Meter Pedestals, 0 – 200 Amps

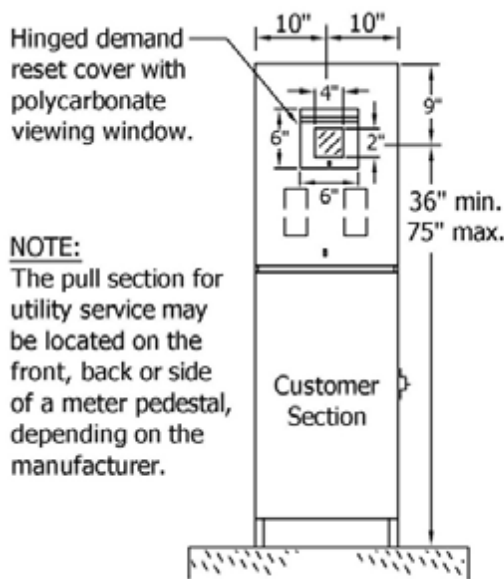


FIGURE 1
Front View (Single)

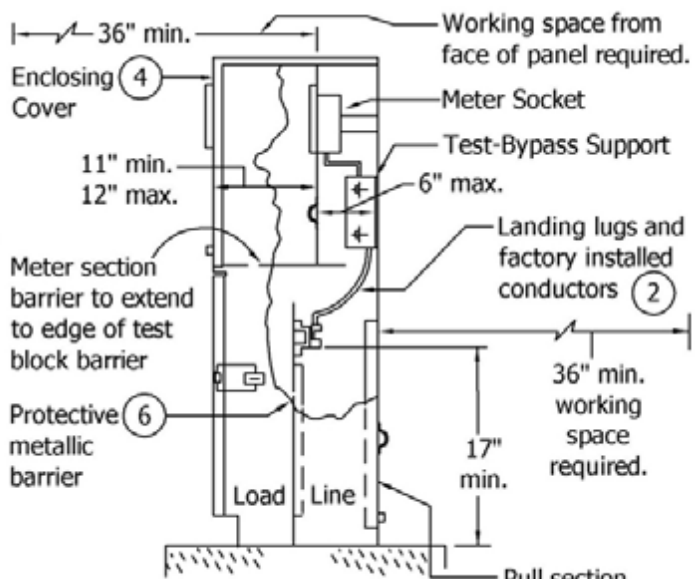


FIGURE 2
Side View (Typical)
Pull section and cover. See (1) & (2)

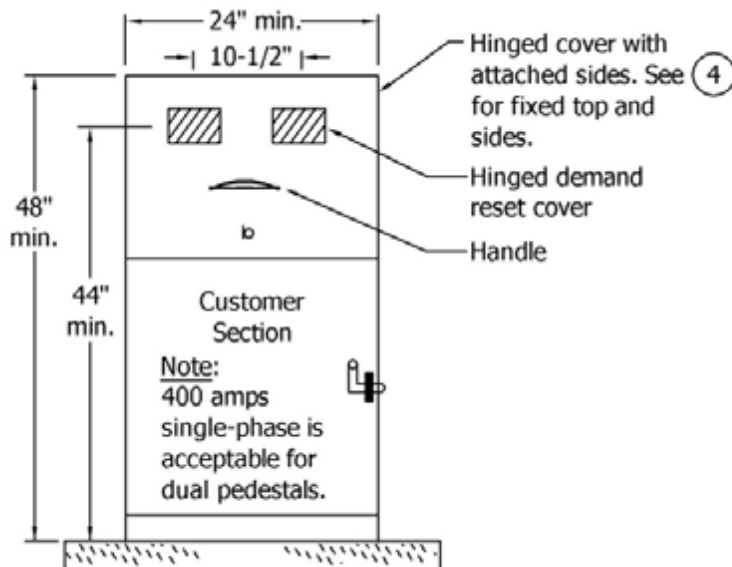


FIGURE 3
Front View (Dual)

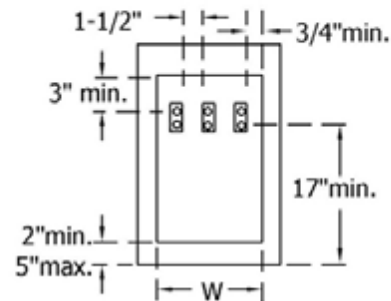


Table 1 - Min. Dimensions

Service	W
1 Phase	10-1/2"
3 Phase	12-1/2"

FIGURE 4
Utility Termination Section

Refer to page SG 519.5 for Meter Pedestal Foundation Details.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 5

SDG&E SERVICE STANDARDS & GUIDE

COMMERCIAL METER PEDESTALS

SG 519.1

Notes:


- ① Utility termination section shall be dimensioned as shown in Figure 4. These dimensions are the minimum access openings allowed for these types of termination sections. The depth of the wireway shall accept a minimum 3" conduit, and the cover shall be equipped with a lifting handle.
- ② Service conductors are to terminate on landing lugs. The service termination lugs shall be No. 6 through No. 250 kCMIL pressure-type, CU-AL listed. Insulated cable or bus shall be installed between the landing lugs and the test-bypass facilities.
3. Pedestals serving both metered and unmetered loads, i.e. traffic signals and street lighting, must have landing lugs, with customer wire from lugs to test blocks (if not bussed) to serve metered loads and from lugs to breakers to serve unmetered loads.
- ④ The meter shall be enclosed and the enclosing cover shall be hinged to allow the top, front and sides to rotate back exposing the metering compartment in order to provide clearances.
5. Internal equipment attached to the outer walls of the enclosure shall be secured in place with devices that may not be loosened from the outside. Screws or bolts requiring special tools for installation or removal are not acceptable.
- ⑥ A protective metallic barrier (16-gauge minimum) shall be installed between the Utility termination section and the customer distribution section. There shall be a ¼" minimum clearance between the customer section and protective barrier to prevent screws and bolts from protruding into the termination section.
7. Test-bypass blocks with rigid insulating barrier shall be furnished, installed and wired or bussed to the meter socket by the manufacturer. Connection sequence is LINE-LOAD from left to right. Each line and load position shall be clearly identified by ¾" minimum block letter labeling. Test-bypass cover panels shall be sealable and fitted with a lifting handle. All panels exceeding 16" in width shall require two lifting handles.
8. All Utility compartments [meter cover, demand reset cover and Underground Pull Section (UGPS)] shall be sealable and padlockable.
9. For identification purposes, the numeric portion of the address must be painted with weatherproof paint or reflective decals on the exterior face of the portion of the pedestal facing the street or drivable surface in numbers at least 1".
10. Plastic pads are acceptable, provided the supporting pull box is filled with gravel or earth compacted to a minimum of 90%. For other structural mounting and support of the pedestal, consult with the SDG&E Trench Inspector.
11. Residential type pedestals are not acceptable for temporary construction power for any type of premises. To serve temporary power, a meter pedestal with test-bypasses, or a properly mounted safety socket can is required. Reference page SG 514.5, Figure 1.
12. Photoelectric cells are not permitted in the Utility area, i.e. UGPS/meter section.
13. SDG&E will no longer supply two-wire, 120-volt service or metering to pedestals. Single-phase service will be three-wire regardless of the voltage, i.e. 120/208 volts, 120/240 volts, or 240/480 volts. Reference pages SG 520.1 – 520.2 for field replacement of an existing 120-volt meter pedestal.
14. To maintain a safe, clear and level working space when a housekeeping pad has not been installed, a concrete slab acceptable to the SDG&E Inspector is required. This requirement is for pedestals on private property and does not apply to pedestals installed in parkway areas of the street where there is a sidewalk.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 5	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 519.2
	SDG&E SERVICE STANDARDS & GUIDE					
	COMMERCIAL METER PEDESTALS					

Commercial Meter Pedestals, 600 Amps Maximum

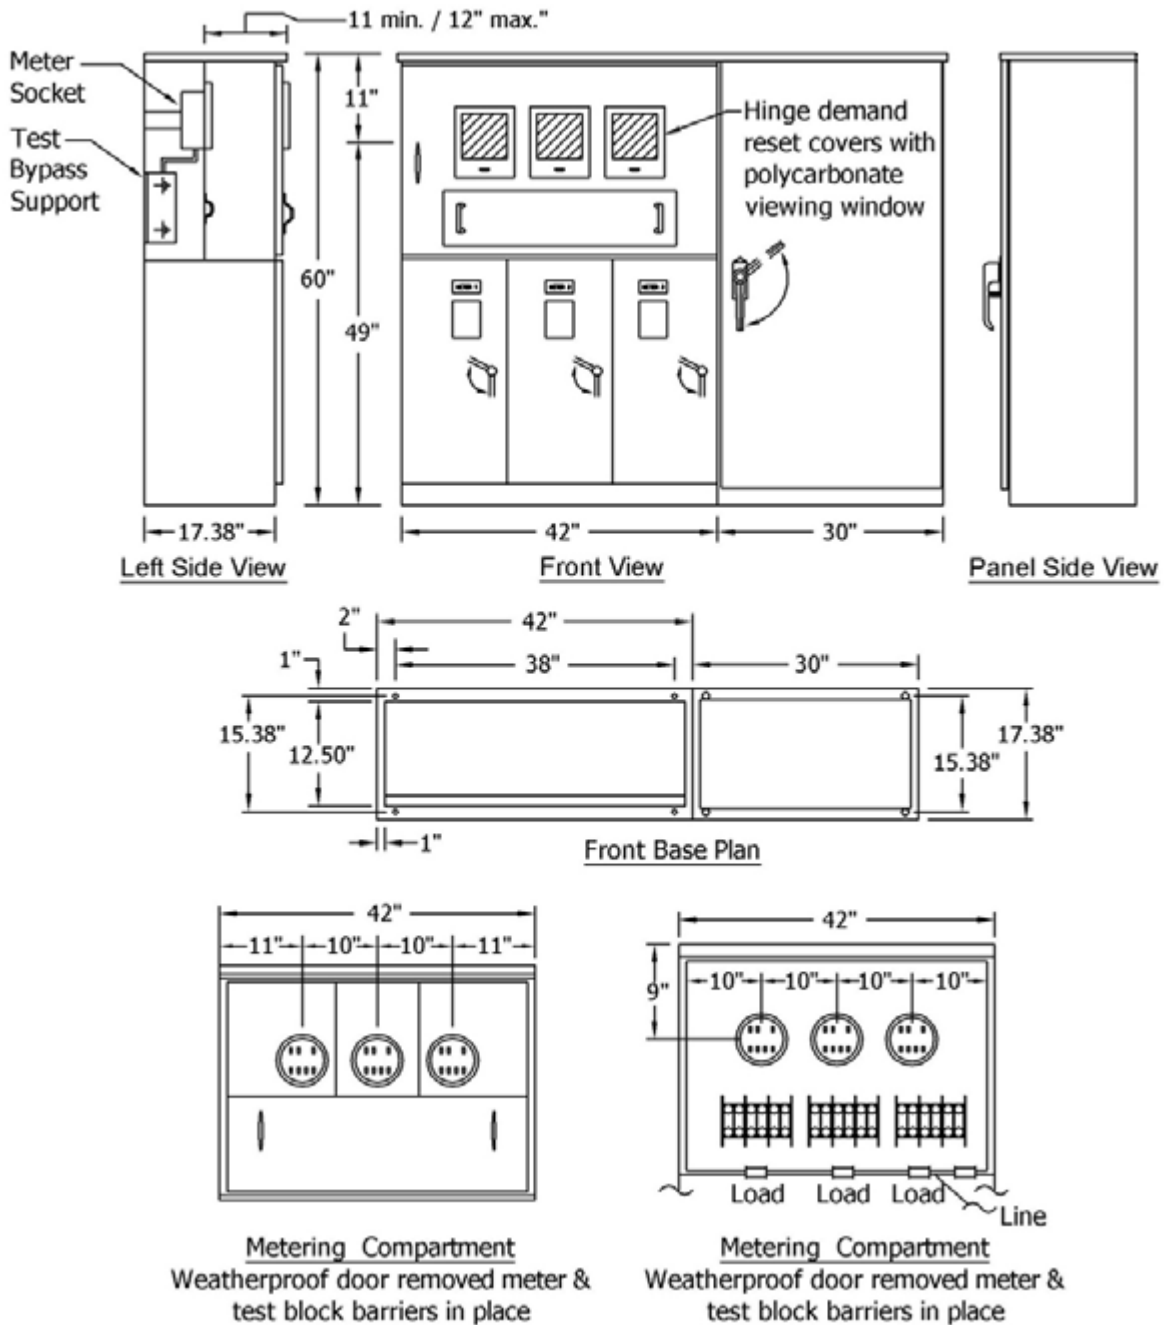

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
3 OF 5

SDG&E SERVICE STANDARDS & GUIDE
COMMERCIAL METER PEDESTALS

SG 519.3

Notes:

1. Commercial meter pedestals rated 401 – 600 amps require three-phase, 4-wire service. Single-phase service is not available for commercial applications 401 amps, and larger.
2. This equipment is designed for a maximum of three meter sockets.
3. Terminating facilities for the Utility's service lateral conductors shall be aluminum-bodied mechanical lugs with a range accepting a No. 4 AWG through No. 500 kCMIL conductor. Two lugs per phase shall be provided for terminations rated 401 – 600 amps in this meter pedestal application.
4. Internal equipment attached to the outer walls of the enclosure shall be secured in place with devices that may not be loosened from the outside. Screws or bolts requiring special tools for installation or removal are not acceptable.
5. A protective metallic barrier (16-gauge minimum) shall be installed between the Utility termination section and the customer distribution section.
6. Test-bypass blocks with rigid insulating barrier shall be furnished, installed and wired or bussed to the meter socket by the manufacturer. Connection sequence is LINE-LOAD from left to right. Each line and load position shall be clearly identified by ¾" minimum block letter labeling. Test-bypass cover panels shall be sealable and fitted with a lifting handle. All panels exceeding 16" in width shall require two lifting handles.
7. All Utility compartments (meter cover, demand reset cover and UGPS) shall be sealable and padlockable.
8. For identification purposes, the numeric portion of the addresses must be painted with weatherproof paint or reflective decals on the exterior face of the portion of the pedestal facing the street or drivable surface in numbers at least 1" high.
9. Photoelectric cells are not permitted in the Utility area, i.e. UGPS/meter section.
10. When service equipment is installed on a "housekeeping pad", that pad must be level and extend a minimum of 3' measured from the face of the meter panel, or a minimum of 6' when 5" conduit is required. See Figures 3 and 4 on page SG 517.6 as they also apply to this installation. If the enclosure doors are wider than 3', the housekeeping pad shall extend 1" beyond the outer edge of the equipment doors when opened at 90 degrees.
11. See pages SG 504.4 – 504.5 for working space and clearance requirements, 0 – 600 volts.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X	Indicates Latest Revision	Completely Revised	New Page	Information Removed
----------	---------------------------	--------------------	----------	---------------------

SHEET
4 OF 5

SDG&E SERVICE STANDARDS & GUIDE

COMMERCIAL METER PEDESTALS

SG 519.4

Meter Pedestal Foundation Details

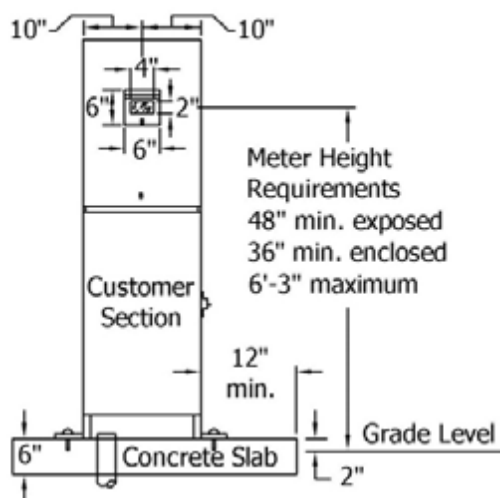


FIGURE 1
Pedestal on slab front view

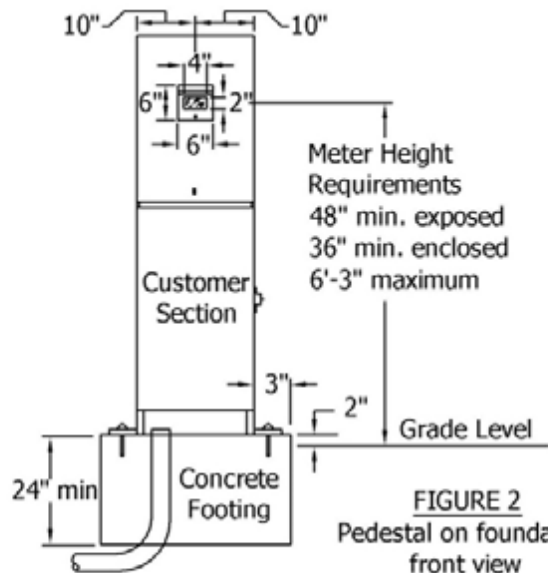


FIGURE 2
Pedestal on foundation front view

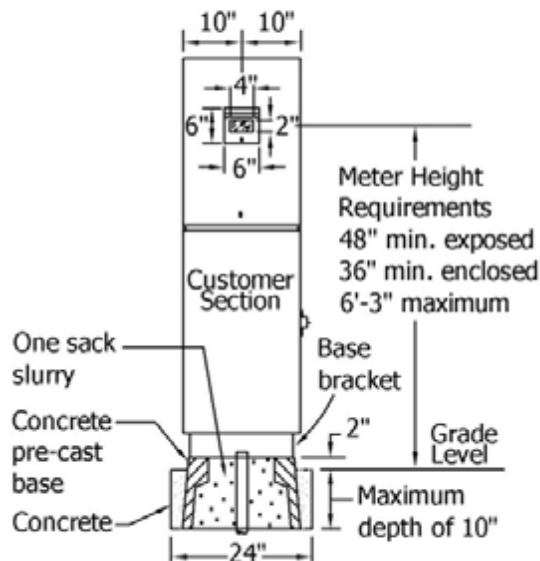


FIGURE 3
Pedestal on pre-cast base front view

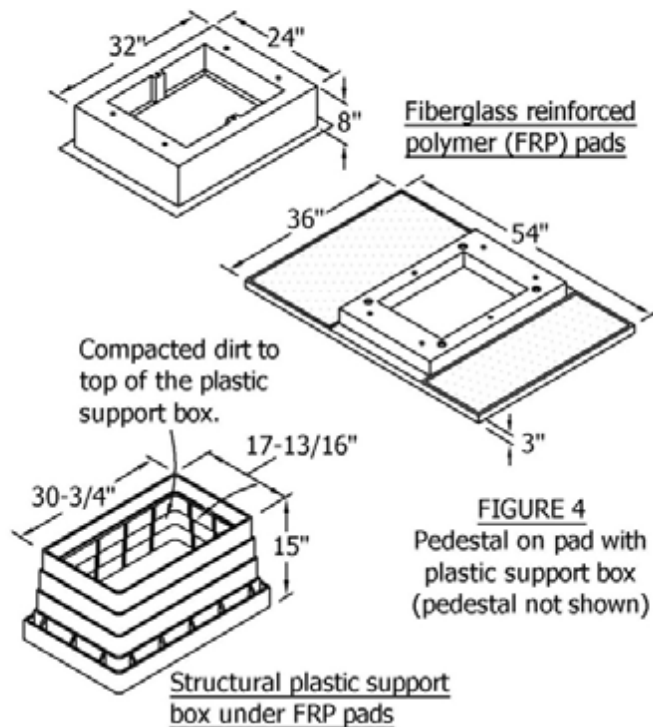


FIGURE 4
Pedestal on pad with plastic support box (pedestal not shown)

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
5 OF 5

SDG&E SERVICE STANDARDS & GUIDE

COMMERCIAL METER PEDESTALS

SG 519.5

SCOPE: This standard applies to residential service only. The replacement option is not available for non-residential applications in which case a new single-phase 3-wire, 120/240 volt commercial pedestal is required. Refer to Commercial Meter Pedestals on pages SG 519.1 – 519.5.


GENERAL INFORMATION

SDG&E (Utility) Planner approval is required in advance of replacing an existing 120-volt, single-phase, 2-wire meter pedestal.

The replacement pedestal shall be listed as equipment suitable for use as service equipment and meet all requirements of the governmental Authority Having Jurisdiction (AHJ) and Utility. The total ampacity of the breakers is not to exceed 30 amps, with no more than 2 breakers.

METER PEDESTAL

The following is an illustration of the pedestal and a list of materials for a normal meter pedestal replacement. This is not intended to be all inclusive but provides the most common requirements.

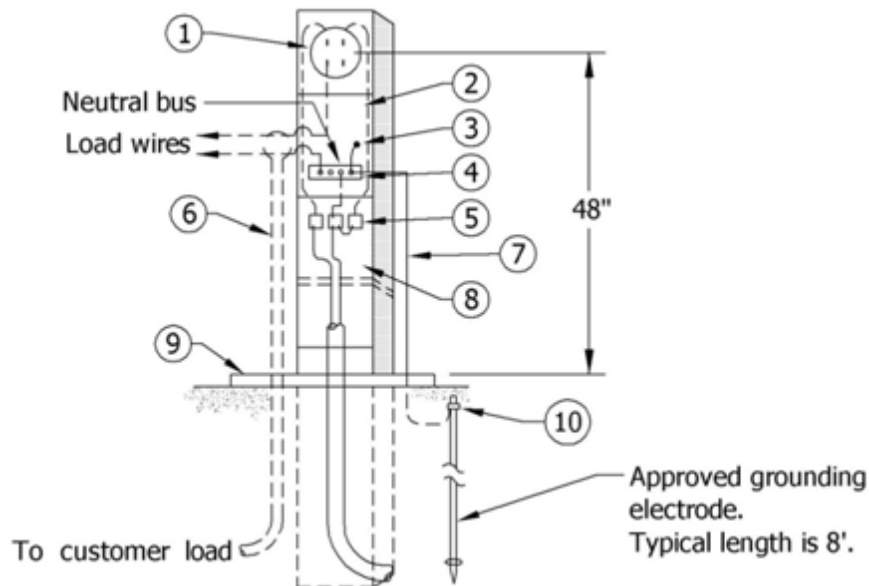

Notes:

- ① The meter socket, breaker compartment and Underground Pull Section (UGPS) must be raintight equipment. Meter socket jaws or clips shall be free of foreign material (mud, paint, plaster, etc.). **RINGLESS METER SOCKETS ARE NOT ACCEPTABLE.** The socket shall have a minimum rating of 100 amps and be factory-wired with the conductors in a separate or barriered wireway from the service termination lugs to the meter socket. The conductors which extend to the meter shall be connected at the service termination lugs independent of the connections for the service lateral conductors. The minimum meter height shall be 48", measured from the standing surface to centerline of meter socket. If the meter is enclosed, the minimum height may be reduced to 36".

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 2	X Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 520.1
	SDG&E SERVICE STANDARDS & GUIDE				
	FIELD REPLACEMENT OF EXISTING 120-VOLT METER PEDESTAL				

- ② Breaker compartment. The pedestal shall have a minimum 10,000 amp withstand rating and the breaker(s) shall have a minimum 10,000 amp Ampere Interrupting Capacity (AIC) rating.
 - ③ Pedestal bond lug. (May be a band screw in some models.)
 - ④ Customer's neutral landing block.
 - ⑤ A minimum 12" opening shall be maintained from the terminating lugs to any fixed panel below the lugs. The minimum lug height is 17" above grade line, the maximum is 48". The service terminating lugs shall be No. 8 to No. 2 aluminum-bodied pressure type for connection of the service lateral conductors.
 - ⑥ Load conductors shall not be run through the Utility's UGPS.
 - ⑦ The ground wire (No. 4 bare copper) shall be continuous from the neutral landing block in the breaker compartment to a grounding electrode system in compliance with NEC Article 250. The ground wire must be properly supported and attached to the outside of the pedestal at 24" intervals. When attaching the ground wire to the pedestal, the method of attachment shall not result in sharp projections, such as metal screws into the wire way below the neutral landing block. See the illustration on page SG 520.1 for the preferred method of installing the grounding electrode conductor.
 - ⑧ The Utility's UGPS shall be covered with a sealable, removable panel, extending from at least 2" to 6" above the concrete pad, and when removed, allow full access to the service termination lugs. Access to the Utility UGPS shall not be blocked in any manner. No customer wiring or equipment is allowed in this area.
 - ⑨ The pedestal at grade line shall have a minimum cross-sectional dimension of 4" x 8". The fixed panel for the final grade and concrete pour shall extend 2" x 6" above grade and a minimum of 18" below grade. The pedestal shall extend 24" below grade. That portion of the pedestal buried in concrete and earth shall be coated with an approved corrosion-resistant material such as zinc, cadmium or enamel to withstand deterioration. Poured concrete slab shall be 24" x 24" minimum size and have a 3-1/2" minimum thickness. The customer shall be responsible for the final grade of the Utility island and the included meter pedestal.
 - ⑩ The approved ground electrode clamp and conductor shall be buried, flush or somehow protected from physical damage. The clamp shall be listed for underground use. Ground rod shall not be installed in or beneath the concrete slab.
11. The new pedestal installation shall be inspected and approved by the AHJ before the Utility can energize and set the meter.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
2 OF 2

SDG&E SERVICE STANDARDS & GUIDE

**FIELD REPLACEMENT OF EXISTING
120-VOLT METER PEDESTAL**

SG 520.2

GENERAL INFORMATION

This standard establishes the requirements for installing new electric service and metering for wireless communication systems on private property. A communication system includes a communication equipment enclosure and communication antennae.


When an existing meter room or cabinet does not have space remaining to group the new meter panel with the existing, special permission may be granted by the SDG&E Planner and the governmental Authority Having Jurisdiction (AHJ) to locate the new meter panel and meter service disconnect as close as practical to the existing meter location outside the meter room or cabinet.

The following scenarios provide examples of acceptable meter and service locations to communication systems. It is important to note that a structure includes a water tank, light pole and similar types of construction.

SCENARIO I – COMMUNICATION SYSTEM LOCATED IN OR ON A BUILDING

The electric service to the communication system shall be served from the existing building service. The new meter shall be grouped with the existing meter(s) in accordance with all other service standards requirements. The antennae location may be in or on the building, or remotely located from the building.


Scenario I Example

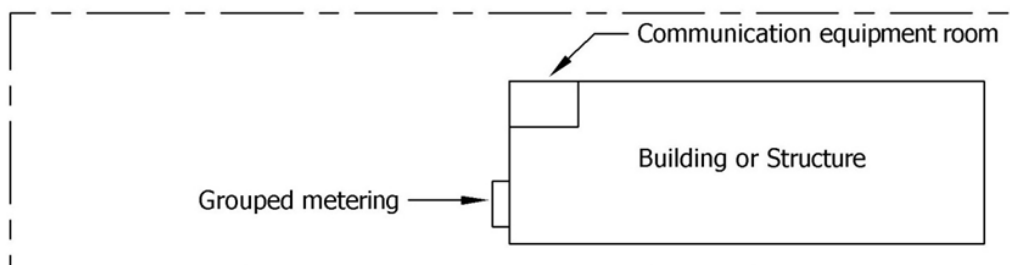

SCENARIO II – COMMUNICATION ANTENNAE IN OR ON A BUILDING WITH COMMUNICAITON EQUIPMENT REMOTE FROM BUILDING

The electric service to the communication system shall be served from the existing building service. The new meter shall be grouped with the existing meter(s) in accordance with all other service standards requirements.

Scenario II Example

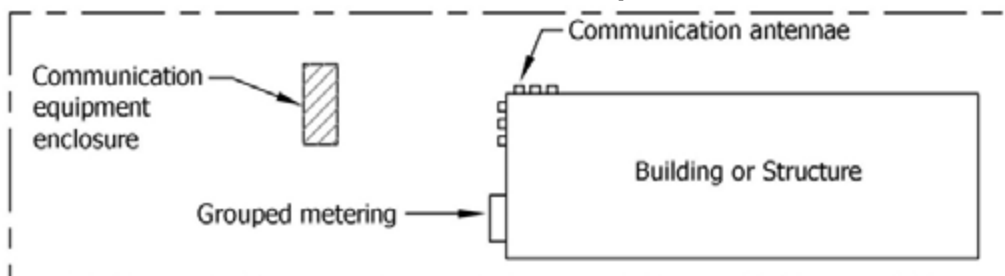

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 2


SDG&E SERVICE STANDARDS & GUIDE

WIRELESS COMMUNICATIONS ON PRIVATE PROPERTY

SG 522.1

SCENARIO III – COMMUNICATION SYSTEM COMPLETELY SEPARATE FROM A RESIDENTIAL OR COMMERCIAL/INDUSTRIAL STRUCTURE WITH AN EXISTING ELECTRIC SERVICE

Scenario III Example

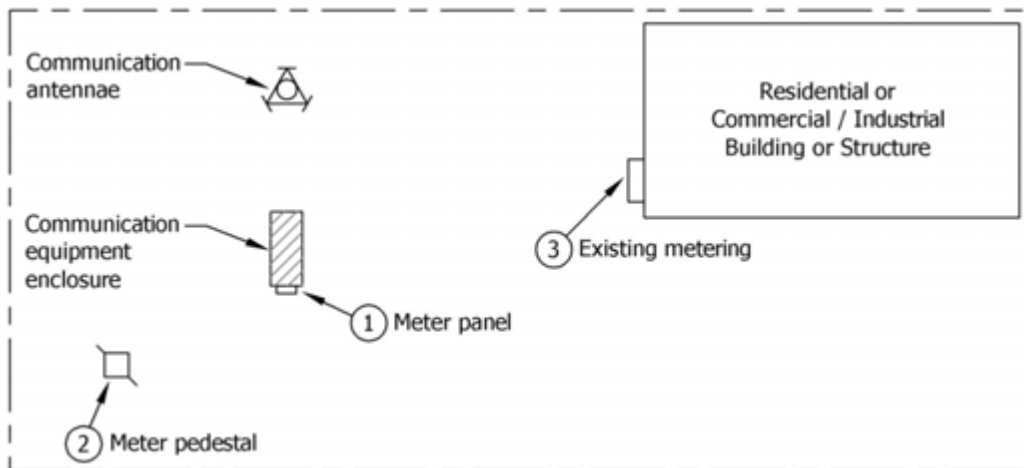

Notes:

- ① A new meter panel and service on the equipment enclosure separate from the building is acceptable.
- ② A new service and meter pedestal may be installed separate from the building and equipment enclosure. The meter pedestal shall not be located within the required property line setbacks established by the AHJ. The customer is to consult with the AHJ for setback requirements.
- ③ A new meter panel grouped with existing building meter(s) is acceptable.
4. The California Electrical Code requires that grounding systems must be electrically bonded to one another when multiple services maintain electrical and/or communications systems on the same structure.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 2


SDG&E SERVICE STANDARDS & GUIDE

WIRELESS COMMUNICATIONS ON PRIVATE PROPERTY

SG 522.2

GENERAL INFORMATION

This standard shows a customer-owned and -installed wireless communications antenna attachment on an SD&GE wood distribution pole for metered electric service.

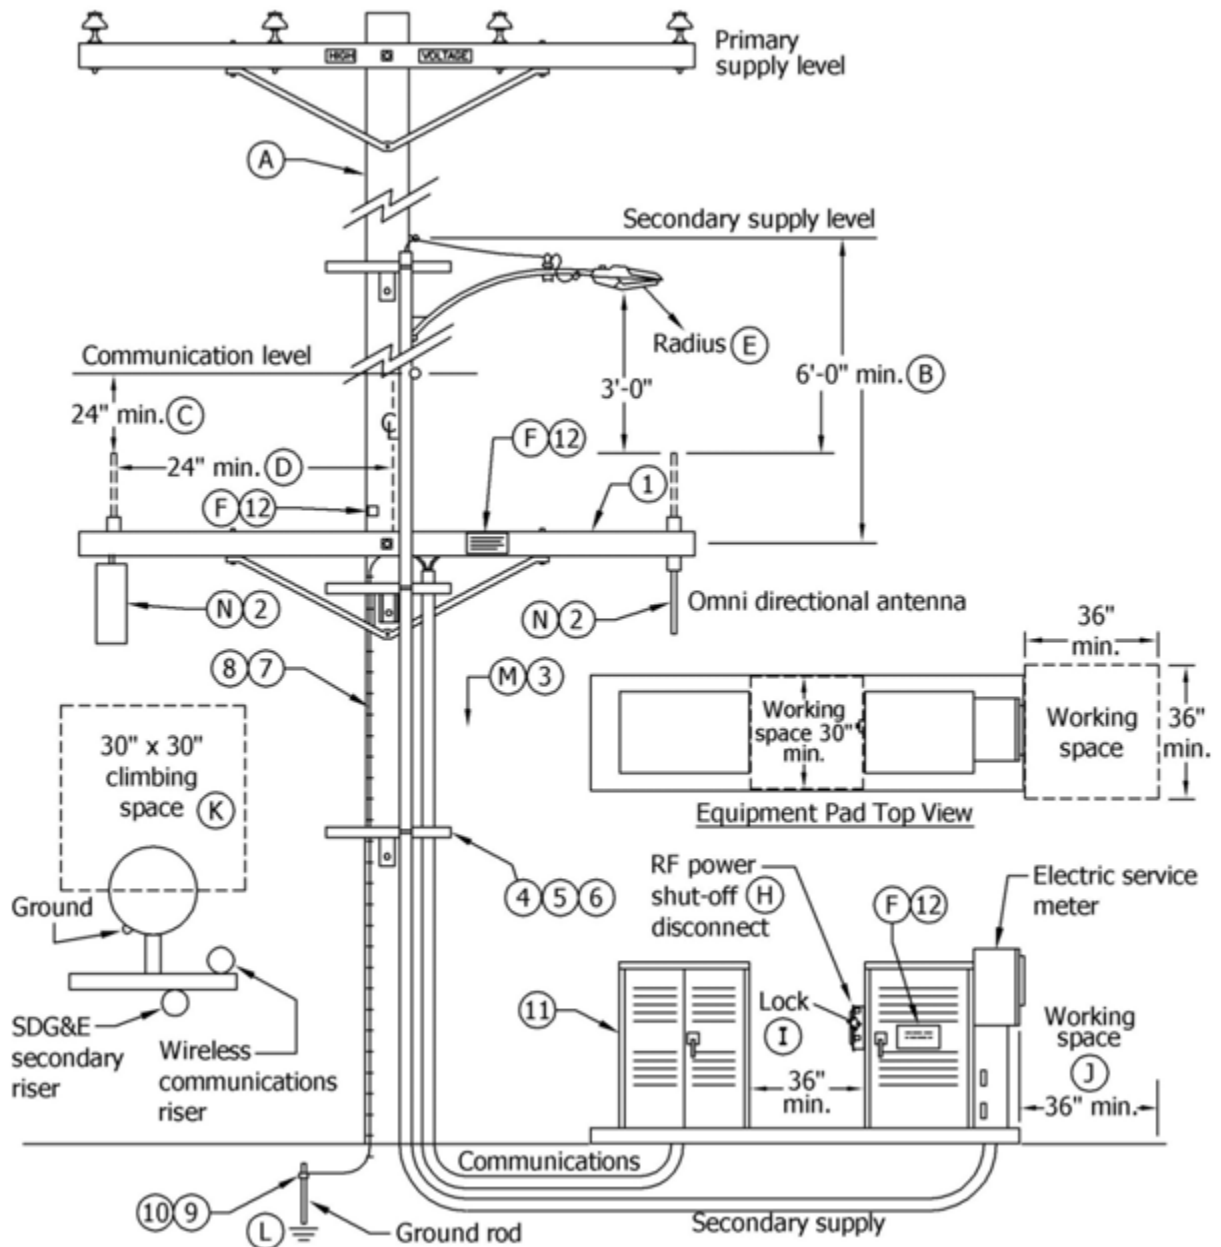

Reference OH 575.1 / UG 4650.1.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 3

SDG&E SERVICE STANDARDS & GUIDE

**WIRELESS COMMUNICATIONS PROVIDER
METERED ELECTRIC SERVICE**

SG 523.1

Bill of Material:

Item	Description	Quantity	Const. Std. or Page No.	Stock Number
①	Crossarm, 3-3/4" x 5-3/4" x 10'-0" (8'-0" min.)	As Required	---	ⓖ
②	Customer-Owned Antenna, Directional or Omni-Directional	As Required	---	ⓖ
③	Riser Construction	As Required	1404/4204	---
④	Bracket, Ladder Arm	As Required	1404/4204	ⓖ
⑤	Channel, Double, Galvanized, 24"	As Required	1404/4204	ⓖ
⑥	Nut, Clamping Channel, with Spring 1/2"	As Required	1404/4204	ⓖ
⑦	#4 CU Solid Ground Wire, PVC Covered Ⓛ	As Required	---	ⓖ
⑧	Staples, Galvanized, for PVC Covered Ground Wire	As Required	---	ⓖ
⑨	Steel Ground Rod, Copper Jacketed, 5/8" x 8'	As Required	---	ⓖ
⑩	Copper Bonded Ground Connector	As Required	---	ⓖ
⑪	Customer-Owned Ancillary Equipment	As Required	---	ⓖ
⑫	Tag, Ownership I.D.	1	209	ⓕ

Installation:

- Ⓐ Do not install a telecommunication antenna on a pole containing a three-phase transformer, booster, service restorer, capacitor, regulator, primary metering, hookstick or gang-operated switch, cutouts, or primary risers.
- Ⓑ A minimum 6' of vertical and radial clearance must be maintained from the telecommunications antennas or supporting equipment to any SDG&E supply conductor level.
- Ⓒ Antennas and supporting elements shall maintain a minimum 24" of vertical separation from communication conductors and equipment.
- Ⓓ Antennas shall maintain 24" horizontal clearance from the centerline of pole.
- Ⓔ Antennas shall maintain 36" vertical and radial clearance from street lights and mast arms.
- Ⓕ This installation must be clearly marked with the appropriate signage, per FCC, CPUC and Utility regulations. Signage to be installed and maintained by the telecommunication antenna owner. See OH Standard 209.
- Ⓖ These items supplied and installed by the telecommunication antenna owner.

Reference OH 575.2 / UG 4650.2.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------

SHEET
2 OF 3

SDG&E SERVICE STANDARDS & GUIDE

**WIRELESS COMMUNICATIONS PROVIDER
METERED ELECTRIC SERVICE**

SG 523.2

- Ⓜ A municipally approved radio frequency (RF), power shutoff disconnects, with test points, will be installed and clearly marked by the telecommunication antenna owner. This disconnect, when open, will prevent the antennas from generating RF including when on battery back-up (see Electric Standard Practice 124). Per the California Electrical Code, maintain a minimum of 36" deep by 30" wide clear working space.
- Ⓜ A cut-away lock will be provided by the telecommunication antenna owner for securing the RF power shutoff disconnect.
- Ⓜ A clear and level working space with both a width and depth of 36" must be maintained from face of meter panel.

References:

- Ⓜ Allowable working and climbing space – See OH Standard 251.
- Ⓜ Grounding methods – See OH Standard 1002.
- Ⓜ Riser Position – See OH Standard 1402 / UG Standard 4206.
- Ⓜ Any communication antenna attachments must comply with the CPUC G.O. 95 and 128 Rules.

Reference OH 575.2 / UG 4650.2.


© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

SHEET 3 OF 3	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 523.3
	SDG&E SERVICE STANDARDS & GUIDE					
	WIRELESS COMMUNICATIONS PROVIDER METERED ELECTRIC SERVICE					

UNMETERED (UM) ELECTRIC SERVICE FROM AN OVERHEAD SOURCE

This standard shows a customer-owned and installed wireless communications antenna attachment for UM electric service on an SDG&E wood distribution pole. This construction is not allowed on a pole with equipment or switches installed.

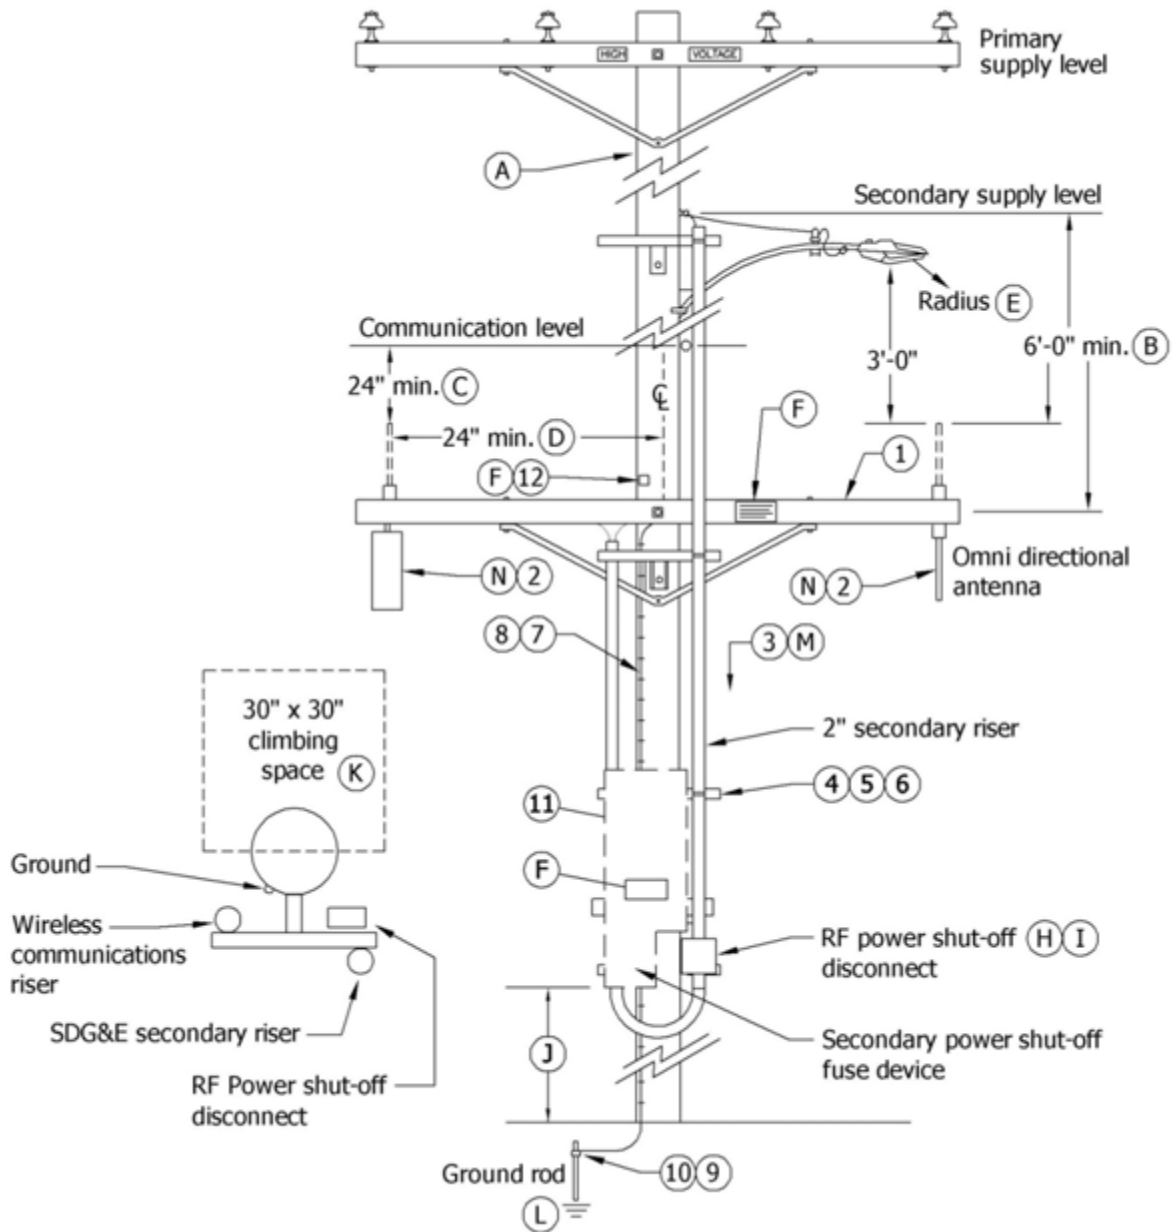

Reference OH 576.1.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 10	<div></div>	Indicates Latest Revision	<div>X</div>	Completely Revised	New Page	Information Removed	SG 524.1
	SDG&E SERVICE STANDARDS & GUIDE						
	UNMETERED ELECTRIC SERVICE						

Bill of Material:

Item	Description	Quantity	Const. Std. or Page No.	Stock Number
①	Crossarm, 3- $\frac{3}{4}$ " x 5- $\frac{3}{4}$ " x 10'-0" (8'-0" min.)	As Required	---	Ⓔ
②	Customer-Owned Antenna, Directional or Omni-Directional	As Required	---	Ⓔ
③	Riser Construction	As Required	1404/4204	---
④	Bracket, Ladder Arm	As Required	1404/4204	Ⓔ
⑤	Channel, Double, Galvanized, 24"	As Required	1404/4204	Ⓔ
⑥	Nut, Clamping Channel, with Spring $\frac{1}{2}$ "	As Required	1404/4204	Ⓔ
⑦	#4 CU Solid Ground Wire, PVC Covered Ⓛ	As Required	---	Ⓔ
⑧	Staples, Galvanized, for PVC Covered Ground Wire	As Required	---	Ⓔ
⑨	Steel Ground Rod, Copper Jacketed, $\frac{5}{8}$ " x 8'	As Required	---	Ⓔ
⑩	Copper Bonded Ground Connector	As Required	---	Ⓔ
⑪	Customer-Owned Ancillary Equipment	As Required	---	Ⓔ
⑫	Tag, Ownership I.D.	1	209	Ⓕ

Installation Notes:

- Ⓐ Do not install a telecommunication antenna on a pole containing a three-phase transformer, booster, service restorer, capacitor, regulator, primary metering, hookstick or gang-operated switch, cutouts, or primary risers.
- Ⓑ A minimum 6' of vertical and radial clearance must be maintained from the telecommunications antennas or supporting equipment to any SDG&E supply conductor level.
- Ⓒ Antennas and supporting elements shall maintain a minimum 24" of vertical separation from communication conductors and equipment.
- Ⓓ Antennas shall maintain 24" horizontal clearance from the centerline of pole.
- Ⓔ Antennas shall maintain 36" vertical and radial clearance from street lights and mast arms.
- Ⓕ This installation must be clearly marked with the appropriate signage, per FCC, CPUC and Utility regulations. Signage to be installed and maintained by the telecommunication antenna owner. See OH Standard 209.
- Ⓖ These items supplied and installed by the telecommunication antenna owner.

Reference OH 576.2.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 10	Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	<input type="checkbox"/> New Page	<input type="checkbox"/> Information Removed	SG 524.2
	SDG&E SERVICE STANDARDS & GUIDE				
	UNMETERED ELECTRIC SERVICE				

- Ⓜ A municipally approved radio frequency (RF), power shutoff disconnects, with test points, will be installed and clearly marked by the telecommunication antenna owner. This disconnect, when open, will prevent the antennas from generating RF including when on battery back-up (see Standard Practice 124). Per the California Electrical Code, enforced by the governmental Authority Having Jurisdiction (AHJ), maintain a minimum of 36" deep by 30" wide clear working space.
- Ⓜ A cut -away lock will be provided by the telecommunication antenna owner for securing the RF power shutoff disconnect.
- Ⓜ Cabinet to be mounted at 10' from ground level to bottom of cabinet when not subject to traffic contact. If vulnerable to vehicle damage, mount cabinet at 13'-6" from ground level to bottom of cabinet. Consider large vehicles parking parallel to curb.

References:

- Ⓜ Allowable working and climbing space – See OH Standard 251.
- Ⓜ Grounding methods – See OH Standard 1002.
- Ⓜ Riser Position – See OH Standard 1402 / UG Standard 4206.
- Ⓜ Any communication antenna attachments must comply with the CPUC G.O. 95 and 128 Rules.

Reference OH 576.2.


© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					


SHEET 3 OF 10	Indicates Latest Revision	X	Completely Revised	New Page	Information Removed	SG 524.3
	SDG&E SERVICE STANDARDS & GUIDE					
	UNMETERED ELECTRIC SERVICE					

UNMETERED ELECTRIC SERVICE FROM AN UNDERGROUND SOURCE


The installation and all materials shown in the illustrations below are provided by the customer. All installations must comply with the requirements of, and be inspected by, the AHJ and SDG&E (Utility).

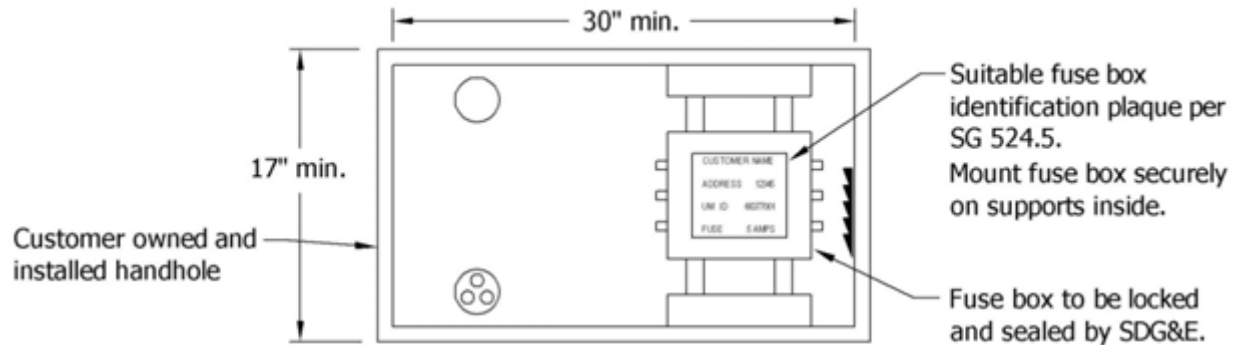

Top View

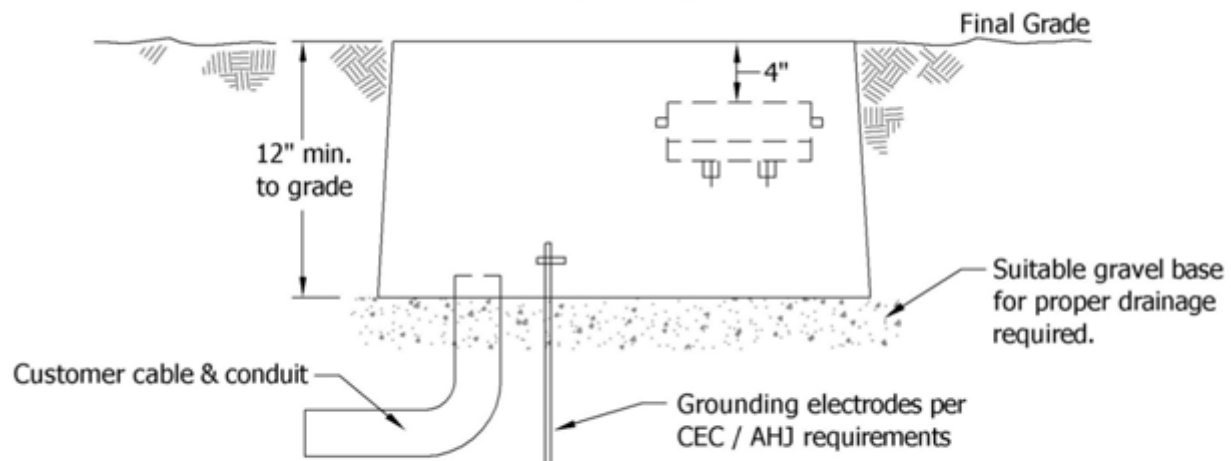

Side View

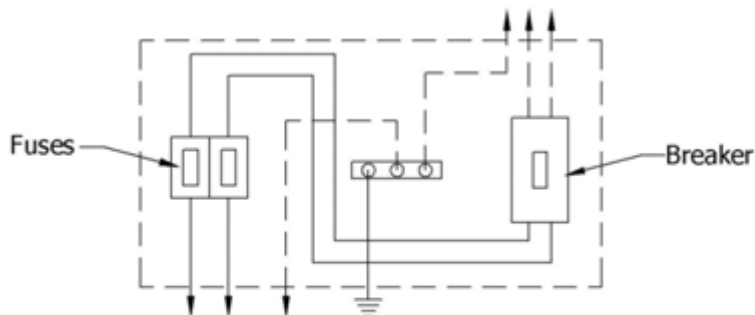

Wiring Diagram Inside Fuse Splice Box

Note:
Alternate fusing methods:
fused disconnect suitable for
underground application, or
in a suitable enclosure.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

Indicates Latest Revision

☒ Completely Revised

☐ New Page

☐ Information Removed

SHEET
4 OF 10

SDG&E SERVICE STANDARDS & GUIDE

UNMETERED ELECTRIC SERVICE

SG 524.4

PLAQUE REQUIREMENTS

The plaque shall be plastic with engraved or machine printed letters in contrasting color to the plaque, and shall be permanently attached to the fuse box with pop rivets or screws. The typical plaque configuration is shown below.

↓ 1/2" ↑	CUSTOMER	NAME
	ADDRESS	12345
	UM ID	66377001
	FUSE	5 AMPS


© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

SHEET 5 OF 10	Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	New Page	Information Removed	SG 524.5
	SDG&E SERVICE STANDARDS & GUIDE				
	UNMETERED ELECTRIC SERVICE				

UNMETERED ELECTRIC SERVICE ON A CUSTOMER-OWNED FUSED SERVICE POLE

This standard shows and describes the installation of a customer-owned fused service pole. This installation is subject to all requirements of, and inspection by, the AHJ and SDG&E (Utility).

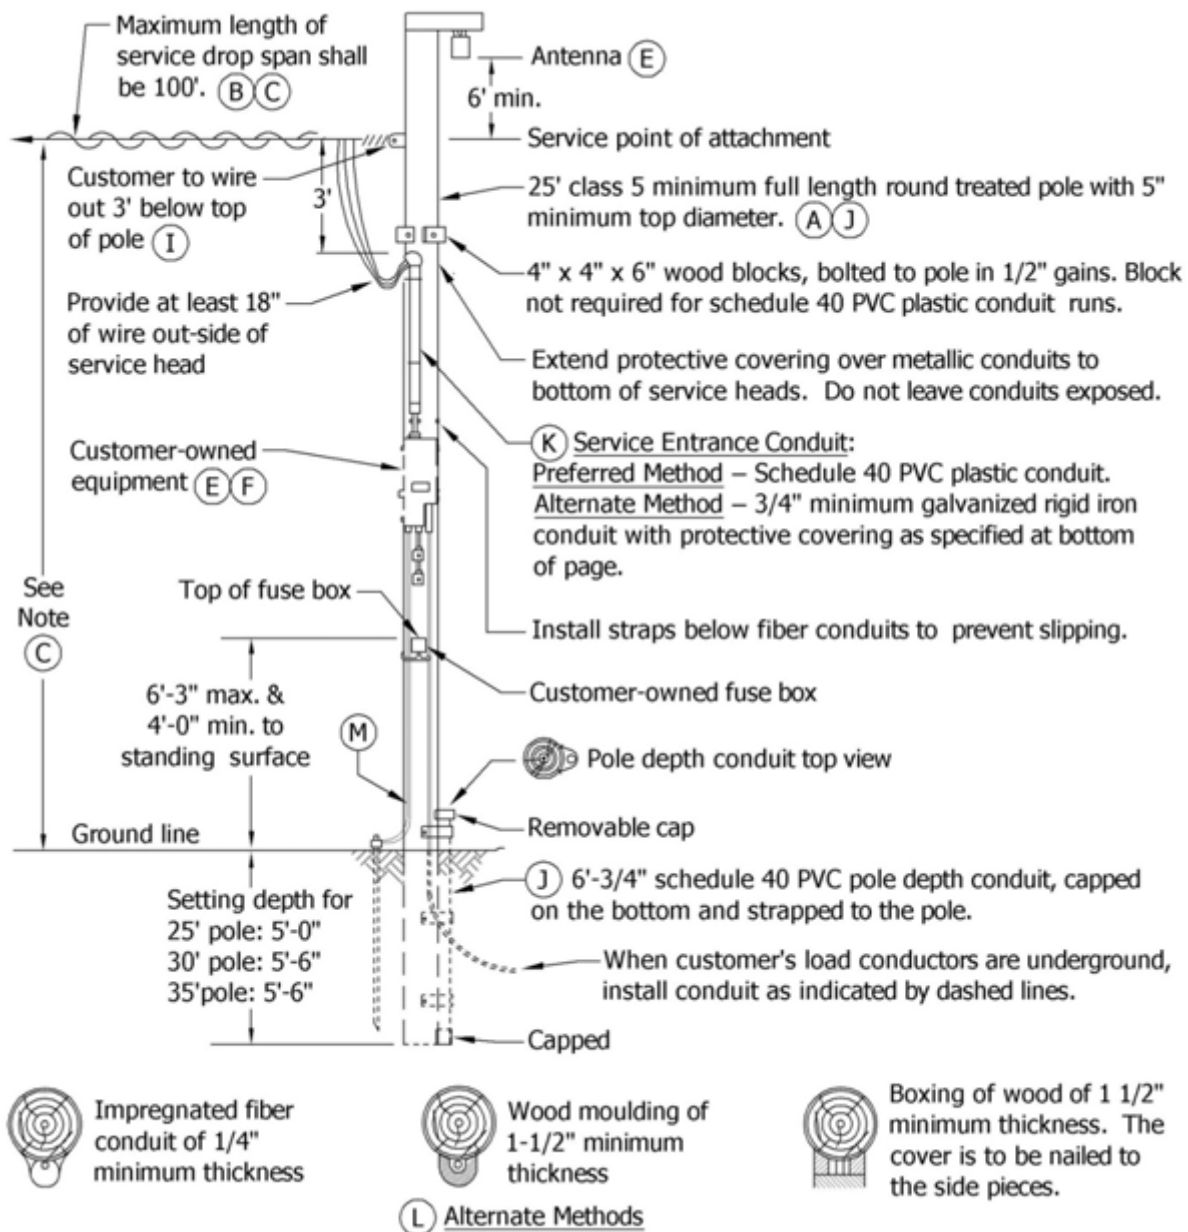

Reference OH 645.1.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

Indicates Latest Revision

X Completely Revised

New Page

Information Removed

SHEET
6 OF 10

SDG&E SERVICE STANDARDS & GUIDE

UNMETERED ELECTRIC SERVICE

SG 524.6

Installation Notes:

- (A) These are minimum requirements for permanent customer-owned fused service poles.
- (B) **Pole Location:** The pole shall be set not more than 100', or less than 10', from the surface of the Utility's service pole and so located that all required service drop clearances will be obtained from ground, buildings, and structures.
- (C) **Service Drop Minimum Clearances:**
 - At center of street or 12' from curb, whichever is less18'
 - At curb line.....16'
 - Over commercial or industrial driveways, parking areas, or areas capable of being traversed by vehicles16'
 - Over residential driveways.....12'*
 - Over agricultural areas15'
 - Over railroads or for other special conditions, consult the Utility's Planner.
- * May be reduced to 10' if Self-Supporting Cable (SSC) service.
The Utility will use SSC. The type of construction used by the customer is their option.
- D. Where clearances in Note C cannot be obtained with the 25' pole shown, a 35' maximum pole shall be used.
- (E) Refer to pages SG 524.1 – 524.4 for specifications for installing customer-owned and -installed wireless communications antennas.
- (F) All customer equipment shall have an identifying plaque indicating customer name, address, UM identification number and fuse size. The plaque shall be plastic with engraved or machine printed letters in contrasting colors to the plaque, and shall be permanently attached to the fuse box with pop rivets or screws. Refer to page SG 524.4 for specifications.
- G. Permit and inspection must be obtained from the AHJ before service will be connected by the Utility.
- H. Consult the Utility's Planner for service requirements whenever three-phase service is desired.
- (I) The Utility will furnish and install the service drop and service drop rack or wire holders. All other equipment, including the pole, shall be furnished and installed by the customer.
- (J) The customer is to dig the pole in natural soil. Backfill must be compacted to 90% minimum within a 5' radius of the pole. Pole depth will be confirmed by insertion of a ground rod or similar probe into the PVC depth conduit attached to the climbable pole. Install a removable cap on top of the depth conduit to prevent falling debris from entering the conduit.
- (K) All conduit fittings must be raintight. Approved wire, not less than No. 8 AWG, shall be used in the service entrance conduit.
- (L) Alternate methods of covering service entrance conduits are shown on page SG 524.6. Covering to be strapped to the pole with galvanized two-hole pipe straps spaced not to exceed 3' apart.
- (M) The service ground is to comply with all applicable codes and ordinances and be mechanically protected in compliance with G.O. 95 per one of the following methods:
 - a. Encased in rigid steel conduit.
 - b. Minimum No. 8 AWG armored copper ground wire.
 - c. Covered by a minimum of: (1) hardwood molding (of oak or rock elm) 3/8" in thickness, (2) Douglas fir molding 1/2" in thickness, (3) rigid conduit or rigid U-shaped molding of a minimum Schedule 40 PVC or (4) poly-protected ground wire.

Reference OH 645.2.


© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

SHEET 7 OF 10	Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	<input type="checkbox"/> New Page	<input type="checkbox"/> Information Removed	SG 524.7
	SDG&E SERVICE STANDARDS & GUIDE				
	UNMETERED ELECTRIC SERVICE				

UNMETERED ELECTRIC SERVICE ON AN SDG&E-OWNED STREET LIGHT POLE

This standard shows and describes the installation of a customer-owned and -installed wireless communications antenna attachment on a direct burial or foundation pole with conventional luminaire for roadway lighting owned by SDG&E.


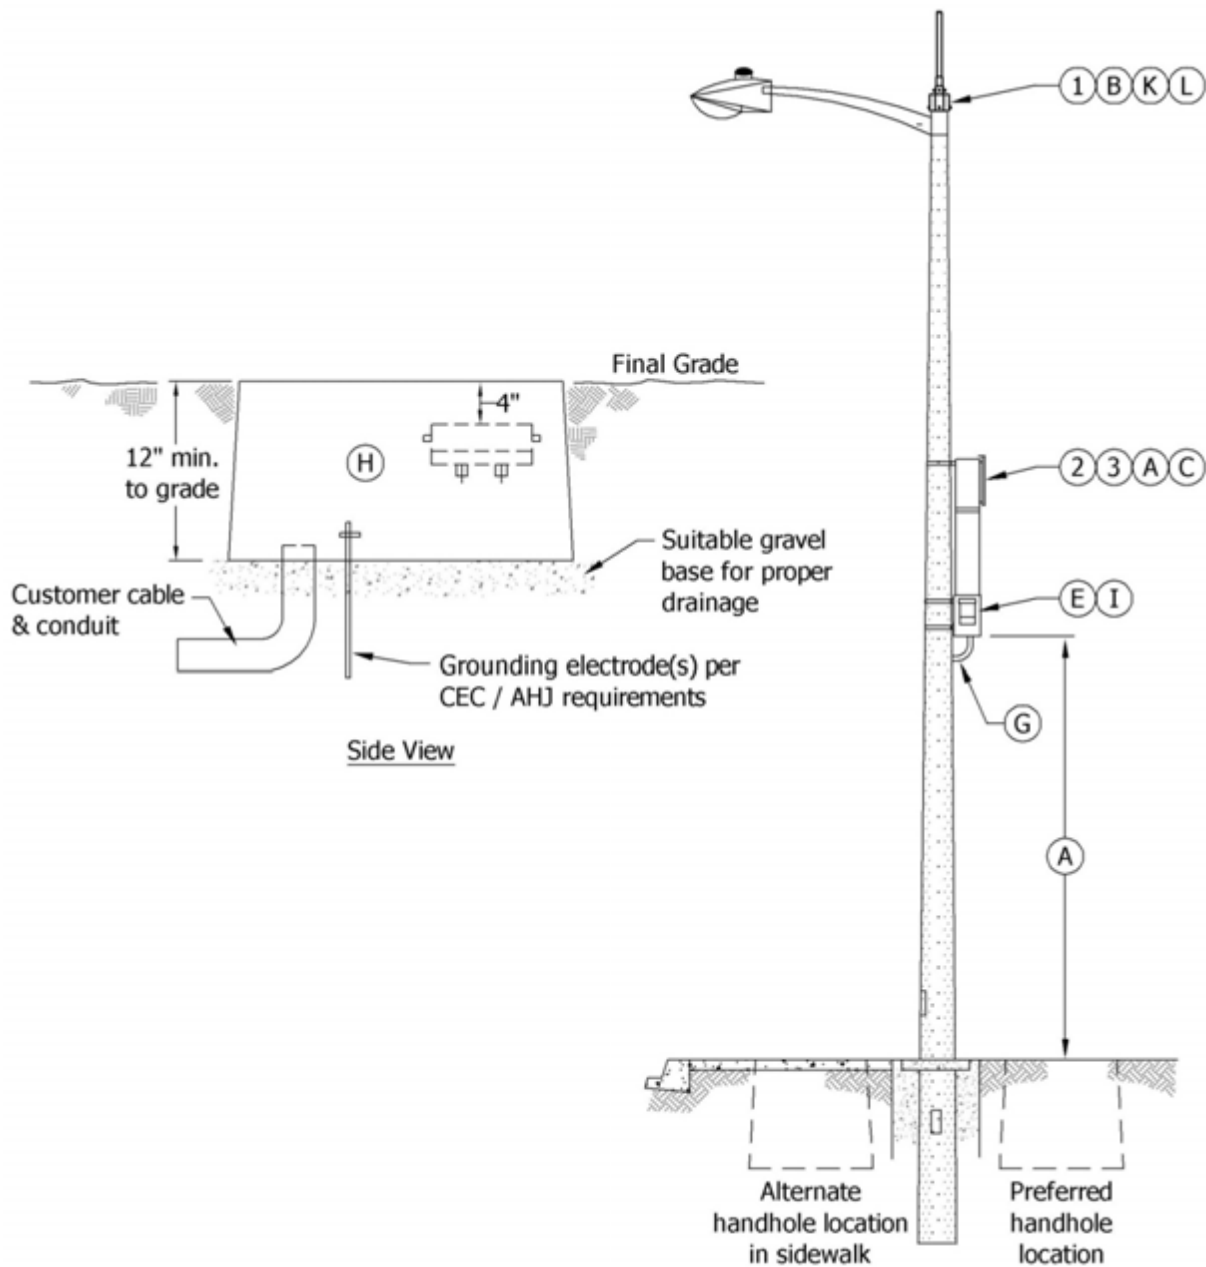


Reference OH 578.1 / UG 4660.1.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

SHEET 8 OF 10	<div></div>	Indicates Latest Revision	<div>X</div>	Completely Revised	New Page	Information Removed	SG 524.8
	SDG&E SERVICE STANDARDS & GUIDE						
	UNMETERED ELECTRIC SERVICE						

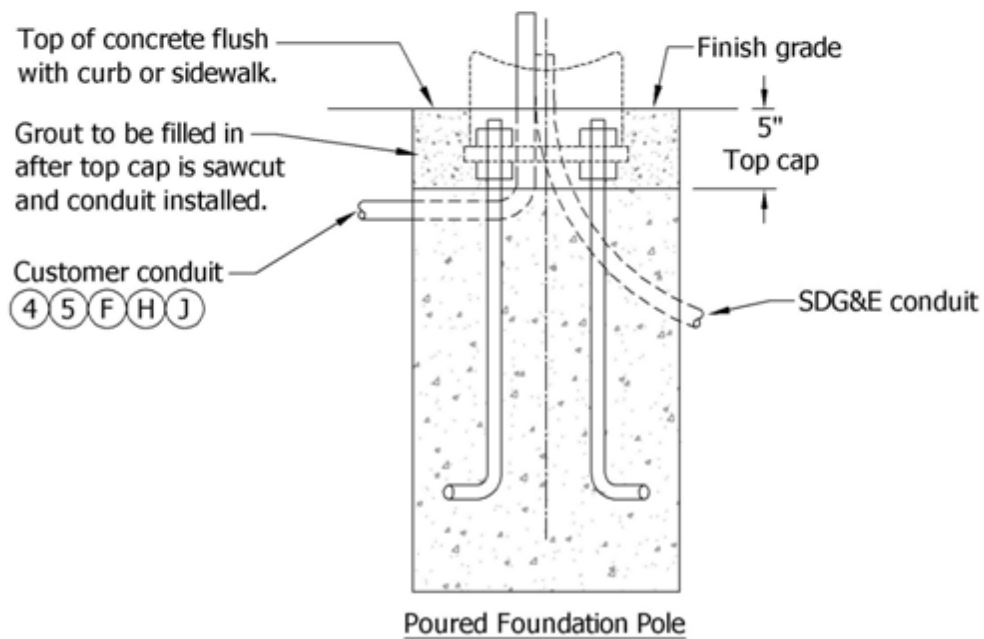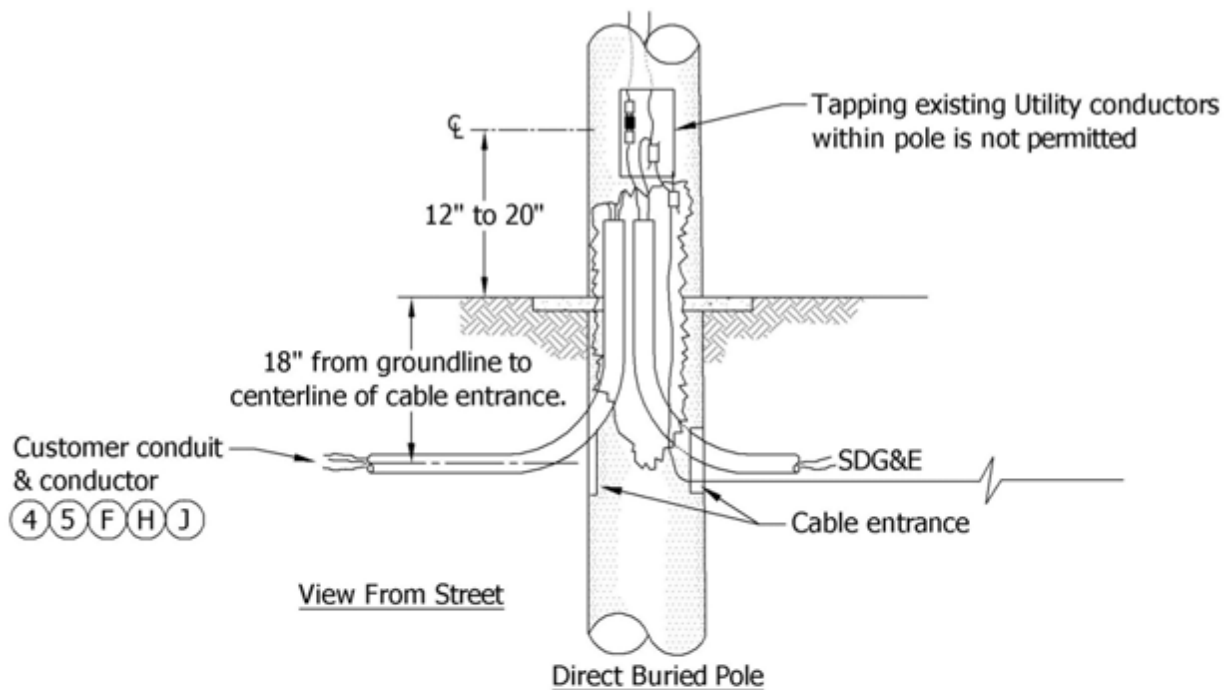

Reference OH 578.1 – 578.2 / UG 4660.1 – 4660.2.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

Indicates Latest Revision

☒ Completely Revised

☐ New Page

☐ Information Removed

SHEET
9 OF 10

SDG&E SERVICE STANDARDS & GUIDE
UNMETERED ELECTRIC SERVICE

SG 524.9

Bill of Material:

Item	Description	Quantity	Const. Std. or Page No.	Stock Number
①	Customer-Owned Antenna, Directional or Omni-Directional (B)(K)(L)	As Required		(D)
②	Customer-Owned Ancillary Equipment	As Required		(D)
③	Tag, Ownership I.D. (C)	1	209	(C)(D)
④	Wire, Bare Copper Ground (F)(J)		4431.2	(D)
⑤	Connector Copper Compression Ground	As Required		(D)

Installation Notes:

- (A) Ancillary communications equipment must be banded to SDG&E's street light pole. Cabinet to be mounted at 10' from ground level to bottom of cabinet when not subject to traffic contact. If vulnerable to vehicle damage, mount cabinet at 13'-6" from ground level to bottom of cabinet. Consider large vehicles parking parallel to curb.
- (B) The customer-owned antenna must fit and fasten securely over the top of the street light pole, and all cables will be required to be installed within the hollow portion of the street light pole.
- (C) This installation must be clearly marked with the appropriate signage, per FCC, CPUC and Utility regulations. Signage to be installed and maintained by the telecommunications antenna owner. See OH Standard 209.
- (D) These items supplied and installed by the telecommunications antenna owner.
- (E) A municipally approved radio frequency (RF) power shutoff disconnect, with test points, will be installed and clearly marked by the telecommunications antenna owner. This disconnect, when open, will prevent the antennas from generating RF, including when on battery back-up (see Electric Standard Practice 124). Power disconnect to be mounted on the bottom of customer-owned ancillary equipment cabinet.
- (F) Customer-owned ancillary equipment must be securely grounded per G.O. 95 and local code requirements. Customer to provide their own grounding system. Attachment to the SDG&E grounding system, which includes, but is not limited to, the grounding electrode and grounding electrode conductor, is not allowed.
- (G) There can be no more than one hole drilled in the street light pole for installation of the power cables, coaxial cable and system ground. This hole is to be no larger than 1-1/2", and must be permanently sealed to prevent water entry. Drill hole in-line vertically with access door, or at 90 degree intervals from access door to avoid cutting embedded reinforcing wire.
- (H) This is the customer's Schedule UM fuse box installed in a customer-owned handhole per page SG 524.4. It will not be served by tapping existing SDG&E conductors within the street light pole. It must be served from a separate SDG&E structure suitable for use as a Service Point for Schedule UM service. A service order from an SDG&E Service Planner is required.
- (I) A cut-away lock will be provided by the telecommunication antenna owner for securing the RF power shut off disconnect.

References:

- (J) Grounding methods – See page SG 524.4.
- (K) All antenna brackets must be reviewed and approved by SDG&E before they are installed on SDG&E's street light poles.
- (L) Any communication antenna attachments must comply with the CPUC G.O. 95 and 128 Rules.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

SHEET 10 OF 10	<div></div>	Indicates Latest Revision	<div>X</div>	Completely Revised		New Page		Information Removed	SG 524.10
	SDG&E SERVICE STANDARDS & GUIDE								
	UNMETERED ELECTRIC SERVICE								

This standard provides direction for establishing effective metering communications when a meter location does not facilitate standard "Smart Meter" communication methods.

Smart Metering Operations (SMO) requirements for type, placement, and quantity of smart meter network devices will vary according to the construction and location of meters throughout the customer's premises, so each premise must be evaluated by SDG&E (Utility) on a case-by-case basis.

For network device placement, contact the Network Device team via email at networkdevice@semprautilities.com.

When new construction has commenced, Project Management shall provide notification of new construction to the Smart Meter Network Expansion team at SmartMeterNetworkExpansion@semprautilities.com.

NETWORK DEVICE WITH CUSTOMER POWER SOURCE

Where the customer will allow the Utility-owned smart meter network devices installed on the customer premises and will provide power outlets for these network devices, the requirement for a communication conduit can be waived.

The power outlets to support network devices shall be installed at locations designated by the Utility's Meter and Network Operations personnel. For each location with one or more network devices, a 2-wire 120-volt AC power outlet shall be co-located. The network device will be installed with a hard wire connection to the power outlet. The power outlet can be located anywhere a conduit can be run from the power outlet to the network device power supply.

NETWORK DEVICE WITHOUT CUSTOMER POWER SOURCE

Where the customer will allow the Utility-owned smart meter network devices installed on the customer premise and will not provide power outlets for these network devices, SMO has specific communication conduit requirements that must be met in order to proceed. Contact with SMO must be made prior to construction in order to obtain the specific requirements and apply them to the customer's electrical conduit installation.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	New Page	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 1	Indicates Latest Revision	Completely Revised	X	New Page	Information Removed	SG 525
	SDG&E SERVICE STANDARDS & GUIDE					
	METERING COMMUNICATIONS					

**600 - MEDIUM VOLTAGE
ELECTRIC SERVICE &
METERING EQUIPMENT**

**600 - MEDIUM VOLTAGE
ELECTRIC SERVICE &
METERING EQUIPMENT**

SUBJECTPAGE #

Auxiliary Equipment Connected Ahead of Service Main	SG 603.3
Basic Lightning Impulse Insulation Level (BIL) Rating.....	SG 603.5
Bus Dimension	SG 603.5
Bus Material.....	SG 603.5
Bus Tap Drawings for Approval	SG 603.3
Conductors Passing Through Compartment Walls.....	SG 603.6
Control Power Transformer (CPT) Meter Wiring Diagram	SG 605
Current & Voltage Transformer Installation.....	SG 603.5
Current Transformer, Indoor, Dimensions.....	SG 606
Current Transformers & Bus Link	SG 603.7
Door Access to Metering Cubicles.....	SG 603.5
Engineering Specifications	SG 603.1
Fuse Specification	SG 603.7
Instrument Transformer Mounting	SG 603.7, SG 607
Main Service & Meter Disconnect	SG 603.2
Manufacturer's Drawings for Approval	SG 603.1
Medium-Voltage Metering Cubicle	SG 604.1 – 604.6
Enclosure Dimensions	SG 604.3
Field Maintenance Only	SG 604.6
Meter Panel Layout.....	SG 604.4, SG 604.6
Metering Cubicle.....	SG 604.1 – 604.2
Pad Layout.....	SG 604.1
Test Switch Layout	SG 604.5
Meter Panel	SG 603.4

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 2	<div></div> Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	<input type="checkbox"/> New Page	<input type="checkbox"/> Information Removed	SG 602.1
	SDG&E SERVICE STANDARDS & GUIDE				
	<div>MEDIUM VOLTAGE ELECTRIC SERVICE & METERING EQUIPMENT ALPHABETICAL SUBJECT INDEX</div>				

SUBJECTPAGE #

Phase Taps Protecting Fuses & Voltage Transformers.....	SG 603.6
Safety Grounding Provisions	603.4
Service Point Connection for 12kV Trolley Traction Station	SG 609
Switchgear Underground Service Terminating Pull Section.....	SG 603.1, SG 608.1 – 608.3
Utility Compartment Labeling.....	SG 603.4
Ventilation	SG 603.5
Voltage Transformer Disconnect Requirements	SG 603.6
Voltage Transformer Fuse Specification	SG 603.6
Weatherproofing & Locking	SG 603.5
Working Space for Medium-Voltage Switchgear	SG 603.4

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 2	<div></div> Indicates Latest Revision	<div>X</div> Completely Revised	<div></div> New Page	<div></div> Information Removed	SG 602.2
	SDG&E SERVICE STANDARDS & GUIDE				
	<div>MEDIUM VOLTAGE ELECTRIC SERVICE & METERING EQUIPMENT ALPHABETICAL SUBJECT INDEX</div>				

ENGINEERING SPECIFICATIONS

1. SDG&E (Utility) will issue specifications for each medium voltage service installation. These specifications will be based on the application for service, the electrical load, service voltage plans as requested by the customer and the service rules of the Utility. The Utility's Planner may approve medium voltage service and metering equipment in an electric meter room provided all requirements on pages SG 506.1 – 506.4 are met.
2. The installation shall comply with all applicable rules of the California Electrical Code and other governing codes and ordinances.

MANUFACTURER'S DRAWINGS FOR APPROVAL

1. The manufacturer of the medium-voltage switchgear for the customer's service shall submit five (5) copies of the drawings showing the service cable terminating section, the main breaker or switch section and the metering cubicle prior to fabrication to:

SDG&E Service Standards
8316 Century Park Court, CP52F
San Diego, CA 92123-1582

2. The job address must be shown on drawings for review and approval. One copy will be returned to the sender with approvals or corrections as needed. When a parallel stand-by or emergency generation system is existing or is to be installed in connection with new medium voltage service equipment, a one-line electrical diagram showing the relationship of the generator with the service equipment, including the transfer device and its sequence of operation, is to be submitted with the switchgear drawings. The electrical one-line diagram submittal requirement applies to all medium voltage service.
3. This practice will ensure your service equipment meets all of the Utility's requirements and is acceptable for installation.

SWITCHGEAR UNDERGROUND SERVICE TERMINATING UNDERGROUND PULL SECTION

1. All switchgear to which medium voltage service is to be supplied by the Utility shall be equipped with a "separate, fully enclosed" switchgear underground service terminating Underground Pull Section (UGPS). See pages SG 608.1 – 608.3. Space will be provided for the support and connection of the service cables to a bussed section which has standard NEMA drillings for two-hole termination lugs. The Utility will specify the number of cables they will install and terminate in the UGPS. The Utility will furnish and install the terminating lugs.
2. The service cable terminating UGPS shall have a full-height hinged door that is sealable and pad-lockable.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	Editorial Changes	JC	BRB	MDJ	07/16/15	E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 7

SDG&E SERVICE STANDARDS & GUIDE

GENERAL INFORMATION

SG 603.1

MAIN SERVICE & METER DISCONNECT

1. The manufacturer or contractor shall furnish and install a single main service and meter disconnect for each medium voltage service. This main service and meter disconnect shall control all of and only the energy carried by the service and registered by the medium-voltage metering equipment.
2. The service and meter disconnect shall coordinate electrically with the Utility and be installed and connected to the service on the supply (line) side of the metering equipment. This is referred to as "cold sequence metering". Grounding switches shall not be permitted in between Utility pull section and main disconnect.
3. The customer will provide, own and maintain their premises distribution system which is required to coordinate electrically with the Utility's system, and they will provide a one-line diagram of the medium voltage service equipment. This applies to both new switchgear and modifications to existing switchgear.
4. A main breaker with phase and ground relays is required if the customer demand is 2,500 kW, or above. At the Utility's option, a breaker may be required for lesser demands to ensure coordination with the Utility's protective devices, which includes automated sectionalizing devices such as service restorers.
5. If a multifunction protective relay (i.e. microprocessor, solid state, etc.) is used to protect customer's switchgear, then a redundant protection system must be installed, e.g., two (2) multifunction protective relays in parallel. The reason for this requirement is a failure of an internal component(s) (such as a power supply, RAM, ROM, A/D converter, etc.) may disable all protection functions within the protective relay.
6. When breaker protection is provided, the customer will inform the Utility of the breaker manufacturer, type, size, Current Transformer (CT) ratios, protective relay manufacturer, ANSI functions and instantaneous trip current values, etc.
7. The protective relay settings must be approved and a written test report received by the Utility's Protection Engineer before the customer's service is energized.
8. When a service disconnect with fused protection is provided, the customer will inform the Utility of the fuse manufacturer type, ampacity and Time Current Curves (TCC) for review and approval. The customer will permanently label the Utility-approved fuse size and type on the disconnect cover prior to the Utility energizing the service. A permanent plaque shall be affixed to the disconnect cover stating:

DO NOT INCREASE FUSE SIZE, TYPE OF FUSE OR MANUFACTURER
WITHOUT OBTAINING PERMISSION FROM SDG&E.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	Editorial Changes	JC	BRB	MDJ	07/16/15	E					
C						F					

SHEET 2 OF 7	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 603.2
	SDG&E SERVICE STANDARDS & GUIDE					
	GENERAL INFORMATION					

AUXILIARY EQUIPMENT CONNECTED AHEAD OF SERVICE MAIN

1. Voltage Transformers (VTs) may be installed on the supply side of the MAIN service breaker for voltage indication and protective relays.
2. Cogeneration and other power production sources interconnected directly with the Utility may require control power, conduits for communication and/or High-End Metering. Please refer to the Generation Handbook.
3. A Control Power Transformer (CPT) used exclusively for the protective relays and the control circuit of the MAIN service breaker ONLY may be installed on the supply side of the breaker without the requirement for a separate 4- or 7-clip meter socket.
4. Where a CPT is required for AC control circuits, space heating, lighting and other incidental use within the switchgear, the CPT may be installed in the switchgear and connected to the supply side of the service breaker. The CPT secondary load side will be separately metered. The CPT secondary leads shall be taken through test blocks to a 4-or 7-clip meter socket located on the door above the main service 15-clip meter socket. Refer to page SG 604.6.
5. AC power may be used for breaker control. A capacitor potential device shall be used with a redundant energy source, e.g. device mounted batteries or Uninterruptable Power Supply (UPS).
6. Redundant control power for operating protective relays must be supplied that provides 72 hours minimum sufficient power for tripping operations.
7. Visible indication of sufficient charge for operating the service breaker trip coil must be available from the redundant control power system.
8. New redundant sources of energy not specifically mentioned in this standard may be submitted to SDG&E Service Standards for review and approval. Refer to page SG 603.1 for Service Standards' mailing address.

BUS TAP DRAWINGS FOR APPROVAL

1. Bus taps ahead of the main service and meter disconnect are not permitted except as specified under "Auxiliary Equipment Connected Ahead of Service Main" above. Proposed load side of metering bus taps ahead of the load side main disconnect require Utility approval. Submit five (5) copies of the tap drawing with a one-line diagram of the switchgear to SDG&E Service Standards at the address provided on page SG 603.1.
2. The bus tap drawing must be prepared by a qualified engineer, and the one-line diagram must show the tap location in the switchgear lineup. The job address must be shown on the drawings in order to process.
3. The customer's modified system must coordinate electrically with the Utility's system. Both the governmental Authority Having Jurisdiction (AHJ) and the Utility will inspect the bus tap, and the Utility must receive inspection clearance from the AHJ as a condition of energizing.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	Editorial Changes	JC	BRB	MDJ	07/16/15	E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------

SHEET
3 OF 7

SDG&E SERVICE STANDARDS & GUIDE

GENERAL INFORMATION

SG 603.3

4. An acceptable service disconnect with standard access and working space is required on the tap in immediate proximity to the main switchgear.

WORKING SPACE FOR MEDIUM-VOLTAGE SWITCHGEAR

1. Medium-voltage switchgear shall in every case (indoor or outdoor) be installed with at least 5' of clear, level and unobstructed working space in the front, rear and sides of any section where such supports or provides access to metering, VTs, CTs, grounding ball studs or testing equipment.
2. A minimum of 8' clear, level and unobstructed working space in front of the UGPS is required. Front is defined as the section cover that provides access to the Utility landing position termination points and grounding ball studs.
3. Because access is required to both the front and rear of the switchgear, a walkway of at least 2' wide shall be provided around one end of the medium voltage service and metering equipment. (This is required only if the 5' provision above is not required in front of an end section.)
4. To maintain a safe, clear and level permanent working area in front of new or existing meter and service equipment, a concrete slab, acceptable to the Utility Inspector, is required. The slope of the working space for drainage is not to exceed 1/4" per foot sloping away from the equipment.

UTILITY COMPARTMENT LABELING

Compartments of the metering enclosure shall be permanently labeled with machine-engraved laminated UV stabilized plastic tags. Quarter-inch white letters and numbers on red-colored material which is readily visible and mechanically attached to the face of the following designated compartments, and shall be worded as follows:

1. UTILITY VOLTAGE TRANSFORMER COMPARTMENT
2. UTILITY VOLTAGE TRANSFORMER FUSE COMPARTMENT
3. UTILITY CURRENT TRANSFORMER COMPARTMENT
4. UTILITY SERVICE TERMINATION COMPARTMENT
5. UTILITY METERING PANEL

SAFETY GROUNDING PROVISIONS

The bare bus 4" above and below the CT shall be provided to permit application of Utility medium-voltage worker's safety grounds. Grounding ball studs shall be provided on the line and load side of the bus at each CT location.

METER PANEL

1. The Utility will inform the manufacturer of the meter panel layout for the medium-voltage metering cubicle.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	Editorial Changes	JC	BRB	MDJ	07/16/15	E					
C						F					

SHEET 4 OF 7	X Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 603.4
	SDG&E SERVICE STANDARDS & GUIDE				
	GENERAL INFORMATION				

- The meter panel and hinges are to be designed to adequately support a 25-pound load applied at the unsupported end with 1/8" maximum sag when open. A #4 AWG flexible braided bond wire shall be installed across the hinges.

BASIC LIGHTNING IMPULSE INSULATION LEVEL (BIL) RATING

BIL for the metering enclosure shall be not less than the BIL rating for the customer's associated switchgear. Reference shall be made to ANSI Standards for the minimum accepted BIL ratings for medium-voltage switchgear built to the listed nominal voltage as shown in the tables below.

Refer to Table 1.1-2 Metal-Clad Switchgear Voltage & Insulation Levels (From IEEE Std. C37.20.2-2015) and Table 1.1-3 Metal-Enclosed Switchgear Voltage & Insulation Levels (From IEEE Std. C37.20.3-2013)

VENTILATION

Ventilation openings shall be provided as per ANSI Standards, and shall be louvered or screened and be guarded with internal barriers to prevent access to energized parts.

DOOR ACCESS TO METERING CUBICLES

A full-height hinged door with a 3-point locking mechanism and provisions for a Utility-furnished padlock is required.

WEATHERPROOFING & LOCKING

- Figures 3 and 4 on page SG 604.2 shows equipment with weatherproof doors. These enclosure doors shall be designed to be secure in the open position 90 degrees or more.
- The meter panel shall be hinged on the opposite side of the outer door on the weatherproof units to permit 90-degree opening with the meters and test facilities in place. Omit the weatherproof doors if the equipment is located indoors.
- If the outer door is omitted, furnish a lockable meter panel. The front and rear weatherproof doors shall be single doors equipped with a latch-type handle for a Utility padlock.

CURRENT & VOLTAGE TRANSFORMER INSTALLATION

CTs, VTs, meters, testing facilities and all secondary wiring from the transformers to the meters will be furnished and installed by the Utility.

BUS MATERIAL

All copper or aluminum bus used in the metering enclosure shall be tin or silver-PLATED to prevent the corrosion of the Utility-supplied CTs at the connection points to the bus. This shall also include the CT mounting hardware – bolts, washers and nuts.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	Editorial Changes	JC	BRB	MDJ	07/16/15	E					
C						F					

SHEET 5 OF 7	X Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 603.5
	SDG&E SERVICE STANDARDS & GUIDE				
	GENERAL INFORMATION				

BUS DIMENSION

The maximum bus size shall be $\frac{3}{8}$ " x 4". Minimum bus size shall be $\frac{1}{4}$ " x 2" unless otherwise indicated on specific drawing. A bus size outside these limits requires special engineering and consultation with the Utility.

CONDUCTORS PASSING THROUGH COMPARTMENT WALLS

Where cable or busses pass through compartment walls, through-the-wall bushings with full voltage rating on the switchgear must be used.

PHASE TAPS FOR FUSES PROTECTING VOLTAGE TRANSFORMERS

Bussed through-wall insulators for phase VT taps are to be furnished with lugs on the VT compartment side. Cable or bus conductor shall be furnished for the tap to the fuse carriage and to the VT compartment maintaining bare bus clearance. Mechanical lugs (equal to ILSCO TA-2) for #6 BARE copper wire shall be provided on the LOAD side of the fuse carriage connecting to the VTs. One (1) mechanical lug (equal to ILSCO TA-2) for #6 BARE copper wire shall be provided on the GROUND bus for connecting to the VTs. Conductors by SDG&E.

VOLTAGE TRANSFORMER FUSE SPECIFICATION

VT fuses shall be furnished and installed by the Utility. The manufacturer shall provide mounting clips for current limiting fuses with mounting clip separation and fuse ferrule diameter appropriate for the voltage rating of the equipment.

VOLTAGE TRANSFORMER DISCONNECT REQUIREMENTS

Key interlocking is required between the VT disconnect and the VT compartment door so that, for personnel safety, the VT compartment cannot be entered until the following conditions are met:

1. The disconnect is fully and visibly open.
2. When the VT disconnect is fully open, the disconnect blades must ground automatically.
3. Arcing horns are not permitted on no-load disconnect assemblies.
4. The disconnect is locked open with a key interlock system.
5. VT disconnect switch shall be pad-lockable in the closed position.
6. VT disconnect switch to be connected on line side of CTs.

The Utility requires the customer to provide TWO (2) SETS of INTERLOCK KEYS for Utility use prior to energizing the service. One of the keys will be retained by the Utility and one will remain with the service equipment. The key interlock system must prevent closing of the disconnect without first closing and locking the VT compartment door.

Primary contacts for the voltage disconnect shall be of the blade and jaw design or equivalent to ensure continued adequate contact. Wiping or pressure contact is not acceptable.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	Editorial Changes	JC	BRB	MDJ	07/16/15	E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
6 OF 7

SDG&E SERVICE STANDARDS & GUIDE

GENERAL INFORMATION

SG 603.6

As an alternative, the meter panel may be mounted in front of the CT compartment, provided that when the meter panel is opened, the compartment is fully isolated by a hinged barrier.

INSTRUMENT TRANSFORMER MOUNTING

Instrument Transformer Mounting specifications include Current Transformer (CT) Mounting Base and Voltage Transformer (VT) Mounting Rail Detail specifications.

CURRENT TRANSFORMERS & BUS LINK

Bus drilling and spacing shall accommodate 800 amp or less CTs of the proper voltage insulation class. CT center phase position shall be bussed straight through for 3-phase, 3-wire, service voltage installations with a removable link dimensioned the same as the CT bars on the metered phases.

FUSE SPECIFICATION

VT fuses shall be furnished and installed by the Utility. The manufacturer shall provide mounting clips for current limiting fuses with mounting clip separation and fuse ferrule diameter dimensions as indicated under Dimension H in the Enclosure Dimensions table on page SG 604.3.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	Editorial Changes	JC	BRB	MDJ	07/16/15	E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

**SHEET
7 OF 7**

SDG&E SERVICE STANDARDS & GUIDE

GENERAL INFORMATION

SG 603.7

This standard provides metering cubicle requirements. See Figures 1 and 2, with notes below. Continue to page SG 604.2 for Figures 3 and 4, with notes. Refer to Switchgear Underground Service Terminating Pull Section Standard on pages SG 608.1 – 608.3.

Metering Cubicle

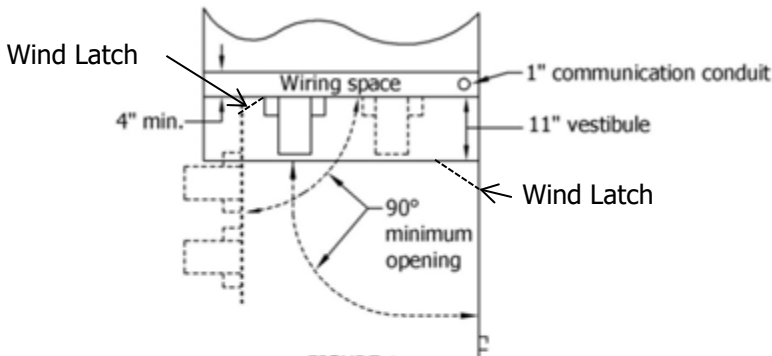


FIGURE 1
Top View

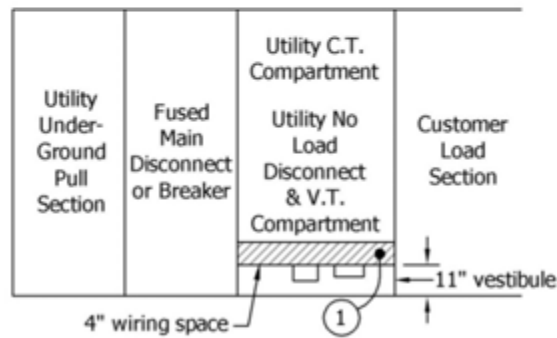


FIGURE 2
Plan View - Pad Layout

Note:

- ① The manufacturer shall install a 1" schedule 40 PVC communication conduit located from the meter compartment to the bottom of the VT compartment on the hinged side of the meter door in the switchgear.

The customer shall provide and install a minimum 1" schedule 40 PVC communication conduit from the switchgear to the communication point of connection service, e.g., Main Point of Entry (MPOE) or Private Branch Exchange (PBX) location.

The customer shall provide and install a 1" liquid-tight non-metallic flexible conduit to connect switchgear PVC conduit.

Consult with the Utility before the installation of the communication conduit. Refer to Metering Communications on page SG 525 for additional requirements.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	No Changes-Reaffirmed	JC	BRB	MDJ	07/16/15	E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------


SHEET
1 OF 6

SDG&E SERVICE STANDARDS & GUIDE

MEDIUM-VOLTAGE METERING CUBICLE

SG 604.1

Metering Cubicle

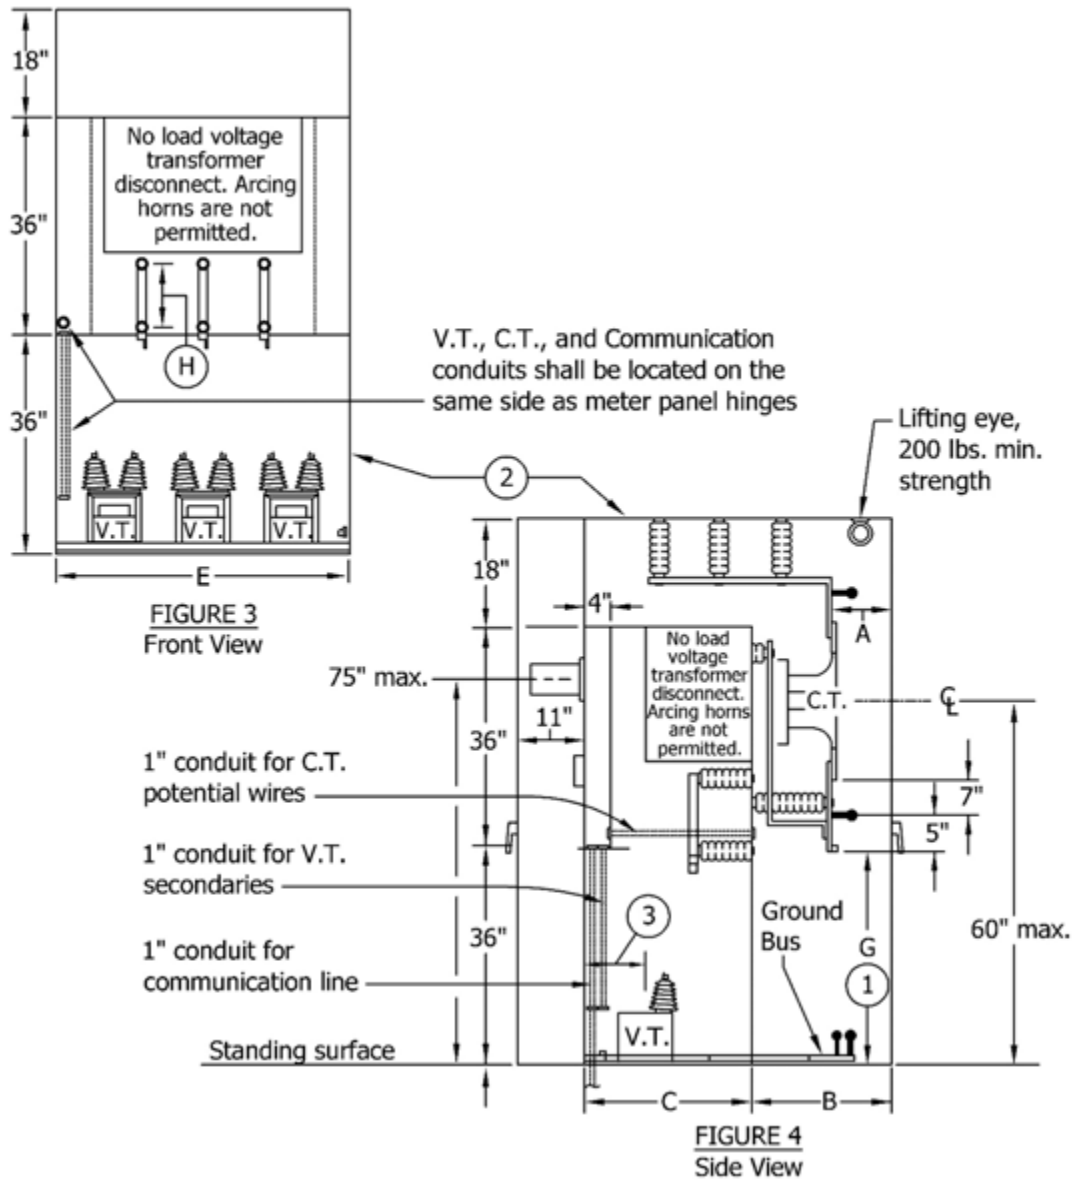

Notes:

- ① Not a cable termination section.
- ② See Enclosure Dimensions Table on page SG 604.3.
- ③ See page SG 607.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	No Changes-Reaffirmed	JC	BRB	MDJ	07/16/15	E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
2 OF 6

SDG&E SERVICE STANDARDS & GUIDE

MEDIUM-VOLTAGE METERING CUBICLE

SG 604.2

ENCLOSURE DIMENSIONS

The table below provides dimensions for enclosures. The dimensions are referenced in the illustrations on page SG 604.2.

Enclosure Dimensions Table

Specifications	Voltage Rating	
	4160V	7200/1200V
Minimum Bare Bus Clearance Ø to Ground	3-1/2"	6"
Minimum Bare Bus Clearance Ø to Ø	5"	7-1/2"
Dimension A	5" min. 10" max.	5" min. 10" max.
Dimension B	24" min.	24" min.
Dimension C	24" min.	24" min.
Dimension E	60" min.	60" min.
Dimension G – Not a Cable Termination Section	36" min.	36" min.
Dimension H Fuse Mounting Clip Center	8-1/2"	11-1/2"
Dimension H Fuse Ferrule Diameter	1-5/8"	1-5/8"

Notes:

1. Dimensions D and F have been removed from the table in this edition of the Service Standards & Guide. All service equipment shall be considered 3-phase, 4-wire service.
2. The neutral conductor shall be terminated in a bushing-mounted mechanical lug in the pull section.
3. The bushing is connected to a neutral bus extended to the main service breaker or fused switch section. In an accessible area behind the breaker or fused switch, the neutral bus shall have a removable jumper link for testing and a disconnect bonding link to the ground bus and labeled as such.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	No Changes-Reaffirmed	JC	BRB	MDJ	07/16/15	E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------


SHEET
3 OF 6

SDG&E SERVICE STANDARDS & GUIDE

MEDIUM-VOLTAGE METERING CUBICLE

SG 604.3

Meter Panel Layout

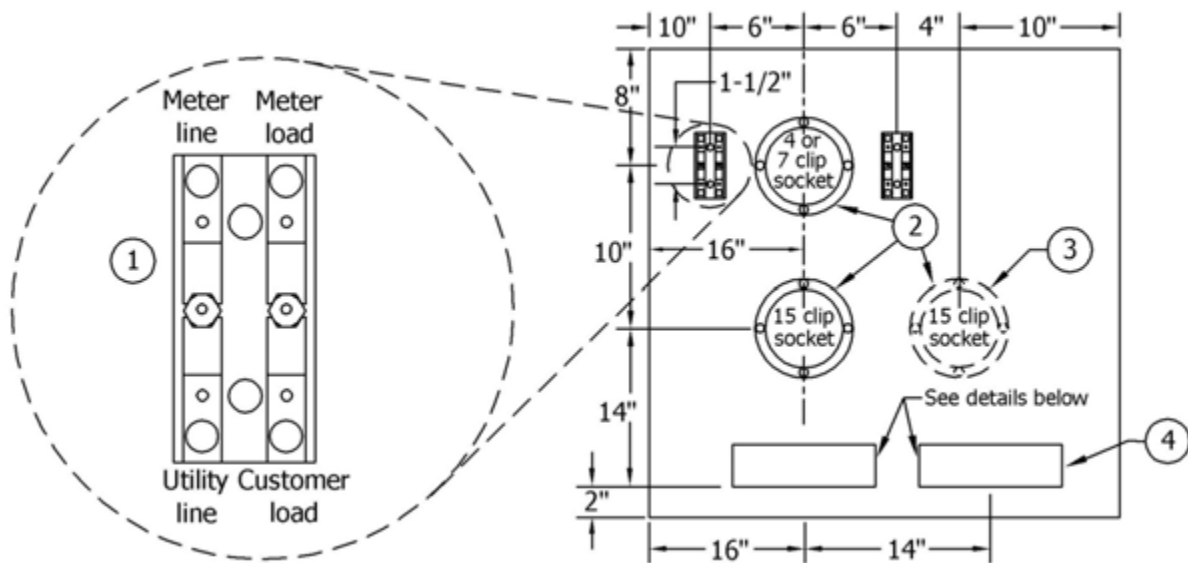

Notes:

- ① Test-bypass blocks supplied by manufacturer and mounted on back side of door. See Test-Bypass Facilities on page SG 513.2 and Control Power Transformer (CPT) Meter Wiring Diagram on page SG 605.
- ② Provide ring meter sockets with number of clips as indicated.
- ③ This meter socket is a requirement when California Independent System Operator (ISO) metering is required. Consult with SDG&E Service Standards.
- ④ Customer to provide blank plate for second test switch location.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	No Changes-Reaffirmed	JC	BRB	MDJ	07/16/15	E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
4 OF 6

SDG&E SERVICE STANDARDS & GUIDE

MEDIUM-VOLTAGE METERING CUBICLE

SG 604.4

Test Switch Layout

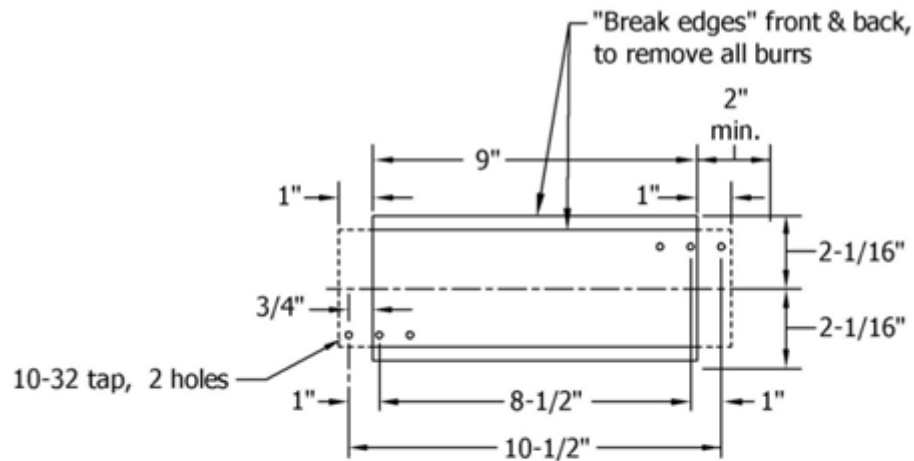


FIGURE 1

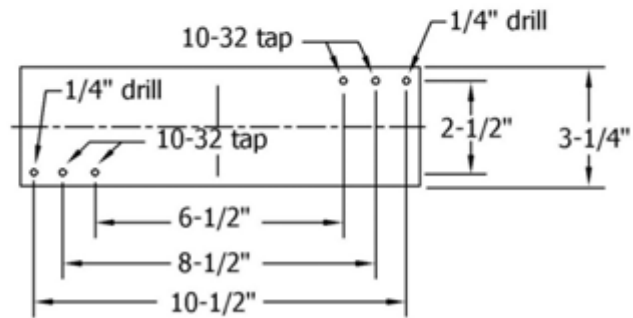


FIGURE 2
Removable Plate Detail

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	No Changes-Reaffirmed	JC	BRB	MDJ	07/16/15	E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
5 OF 6


SDG&E SERVICE STANDARDS & GUIDE

MEDIUM-VOLTAGE METERING CUBICLE

SG 604.5

THIS PAGE IS FOR FIELD MAINTENANCE ONLY

Meter Panel Layout

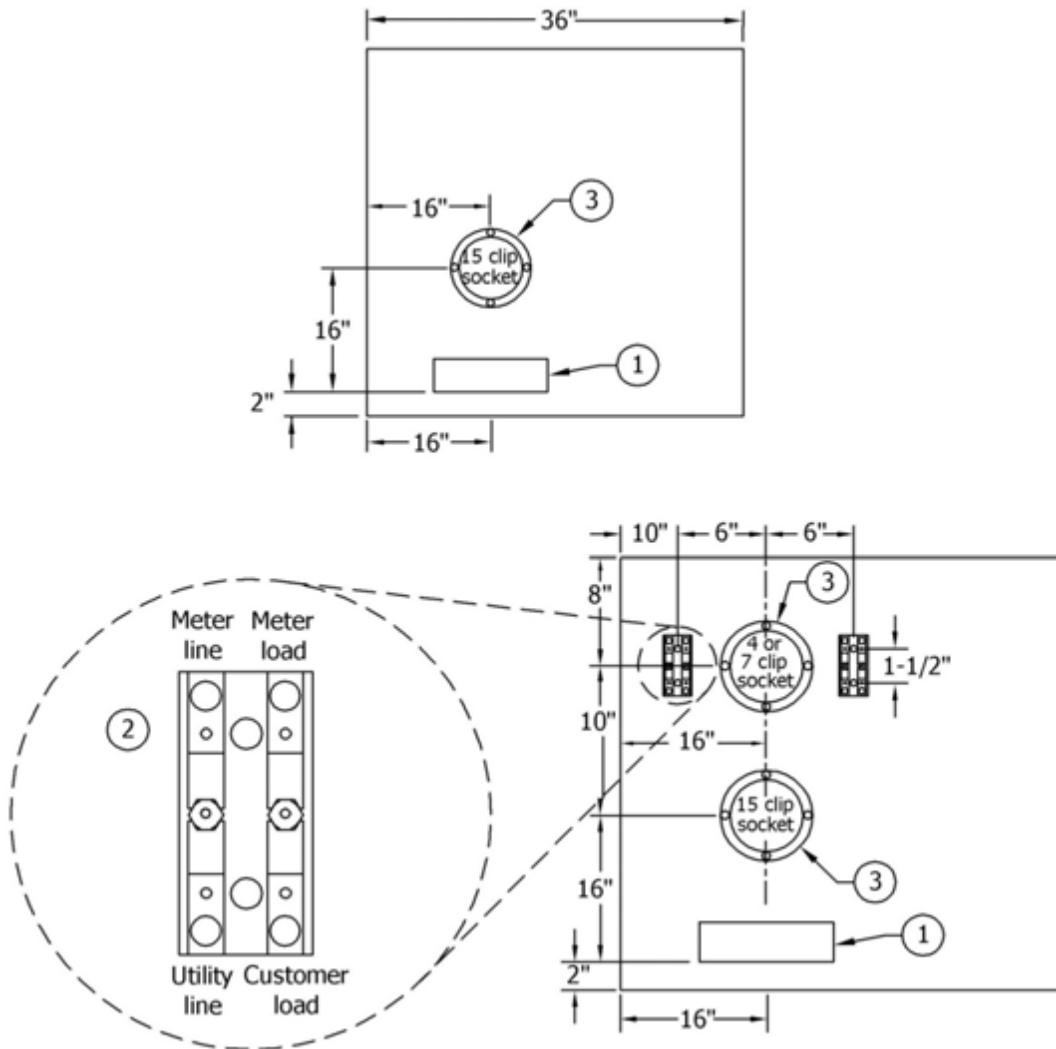

Notes:

- ① Refer to Test Switch Layout specifications on page SG 604.5.
- ② Test-bypass blocks supplied by manufacturer and mounted on inside of meter panel. See Test-Bypass Facilities on page SG 513.2 and Control Power Transformer (CPT) Meter Wiring Diagram on page SG 605.
- ③ Provide ring meter sockets with number of clips as indicated.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	No Changes-Reaffirmed	JC	BRB	MDJ	07/16/15	E					
C						F					


X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
6 OF 6

SDG&E SERVICE STANDARDS & GUIDE

MEDIUM-VOLTAGE METERING CUBICLE

SG 604.6

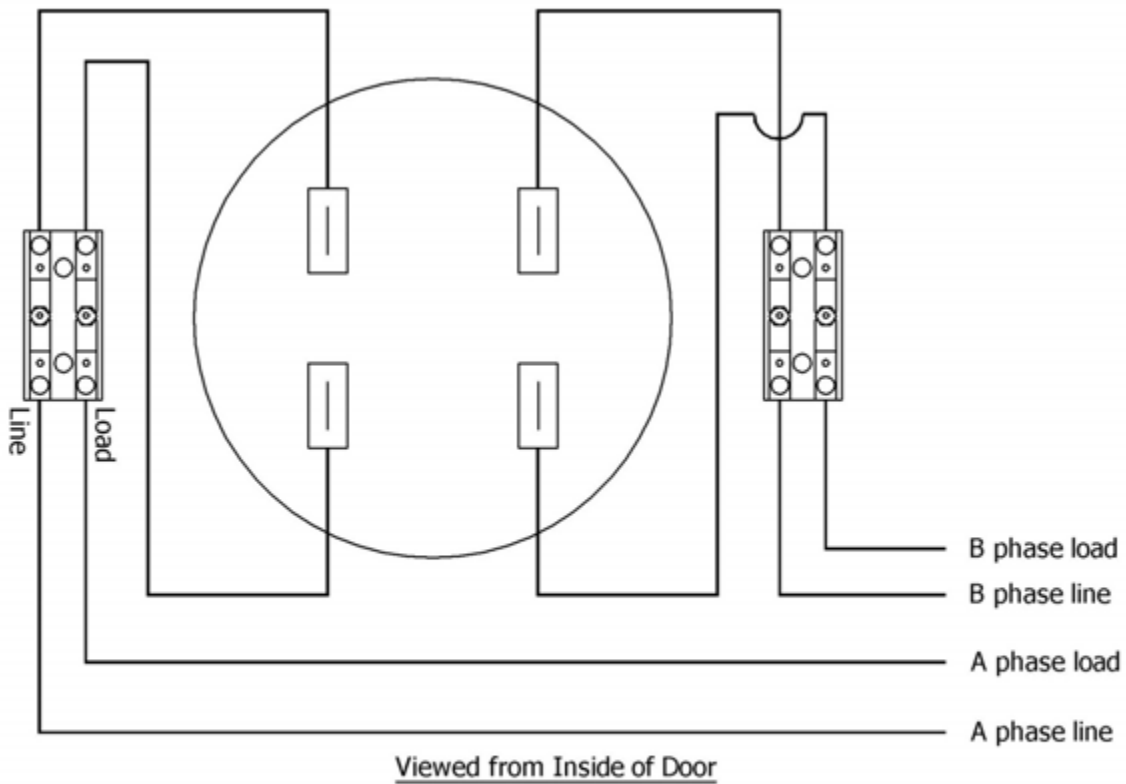

Control Power Transformer (CPT) Meter
Wiring Diagram

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	No Changes-Reaffirmed	JC	BRB	MDJ	07/16/15	E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed


SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

CONTROL POWER TRANSFORMER METERING

SG 605

This standard provides indoor current transformer dimensions for 5kV through 15kV metering purposes.

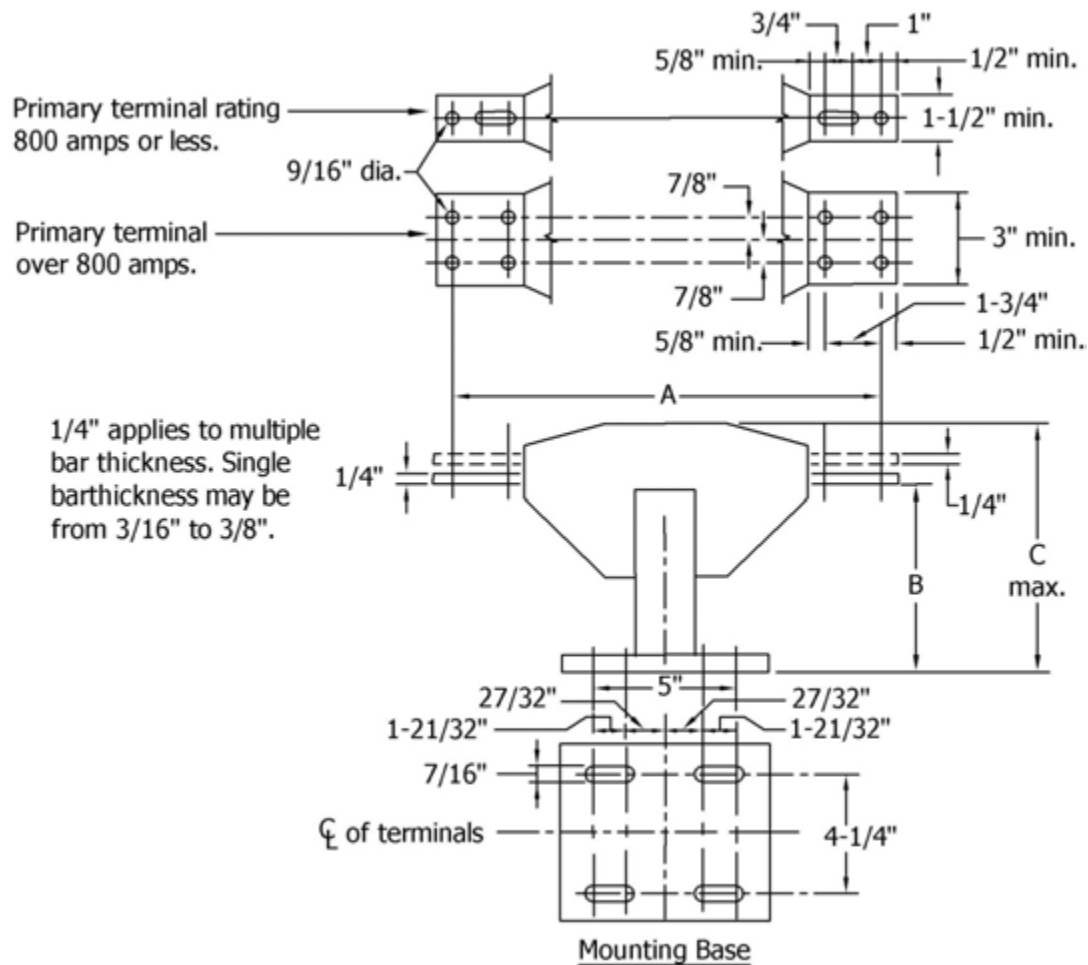

Note: Insulation classes are 5, 8.7 and 15kV. Basic Lightning Impulse Insulation Levels (BILs) for these classes are 60, 75 and 110kV, respectively.

Insulation Class kV	Dimensions (Inches)					
	"A"		"B"		"C" (Maximum)	
	Amps		Amps		Amps	
	10 – 800	1,200-2,000*	10 – 800	1,200-2,000*	10 – 800	1,200-2,000*
5.0	14	---	5-3/4	---	8	---
8.7	15	---	8	---	10-1/2	---
15.0	22	26	9	5-3/4	11-1/4	13

Unless otherwise indicated, tolerance plus or minus 1/16".

* Consult with SDG&E Service Standards before constructing.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	No Changes-Reaffirmed	JC	BRB	MDJ	07/16/15	E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed


SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

INDOOR CURRENT TRANSFORMER DIMENSIONS


SG 606

This standard provides specifications for instrument transformer mounting in medium-voltage metering enclosures.

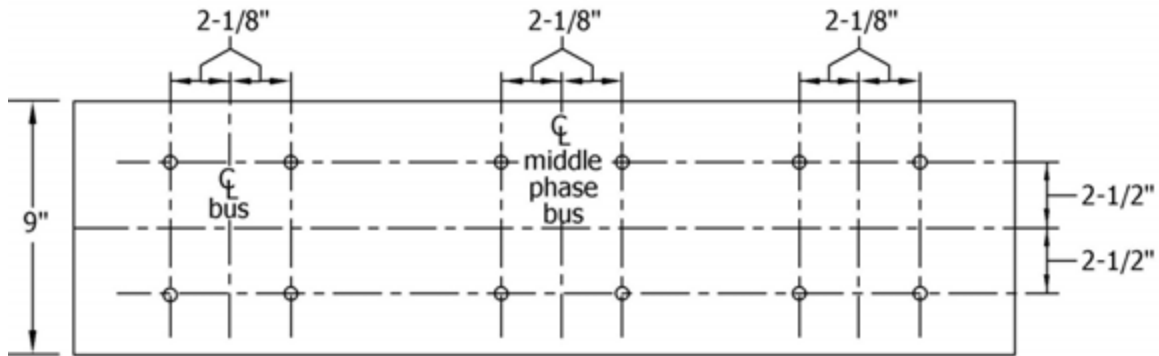


CURRENT TRANSFORMER MOUNTING BASE

Note: All holes tap 3/8"-16

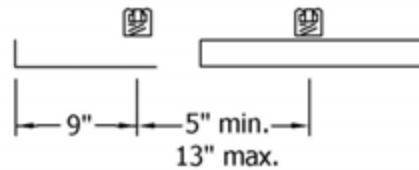

P1000 Unistrut (or equivalent) channel (Typical)

P1008 3/8"-16 nut.
Typical 6 each channel

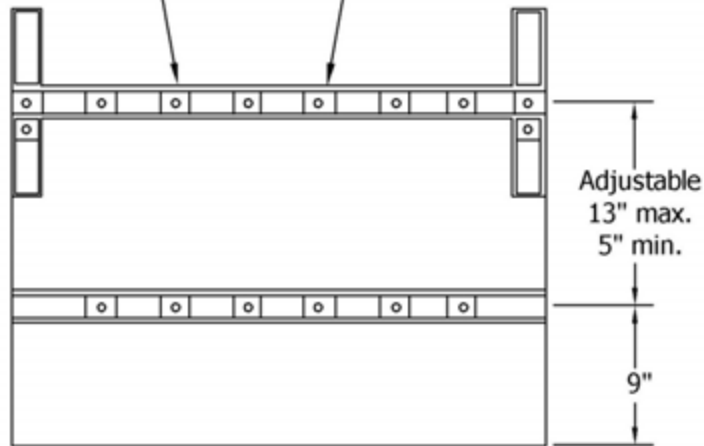

Top View Of Cabinet

VOLTAGE TRANSFORMER MOUNTING RAIL DETAIL

© 1998-2016 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	No Changes-Reaffirmed	JC	BRB	MDJ	07/16/15	E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

INSTRUMENT TRANSFORMER MOUNTING SPECIFICATIONS


SG 607

This standard provides requirements for switchgear Underground service terminating Pull Sections (UGPS) in the SDG&E (Utility) service territory. This standard applies to the following voltages:

- 5 kV Class: 4,160 Volts, 3-wire and 4-wire services
- 15 kV Class: 6,900 to 15,000 Volts, 3-wire and 4-wire services

Minimum bare bus clearances:

1. 5 kV Class: 3-½" Ø to ground, 5" Ø to Ø
2. 15 kV Class: 6" Ø to ground, 7-½" Ø to Ø

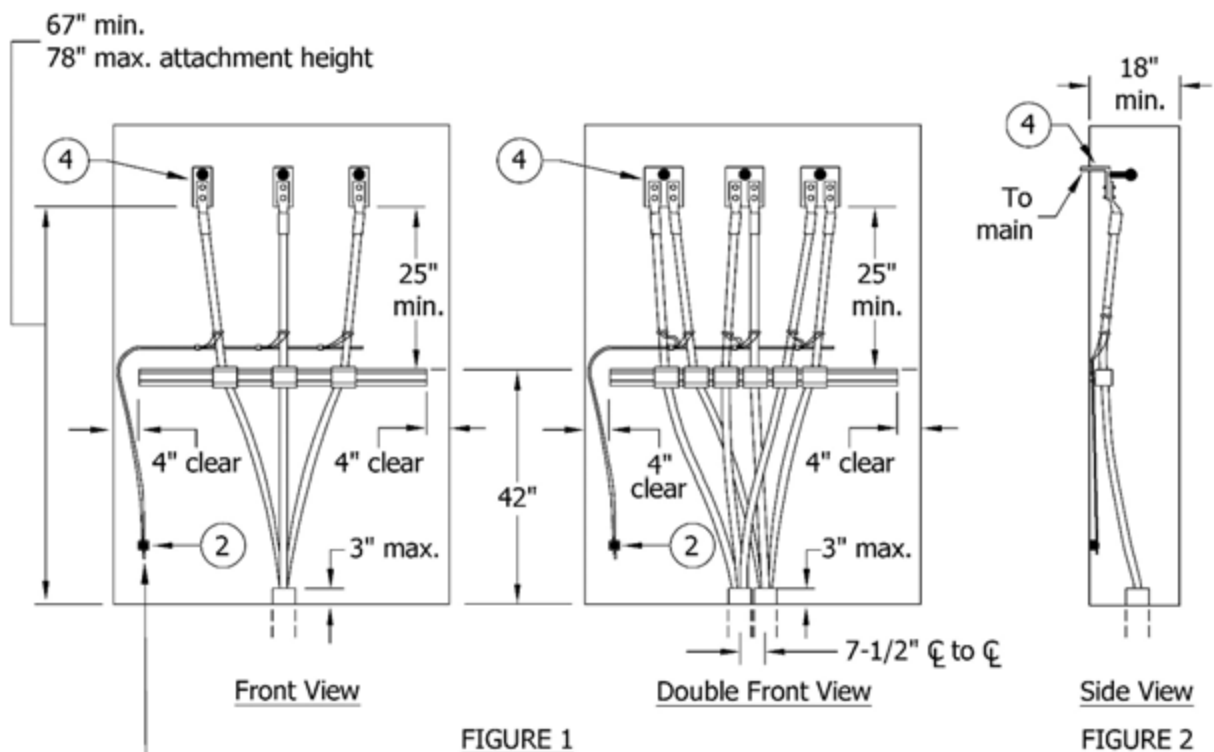

Terminate concentric neutral
on neutral lug for 4-wire
services, and on the ground
lug for 3-wire services.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	Editorial Changes	JC	BRB	MDJ	07/16/15	E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 3

SDG&E SERVICE STANDARDS & GUIDE

SWITCHGEAR UNDERGROUND SERVICE TERMINATING PULL SECTION

SG 608.1

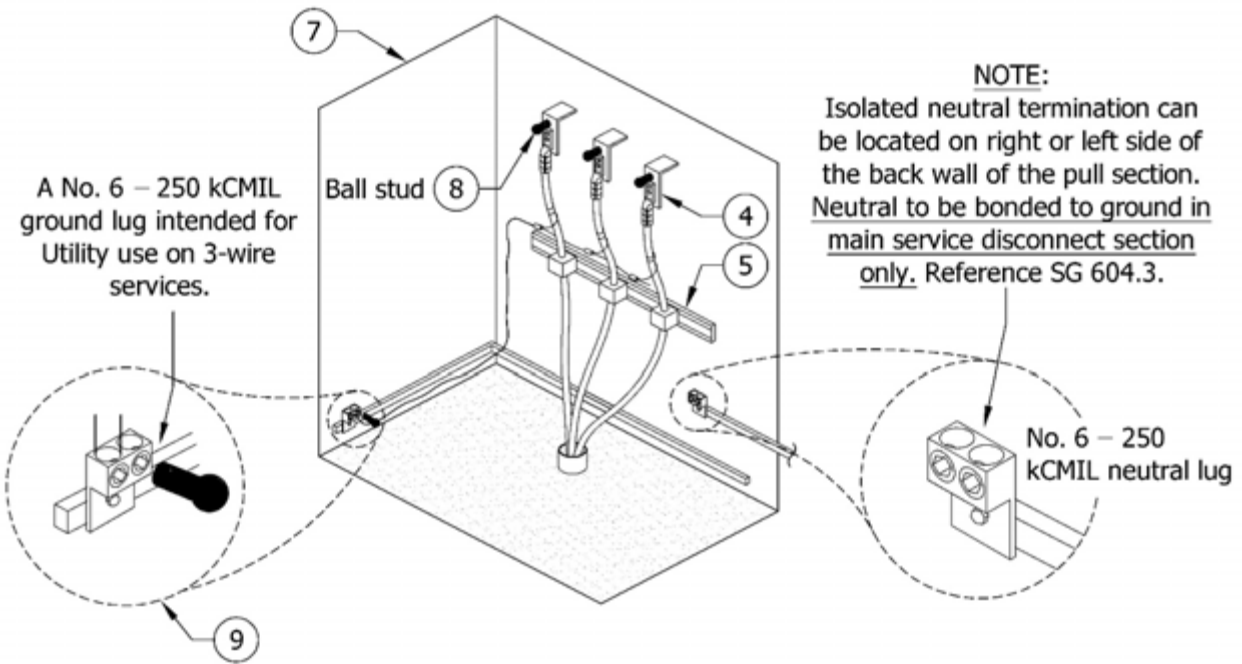


FIGURE 3

Notes:

1. Consult with the Utility for the number of service cables, number, size and location of service conduits, and type of switchgear service terminating UGPS required.
- ② Consult with the Utility to determine if the service is to be 3-wire or 4-wire (3 phases and a neutral) and if an insulated neutral landing with a range No. 6 – 250 kCMIL is required.
3. The removable enclosing panels shall normally be front or back. Removable panels shall be equipped with two lifting handles and attached with studs and wing nuts. Panel cover shall not exceed 9 square feet. Consult with SDG&E Service Standards for special permission to locate the removable enclosing panels on the side. If the removable enclosing panels are located on the side, a 12" minimum access distance to busses shall be provided, measured from the busses to the panels, with the panels in place. The UGPS may be required to be equipped with hinged full opening, sealable access doors, with padlock provisions.
- ④ Manufacturer to provide the standard NEMA two-hole drilling pattern for holes on terminating bus. Consult the Utility for the number of landing positions required per phase. The Utility will provide the necessary terminating bolts.
- ⑤ Furnish and install one (1) piece of structural support system equal to Unistrut P1000 as shown.
6. The Basic Lightning Impulse Insulation Level (BIL) rating for the UGPS shall be not less than the BIL rating of the customer's associated switchgear.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	Editorial Changes	JC	BRB	MDJ	07/16/15	E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

**SHEET
2 OF 3**

SDG&E SERVICE STANDARDS & GUIDE

**SWITCHGEAR UNDERGROUND SERVICE
TERMINATING PULL SECTION**

SG 608.2

- ⑦ No customer connections or customer equipment are permitted in the UGPS where the Utility terminates its conductors.
- ⑧ Grounding ball stud 1/2-13 thread, with insulating cover. The ball stud provides a place for Utility medium-voltage workers to test and ground service equipment. Locate the ball stud on the Utility landing position flag.
- ⑨ The ground bus in the rear of the UGPS is to be extended to the front left or right side. Grounding termination devices for Utility grounding and bonding shall be aluminum-bodied mechanical lugs with a range of No. 6 – 250 kCMIL.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	Editorial Changes	JC	BRB	MDJ	07/16/15	E					
C						F					

X	Indicates Latest Revision	Completely Revised	New Page	Information Removed
----------	---------------------------	--------------------	----------	---------------------


SHEET
3 OF 3

SDG&E SERVICE STANDARDS & GUIDE

**SWITCHGEAR UNDERGROUND SERVICE
TERMINATING PULL SECTION**

SG 608.3

SCOPE: This standard provides guidelines for the connection of SDG&E's 12kV distribution system to a primary metered service point for a 600 volt direct current (DC) trolley traction station.

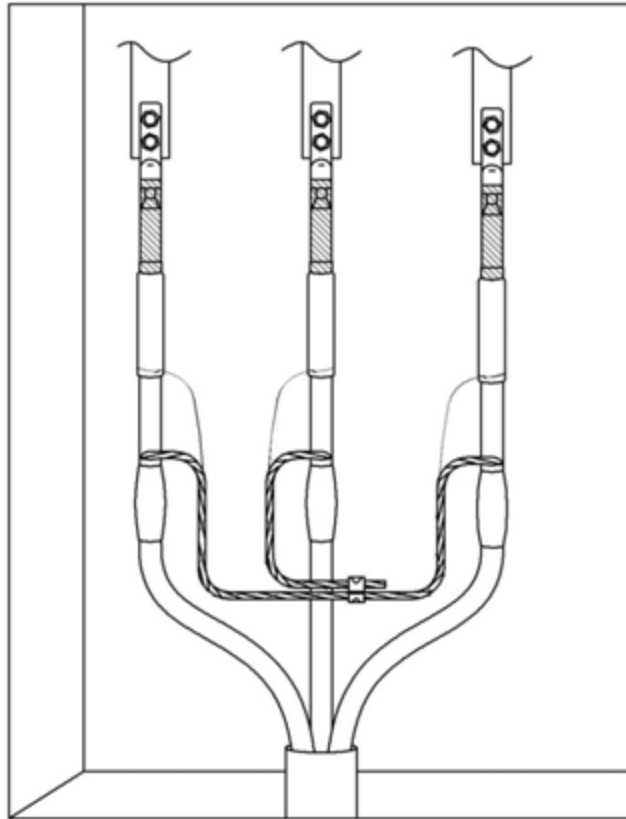

The following requirements shall be met when making this connection:

1. SDG&E (Utility) shall locate its substructure as close as practicable to the customer's ground grid but in no case shall the substructure be in contact with the customer's ground grid (grounding electrode system).
2. The concentric neutrals from the Utility's cable shall not be connected to the customer's equipment.
3. The cable termination in the customer's switchgear cabinet shall be a live-front delta connection.
4. All requirements of the Switchboard Underground Service Terminating Pull Section standard, on pages SG 608.1 – 608.3, shall be met, except as modified by this standard as it pertains to serving voltage and grounding and bonding of the system.

Reference SG 608.1 – 608.3, SPM 254 & UG 4705.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

**12KV SERVICE POINT CONNECTION FOR
TROLLEY TRACTION STATION**

SG 609

**700 - ELECTRIC
TERMINATING
ENCLOSURES, 0-600V**

**700 - ELECTRIC
TERMINATING
ENCLOSURES, 0-600V**

SUBJECTPAGE #

Cable Termination Bus Stubs in Underground Pull Cans or Pull Sections	SG 709.1 – 709.3
Conductor Identification	SG 703
General Information	SG 703
Grounding Electrode, Grounding Electrode Conductor.....	SG 703, SG 706.2
Line Truck Access	SG 703
Location	SG 703
Overhead Service Terminating Enclosure, Standard Switchboard Service Section	SG 704
Phase Arrangement.....	SG 703
Residential Single-Phase Multi-Meter Stack "Special Application"	SG 707.1 – 707.2
Underground Pull Can with Cable Termination Bus Stubs.....	SG 706.1 – 706.2
Underground Pull Can, with or without Mechanical Lugs	SG 705.1 – 705.4
Underground Service Pull Can, with Mechanical Lugs	SG 705.3 – 705.4
Underground Service Pull Can, without Mechanical Lugs.....	SG 705.1 – 705.2
Underground Pull Section, 0-600 Volts.....	SG 708.1 – 708.2

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 1	Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	<input type="checkbox"/> New Page	<input type="checkbox"/> Information Removed	SG 702
	SDG&E SERVICE STANDARDS & GUIDE				
	ELECTRIC TERMINATING ENCLOSURES, 0 – 600 VOLTS ALPHABETICAL SUBJECT INDEX				

SDG&E (Utility) will pull and terminate its service lateral conductors directly to the customer-furnished service termination facilities which consist of a free standing Underground Pull Section (UGPS) or a wall-mounted underground pull can. No other method of termination in an enclosure is acceptable.

Terminating enclosures may be remote from the metering section; consult the Utility and the appropriate governmental Authority Having Jurisdiction (AHJ) for limitations. See pages SG 016.1 – 016.2 for an alternative to line truck access to terminating enclosures.

A UGPS may not come in contact with the earth and must be located on a suitable foundation or slab.

The grounding electrode and/or the grounding electrode conductor are not to be permitted within the Utility portion of the underground pull can or pull section. The covers are sealed by the Utility and not readily accessible for the AHJ to inspect. For exception, see page SG 706.2, Note 3.

CONDUCTOR IDENTIFICATION

Equipment Grounding Conductors: Green, or green with one or more yellow stripes.

Grounded Conductors: White or gray in color.

High Leg Marking: 4-wire, delta-connected service where the midpoint of one phase is grounded, the service entrance conductor having the higher phase-to-ground voltage (208-volts) shall be marked orange in color.

Grounded Phase Conductor: 3-wire, delta-connected service where "B" phase is corner-grounded, B phase shall be marked red in color.

Ungrounded Conductors: Color other than white, gray, green or orange if color markings are used.

PHASE ARRANGEMENT

The phase arrangement shall be "ABC" front to back, top to bottom, or left to right as viewed from the front of the terminating enclosure and in switchboards.

On a three-phase, 4-wire, 120/240-volt delta-connected service, the high leg shall be in the "C" phase position only. See High Leg Marking identification requirements above.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B	Editorial Changes	JC	BRB	MDJ	08/26/15	E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------

SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

GENERAL INFORMATION

SG 703

STANDARD SWITCHBOARD SERVICE SECTION, 0 – 600 VOLTS

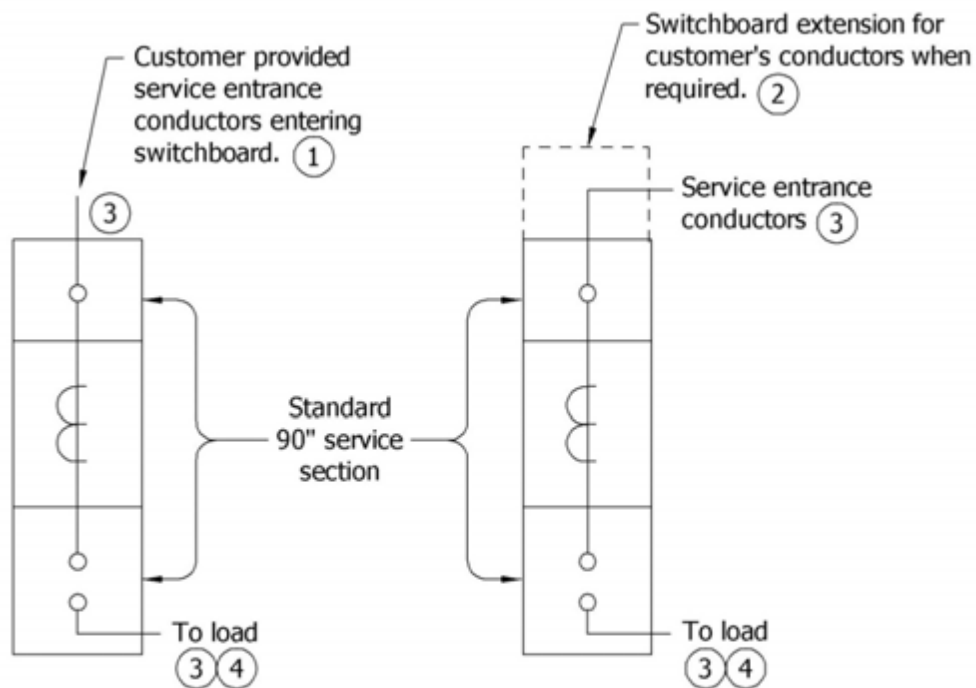


FIGURE 1

FIGURE 2

Notes:

- ① The service entrance conductors as shown in Figure 1, either cable or bus bar, are furnished and installed by the customer in the following manner:
 - a. When switchboards are served through bus bar conductors, the conductors shall enter through the top, or at the side or back in the upper 10" section.
 - b. When switchboards are served through cable conductors (800 amps maximum), the service entrance conductors shall enter through the top of the switchboard only as shown in Figure 1.
- ② When the customer requires incoming conduits from the side or rear for the service entrance conductors, an extension as shown in Figure 2 may be used.
- ③ The direction of feed is from top to bottom in the standard switchboard service section. Load conductors shall leave below the main switch or breaker, and may not be routed back through the Current Transformer (CT) compartment in order to exit the service section.
- ④ The grounding connections shall be made in the main switch or breaker compartment.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

**SHEET
1 OF 1**

SDG&E SERVICE STANDARDS & GUIDE

OVERHEAD SERVICE TERMINATING ENCLOSURE

SG 704

This standard provides the requirements for underground pull cans with or without mechanical lugs for cable termination.

1. Underground Service Pull Can without Mechanical Lugs

SDG&E (Utility) accepts underground pull cans rated 0 – 600 volts, 0 – 400 amps maximum, without mechanical lugs for residential or commercial/industrial service provided the requirements of this standard are met. Pull cans are required to be wall-mounted.

- a. Pull cans shall be readily accessible and located in conformance with the requirements for electric meters. Refer to pages SG 504.1 – 504.5.
- b. Pull cans of this type are used to pull and splice connection of the Utility's service lateral conductors to customer-owned service entrance conductors. The service entrance conduit must exit from the top or within 2" of the top of the pull can. Customer shall provide enough wire to reach the bottom of the pull can.
- c. Pull cans without mechanical lugs may only be used when all of the following requirements are met:
 - i. Service equipment ampacity rating and the size of the customer's conductors do not exceed the values shown in Table 1.
 - ii. Not more than one conductor per phase and neutral of customer service entrance conductors are installed.
 - iii. The Utility's service lateral conductors do not exceed 1 run of 3/C or 4/C No. 500 kCMIL.

When all of the above conditions cannot be met, refer to pages SG 705.3 – 705.4 for a pull can with mechanical lugs.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------

SHEET
1 OF 4

SDG&E SERVICE STANDARDS & GUIDE

**UNDERGROUND PULL CAN
WITH OR WITHOUT MECHANICAL LUGS**

SG 705.1

Underground Service Pull Can without Mechanical Lugs

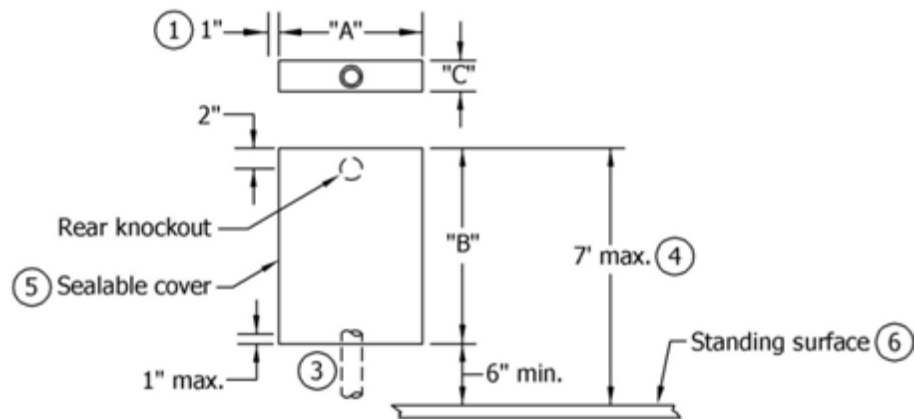


TABLE 1

Type of Service	Customer-Installed		Maximum Size for Customer-Installed Service Lateral Conduit 3W or 4W Service	Minimum Pull Can Dimensions Residential or Commercial		
	Service Equipment Ampacity	Service Entrance Conductors Max. Wire Size		"A"	"B"	"C"
Commercial	0 – 100	#3/0	3" Single-Phase or Three-Phase ②	10"	12"	4"
Residential	0 – 125			6"	18"	
Commercial	101 – 200	#250 kCMIL	3" Single-Phase or Three-Phase ②	12"	18"	6"
Residential	126 – 225			12"	18"	
Commercial	201 – 400	#500 kCMIL	3" Single-Phase or 4" Three-Phase	18"	24"	8"
Residential	226 – 400			18"	24"	

Notes:

- ① 1" side clearance is required to any side wall, equipment or obstruction. Any projection which extends more than the depth of the pull can from the surface on which the pull can is mounted shall be considered an obstruction.
- ② See page SG 309.3, Note C, for 3" conduit exception.
- ③ Service lateral conduit must be firmly secured to pull can with lock nut, hub or bushing and must enter the bottom of the pull can. Maximum conduit intrusion inside can is 1".
- ④ Exception to the 7' maximum mounting height may be granted due to special conditions. Consult with the Utility.
- ⑤ Pull can covers shall be removable and sealable. See page SG 503 for sealing requirements.
- ⑥ 3' x 3' clear and level working space required in front of pull can. See pages SG 504.4 – 504.5 for additional working space clearance requirements.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
2 OF 4

SDG&E SERVICE STANDARDS & GUIDE

UNDERGROUND PULL CAN WITH OR WITHOUT MECHANICAL LUGS

SG 705.2

2. Underground Service Pull Can With Mechanical Lugs

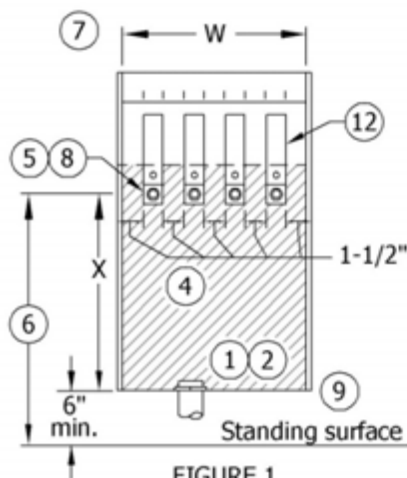


FIGURE 1
Front View

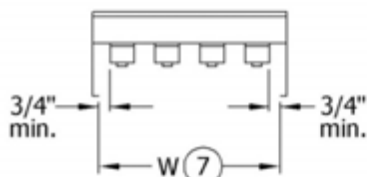


FIGURE 3
Top View



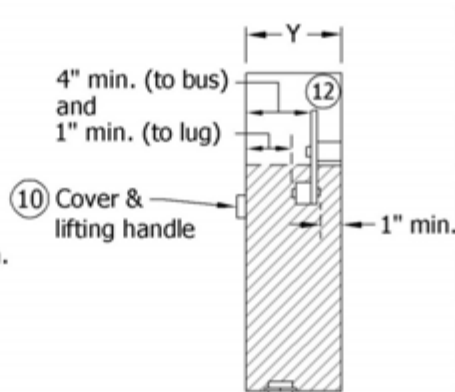


FIGURE 2
Side View

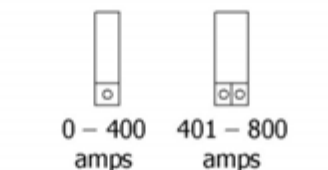

Mechanical Lug Arrangement
for Terminating Facilities

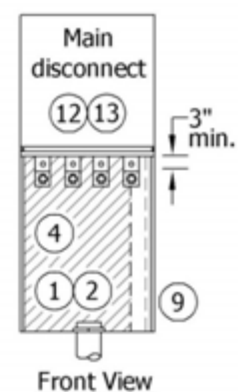

Front View




FIGURE 4
Combination
Underground Pull and
Disconnect Can

The Utility accepts underground pull cans rated 0 – 600 volts, 0 – 800 amps maximum, with mechanical lugs for cable termination for residential or commercial/industrial service provided the requirements of this standard are met. Pull cans are required to be wall-mounted.

TABLE 2

Minimum Pull Can Dimensions				
Service Ampacity	"W" Width		"X" Lug	"Y" Depth
	3W	4W		
0 – 200*	10"	14"	11"	6"
201 – 400	10"	14"	22"	6"
401 – 800	16"	22"	26"	11"

* 225 amps for residential service equipment

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
3 OF 4

SDG&E SERVICE STANDARDS & GUIDE
**UNDERGROUND PULL CAN
WITH OR WITHOUT MECHANICAL LUGS**

SG 705.3

Notes:

- ① Service lateral conduits, firmly secured with a locknut, hub or bushing, must enter bottom of pull can. Maximum conduit intrusion inside pull can is 1". Load conduits must exit above shaded area. See pages SG 309.1 – 309.3 for service lateral conduit requirements.
 - ② Bonding connection for service lateral conduits only is permitted at bottom of can. Any other bonding or grounding connection must be made above the shaded area and no grounding or bonding conductor is permitted to pass through shaded area.
 - ③ In the combination underground pull and disconnect can (see Figure 4) the grounding electrode conductor or bond jumper may be installed in a fully enclosed, factory-installed wireway (2" x 2" maximum) located in either back corner of the pull can area (see Figure 4 Bottom View). The raceway may not impede the required working space or reduce any specific clearances.
 - ④ Shaded area is for Utility service lateral conductor only. See Note 2 for exception.
 - ⑤ Terminating facilities for Utility's service lateral conductors shall be aluminum-bodied mechanical lugs with a range accepting one No. 4 AWG through 500 kCMIL conductor. One lug shall be provided for terminations rated up to 400 amps and 2 lugs for terminations rated 401-800 amps. Refer to page SG 707.2 Note 3 for exception that allows a single lug for 600 ampere special application.
 - ⑥ Maximum height from standing surface to centerline of mechanical lug is 60". Utility may approve greater height due to special circumstances. Consult with the Utility.
 - ⑦ Dimension "W" is the minimum width of the pull can access opening and is measured between the left side and right side return flanges; not interior walls of pull can.
 - ⑧ When viewed from front of pull can, return flanges shall not extend closer than ¾" from the outside edge of mechanical lug.
 - ⑨ 1" minimum side clearance is required from side of pull can to any other equipment or obstruction.
 - ⑩ All pull cans shall have full front access. Cover panels shall be removable, sealable, provided with two lifting handles, and limited to a maximum of 9 square feet in area. Sealing provisions shall consist of two drilled stud and wing-nut assemblies on opposite sides of the panel. See page SG 503 for sealing requirements. A minimum of 4" is required from the bus to the inside of the panel cover and 1" minimum from the bolt termination to the inside of the panel cover.
11. See page SG 703 for conductor identification and phase arrangement.
- ⑫ In pull cans rated 0 – 800 amps, either bus bar or cable connections may be used from the top of the cable termination bus to serve a Current Transformer (CT) compartment, a single main disconnect, and multiple main disconnects.
 - ⑬ A main service or meter service disconnect is not permitted on the supply (line) side of a single meter.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------

**SHEET
4 OF 4**

SDG&E SERVICE STANDARDS & GUIDE

**UNDERGROUND PULL CAN
WITH OR WITHOUT MECHANICAL LUGS**

SG 705.4

This standard provides the requirements for underground pull cans with cable termination bus stubs. SDG&E (Utility) accepts underground pull cans rated 0 – 600 volts, 801 – 1,200 amps maximum, with cable termination bus stubs for residential or commercial/industrial service provided the requirements of this standard are met. Pull cans are required to be wall-mounted.

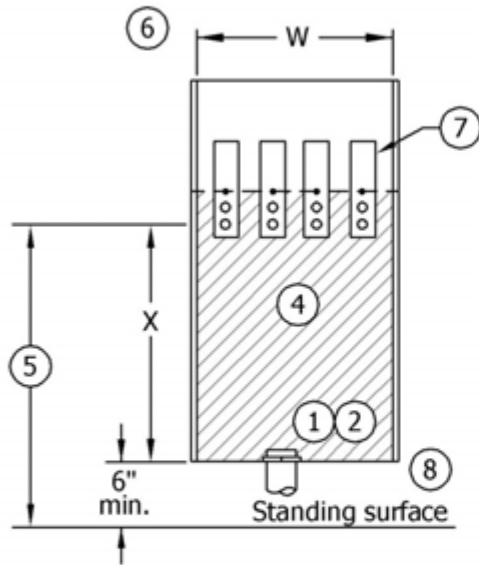


FIGURE 1
Front View

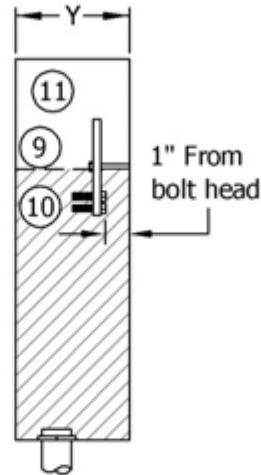


FIGURE 2
Side View

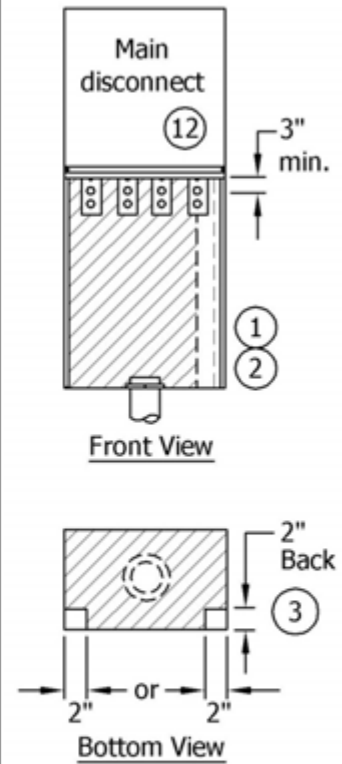


FIGURE 3
Combination
Underground Pull and
Disconnect Can

Minimum Pull Can Dimensions				
Service Ampacity	"W" Width		"X" Lug	"Y" Depth
	3W	4W		
801 – 1,200	---	30"	26"	11"

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 2

SDG&E SERVICE STANDARDS & GUIDE

**UNDERGROUND PULL CAN
WITH CABLE TERMINATION BUS STUBS**

SG 706.1

Notes:

- ① Service lateral conduits, firmly secured with locknut, hub, or bushing, must enter bottom of pull can. Maximum conduit intrusion inside pull can is 1". Load conduits must exit above shaded area. See pages SG 309.1 – 309.3 for service lateral conduit requirements.
- ② Bonding connection for service lateral conduits only is permitted at bottom of can. Any other bonding or grounding connection must be made above the shaded area and no grounding or bonding conductor is permitted to pass through the shaded area.
- ③ In the combination underground pull and disconnect can (see Figure 3) the grounding electrode conductor or bond jumper may be installed in a fully enclosed, factory-installed wireway (2" x 2" maximum) located in either back corner of the pull can area (see Figure 3, Bottom View). The raceway may not impede the required working space or reduce any specified clearances.
- ④ Shaded area is for Utility service lateral conductor only. See Note 2 for exception.
- ⑤ Maximum height from standing surface to centerline of lowest termination bolt is 60". Utility may approve greater height due to special circumstances. Consult with the Utility. 3' x 3' clear and level working space is required in front of the pull can. See pages SG 504.4 – 504.5 for additional working space clearance requirements.
- ⑥ Dimension "W" is the minimum width of the pull can access opening and is measured between the left side and right side return flanges; not the interior walls of the pull can.
- ⑦ When viewed from front of pull can, return flanges shall not extend past the outside edge of bus stub.
- ⑧ 1" minimum side clearance is required from side of pull can to any other equipment or obstruction.
- ⑨ All pull cans shall have full front access. Cover panels shall be removable, sealable, provided with two lifting handles, and limited to a maximum of 9 square feet in area. Sealing provisions shall consist of two drilled stud and wing-nut assemblies on opposite sides of the panel. See page SG 503 for sealing requirements. A minimum of 4" is required from the bus to the inside of the panel cover and 1" minimum from the bolt termination to the inside of the panel cover.
- ⑩ See page SG 703 for conductor identification and phase arrangement. See pages SG 709.1 – 709.3 for bus and bolt details.
- ⑪ In pull cans rated 801 – 1,200 amps, bus bar connections are required from the top of the cable termination bus stubs to serve a Current Transformer (CT) compartment. The reason for requiring bus bar connections is large cable will quite often pull the CT busses out of their vertical alignment, making it difficult or impossible to mount the CTs. Bus bars are not required to serve a main disconnect.
- ⑫ A main service or meter service disconnect is not permitted on the supply (line) side of a single meter.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 2	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 706.2
	SDG&E SERVICE STANDARDS & GUIDE					
	UNDERGROUND PULL CAN WITH CABLE TERMINATION BUS STUBS					

Special Application

This standard provides the requirements for a factory-manufactured pull can and meter stack(s) for residential multi-family occupancy only, rated 600 amps maximum, single-phase, 3-wire, 120/208 volts or 120/240 volts, with 6 meters maximum. This equipment is required to be wall-mounted. This standard does not apply to field installed pull cans with raceways and cabling to individual meter panels.

The SDG&E Planner shall provide the customer with a copy of this standard with the Electric Meter & Service Location form because it is a special application. It is important for the customer to understand the equipment must be factory-manufactured with horizontal bussing from the pull can to the metering section(s).


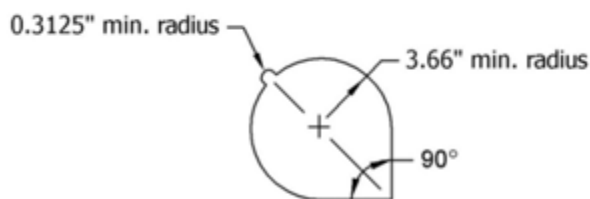


FIGURE 3
Meter Panel Cover Cutout Detail

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

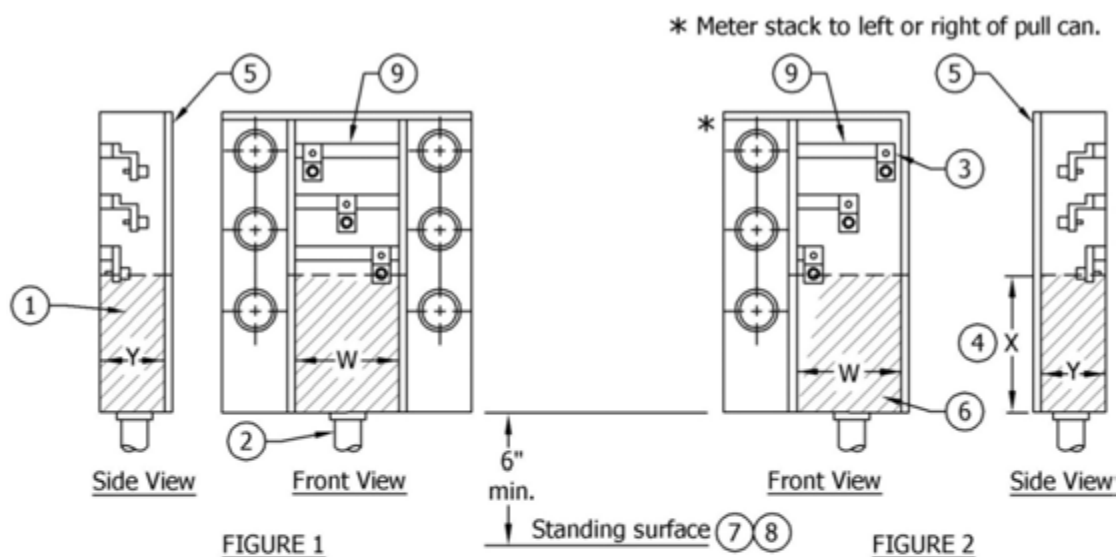

Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 2

SDG&E SERVICE STANDARDS & GUIDE

RESIDENTIAL SINGLE-PHASE MULTI-METER STACK

SG 707.1

Table for Figures 1 & 2

Service Equipment Rating in Amps	Minimum Service Equipment Dimensions			Minimum Conduit Size	Maximum Conduit Size
	"W"	"Y"	"X"		
0 – 200	6-½"	5-½"	11"	1-3"	1-4"
201 – 400	10-½"	6"	22"	1-3"	1-4"
401 – 600	10-½"	6"	22"	1-4"	1-4"

Notes:

- ① Shaded area is for Utility service lateral conductor only. Bonding connection for service lateral conduits only is permitted at bottom of can. Any other bonding or grounding connection must be made above the shaded area and no grounding or bonding conductor is permitted to pass through the shaded area.
- ② Service lateral conduits must enter the bottom of the pull can and be firmly secured with a locknut, hub or bushing. The maximum conduit intrusion inside the shaded area is 1". See pages SG 309.1–309.3 for service lateral conduit requirements.
- ③ See page SG 705.4, Note 5, for mechanical lug details. A "single lug" for 600 amps is permitted for this application only. Service conductors may cross over horizontal busses provided a barrier is installed or the bus is fully insulated.
- ④ The neutral lug height may be reduced to 8-½".
- ⑤ The pull can cover shall be independent of any other service equipment, and shall be removable without disturbing adjacent panels. Pull can covers shall have two lifting handles, and are limited to 9 square feet in area. Covers shall be sealable with two drilled stud and wing-nut assemblies on opposite sides of the panel. See page SG 503 for sealing requirements.
- ⑥ Dimension "W" is the minimum width of the pull can access opening and is measured between the left side and right side return flanges, not the interior walls of the pull can.
- ⑦ A minimum 3' x 3' clear and level working space is required in front of the pull can. See pages SG 504.4 – 504.5 for additional working space clearance requirements.
- ⑧ See pages SG 509.1 – 509.4 for meter cabinet requirements.
- ⑨ Bus taps are not permitted in this special application.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 2

SDG&E SERVICE STANDARDS & GUIDE

RESIDENTIAL SINGLE-PHASE MULTI-METER STACK

SG 707.2

SDG&E (Utility) accepts free-standing Underground Pull Sections (UGPS), rated 0 – 600 volts, 4,000 amps maximum, provided all requirements of this standard are met.

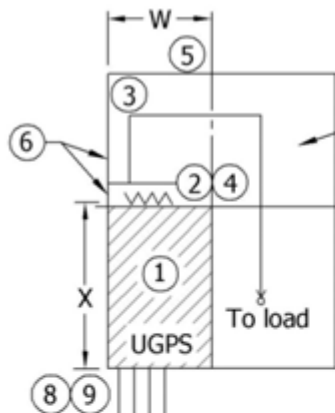


FIGURE 1

Pull section 4,000 amps maximum

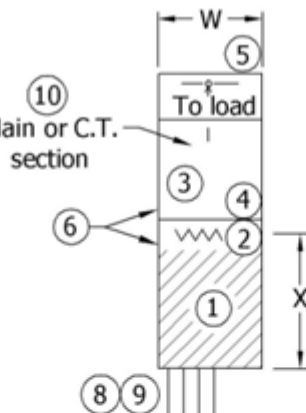


FIGURE 2

Pull section 2,000 amps maximum

Bottom Feed Only



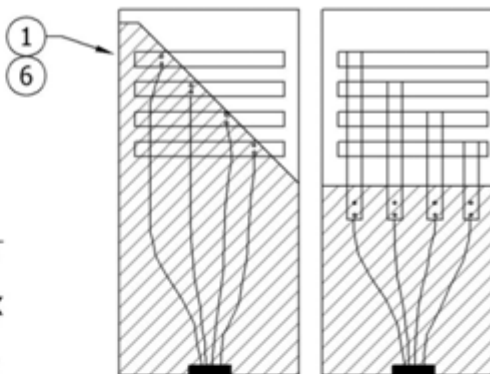


FIGURE 3

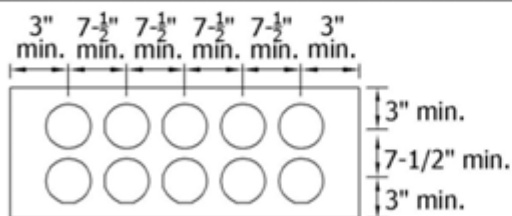

Conduit placement for maximum number of conduits

FIGURE 4
Plan view UGPS

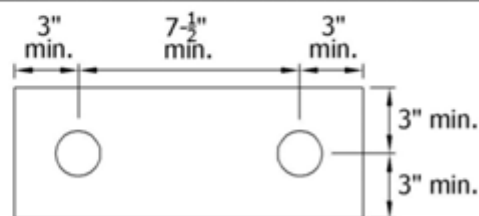

Conduit placement

Minimum Pull Section Dimensions (7)			
Pull Section Rating (Amps)	"W" Width (5)		"X" Lug Height
	3W	4W	
0 – 400	10"	14"	22" – 72"
401 – 800	16"	22"	26" – 72"
801 – 1,200	---	30"	26" – 72"
1,201 – 2,000	---	35"	40-1/4" – 72"
2,001 – 3,000	---	42"	60" – 72"
3,001 – 4,000	---	44"	60" – 72"

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 2

SDG&E SERVICE STANDARDS & GUIDE

UNDERGROUND PULL SECTION, 0 – 600 VOLTS

SG 708.1

Notes:

- ① Underground service lateral conduits shall enter the bottom of the UGPS. The grounding electrode and/or grounding electrode conductor will not be permitted within the Utility portion of the UGPS. No other conductors, equipment or connections are permitted in the shaded area. See pages SG 309.1 – 309.3 for service lateral conduit requirements.
- ② Bolt terminations as shown on pages SG 709.1 – 709.3 are required for all UGPS. See table on page SG 708.1 for minimum and maximum termination heights. The Utility will provide the termination lugs, connect the service lateral conductors to the termination lugs, and connect to the customer-provided two-bolt termination bus stubs.
- ③ Bus bars or cables may extend from the UGPS into switchboard service sections rated up to 800 amps. Bus bars are required when the service section rating exceeds 800 amps, or when a multiple metering section(s) is supplied.
- ④ Service conductors must terminate in the UGPS and shall not be pulled through the UGPS to land on a main or Current Transformer (CT) bus.
- ⑤ Dimension "W", shown in the table on page SG 708.1, is the minimum width of the UGPS access opening and is measured between the left side and right side return flanges, not the interior walls of the UGPS.
- ⑥ All UGPS shall have full front access. Cover panels shall be removable, sealable, provided with two lifting handles, and limited to a maximum of 9 square feet in area. Sealing provisions shall consist of two drilled stud and wing-nut assemblies on opposite sides of the panel. See page SG 503 for additional sealing requirements. A minimum of 4" is required from the bus to the inside of the panel cover and 1" minimum from the bolt termination to the inside of the panel cover.
- ⑦ There is no minimum depth dimension shown or required by the Utility. The depth of the equipment is determined by meeting the bus clearances shown on pages SG 709.1 - 709.3 and providing space for the conduit entry in accordance with page SG 708.1, Figure 4.
- ⑧ Maximum conduit intrusion into the UGPS is 2".
- ⑨ UGPS that require 2", 3" or 4" conduits must allow a minimum of 3' clear and level working space in front of the UGPS. UGPS requiring 5" conduits must allow a minimum of 6' clear and level working space in front of the UGPS. See pages SG 504.4 – 504.5 for additional working space clearance requirements.
- ⑩ A main service or meter service disconnect is not permitted on the supply (line) side of a single meter.

See pages SG 506.1 – 506.4 for electric meter room requirements. See pages SG 509.1 – 509.4 for meter cabinet requirements.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 2	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 708.2
	SDG&E SERVICE STANDARDS & GUIDE					
	UNDERGROUND PULL SECTION, 0 – 600 VOLTS					

This standard provides the requirements for cable termination bus stubs in underground pull cans or Underground Pull Sections (UGPS).

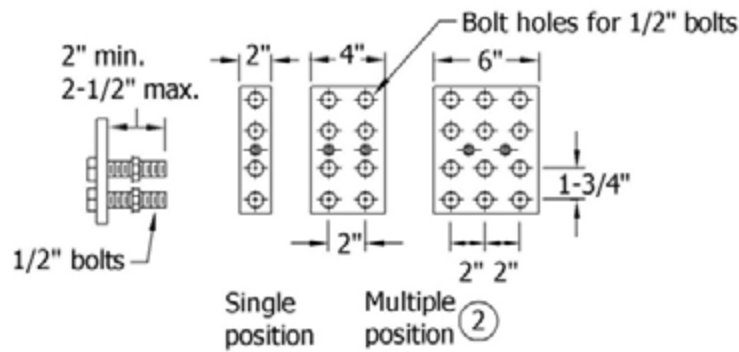


FIGURE 1
Terminating bolt and drilling detail

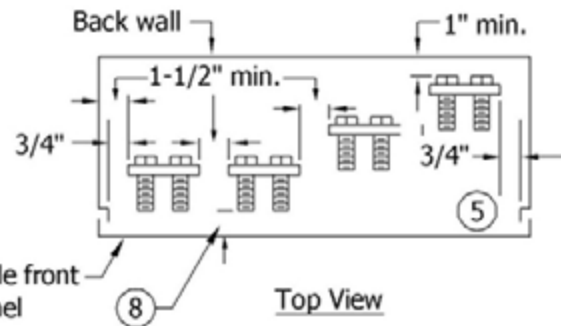
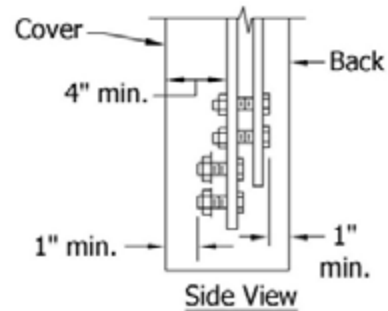


FIGURE 2
Spacing requirements for terminating facilities (side by side, or staggered).

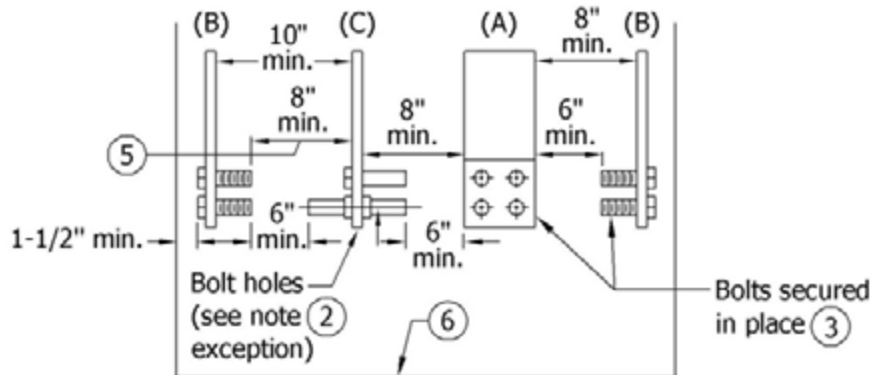


FIGURE 3
Spacing requirements for terminating facilities accessible from (A) front only, (B) one side only, or (C) from either side.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
1 OF 3

SDG&E SERVICE STANDARDS & GUIDE

CABLE TERMINATION BUS STUBS IN UNDERGROUND PULL CANS OR PULL SECTIONS

SG 709.1



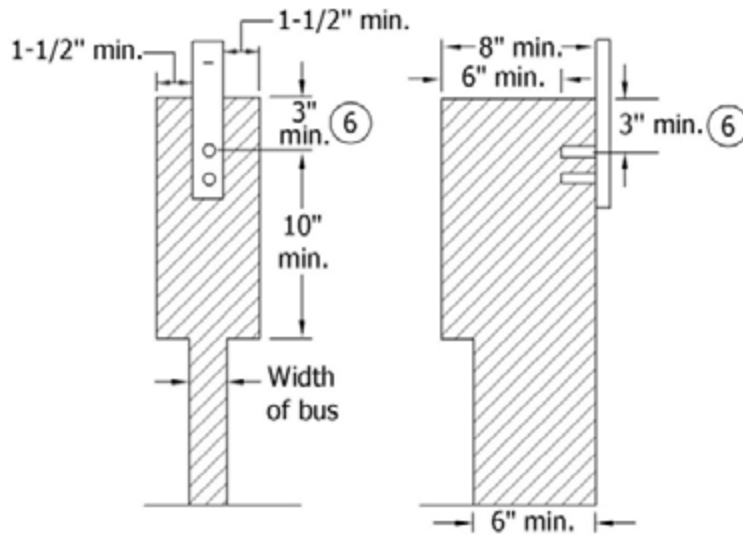


FIGURE 4
Required unobstructed working
space for all terminations.

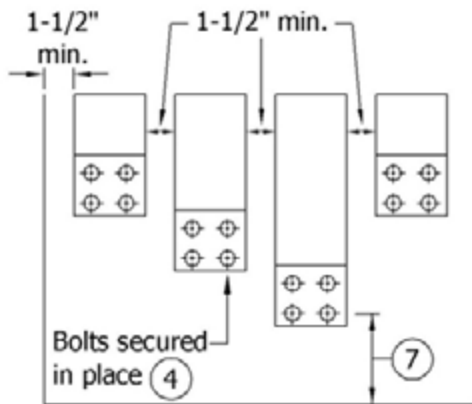

Front View
Spacing requirements for top to bottom
stagger of terminating facilities.

4" min. required [assures 1" min. clearance
from body of terminating lug (when in
place) to front panel].
Exception: See Notes (5) and (6).

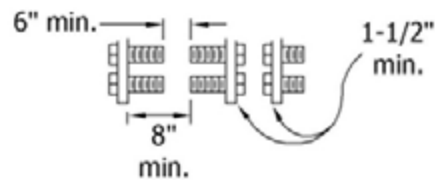

Side View
Bus accessible from one side
only with bolt secured in bus.

FIGURE 5

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 3

SDG&E SERVICE STANDARDS & GUIDE

**CABLE TERMINATION BUS STUBS IN
UNDERGROUND PULL CANS OR PULL SECTIONS**

SG 709.2

Notes:

1. The bolt terminations shown on pages SG 709.1 – 709.2 are required for pull cans rated over 800 amps, and all UGPS (free standing).
- ② One landing position is required for each 400 amps, or portion thereof, of service capacity. Each landing position shall consist of two ½" steel bolts spaced on 1-¾" vertical centers and extending from 2" to 2-½" from the mounting surface. When multiple positions are required, provide a minimum of 2" of horizontal spacing between positions.
Exception: Edgewise terminating facilities may consist of 9/16" holes having the same spacing as specified for the ½" bolts as specified above and in Figure 1. The unobstructed working space shall be provided on both sides of the termination bus (see Figure 3).
- ③ Each terminating bolt shall be provided with a spring washer and a nut. The spring washer may be either a cone-type (Belleville) washer or a split-ring washer and a flat washer. All parts shall be plated to prevent corrosion. Terminating bolts shall not be used to secure the termination bus in place.
- ④ Terminating bolts must be secured in place. "Secured in place" shall mean that the stud will not turn, back out, or loosen in any manner when tightening or loosening terminal nuts (including cross-threaded situations).
- ⑤ Each terminating facility shall have an unobstructed working space, accessible from the front of the UGPS as viewed from the access compartment opening, in front of the entire mounting surface as shown in Figures 3 and 4. No more than one termination facility may be mounted along a side wall. When viewed from the front of the pull can or UGPS, no other termination or cables in place shall impair the 8" minimum working clearance. Uninsulated busses of different potentials shall not be permitted below or behind any terminating position as viewed from the front of the UGPS. If cross-bussing is installed below or behind a terminating position, the cross-bussing shall be fully insulated or barriered.
Exception: For terminating facilities with bolts facing the access opening as shown in Figure 2, the required 1-½" side clearance (bus to access opening return flange) may be reduced to ¾".
- ⑥ In the terminal mounting area, which is defined as the area of the terminating facilities shown in Figure 1, a clear space (barrel of proximity) of a minimum 1-½" radially and 3" above the top bolt is required around any terminating facility including its bolts and bolt heads, any other bus, any other terminating facility, or any grounded surface, except as follows:
 - a. Minimum clearance to back of UGPS may be reduced to 1".
 - b. Minimum clearance to any fully insulated horizontal bus behind terminating facility may be reduced to 1".
 - c. Neutral terminating facility may have a minimum clearance of 1" from any grounded surface.
 - d. The clearance directly above and measured from the center of the top termination bolt may be reduced to 1" to either an insulated surface or bus of the same potential.
- ⑦ See page SG 706.1 or SG 708.1, whichever is applicable, for minimum termination heights.
- ⑧ For switchboard UGPS, a minimum of 4" is required from the bus to the inside of the panel cover and 1" minimum from bolt termination to the inside of the panel cover.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	CTG	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
3 OF 3

SDG&E SERVICE STANDARDS & GUIDE

**CABLE TERMINATION BUS STUBS IN
UNDERGROUND PULL CANS OR PULL SECTIONS**

SG 709.3

**800 - CUSTOMER
GENERATION**

**800 - CUSTOMER
GENERATION**

PAGE #

Connection of Customer-Owned Power Generators to SDG&E's Electrical System	SG 803.1
Directory	SG 803.1
General Information	SG 803.1 – 803.3
Net Generation Output Metering	SG 803.1
Permanently or Temporarily Connected Standby Generators	SG 803.2 – 805.3
Violations	SG 803.2
Warning Statements & Labels	SG 803.1 – 803.2
Disconnection Devices	SG 806.2 – 806.4
Circumstances Requiring Disconnects	SG 806.2
Inverter-Based Devices	SG 806.2
Utility AC Disconnect Requirements	SG 806.2 – 806.4
Distributed Generation	SG 806.1 – 806.16
Accessibility	SG 806.3
Billing and Purchase of Energy Meter	SG 806.5
Disconnection Devices	SG 806.2 – 806.4
Disconnection of Energy Source	SG 806.15
General Information	SG 806.1
Interconnection Process	SG 806.1
Interconnection Request Requirements	SG 806.1
Net Generation Output Metering	SG 806.5 – 806.12
Telemetry	SG 806.15
Transformer Requirements	SG 806.15
Inspection Requirements	SG 803.2, SG 806.7, SG 806.15

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 2	Indicates Latest Revision	X	Completely Revised	New Page	Information Removed	SG 802.1
	SDG&E SERVICE STANDARDS & GUIDE					
	<p align="center">CUSTOMER GENERATION</p> <p align="center">ALPHABETICAL SUBJECT INDEX</p>					

SUBJECTPAGE #

Interconnection Process	SG 806.1
Interconnection Request Requirements	SG 806.1
Metering	
Billing and Purchase of Energy Metering	SG 806.5, SG 806.16
Net Generation Output Metering – General Information & Installation	SG 806.5 – 806.12
Typical Metering Devices Required and Installed by SDG&E	SG 806.14
Operating Requirements	SG 806.2
Standby Generators, Permanently or Temporarily Connected	
General Information	SG 803.2
Generators Connected Permanently but NOT Operating in Parallel with SDG&E's System	SG 803.3
Generators NOT Permanently Connected	SG 803.2 – 803.3
Stand-by Generator Safety Transfer Switch	SG 804
Transfer Systems	SG 803.3, SG 804, SG 805.1 – 805.3
Violations	SG 803.2
Warning Statements & Labels	SG 803.1 – 803.2
Working Space & Clearance Requirements from SDG&E-Owned	
Electric Meter & Gas Meter Set Assembly	SG 806.13

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 2	<div></div>	Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	New Page	Information Removed	SG 802.2
	SDG&E SERVICE STANDARDS & GUIDE					
	<div>CUSTOMER GENERATION</div> <div>ALPHABETICAL SUBJECT INDEX</div>					

All installations of customer-owned electric energy production equipment (hereinafter referred to as generator or generators) require adherence to rules for safeguarding of personnel, SDG&E-owned, and customer-owned equipment. SDG&E (Utility) shall be consulted before a generator is connected to any circuit which is, or can be supplied from the Utility's electrical system. This is to ensure against any unanticipated backfeed of electricity into the Utility's system and compliance with the Utility's tariffs. This standard does not apply to portable generators under circumstances when a customer's cord and plug appliances are connected directly to the generator's receptacles.

DIRECTORY

A permanent plaque or directory, specifying all electrical power sources on or in the premises, shall be installed at each service equipment location (service delivery point) of all generators capable of being interconnected to the Utility's electrical system. Installations with multiple generators may be designated in groups on the plaque. Refer to page SG 017.1 for plaque specifications.

NET GENERATION OUTPUT METERING

Except for emergency or standby generators, used solely during Utility outages and **not** capable of operating in parallel with the Utility's system, customer-owned generators may require the installation of Net Generation Output Metering (NGOM) to satisfy requirements associated with other services applicable to or requested by a customer. Under circumstances when NGOM is required, such requirements may be waived where less intrusive and/or more cost effective options are available for providing generator production data to the Utility. See pages SG 806.5 – 806.12 for additional information about NGOM.

CONNECTION OF CUSTOMER-OWNED GENERATORS TO SDG&E'S ELECTRICAL SYSTEM

The legislature of the State of California intended to prevent electricity generated by permanent or portable electric generators from back feeding into a Utility electrical system by enacting the California Health and Safety Code, Division 104, Part 15, Chapter 5, Sections 119075 through 119090.

In addition, California Code of Regulations, Title 8, Section 2320.9, states:

No electrical power source, permanent or temporary, shall be connected to a premises wiring system, or parts of such a system, unless positive means are used to prevent the transmission of electricity beyond the premises wiring system, or beyond any intentionally segregated parts of such a system.
Exception: When an interconnection has been authorized by the servicing utility.

Positive means is a device which, by its use or operation, interrupts or prevents the flow of current to or from the electrical system and which provides the device operator or user a visual or other definite indication of the existing condition or state of the electrical system.

WARNING STATEMENTS & LABELS

California Health and Safety Code, Section 119080(a), requires:

Every manufacturer of a portable or permanent electrical generator that is capable of being connected either permanently or temporarily to a commercial, industrial or residential structure's electrical system, shall include a warning statement in the generator's instruction manual and a

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 3	X Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 803.1
	SDG&E SERVICE STANDARDS & GUIDE				
	GENERAL INFORMATION				

legible warning label on the generator which states the requirement of Section 119075 and explains the electrical hazards of backfeed into a Utility's distribution system. The same warning information shall be included in all advertisements offering portable electrical generators.

California Health and Safety Code, Section 119080(b), states: "No person or public agency shall sell, rent to another person or public agency, or offer for sale or rent to another person or public agency a portable electrical generator unless the legible warning label is on a visible surface of the generator."

VIOLATIONS

California Health and Safety Code, Section 119090(a), states: "Any person who violates Sections 119075 to 119085, inclusive, is guilty of a misdemeanor, and subject to a fine of not more than five hundred dollars (\$500) or not more than six months' imprisonment."

PERMANENTLY OR TEMPORARILY CONNECTED STANDBY GENERATORS

1. General Information

- When a generator is permanently or temporarily connected to a customer's electric system, it has the potential to energize the building's wiring. This type of installation requires a device that isolates the generator from the Utility's electrical system. Refer to item 4, Transfer Systems, on page SG 803.3 for the requirements of such isolation devices.
- The generator must be 60-hertz alternating current. If a direct current generator is used, the installation must be arranged so that all motors, radios, and other equipment that will not operate on direct current are disconnected from circuits before the circuits are energized from the generator.
- Only a qualified professional, such as a licensed electrical contractor, should install a permanently or temporarily connected standby generator.
- A permit and inspection by the governmental Authority Having Jurisdiction (AHJ) are required for all permanent and temporary connections of generators to the customer's electrical system(s).
- When installation is complete, the customer must call the Utility at (800) 411-SDGE (7343) and provide the address of the generator location.

2. Generators **Not** Permanently Connected (Temporary Connections)

Any portable electric generator connected to SDG&E must comply with California Health & Safety Code, Section 119075. Section 119075(b) states:

Any portable electrical generator that is capable of being connected temporarily to a customer's electrical system, that is normally supplied by an electrical corporation or state or local public agency, shall be connected only after opening the customer's main switch so as to isolate the customer's electrical system from that of the electrical corporation or state or local agency.

Article 702.5 of the 2014 National Electrical Code (NEC) requires transfer equipment "suitable for the intended use and designed and installed [so as] to prevent the inadvertent interconnection of normal and alternate sources of supply in any operation of the transfer equipment." A main breaker or fuse, which is not listed as suitable for use as transfer equipment, cannot be used as the transfer device between temporarily connected portable generators and the Utility's system. This applies to any

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 3	<div>X</div> Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 803.2
	SDG&E SERVICE STANDARDS & GUIDE				
	GENERAL INFORMATION				

generator connected as a temporary (non-routine, nonscheduled) or emergency source of electric energy. Any portable electric generator used as a temporary source of power shall be connected as described below in item 4, Transfer Systems.

3. Generators Connected Permanently but **Not** Operating in Parallel with SDG&E

All generators in this category are to be connected in accordance with SDG&E's CPUC-approved tariffs and California Health and Safety Code 119075(c), which states:

Any electrical generator, other than a generator designed to run in parallel with the system of the servicing Utility and approved by that Utility, that is capable of being permanently connected to a customer's electrical system shall be connected only by means of a double throw switch so as to isolate the customer's electrical system from that of the electrical corporation or state or local agency.

4. Transfer Systems

- a. Service Equipment Rated Transfer – Transfer switches listed and labeled as suitable for use as service equipment are permitted for use as main service equipment upon prior approval from the Utility. All other transfer switches shall be connected on the load side of the main service equipment.
- b. Open-Transition Switching – A double throw switch with a mechanically driven break-before-make sequence shall normally be provided to transfer all ungrounded conductors of an emergency lighting or power load to either the generator or the normal supply. (See Figures 1 – 4 on pages SG 805.1 – 805.3 for typical connections). Manual transfer switch installations do not require review and approval by the Utility prior to installation.
- c. Closed-Transition Switching & Auto Transfer – Requests for closed-transition switching (make-before-break) and automatic transfer systems, with a solid state or programmable logic controller, require specification submittal and must be approved by the Utility. The customer's submittal shall include 3 sets of drawings and all of the following: system description, one-line relay functional diagram, logic controller program, and bill of materials. Closed-transition switching limiting parallel operation with the Utility to no greater than 1 second (60 cycles) does not require a written agreement with the Utility. Submittals should be sent to:

SDG&E Service Standards
8316 Century Park Court, CP52F
San Diego, CA 92123-1582

The customer will receive an approval, or request for changes, after the Utility's review of the request has been completed.

- d. Separately Derived Systems – When an AC generator is installed as a separately derived system, grounding of the neutral conductor shall be in accordance with the California Electrical Code. Separately derived systems require a switched neutral conductor at the transfer switch. Figure 1 on page SG 804 and Figures 1 – 4 on pages SG 805.1 – 805.3 do not show this system configuration.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 3 OF 3	X Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 803.3
	SDG&E SERVICE STANDARDS & GUIDE				
	GENERAL INFORMATION				

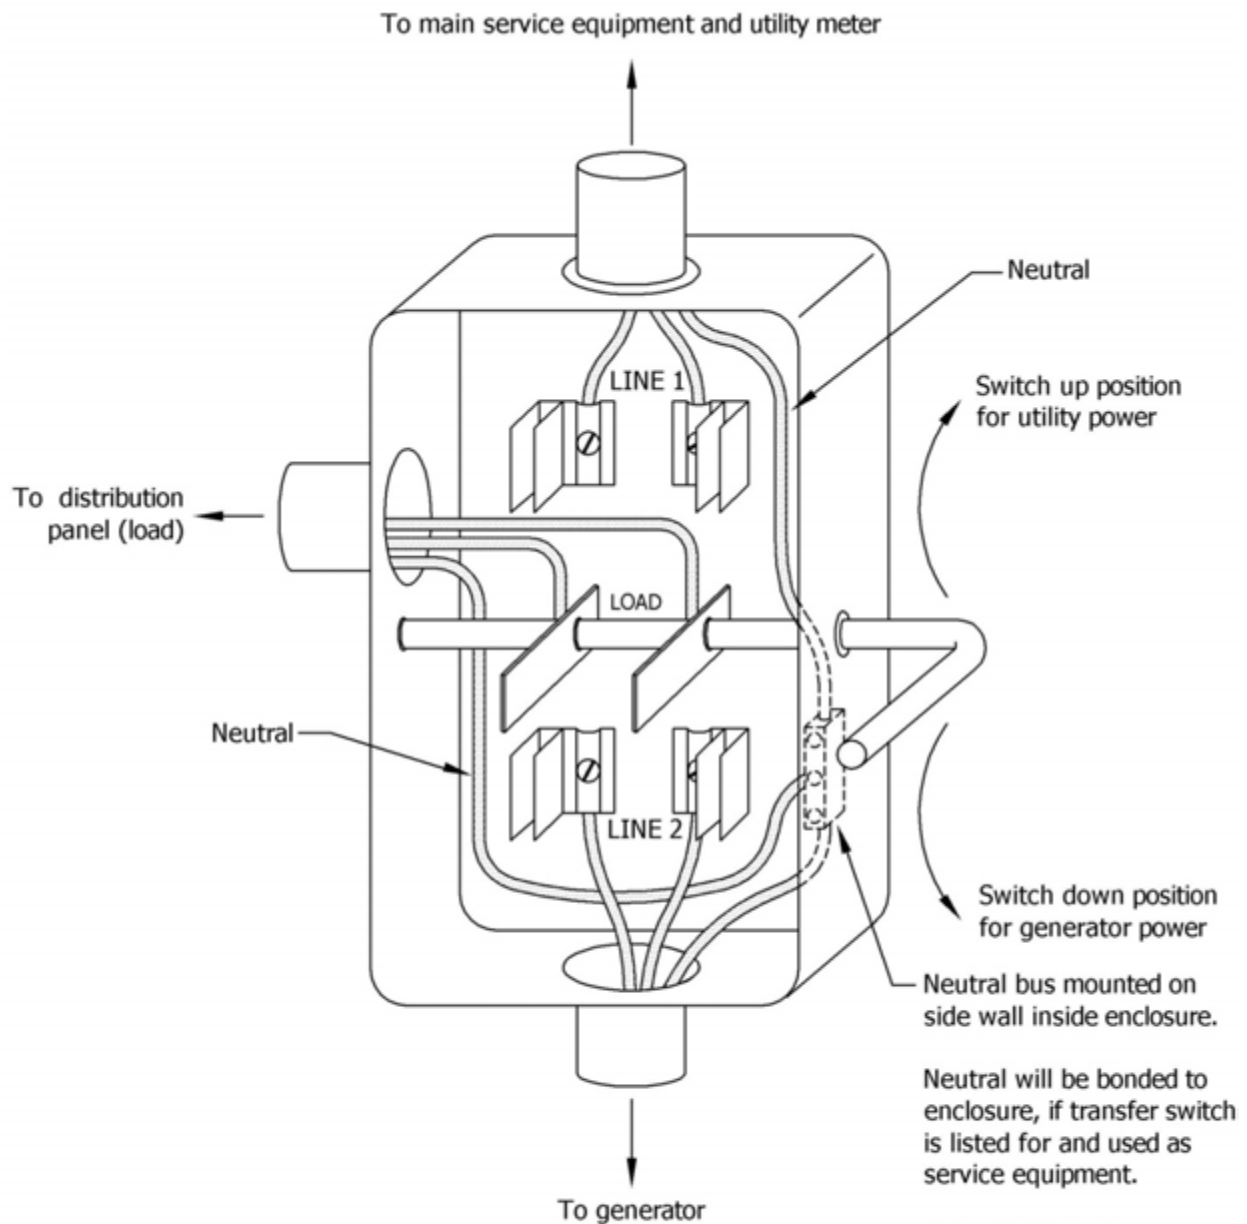


FIGURE 1
STAND-BY ELECTRIC GENERATOR SAFETY
TRANSFER SWITCH TYPICAL LAYOUT

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

STAND-BY GENERATOR SAFETY TRANSFER SWITCH

SG 804

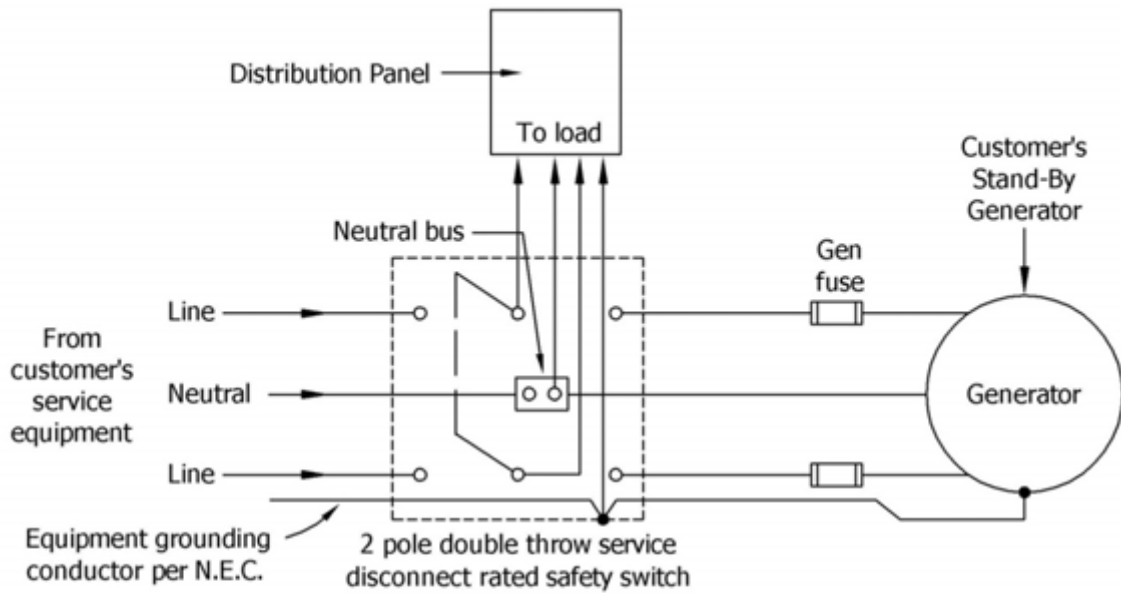


FIGURE 1
CONNECTION OF STAND-BY GENERATOR SUPPLYING CUSTOMER'S ENTIRE LOAD

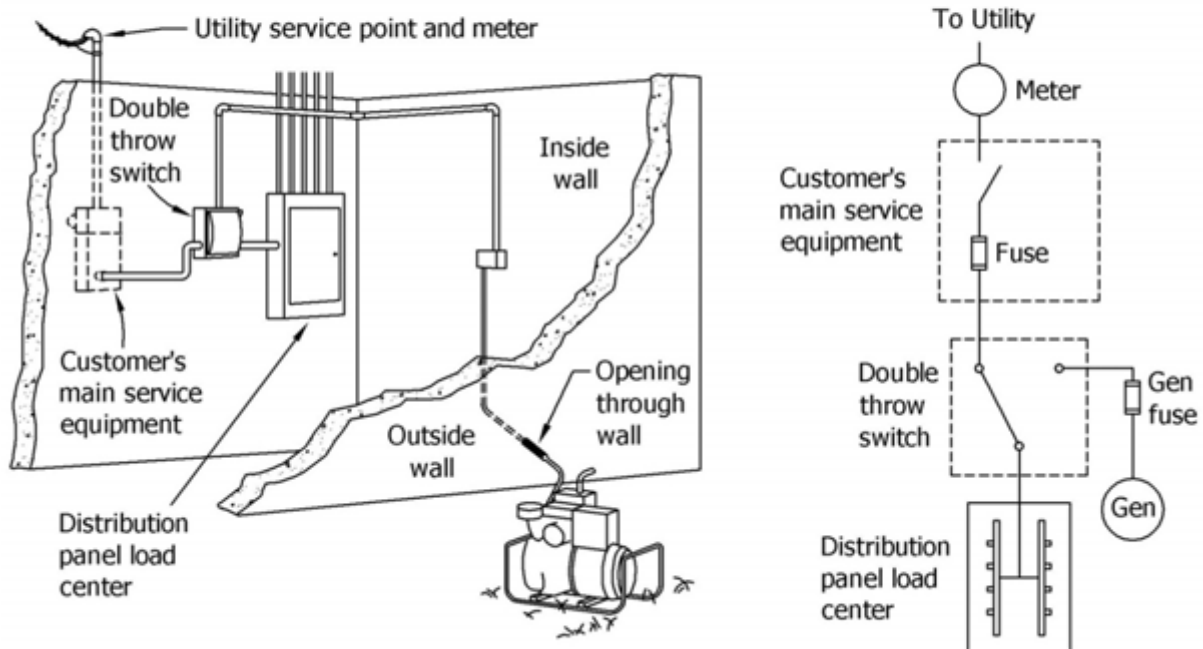


FIGURE 2
STAND-BY GENERATOR NON-PARALLEL OPERATION WITH UTILITY

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
1 OF 3

SDG&E SERVICE STANDARDS & GUIDE

STAND-BY GENERATOR

SG 805.1

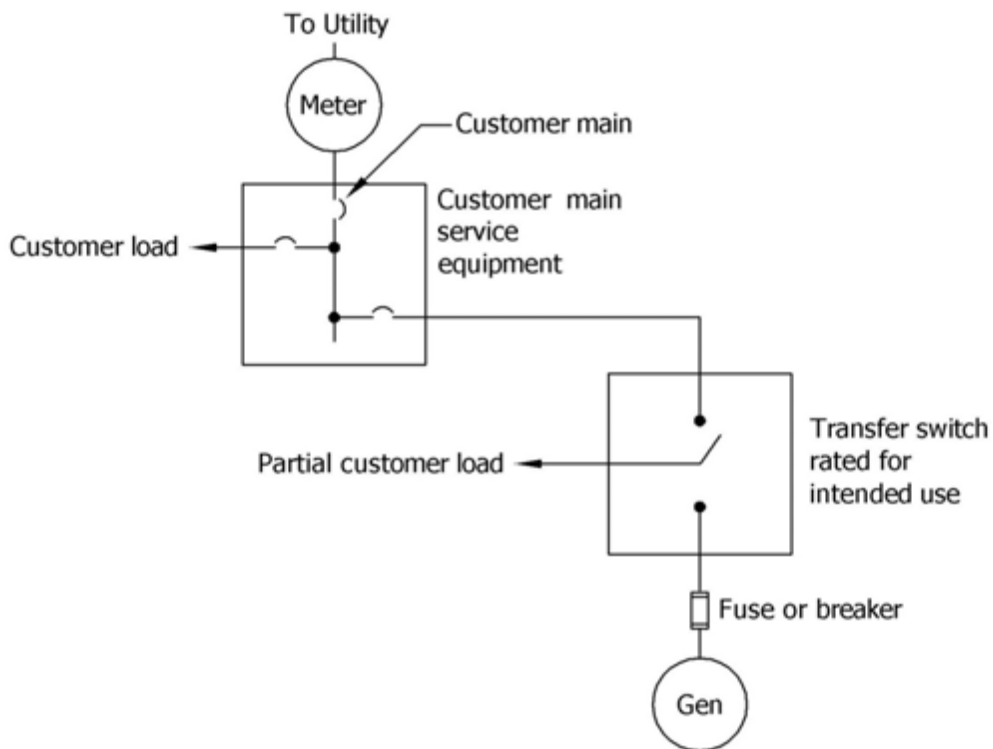
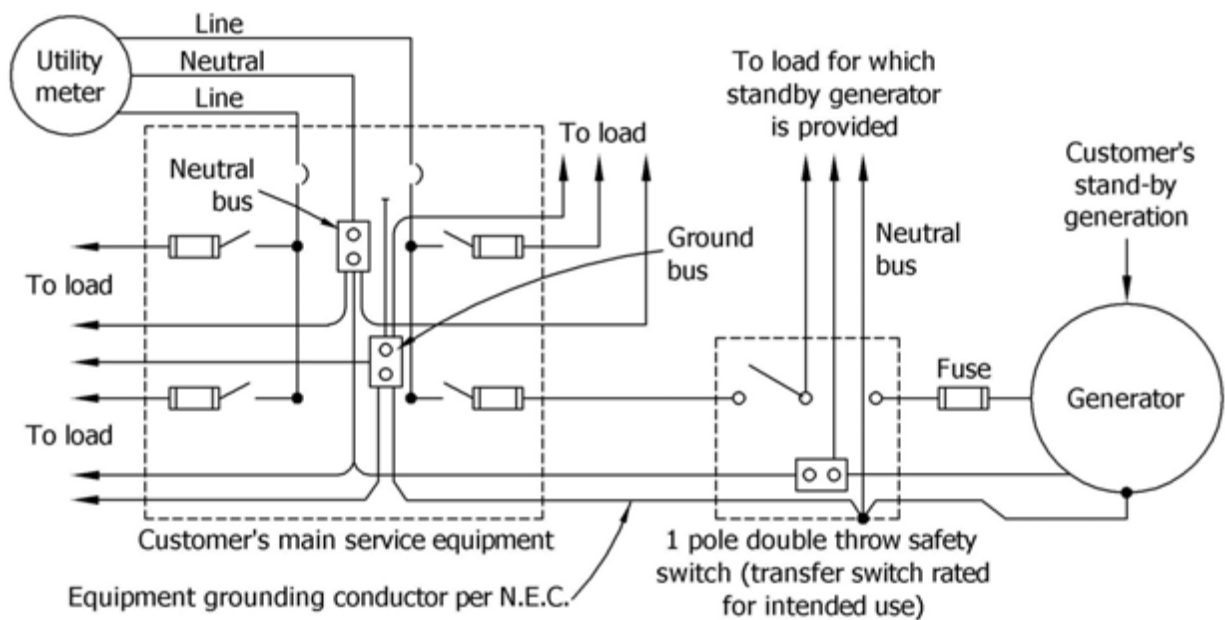


FIGURE 3
CONNECTION OF STAND-BY GENERATOR SUPPLYING ONE 120 VOLT CIRCUIT

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page


Information Removed

SHEET
2 OF 3

SDG&E SERVICE STANDARDS & GUIDE

STAND-BY GENERATOR

SG 805.2

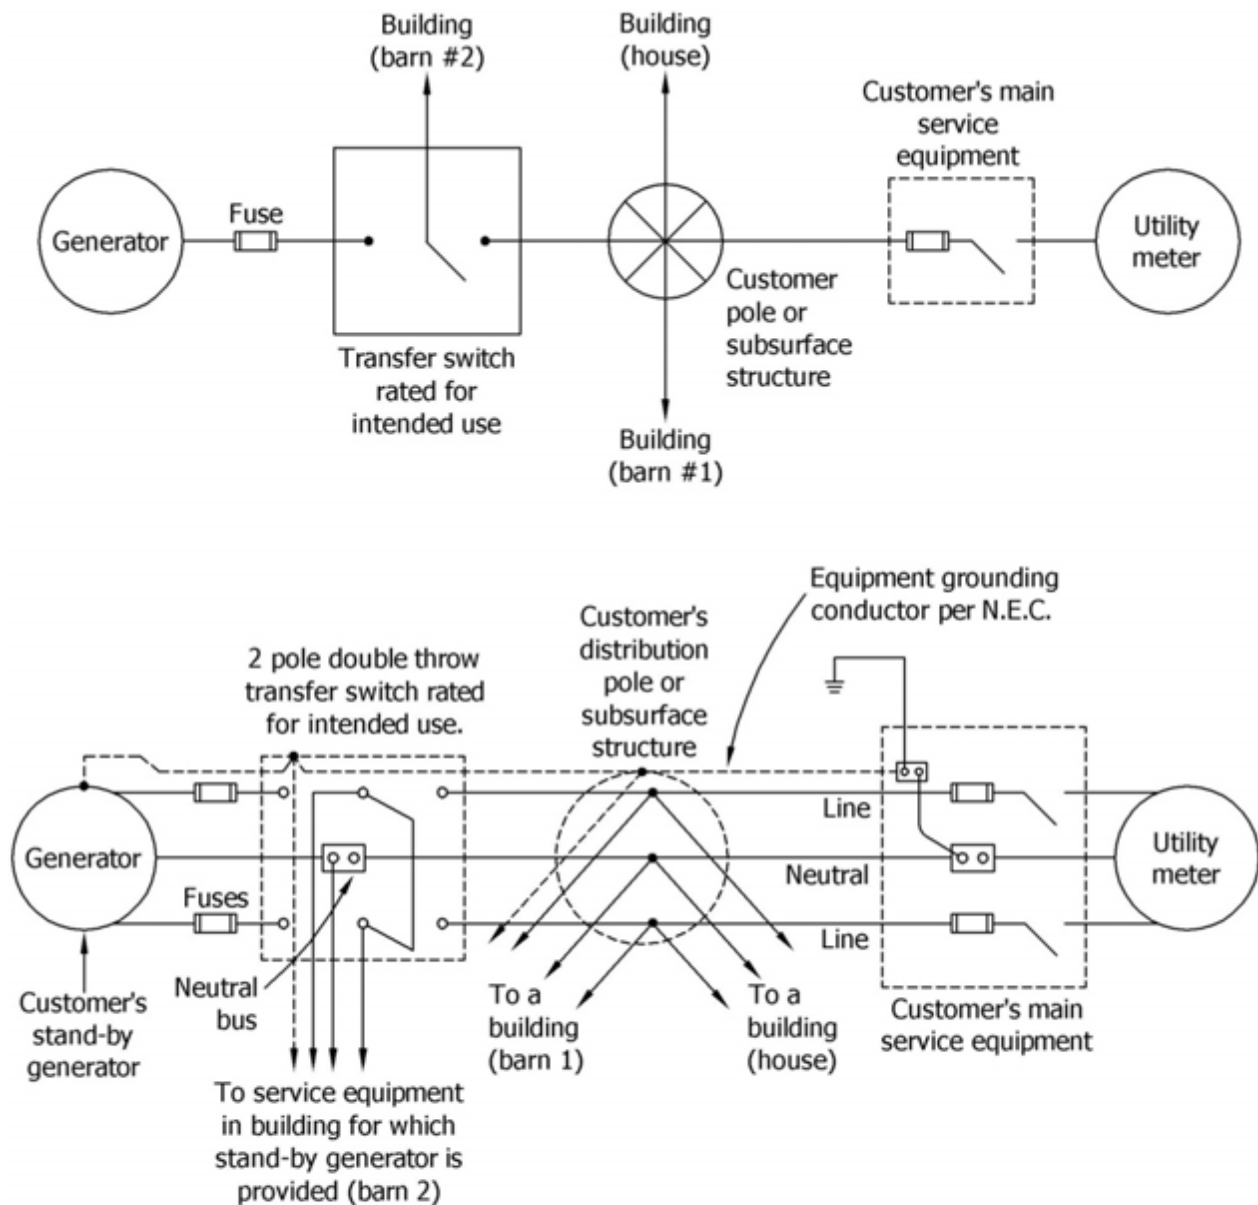

NOTE:
Connections shown are for Utility's service being single-phase, 3-wire, 120/240-volts.

FIGURE 4
CONNECTION OF STAND-BY GENERATOR TO A PORTION OF CUSTOMER LOAD SERVED FROM SINGLE UTILITY SERVICE. EXAMPLE SHOWN IS MULTIPLE BUILDINGS IN RURAL AREAS.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
3 OF 3

SDG&E SERVICE STANDARDS & GUIDE

STAND-BY GENERATOR

SG 805.3

GENERAL INFORMATION

This section provides an overview of SDG&E's requirements for interconnecting customer-owned generators to SDG&E's electric distribution system. It is not intended to be a substitute for the SDG&E Generation Interconnection Handbook (Interconnection Handbook) or SDG&E's Electric Rule 21 (Rule 21) and should not be relied on to determine the interconnection requirements for any project. Where there is any perceived or actual inconsistency between this document and the requirements of Rule 21 or the Interconnection Handbook, Rule 21 shall govern. Customers planning to install a generator that will operate in parallel with SDG&E's electric distribution system for the purpose of (1) only serving their own electrical load, (2) serving their own electrical load and exporting excess power to the grid or (3) only exporting power to the grid, must submit an application for interconnection and receive written authorization from SDG&E to interconnect and operate in parallel.

1. Interconnection Process

Interconnection can be achieved by means of either the Rule 21 process or the Wholesale Distribution Open Access Tariff (WDAT) process. Both interconnection processes require the customer to complete a generating facility technical review or study and execute an Interconnection Agreement with SDG&E before the generating facility is authorized to interconnect and operate in parallel with SDG&E's electric system. Detailed information addressing the interconnection of customer-owned generators is located on SDG&E's website at <http://www.sdge.com/generation-interconnections/overview-generation-interconnections>.

Rule 21 information and documents:

<http://sdge.com/direct-access/electricity/self-generation-interconnection>

WDAT information and documents:

<http://sdge.com/generation-interconnections/wholesale-generator-transmission-interconnections>

SDG&E Generation Interconnection Handbook:

<https://www.sdge.com/generation-interconnection-handbook>

2. Interconnection Request Requirements

- a. Single-Line Diagram – A single-line representation of the proposed interconnection system that clearly distinguishes existing equipment from proposed equipment.
- b. Completed Interconnection application, including a complete set of specifications as follows:
 - i. Maximum kW rating
 - ii. Nominal output voltage
 - iii. All necessary relays
 - iv. Power factor
 - v. Maximum fault current contribution
 - vi. kWh rating for energy storage projects
 - vii. Make and model of inverter, if an inverter will be used
- c. Applicable fees and/or deposits.
- d. Documentation demonstrating proof of site exclusivity/control.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 16	<div></div>	Indicates Latest Revision	<div>X</div>	Completely Revised	New Page	Information Removed	SG 806.1
	SDG&E SERVICE STANDARDS & GUIDE						
	DISTRIBUTED GENERATION						

3. Operating Requirements

The customer shall operate the generating facility, whether permanent or temporary, in accordance with the Interconnection Agreement, SDG&E's Electric Service Requirements, SDG&E's CPUC-approved tariffs, and all applicable laws, codes and ordinances. The customer shall not be permitted to energize any de-energized portion of SDG&E's distribution system.

DISCONNECTION DEVICES

1. Inverter-Based Systems

- a. Customers installing inverter-based systems less than 30 kW CEC AC will no longer be required to include an AC disconnect switch when the facility has a self-contained billing meter (i.e., 0 – 225 amp socket-based meter or a 400 amp Class 320 socket based meter). These types of meters are not Current Transformer (CT) rated and are used for the vast majority of all SDG&E customers.
- b. In lieu of an AC disconnect, the billing meter may temporarily be removed by SDG&E to isolate the customer's inverter from the electric distribution system to maintain operating safety needs during an emergency or maintenance on SDG&E's system. Removal of the billing meter will result in loss of electrical service to the customer's facility or residence for the duration of time that work is actively in progress. However, it is highly recommended to install an AC disconnect on all generating facilities, regardless of size.

2. Circumstances Requiring Disconnects

- a. Inverter-based systems 30 kW CEC AC and larger.
- b. Inverter-based interconnections having a CT rated meter, i.e., all meter panels or switchboards employing the use of potential and/or PTs/CTs.
- c. Non inverter-based generators, including rotating or machine-based generators, regardless of whether the service meter configuration is CT rated or self-contained.

3. Utility AC Disconnect Requirements

The customer shall furnish, install, own and maintain an AC disconnect in compliance with the following:

- a. A single, visible open, lockable AC disconnect is required to isolate all generation without impacting customer load. A single, visible open, lockable AC disconnect must be installed near the Point of Common Coupling (PCC), also referred to as the service and metering equipment, at a location approved by SDG&E. Refer to pages SG 504.3 – 504.4 for Unacceptable Meter Locations. Acceptable meter locations are generally:
 - i. Inside the electric meter room. Refer to SG 506.1 for electric meter room access requirements.
 - ii. Immediately outside the electric meter room at a location approved by SDG&E and the governmental Authority Having Jurisdiction (AHJ).
- b. When adding additional generation to a facility that currently has generation, the added generation must be connected to the existing disconnecting device, or the replacement disconnecting device if a larger ampacity device is required so that all generation can be isolated without impacting customer load.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 16	Indicates Latest Revision	<input checked="" type="checkbox"/>	Completely Revised	New Page	Information Removed	SG 806.2
	SDG&E SERVICE STANDARDS & GUIDE					
	DISTRIBUTED GENERATION					

- c. Consistent with meter room access requirements (see SG 506.1), all devices used to disconnect the generating facility shall be readily accessible under all conditions and at all times, 24 hours a day. The switch operation shall utilize an open air gap and shall provide visible verification.
 - i. The switch blades' jaws, and the air-gap between them, shall be clearly visible when the disconnect is in the open position.
 - ii. The visible air-gap must be observed without disassembling the device.
- d. The switch shall be lockable in the open position.
 - i. The locking operation shall be accomplished with a single SDG&E lock.
 - ii. The switch panel cover shall not be removable with the switch padlocked in the open position.
- e. Customers shall install plaques at all AC disconnects clearly stating their purpose is for operation by the Utility or authorized emergency responders. Refer to the following Figures 1 – 3 and notes.

TYPICAL SELF-CONTAINED METER <30 KW CEC AC

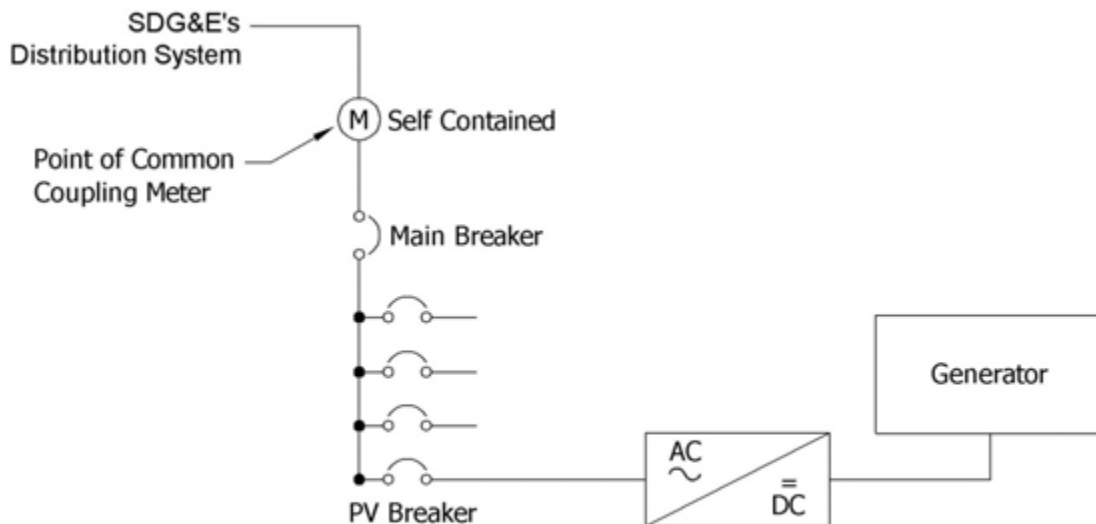


FIGURE 1

Notes:

1. A site placard is required at the service and metering equipment. See page SG 017.1 for site placard requirements.
2. A disconnect switch is highly recommended but not required. Refer to Figure 2 on page SG 806.4 if you choose to install a disconnect switch.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 3 OF 16	Indicates Latest Revision	X	Completely Revised	New Page	Information Removed	SG 806.3
	SDG&E SERVICE STANDARDS & GUIDE					
	DISTRIBUTED GENERATION					

TYPICAL SELF-CONTAINED METER ≥ 30 KW CEC AC

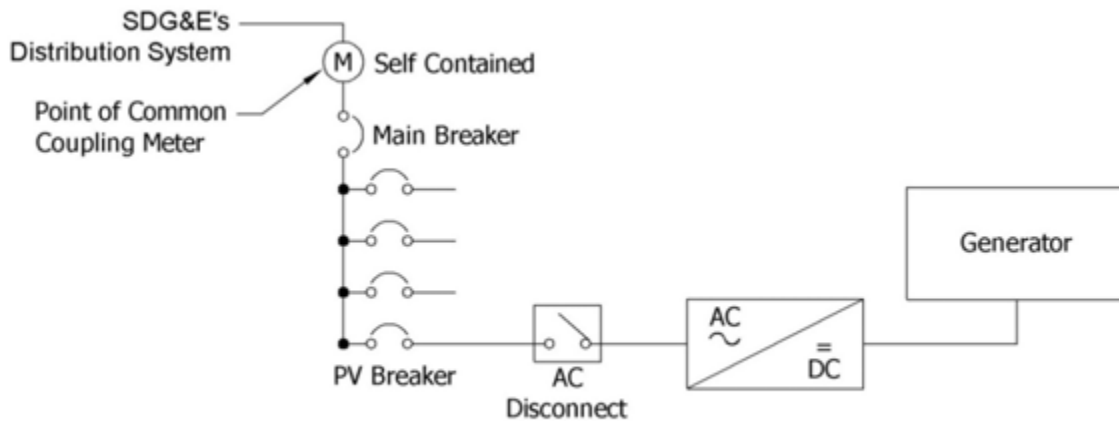


FIGURE 2

TYPICAL INSTRUMENT TRANSFORMER RATED METERING INSTALLATION

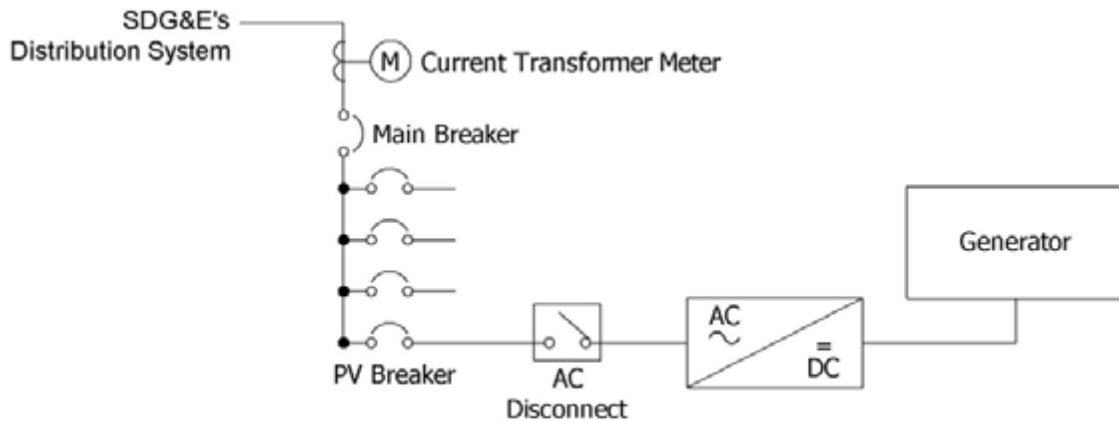


FIGURE 3

Notes:

1. Refer to pages SG 511.1 – 511.3 for disconnect requirements.
2. A site placard is required at the service and metering equipment. See page SG 017.1 for site placard requirements.
3. Customer shall install a placard on the AC disconnect switch labeled "PV SYSTEM DISCONNECT FOR UTILITY OPERATION" or "WIND TURBINE, FUEL CELL, BATTERY, etc., SYSTEM DISCONNECT FOR UTILITY OPERATION", as appropriate. The AC disconnect shall be identified the same on the site placard.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

Indicates Latest Revision

X Completely Revised

New Page

Information Removed

SHEET
4 OF 16

SDG&E SERVICE STANDARDS & GUIDE

DISTRIBUTED GENERATION

SG 806.4

The diagram illustrates a typical distribution system configuration for a co-generator facility. It shows the connection between the SDG&E's Distribution System, the Main Breaker Ahead of Multiple Meters, the Utility Side Disconnect, the NGOM (Neutral Grounding and Overcurrent Monitoring) unit, the Photo-Voltaic/Wind Turbine Generator Side Disconnect, and the Photo-Voltaic/Wind Turbine Co-Generating Facility. The diagram includes numbered nodes (1 through 11) and a note: "* Bus tap ahead of main breaker to serve only the co-generator facility."

Notes to Figures 1 and 2:

- © 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 6 OF 16	Indicates Latest Revision	X	Completely Revised	New Page	Information Removed	SG 806.6
	SDG&E SERVICE STANDARDS & GUIDE					
	<p align="center">DISTRIBUTED GENERATION</p>					

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 7 OF 16	<div></div>	Indicates Latest Revision	<input checked="" type="checkbox"/>	Completely Revised	<input type="checkbox"/>	New Page	<input type="checkbox"/>	Information Removed	SG 806.7
	SDG&E SERVICE STANDARDS & GUIDE								
	DISTRIBUTED GENERATION								

When SDG&E's charges are calculated based on metered quantities, the accuracy and quality of the metering used is subject to regulation by the CPUC. If the customer chooses not to install an NGOM, SDG&E will estimate the departing load.

- a. Distribution System Planning – A customer's generator may be operated in such a manner that it reduces the loading on SDG&E's distribution system. NGOM data can be used by SDG&E to integrate customer generating facility operational and energy production information with distribution circuit loading information to better plan for the loading of SDG&E's distribution circuits.
- b. Distribution System Operation – SDG&E's distribution circuit operation and switching decisions can be improved with timely (i.e., real-time or near real-time) information regarding the amount of generation operating at any point in time on a particular section of a distribution circuit. NGOM data can be integrated with a communication circuit and data management program to provide a very current snapshot of the nature of a circuit's load, thereby allowing for more finely tuned operations of SDG&E's distribution system.
- d. Customer Generation Operation and Monitoring – Generation operation, energy production, and sales need to be measured by the customer and, in many cases, third parties who are either selling the energy produced by the generator(s) to the customer or who have provided financial incentives tied to certain performance criteria based on the energy produced. NGOM can be used with various data management programs to provide both real-time and cumulative data that can be used for these purposes.
- e. Multiple Tariff Metering – Where a generating facility includes multiple generators eligible for service under more than one Net Energy Metering (NEM) rate schedule (e.g. NEM or NEM-FC), or where a generating facility consists of one or more NEM-eligible generators in combination with one or more non-NEM eligible generators without Non-Export relays, metering will be required at the PCC and at each of the NEM-eligible generator groups to ensure proper tariff administration. Where a generating facility consists of one or more NEM-eligible generator groups in combination with one or more non-NEM generators, metering of the non-NEM generators is not required.

4. Exceptions to SDG&E's NGOM Requirements


- a. NGOM is not normally required for small (<10 kW) generating facilities that are eligible for service under SDG&E's Net Energy Metering (NEM) Tariff. Should SDG&E determine it necessary that NGOM is required at a NEM-eligible location, such metering will be installed at SDG&E's expense.
- b. NGOM is not required for generators that are installed only for emergency or back-up service and are not authorized to be operated in parallel outside of a momentary transfer. SDG&E will screen generating facility interconnection applications and advise customers on the use of NGOM.
- c. An NGOM is not usually required for generating facilities that only export power to SDG&E's electric distribution system. SDG&E will install a meter that is capable of recording both the generating facility's energy consumption and power exported to the electric distribution system.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 8 OF 16	<input type="checkbox"/> Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	<input type="checkbox"/> New Page	<input type="checkbox"/> Information Removed	SG 806.8
	SDG&E SERVICE STANDARDS & GUIDE				
	DISTRIBUTED GENERATION				

**NET GENERATION OUTPUT METERING (NGOM) SAFETY SOCKET CAN
WITH FACTORY-INSTALLED TEST-BYPASS FACILITIES, 0 – 600 VOLTS,
100 AMPS (STANDARD DUTY), 200 AMPS (HEAVY DUTY)**

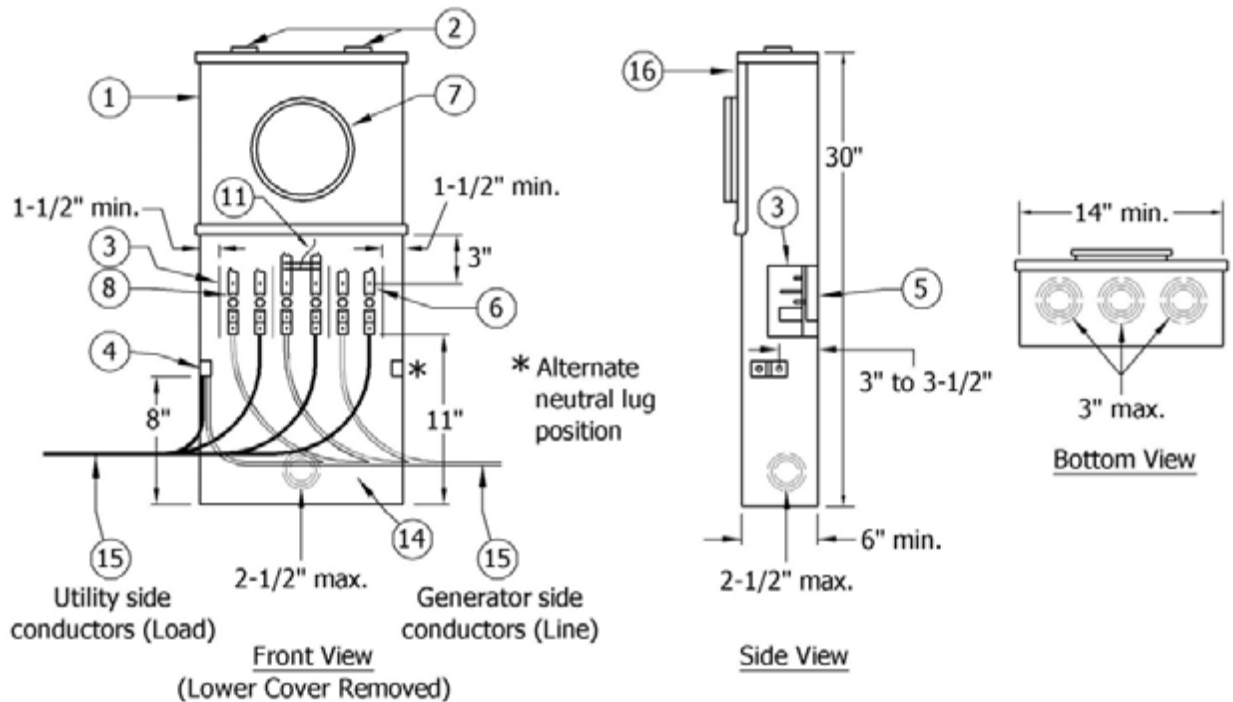

Notes:

- ① Refer to page SG 514.2 for 100 amp and SG 514.3 for 200 amp safety socket can specifications.
- ② Hubs capped off if used for underground feed.
- ③ Rigid insulating barriers. See page SG 513.2.
- ④ Vertical lay-in, double neutral lug with No. 250 MCM CU-AL wire capacity, mounted on either sidewall.
- ⑤ Test-bypass blocks shall be bussed or wired to socket jaws or terminals. See page SG 516 for meter socket clip requirements.
- ⑥ Upper test connector studs.
- ⑦ All covers shall be independently removable. Upper cover shall be non-removable when meter is in place. Meter socket shall be mounted on support and attached to panel. Lower cover shall be sealable and permanently labeled: "DO NOT BREAK SEALS. NO FUSES INSIDE." See page SG 503.1 for sealing requirements.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 9 OF 16	Indicates Latest Revision	X	Completely Revised	New Page	Information Removed	SG 806.9
	SDG&E SERVICE STANDARDS & GUIDE					
	DISTRIBUTED GENERATION					


- ⑧ Test-bypass block detail on separate drawing located on page SG 513.2.
9. For 3-phase, 4-wire, connect 7th jaw to body of neutral lug with a No. 12 copper wire, white in color.
10. For 3-phase, 4-wire delta, identify right hand test-bypass block (2 poles) as power leg, orange in color (C phase).
- ⑪ For 3-phase, 3-wire, install bus to connect line and load poles together at top of center test-bypass block and connect 5th jaw to this bus using a No. 12 wire, red in color.
12. For single-phase, 3-wire, provide 2 test-bypass blocks mounted in the outer positions and a 4-jaw socket.
13. For single-phase, 3-wire, 120/208 volts, provide 2 test-bypass blocks mounted in the outer positions and a 5-jaw socket. Connect 5th jaw of meter socket to body of neutral lug with a No. 12 copper wire, white in color.
- ⑭ Permanent labels indicating line and load connections for the test blocks on inside back of enclosure in ¾" (minimum) high block letters. Refer to page SG 514.3.
- ⑮ Label conductors in meter panel "Generator" and "Utility".
- ⑯ An address placard is required on the front of the NGOM panel. A site placard is required at the service and metering equipment. See page SG 017.1 for address and site placard requirements. If NGOM is not located in line of site of the service and metering equipment, an additional site placard is required on the NGOM showing the location of the service and metering equipment.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 10 OF 16	Indicates Latest Revision	X	Completely Revised	New Page	Information Removed	SG 806.10
	SDG&E SERVICE STANDARDS & GUIDE					
	DISTRIBUTED GENERATION					

NET GENERATION OUTPUT METERING (NGOM) ONLY – COMBINATION CURRENT TRANSFORMER & METER SOCKET CAN, 0 – 600 VOLTS, 800 AMPS MAXIMUM

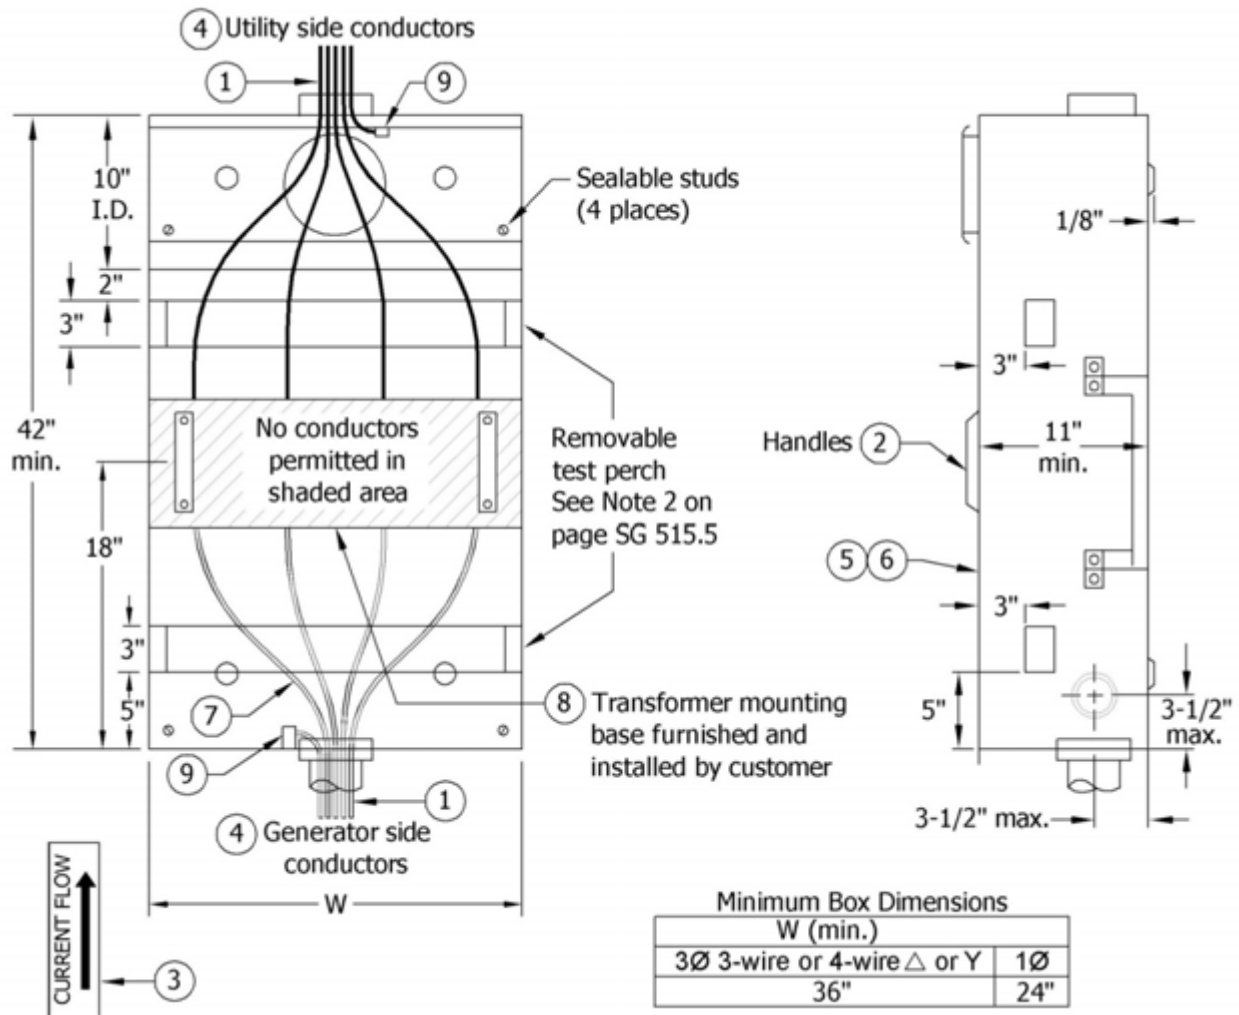

Notes:

- ① Generator and Utility side conductors must enter above the test perch and below the CT mounting base. See page SG 515.4 for overhead-fed can and page SG 515.5 for underground-fed cans.
- ② Cover shall have two lifting handles, be a maximum of 9 square feet, and a caution sign that reads, "DO NOT BREAK SEALS, NO FUSES INSIDE."

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 11 OF 16	<div></div>	Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	<input type="checkbox"/> New Page	<input type="checkbox"/> Information Removed	SG 806.11
	SDG&E SERVICE STANDARDS & GUIDE					
	DISTRIBUTED GENERATION					

- ③ Install "CURRENT FLOW" placard on inside side panel or outside front of meter panel. Current flow arrow should be pointed toward Utility side conductors.
- ④ Label conductors in meter panel "Generator" and "Utility".
- ⑤ An address placard is required on the front of the NGOM panel.
- ⑥ Site placard is required at the service and metering equipment. See page SG 017.1 for site placard requirements. If NGOM is not located in line of sight of the service and metering equipment, an additional site placard is required on the NGOM.
- ⑦ Provision shall be made in the CT compartment for a mechanical lug bondable termination of the Utility's neutral. This termination may be installed on the CT mounting base. The grounding electrode conductor may not enter or terminate inside the panel.
- ⑧ See pages SG 515.2 – 515.3 for transformer mounting base details.
- ⑨ Bond equipment grounding conductor to the bonding lug on the bushing.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 12 OF 16	Indicates Latest Revision	X	Completely Revised	New Page	Information Removed	SG 806.12
	SDG&E SERVICE STANDARDS & GUIDE					
	DISTRIBUTED GENERATION					

[illegible]

1. Size and dimensions of panels may vary. Illustration is not to scale.
2. Wall area (shaded area) behind meter set assembly including headers, must be free of any obstructions such as water pipes, hose bibs, sewer clean outs, drain spouts, electric conduits, etc. No building vent, window or other openings, covered or uncovered, are allowed within 36" from the SDG&E gas riser, and from final grade to a height of 10'. Fixed windows are acceptable. Equipment, such as but not limited to, cable TV, telephone, inverters, disconnecting devices, transfer switches, etc., are also not allowed within 36" on either side of the SDG&E gas riser, and from final grade to a height of 10' above the gas meter set assembly as indicated by the diagonal-lined shaded area.
3. Maintain 36" clear and level working space in front of gas and electric meters.
5. Electric bonding to or use of the Utility's gas service piping, gas risers or meter facilities for electric grounding is not permitted.
7. Tankless water heaters require a minimum 36" horizontal clearance from the Utility gas riser to a height of 10' above grade, and shall not be located directly under electrical service and metering equipment.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 13 OF 16	Indicates Latest Revision	X	Completely Revised	New Page	Information Removed	SG 806.13
	SDG&E SERVICE STANDARDS & GUIDE					
	DISTRIBUTED GENERATION					

Typical Metering Devices Required and Installed By SDG&E

The following table lists the type of meters and related monitoring equipment SDG&E may require to measure the net energy output of a customer's generating facility and, in some cases, to monitor the status of the customer's equipment used to interconnect the generating facility. Unless otherwise agreed to between SDG&E and the customer, the customer will supply the metering panel and related hardware and SDG&E will provide the meters or monitoring equipment at the customer's expense.

Note: SDG&E's charges for such devices are regulated by the CPUC.

Total Rated kW of Generating Facility	Typical Metering Devices Installed by SDG&E
< 200	Non-Time of Use (TOU) revenue grade meters measuring net generation output. Interval Data Recording (IDR) meters may be required to determine compliance under various incentive programs.
$200 \leq X < 1000$	Revenue grade IDR meters measuring net generation output and customer load. No telemetry required.
$1,000 \leq X < 10,000$	Revenue grade Real-Time Energy Metering (RTEM) meters capable of near real-time telemetry measuring net generation output and customer load, watts, vars, watt-hour, var hour, amps and volts.
Wind Projects $\geq 1,000$	Revenue grade IDR meters measuring net generation output and customer load, plus real-time (SCADA) telemetry required to measure/monitor total watts, vars, circuit breaker (CB) status and voltage of generating facility. Real-time telemetering requirements for wind projects less than 10 MW will be evaluated on a case-by-case basis.
$\geq 10,000$	Revenue grade IDR meters measuring net generation output and customer load, plus real-time (SCADA) telemetry required to measure at least two of the following three parameters: (1) total gross generation, (2) customer load, or (3) net flow to/from Utility interface. SCADA telemetry also required to monitor watts, vars, amps, volts (generator bus) and interface CB status. Actual points will vary depending on customer configuration.
Generating facilities where any single generator $\geq 10,000$	Revenue grade IDR meters measuring net generation output and customer load, plus real-time (SCADA) telemetry will be required to measure/monitor each individual unit's watts, vars, amps, volts (generator bus) and unit CB status.

Note: Where generation is connected directly to SDG&E through a customer or SDG&E switchyard interface at 69 kV and above, SDG&E also requires real-time (SCADA) telemetry for switchyard CB status, bus volts, and line watts and vars.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 14 OF 16	Indicates Latest Revision	<input checked="" type="checkbox"/>	Completely Revised	New Page	Information Removed	SG 806.14
	SDG&E SERVICE STANDARDS & GUIDE					
	DISTRIBUTED GENERATION					

If a customer installs a generator utilizing a voltage not listed in SDG&E's Service Standards & Guide, then the customer will be required to install, own and maintain a transformer to match the Utility's service voltage. NGOM panels or switchgear must be located on the Utility side of the voltage-matching transformer.

All conditions specified in these requirements must be met and verified by an authorized SDG&E representative. In addition, approval from the AHJ, for portions of the electric system under their jurisdiction, is required before interconnection is allowed.

Whenever it is determined by SDG&E that the customer's generator is adversely affecting its electric distribution system, SDG&E reserves the right to disconnect the generator from its system until the customer has corrected the problem. Under emergency conditions, SDG&E reserves the right to disconnect the customer's generator from its electric distribution system without notification.


All devices used to disconnect the generator shall be accessible under all conditions and at all times, 24 hours a day, to SDG&E's authorized employees or agents.

Where service is provided at or below 480 volts, the customer is to be served by a dedicated transformer with the following exceptions:


- Exception 1: Not required for generation under 10 kW
- Exception 2: Not required for induction generation under 100 kW

For generation facilities that are rated one megawatt and above, SDG&E requires telemetering equipment at the source (at the customer's expense), to provide a continuous generation output data to SDG&E's operations personnel. The customer shall provide a dedicated communication service and 120-volt uninterruptable power source at each telemetering installation.



REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 15 OF 16		Indicates Latest Revision	<input checked="" type="checkbox"/>	Completely Revised	<input type="checkbox"/>	New Page	<input type="checkbox"/>	Information Removed	SG 806.15
	SDG&E SERVICE STANDARDS & GUIDE								
	DISTRIBUTED GENERATION								

Below are examples of typical billing and power purchase meters. Detented meters will be required on all installations.

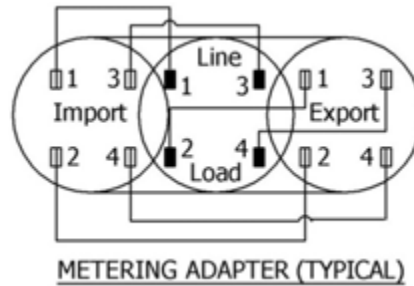

Note: The horizontal series meter adapter must have the billing meter in the left-hand socket and the power purchase meter in the right-hand socket. The vertical series meter adapter must have the billing meter in the top socket and the power purchase meter in the bottom socket.

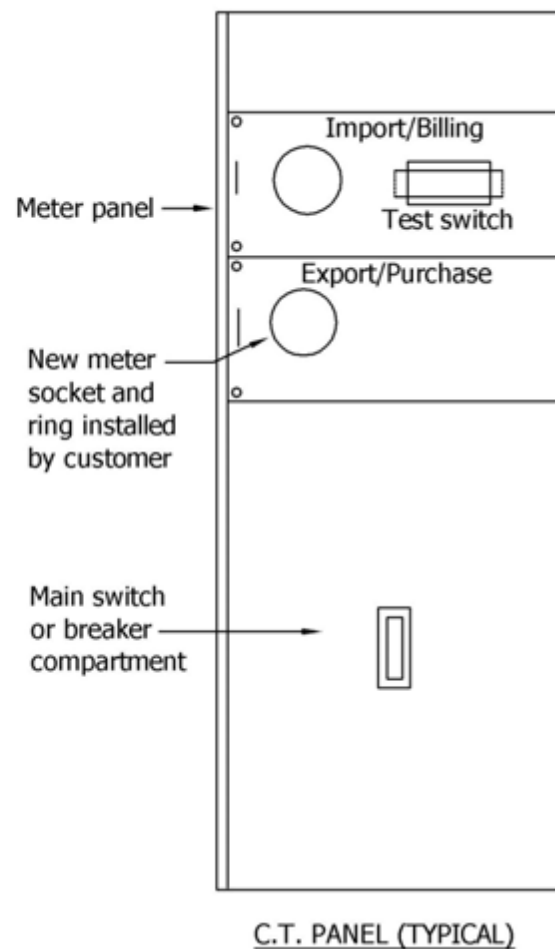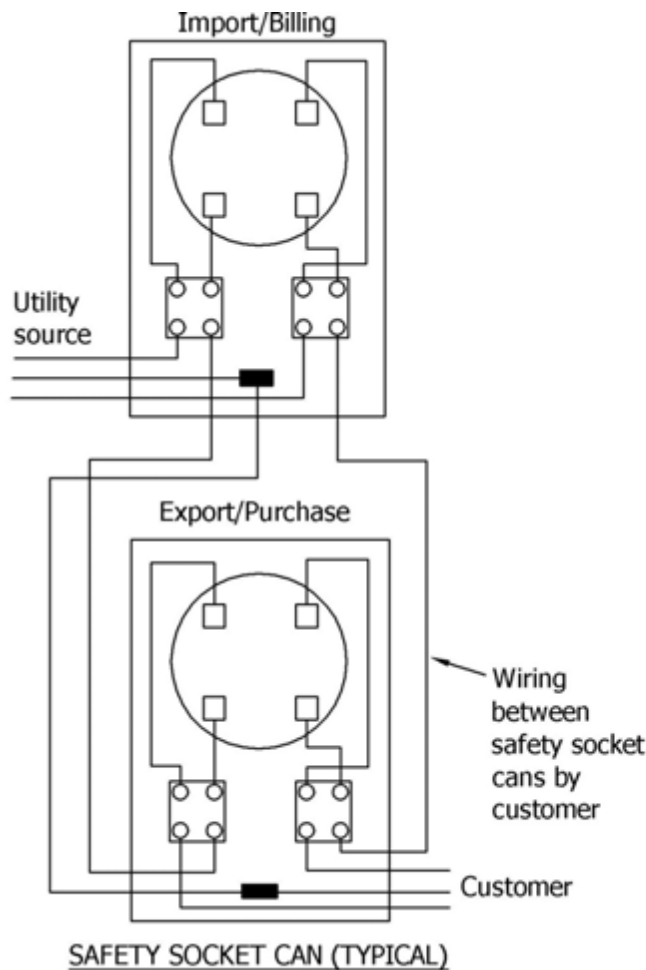

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

Indicates Latest Revision

☒ Completely Revised

☐ New Page

☐ Information Removed

SHEET
16 OF 16

SDG&E SERVICE STANDARDS & GUIDE

DISTRIBUTED GENERATION

SG 806.16

1000 - GAS

1000 - GAS

SUBJECTPAGE #

Access to Customer's Premises	SG 1003.1, SG 1003.3
Alcove	SG 1003.1
Assistance & Information for Equipment Selection & Energy Savings.....	SG 1003.3
Barricades for Gas Meter Sets	SG 1014.1 – 1014.3
Billing Account Establishment.....	SG 1003.3
Customer Responsibility for Appliances.....	1003.3
Definition of Terms	SG 1003.1 – 1003.2, SG 1009.2
Electric Bonding & Grounding of Gas Pipe.....	SG 1003.5
Establishing the Gas Meter Location & Location of Customer's Houeline.....	SG 1003.2
Gas Facilities near Underground Padmounted Equipment or Substructures	SG 1015.1 – 1015.7
Gas Meter Capacity & Selection.....	SG 1005
Gas Meters Grouped on Meter Headers	SG 1010.1 – 1010.8
Adequate Support for Wall Mounted Meter Headers	SG 1010.8
Customer Built Header Support.....	SG 1010.6 – 1010.7
Left Hand Headers	SG 1010.2 – 1010.3
Right Hand Headers	SG 1010.1, 1010.4 – 1010.5
Gas Service & Metering	SG 1003.2
Behind Wing Walls	SG 1011
Building Recess for Gas Service & Meters	SG 1012.1 – 1012.4
Meter Cabinet for Single Residential Gas Meter	SG 1008.1 – 1008.3
Gas Service Policies & Meter Locations	SG1006.1 – 1006.5
Existing Gas Service – Customer Requests for Additional Services	SG 1006.3 – 1006.4
Gas Meter Assembly Installation	SG 1007.1 – 1007.5
Gas Service & Metering	SG 1003.2
Meter Locations	SG 1006.1 – 1006.2

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 1 OF 2	Indicates Latest Revision	X	Completely Revised	New Page	Information Removed	SG 1002.1
	SDG&E SERVICE STANDARDS & GUIDE					
	GAS					
	ALPHABETICAL SUBJECT INDEX					

SUBJECTPAGE #

Meter & Service Location	SG 1006.1
Number of Services Allowed to a Building – New Projects	SG 1006.2 – 1006.3
Service Locations	SG 1006.5
Gas Service Riser & Houseline Spacing, Clearances & Minimum Working Space	SG 1009.1 – 1009.3
Clear & Level Working Space	SG 1009.2 – 1009.3
Clearances from Building Walls & Corners.....	SG 1009.1
Installation Space & Dimensions	SG 1009.2 – 1009.3
Gas Trench Only for San Diego County.....	SG 1004.1 – 1004.2
High-Pressure Metering	SG 1003.1, SG 1009.2
Houseline Modifications	SG 1003.4
Large Gas Field Service Vehicle Access	SG 1003.1
Markout Service	SG 1003.5
Meter Set Assembly (MSA).....	SG 1003.1
Mobile Home Meter Pad	SG 1013
Orange County District Meter Clearances.....	SG 1007.5
Ownership & Maintenance of Utility's Facilities	SG 1003.4
Recess (Building)	SG 1003.1, SG 1012.1 – 12012.4
Resale of Natural Gas.....	SG 1003.5
Signage Requirements for Gas Service Locations on Multi-Tenant Buildings	SG 1003.2 – 1003.3
Standard Cubic Feet per Hour (SCFH)	SG 1003.1
Utility Placement in Joint Trench & Gas Meter Assembly Installation.....	SG 1007.1 – 1007.5
Vent.....	SG 1003.1
Vented Appliance	SG 1003.1
Vented Decorative Appliance	SG 1003.2
Venting System.....	SG 1003.2

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	LSM	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 2	Indicates Latest Revision	X	Completely Revised	New Page	Information Removed	SG 1002.2
	SDG&E SERVICE STANDARDS & GUIDE					
	GAS					
	ALPHABETICAL SUBJECT INDEX					

SCOPE

The Gas Section presents general and detailed information concerning the location, accessibility, and ventilation of gas meters, risers, service regulators and gas services for new installations and relocations.

PURPOSE

The Service Standards & Guide Gas Section is for use by plumbers, architects, builders and others interested in designing and building a proper gas service and meter(s) installation.

DEFINITIONS OF TERMS

Accessible: Capable of being reached quickly and conveniently 24 hours a day for construction, operation, maintenance, inspection, testing or reading, without requiring those seeking access to climb over or remove obstacles; or to obtain special permission or security clearances.

Alcove: An enclosed, normally recessed, area where gas meters are installed. Enclosed alcoves are not permitted for any new project submitted to the Utility. Existing alcoves are grandfathered. If modifications are made to the customer's gas system, such as load additions requiring a larger gas meter, the gas meter will not be allowed to stay in the alcove.

Large Gas Field Service Vehicle Access: A minimum 16' wide "all weather" driven way of sufficient strength to support truck weight class H20 (20 tons), with a clear height of 13'-6" and a 40' minimum turning radius measured from inside curb.

Meter Set Assembly (MSA): Service riser, regulator, meter, and associated piping.

Recess: An indentation of a building wall, foundation, and floor. A recess is open on the front so that the meter set assembly is visible. No doors, lattice work, or covers of any type are permitted. The building foundation must not cross any portion of the recess. See pages SG 1012.1 – 1012.4 for minimum requirements for a recess.

Standard Cubic feet per Hour (SCFH): A unit of measure to represent the rate of flow of gas, adjusted to standard temperature and pressure conditions.

High-Pressure Metering: Gas pressure higher than the standard 7" water column.

Vent: A listed factory-made vent pipe and vent fittings for conveying flue gases to the outside atmosphere.

Vented Appliance: An appliance that requires a venting system. See definition of Venting System.

Vented Decorative Appliance: A vented appliance whose only function is providing an esthetic effect of flames. In very rare cases when the heat value of the vented decorative appliance (fireplace or gas log appliance) is being used in the space heating calculations for Title 24 energy calculations, the appliance is no longer considered "decorative only" and will require individual gas metering by the Utility. When this occurs, all individual vented and un-vented gas appliances serving a dwelling unit must be individually metered by the Utility.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B	No Changes – Reaffirmed	JC	TPM	MDJ	07/23/15	E					
C						F					

SHEET 1 OF 5	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 1003.1
	SDG&E SERVICE STANDARDS & GUIDE					
	GENERAL INFORMATION					

Venting System: Consists of the vent or chimney and its connectors, assembled to form a continuous open passageway from an appliance to the outside atmosphere for the purpose of removing products of combustion. This definition shall also include a venting assembly which is an integral part of an appliance.

GAS SERVICE & METERING

Each new single or multi-family residential dwelling unit, where the tenant can use gas directly in gas appliances which require venting, shall be individually metered by the Utility.

Exception: If the only vented appliances serving the dwelling units are decorative appliances the unit is not required to be separately metered and may receive its gas supply through a master meter effective January 1, 2005. See vent-related definitions above. This exception does not apply to log lighters. Log lighters are a vented appliance, and are not considered to be decorative.

The Utility supplies natural gas at a heating value that may change from time to time due to the supply from various gas fields as gathered and transmitted to the Utility.

ESTABLISHING THE GAS METER LOCATION & LOCATION OF CUSTOMER'S HOUSELINE

When building plans have been completed and gas loads are known, the Utility's Planner should be contacted. Refer to page SG 2 for contact information. After reviewing building plans and gas load information, the Planner will provide a written "Gas Service and Meter Location" form. This will establish where the gas meter(s) and houseline(s) are to be located. Buildings requiring multiple meters shall have all meters located at one location. See pages SG 1006.2 – 1006.4 for information on additional services. All houselines shall be clearly and permanently marked by the contractor or customer to identify the unit to be served.

When any gas design load is over 1,000 SCFH, or "high pressure" gas service is required, the Utility will initiate a gas load study. This study will be based on information supplied by the customer or their representative. The Utility will confirm the results of the load study to the customer or their representative via certified mail. The Utility's Planner will advise if large gas field service vehicle access will be required. See definition on page SG 1003.1. Extensions of gas mains and services will be made in accordance with the Utility's filed rules.

SIGNAGE REQUIREMENTS FOR GAS SERVICE LOCATIONS ON MULTI-TENANT BUILDINGS

Identification plaques are required for each gas service/header serving a multi-tenant building. They are to have a directory diagram showing all the gas service points and meter locations for the building, and must identify the particular service point being identified with the serving pressure to the header, and a listing of the units/suites served by it. See page SG 017.1 for plaque specifications, with the exception that all letter sizes may be reduced to 1/8".

In addition to the information specified above, plaques for 2-PSIG services to multi-family buildings are to show the location and access route to the 7" water column regulators for each unit served by the header being identified.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B	No Changes – Reaffirmed	JC	TPM	MDJ	07/23/15	E					
C						F					

SHEET 2 OF 5	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 1003.2
	SDG&E SERVICE STANDARDS & GUIDE					
	GENERAL INFORMATION					

The plaque is to be permanently affixed to the wall of the building served in immediate proximity to the header, or it is to be installed as a permanent self-supporting sign next to the header in a manner that does not impede required clearances and working space requirements for the header/meter set assembly.

BILLING ACCOUNT ESTABLISHMENT

A request to the Utility for electric and/or gas service is different than an inquiry into the availability of or charges for such service. Contact the Utility's Customer Contact Center at (800) 411-7343, to make an application for a billing account as soon as the street address has been assigned by the city/county.

CUSTOMER RESPONSIBILITY FOR APPLIANCES

The customer will maintain all gas piping and equipment in good safe condition beyond the point of service connection to the houseline. The Utility will not be responsible for any loss or damage caused by the customer's negligence, want of proper care, or wrongful act in maintaining the equipment.

The Utility has the right to refuse or to cease to deliver gas to any customer if any part of the piping, appliances or apparatus shall at any time be unsafe or if use is prohibited under any law, municipal ordinance or regulation.

The Utility does not assume the duty of inspecting the customer's piping, appliances or equipment and therefore, assumes no liability.

Gas service will not be supplied to apparatus or appliances where their operation will be detrimental to our gas system or other customers. Gas service will be discontinued to customers who continue to use such apparatus or equipment after being notified.

UTILITY'S RIGHT OF ACCESS TO CUSTOMER'S PREMISES

The Utility shall at all times have the right to enter and leave Applicant's Premises for any purpose connected with the furnishing of gas service (meter reading, inspection, testing, routine repairs, replacement, maintenance, emergency work, etc.) and the exercise of any and all rights secured to it by law, or under Utility's tariff schedules. These rights include but are not limited to:

1. The use of a Utility-approved locking device, if Applicant desires to prevent unauthorized access to Utility's facilities.
2. Safe and ready access for Utility personnel free from unrestrained animals.
3. Unobstructed ready access for Utility's vehicles and equipment to install, remove, repair or maintain its facilities.
4. Removal of any and all of its property installed on applicants premises after the termination of service.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B	No Changes – Reaffirmed	JC	TPM	MDJ	07/23/15	E					
C						F					

SHEET 3 OF 5	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 1003.3
	SDG&E SERVICE STANDARDS & GUIDE					
	GENERAL INFORMATION					

OWNERSHIP & MAINTENANCE OF UTILITY'S FACILITIES

Service pipe, meters, headers, regulators and other facilities furnished and installed by the Utility will continue to be the property of the Utility. They may be repaired or replaced by the Utility at any time and may be removed on termination of service. No rent or other charge may be made against the Utility for placing or maintaining its facilities on the customer's premises. The customer will exercise reasonable care to prevent the facilities from being damaged or destroyed.

In the event that the customer finds the gas service to be defective, they should notify the Utility immediately by calling (800) 411-SDGE (7343).

A typical meter installation consists of the service riser coming up out of the ground to the pressure regulator which connects to the meter. The houseline, installed by the customer's plumber, is connected by the Utility to the outlet side of the meter. Any changes to the houseline thereafter will be made by the customer or their plumber at the customer's expense in accordance with applicable codes and regulations. Adequate working space and access must be provided 24 hours per day for inspection and servicing by the Utility.

Large meters (8C or larger) must be located so as to be available for servicing with large gas field service vehicle access to the meter location. See definition on page SG 1003.1. In all cases, it is highly advisable that a meter location be established by the Utility before detailed design of the building and awarding of the plumbing contract is done.

HOUSELINE MODIFICATIONS

In cases where a customer's planned improvement or alteration to a building requires relocation or change to their houseline, such work must be done by the customer prior to the Utility re-routing its service pipe. It is the customer's responsibility to tie-in a new houseline(s) to the existing houseline(s). It is also the customer's responsibility to pay to the Utility any relocation charges for any service pipe which is relocated.

An inspection clearance from the governmental Authority Having Jurisdiction (AHJ) is required before a new houseline can be connected or an altered houseline can be reconnected.

Should it be necessary to extend or enlarge a houseline because of added load, call the Planner at the Project Management Regional Office nearest your job location prior to connecting the houseline. (See page SG 2.) Large added gas loads, such as pool heaters, may require the replacement of the existing gas meter with a larger one to assure adequate pressure and flow.

In many instances, a "hot change tee" has been installed on the outlet side of the gas meter. This tee is used to improve our service to the customer by allowing a meter change or test to be performed without interrupting the customer's gas service. The tee is designed for use by the Utility only and must not be used for any other purpose by the customer or their plumber.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B	No Changes – Reaffirmed	JC	TPM	MDJ	07/23/15	E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
4 OF 5

SDG&E SERVICE STANDARDS & GUIDE

GENERAL INFORMATION

SG 1003.4

RESALE OF NATURAL GAS

It is not permissible for a customer to resell any of the gas received from the Utility to any other person, firm or corporation, except that the owner or lessee of any existing "Master Metered" mobile home park may resell to their tenants. Such resale of gas must be at rates identical to those rates the Utility would apply in the event that gas was supplied to the sub-consumer directly by the Utility.

ELECTRIC BONDING & GROUNDING OF GAS PIPE

The following are not permitted:

1. Electric bonding to the Utility's gas service piping, gas risers, or meter facilities.
2. Using the Utility's gas service piping, gas risers, or meter facilities for electrical grounding, or in a manner that the gas piping or other gas facilities become current-carrying conductors.

MARKOUT SERVICE

Before you begin digging at your building site, contact DigAlert for markout service, to avoid conflict with existing underground facilities. You may contact DigAlert by calling 811, Monday through Friday, 6:00 a.m. – 7:00 p.m., or visit their website, <https://www.digalert.org/>. For emergency markout service only, call Service Dispatch at (619) 725-5100.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B	No Changes – Reaffirmed	JC	TPM	MDJ	07/23/15	E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
5 OF 5


SDG&E SERVICE STANDARDS & GUIDE

GENERAL INFORMATION


SG 1003.5

This standard applies to new 3" or smaller gas services tapped off a 4" or smaller gas main or service. The trench and tie-in hole (weld hole) in which your service will be installed must conform to the minimum standards which appear below and on page SG 1004.2.

GAS TRENCH ONLY TRENCH DETAIL

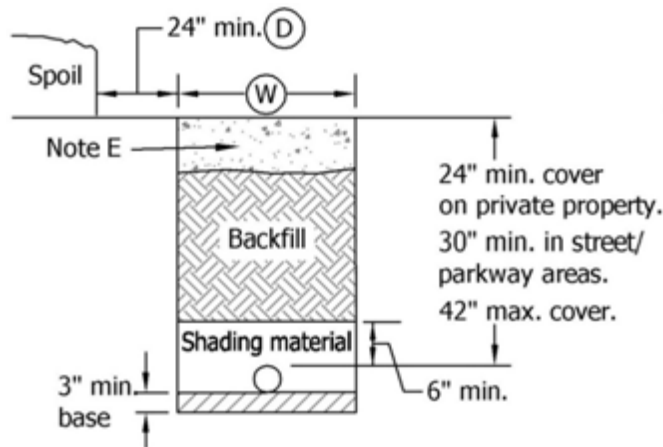

TIE-IN HOLE DIMENSIONS

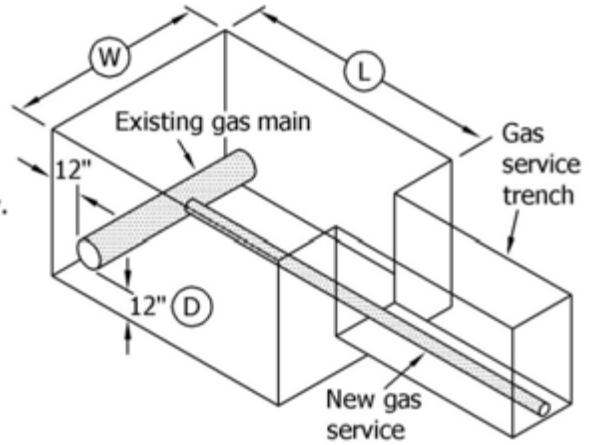

(W) Minimum Dimensions for Width of Trench	
Gas Pipe Size	Width
1" or Less	6"
2"	9"
3"	12"*

- (D) Depth = 12" below existing gas main
- (W) Width = 48" minimum
- (L) Length = 60" minimum

Note: The SDG&E Inspector will advise if field conditions warrant additional excavation.

* Width at coupling locations must be increased to 18" for 5' on each end of coupling.

Notes:

- A. Customer to contact the local city or county for an excavation permit and their requirements prior to excavation in the public right-of-way. State law requires you to contact DigAlert at 811 or visit www.digalert.org, at least 2 working days prior to excavation.
- B. A 3" base is required to prevent damage from rocks, sags or pockets. Imported material consisting of natural sand or manufactured sand, existing native material or combinations may be used for base and shading material provided it complies with SDG&E (Utility) standards and the compaction requirements of the governmental agencies. Shading material must have a mixture of particle sizes all smaller than 1/2". A minimum cover of 4" of compacted shading material (4" after compaction) shall be installed above gas pipe. A minimum cover of 12" of compacted shading material will be required if in the opinion of the Inspector there is an excessive amount of rocks and clods in the backfill. The shading material must be installed before the trench is backfilled to prevent damage from rocks, etc. The backfill material shall meet the requirements of all applicable codes, ordinances, and the Utility's Standards and be free of debris and organic matter. The coarse material shall be well

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B	Editorial Changes	JC	TPM	MDJ	09/16/15	E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 2

SDG&E SERVICE STANDARDS & GUIDE

GAS TRENCH ONLY FOR SAN DIEGO COUNTY

SG 1004.1

distributed throughout the finer material. All base, shading and backfill must be approved by the Utility's Inspector.

- C. After the Utility's Inspector approves the trench, tie-in excavation, base shading and backfill material, the Utility will install and energize the gas service. When the gas service is energized, it must be covered during the same working day. The Utility's Inspector must approve installation of shading material prior to backfilling.
- D. Where Utility employees, or their contractors, are required to enter the trench, spoil must be placed a minimum of 24" from edge of trench. (See Gas Trench Only Trench Detail figure on page SG 1004.1.) If excavation at the gas main is 5' or more in depth, all safety requirements, including shoring the tie-in hole (weld hole), must be met.
- E. No wet utilities, such as water, sewer or irrigation pipes are allowed in the service trench. A minimum 12" horizontal separation of undisturbed soil is required between your service trench and any water, sewer or drain pipe. A minimum 6" vertical separation is required for crossings.
- F. All trench resurfacing shall be done according to the governmental agencies' requirements.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B	Editorial Changes	JC	TPM	MDJ	09/16/15	E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
2 OF 2

SDG&E SERVICE STANDARDS & GUIDE

GAS TRENCH ONLY FOR SAN DIEGO COUNTY

SG 1004.2

Table 1
Standard 7" Water Column (WC) Service Pressure Gas Meter Capacity & Section

Meter Type & Size D=Diaphragm R=Rotary	Meter Capacity at 7" WC in SCFH	Maximum SDG&E Riser Size at 7" WC	SDG&E Riser to Houseline Spacing Dimension
D 250-275	250-275	¾" STL x ½" PE	19"
D 425	425	¾" STL x ½" PE	19"
D 630	630	¾" STL x ½" PE	19"
R 8C	800	1"	30"
R 11C 175	1,100	1"	30"
R 15C 175	1,500	1"	36"
R 2M 175	2,000	1"	48"
R 3M 175	3,000	1"	48"
R 5M 175	5,000	1"	75"
R 7M 175	7,000	1"	75"

Table 2
High Pressure (5 PSIG) Service Pressure Gas Meter Capacity & Section

Meter Type & Size D=Diaphragm R=Rotary	Meter Capacity at 7" WC in SCFH	Maximum SDG&E Riser Size at 7" WC	SDG&E Riser to Houseline Spacing Dimension
D 425	1,030	1"	48"
R 8C	1,100	1"	48"
D 630	1,500	1"	48"
R 2M 175	2,600	1"	48"
R 3M 175	4,000	1"	48"
R 5M 175	6,600	1"	75"
R 7M 175	9,200	1"	75"
R 11M 175	14,500	1"	90"
R 16M 175	21,100	1"	90"

Notes:

1. Rotary type meters require truck access for installation and maintenance.
2. The SDG&E riser diameter selected for a meter does not need to match the service pipe diameter. Use the "Maximum SDG&E Riser Size" column in the appropriate table above to make your selection.
3. The houseline should be located to the right of the meter set assembly. The flow of gas from inlet to outlet should be left to right.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE

GAS METER CAPACITY & SELECTION

SG 1005

METER & SERVICE LOCATION

Location for gas meters and services shall comply with the provisions of this manual and applicable codes, laws, and ordinances of the governmental Authority Having Jurisdiction (AHJ) for inspection.

It is necessary that the location for the meter and service be approved in writing by an SDG&E Planner. This can be accomplished by the customer or contractor contacting the Utility's nearest Service Planning or Project Management Regional Office by telephone or the internet and requesting a "Meter and Service Location" form. See page SG 2 for contact information.

METER LOCATIONS

1. Gas meters and regulators must be installed by the Utility in a readily accessible location, approved by the Utility on the customer's premises. They must be capable of being reached quickly and conveniently 24 hours a day by an unobstructed access route for construction, operation, maintenance, inspection, testing or reading, and without requiring those seeking access to climb over or remove obstacles, or obtain special permission or security clearances. The access route must not be prone to flooding, or planted with anything other than grass or artificial turf.
2. The Utility's gas meters and service pipe are not permitted on, in, over or under a house, building, underground structure, breezeway, patio, wood deck, asphalt, concrete pad, carport or bio-retention facilities.
3. Large meters (8C or larger) must be located so as to be available for servicing with large gas field service vehicles. See definition of "Large Gas Field Service Vehicle Access" on page SG 1003.1.
4. Doors, gates or other such facilities which restrict access to any meter location, must be locked only with locking devices acceptable to the Utility.
5. For single and multiple occupancy buildings, meter and metering equipment may be installed:
 - a. Outdoors and adjacent to a building
 - b. Behind a wing wall
 - c. For multiple occupancy buildings, meters and metering equipment are to be grouped at one location
6. For mobile home lots, meters and metering equipment may be installed:
 - a. At or near the corner of the mobile home, closest to the Utility's source
 - b. On a permanently installed structure near the front lot line of the mobile home lot
 - c. At or near the corner of the mobile home lot, closest to the Utility's source

Note: Meters shall not depend on a flex gas houseline for support. A post, bracket or other means of rigid support is to be provided by the customer when required by the appropriate AHJ or Utility. See page SG 1013 for mobile home meter pad information.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B	No Changes – Reaffirmed	JC	TPM	MDJ	07/23/15	E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 5

SDG&E SERVICE STANDARDS & GUIDE

GAS SERVICE POLICIES & METER LOCATIONS

SG 1006.1

7. Meter headers are limited to two tiers to ensure safety of personnel and meter accessibility.
8. Meters must be located in a ventilated area.
9. A minimum of 3' clear and level working space is required directly in front of any portion of the Meter Set Assembly (MSA) or recess. See pages SG 1012.1 – 1012.2 for minimum working space requirements for a building recess.
10. Gas regulators must be located away from openings into a building in order to allow gas to escape freely to the outside atmosphere in the event of a leak. The Utility is installing service regulators with internal relief valves for over pressure protection which may release gas through the regulator vent opening. See pages SG 1007.1 – 1007.5 for specific requirements.
11. Gas meters and service regulators must be protected from damage due to corrosion, extreme temperatures, vehicular traffic and moisture. Exposure to pool chemicals, dryer vents, lawn sprinklers, etc., must be avoided.

GAS SERVICE POLICY FOR NEW PROJECTS – NUMBER OF SERVICES ALLOWED

1. Multi-family Residential Buildings – Less than 3 Stories High

One service per building will typically be granted. At the Utility's discretion, and with approval from the AHJ, a second service may be granted if space is not available to group all the meters at one location. Gas Rule 16 will apply and residential allowances will be applied to the cost of the second service.

Note: The 300' rule that applies to electric service policies does not apply to gas. Justification for a second service is based on space constraints for meters, building layout, etc.

2. Residential or Mixed Use Buildings – 3 Stories or Greater

One service per building will typically be granted. At the Utility's discretion, and with approval from the AHJ, a second service may be granted if space is not available to group all meters at one location. Gas Rule 16 will apply and residential allowances will be applied to the cost of the second service.

Note: The 300' rule that applies to electric service policies does not apply to gas. Justification for a second service is based on space constraints for meters, building layout, etc.

3. Residential Contiguous Dwellings – Townhouses (Row Homes)

- a. Each individual townhouse or duplex located on a parcel of land bounded by legal property lines must be provided with an individual gas service and meter(s) located on the property served.
- b. Each individual townhouse or duplex located on a single parcel of property divided with "assumed property lines" with approval from the AHJ may be provided with:
 - i. An individual gas service and meter(s) located on the townhouse bounded by assumed property lines, or

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B	No Changes – Reaffirmed	JC	TPM	MDJ	07/23/15	E					
C						F					

X	Indicates Latest Revision	Completely Revised	New Page	Information Removed
----------	---------------------------	--------------------	----------	---------------------

**SHEET
2 OF 5**

SDG&E SERVICE STANDARDS & GUIDE

GAS SERVICE POLICIES & METER LOCATIONS

SG 1006.2

- ii. May be served through a single gas service, with meters grouped at one location in a common area. The header must be supported independent of the buildings containing dwelling units.

Easements will be required to be established and recorded in the deed of every townhouse allowing for privately-owned gas lines to cross assumed property lines. The Utility is not involved in the easement process but it is important for developers to understand this requirement.

4. Single Premise – Multiple Non-Residential Enterprises (such as Shopping Centers & Office Buildings)

One service per building will typically be granted. At the Utility's discretion, and with approval from the AHJ, a second service may be granted if space is not available to group all meters at one location. Gas Rule 16 will apply and non-residential allowances will be applied to the cost of the second service.

Note: The 300' rule that applies to electric service policies does not apply to gas. Justification for a second service is based on space constraints for meters, building layout, etc.

5. Single Premise – Single Non-Residential Enterprise (Customer)

One service per premise serving a single enterprise will be granted. If a second service is approved, the customer will be required to pay the total estimated installed cost as a non-refundable payment. No allowances will be granted for the second service.

6. Single Premise – Multiple Residential Customers

Each separate structure containing two or more legal dwelling units must be individually served by the Utility. Each dwelling unit must be individually metered by the Utility. Gas Rule 16 for Service Extensions and the residential allowances per Rule 15 for each dwelling unit will apply to each service. Approval by the AHJ is required.

GAS SERVICE POLICY FOR EXISTING CUSTOMERS – REQUESTS FOR ADDITIONAL SERVICE

1. Multi-Family Residential Buildings – Less than 3 Stories High

The customer should be instructed to plumb to the existing meter location. If field conditions make it impractical, a second service can be granted. The customer will be billed total installed cost. Master to individual requests requiring a second service to accommodate all of the individual meters will be billed total installed cost.

2. Residential or Mixed Use Buildings – 3 Stories or Greater

The customer should be instructed to plumb to the existing meter location. If field conditions make it impractical, a second service can be granted. The customer will be billed total installed cost.

Master to individual requests requiring a second service to accommodate all of the individual meters will be billed total installed cost.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B	No Changes – Reaffirmed	JC	TPM	MDJ	07/23/15	E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------

SHEET
3 OF 5

SDG&E SERVICE STANDARDS & GUIDE

GAS SERVICE POLICIES & METER LOCATIONS

SG 1006.3

3. Residential Contiguous Dwellings – Townhouses (Row Homes)

- a. Each individual townhouse or duplex located on a parcel of land bounded by legal property lines must be provided with an individual gas service and meter(s) located on the property served.
- b. Each individual townhouse or duplex located on a single parcel of property divided with "assumed property lines" may be provided with:
 - i. An individual gas service and meter(s) located on the townhouse bounded by assumed property lines, or
 - ii. May be served through a single gas service, with meters grouped at one location in a common area. The header must be supported independent of the buildings containing dwelling units.

Easements will be required to be established and recorded in the deed of every townhouse allowing for privately-owned gas lines to cross assumed property lines. The Utility is not involved in the easement process but it is important for developers to understand this requirement.

4. Single Premise – Multiple Non-Residential Enterprises (such as Shopping Centers & Office Buildings)

The customer should be instructed to plumb to the existing meter location if same pressure. If high pressure is required, set new meter adjacent to existing meter location. Allowances will be granted towards Rule 16 costs.

5. Single Premise, Single Non-Residential Enterprise (Customer)

The customer should be instructed to plumb to the existing meter location if same pressure. If high pressure is required, set new meter adjacent to existing meter location. Allowances will be granted towards Rule 16 costs. If reinforcement is required, customer will pay incremental cost of reinforcement less the allowance for new load. At the Utility's discretion, a new service may be less expensive than the reinforcement of the existing service. If so, the customer would pay the cost for the new service less the allowance granted for the new load

6. Single Premise – Multiple Residential Customer

The customer should be instructed to plumb to the existing meter location. For new service requests, each separate structure containing two or more legal dwelling units must be individually served by the Utility. Each dwelling unit must be individually metered by the Utility. Gas Rule 16 for Service Extensions and the residential allowances per Rule 15 for each dwelling unit will apply to each service. Approval by the AHJ is required.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B	No Changes – Reaffirmed	JC	TPM	MDJ	07/23/15	E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
4 OF 5

SDG&E SERVICE STANDARDS & GUIDE


GAS SERVICE POLICIES & METER LOCATIONS

SG 1006.4

SERVICE LOCATIONS

1. Gas services are to be installed along the shortest most practical route from the Utility's closest source to the meter location acceptable to the Utility. Install services perpendicular to the gas main. Diagonal installation shall not be permitted. See pages SG 1006.1 – 1006.2 for meter locations.

A joint service is limited to two risers per service line.
2. Each gas service must have a shutoff valve located outside of the building in a readily accessible location. The shutoff valve is not permitted in a locked security area.
3. Location of the Utility's gas service pipe will be designed to avoid hazards or obstructions (particularly retaining walls, trees, plowed land, excessive moisture, and steep banks).
4. Service pipe must not be run under or through a building, underground structure, breezeway, patio (asphalt, concrete pad, or wood decking) or carport.
5. The route of the gas service pipe must be accessible for leakage patrol and maintenance. The service pipe must not be installed in a steep bank that is higher than 8' and has a slope greater than a 3-to-1 ratio. The Utility must approve installation in slopes greater than 3-to-1.

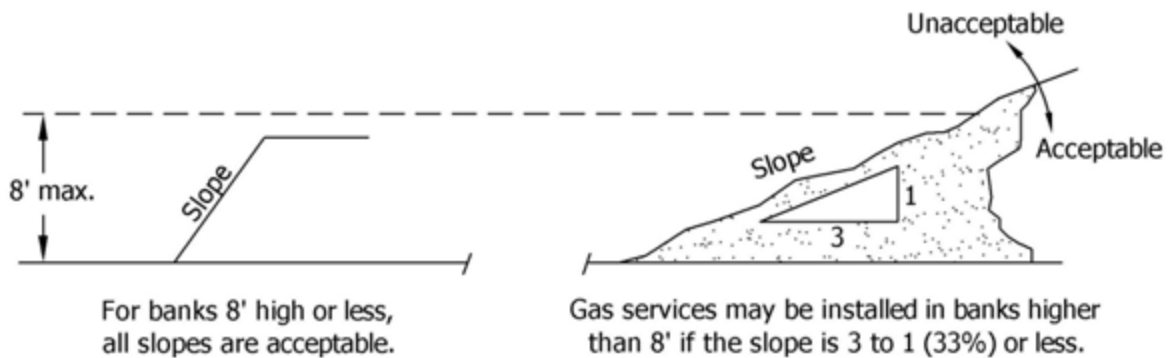

6. During construction, if the area around the riser is to be paved, a 4" minimum diameter or square opening around the riser is required. This includes mobile home meter pads. This must be provided to prevent damage to the riser and to provide an escape route in the event of a gas leak.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B	No Changes – Reaffirmed	JC	TPM	MDJ	07/23/15	E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
5 OF 5


SDG&E SERVICE STANDARDS & GUIDE

GAS SERVICE POLICIES & METER LOCATIONS

SG 1006.5

This Standard provides typical preferred and alternate utility placement in a joint trench for gas and electric service and meter installations, and gas meter set assembly separation requirements from electric meters, communication equipment, building openings, and miscellaneous equipment such as, but not limited to, tankless water heaters. The illustrations shown are typical for a residential single meter installation, but may be modified for multiple gas meter header installations and commercial/industrial premises.

TYPICAL INSTALLATION WITH SERVICES & METERING ON RIGHT SIDE OF STRUCTURE AND ELECTRIC METER LOCATED LEFT OF THE GAS METER (PREFERRED LOCATION)

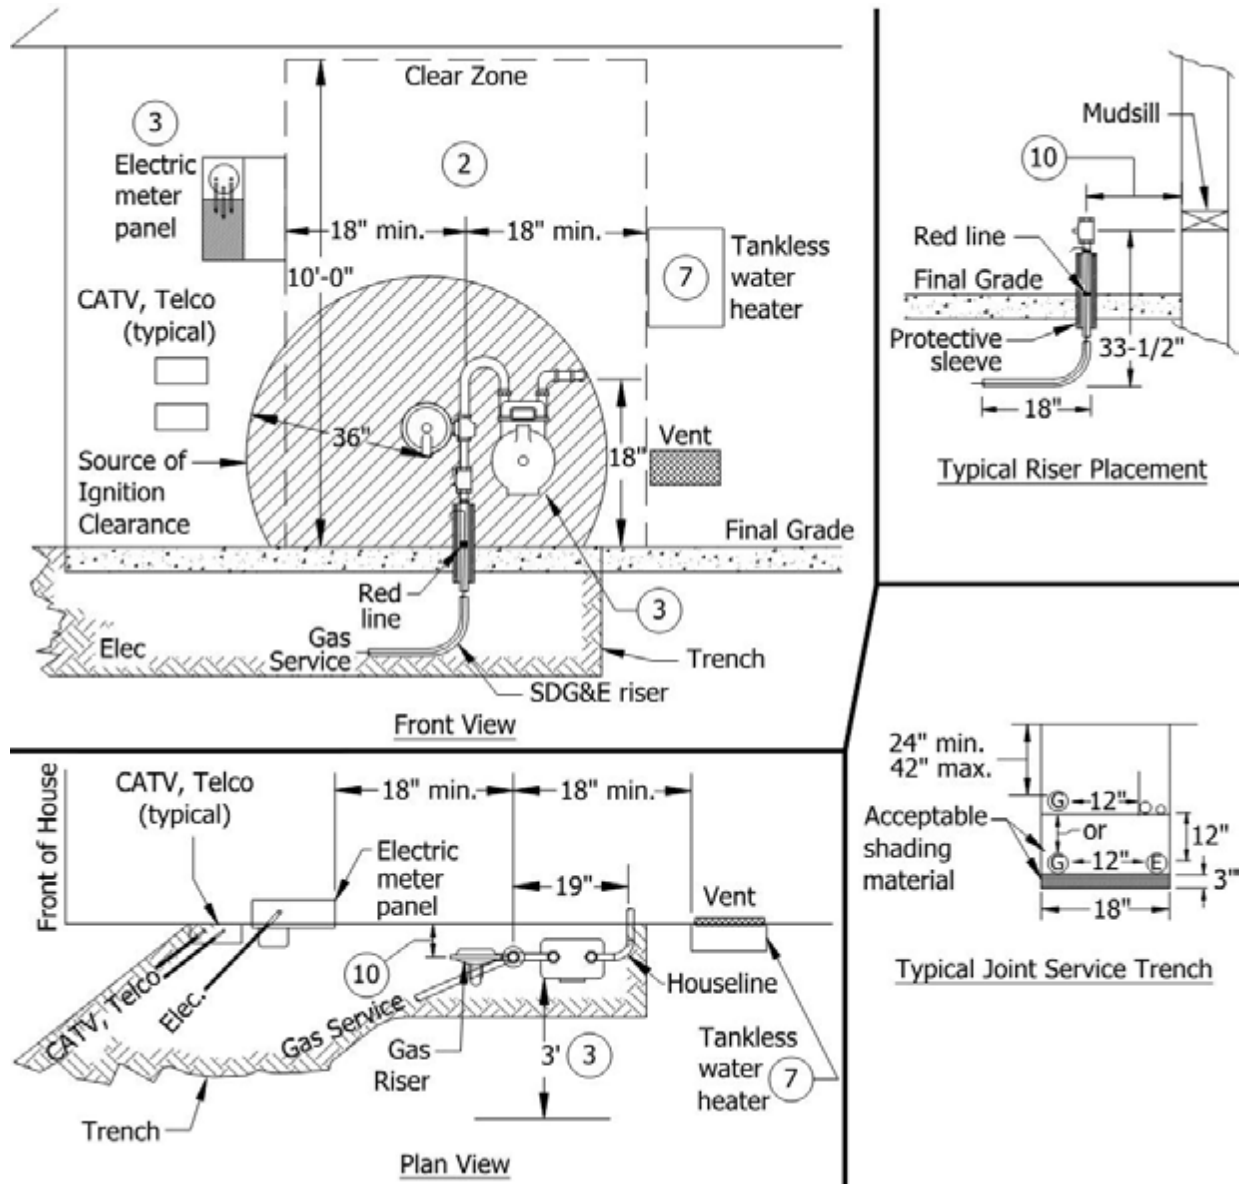

Reference D7103

Not to Scale

© 1998- 2019 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	EDITORIAL CHANGES	LSM	BRB	TPM	08/16/16	D					
B	EDITORIAL CHANGES	IPJ	IPJ	CZH	10/15/19	E					
C						F					

Indicates Latest Revision

☒ Completely Revised

☐ New Page

☐ Information Removed


SHEET
1 OF 5

SDG&E SERVICE STANDARDS & GUIDE


**UTILITY PLACEMENT IN JOINT TRENCH &
GAS METER SET ASSEMBLY INSTALLATION**

SG 1007.1


TYPICAL INSTALLATION WITH SERVICES & METERING ON RIGHT SIDE OF STRUCTURE & ELECTRIC METER LOCATED RIGHT OF THE GAS METER (ALTERNATE LOCATION)

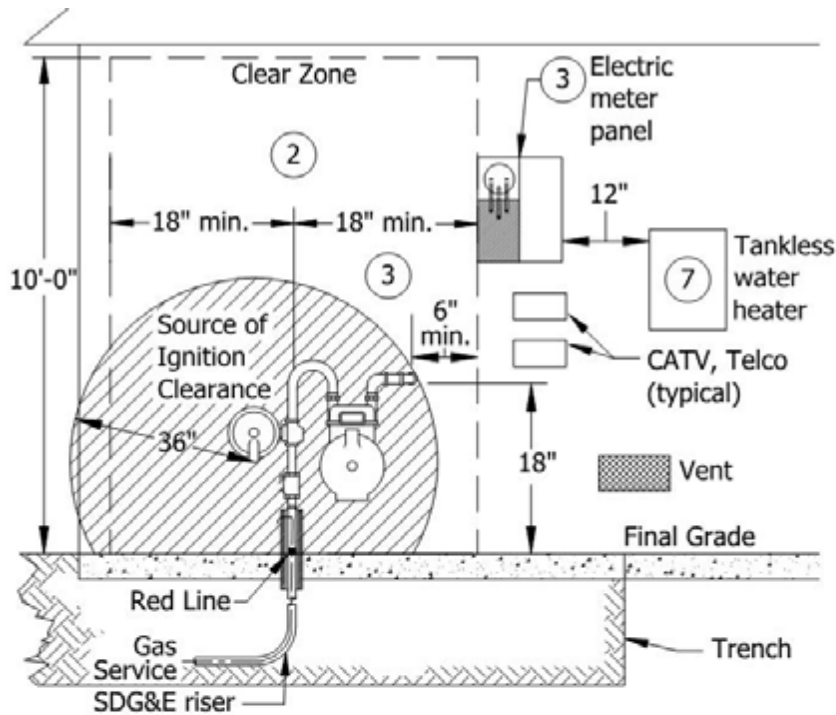


Front View

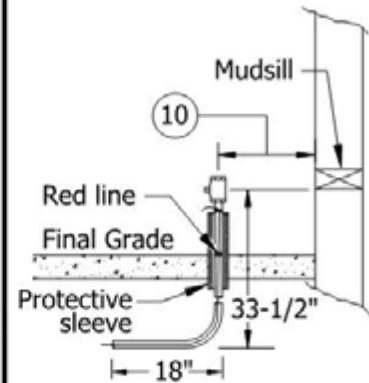

Typical Riser Placement

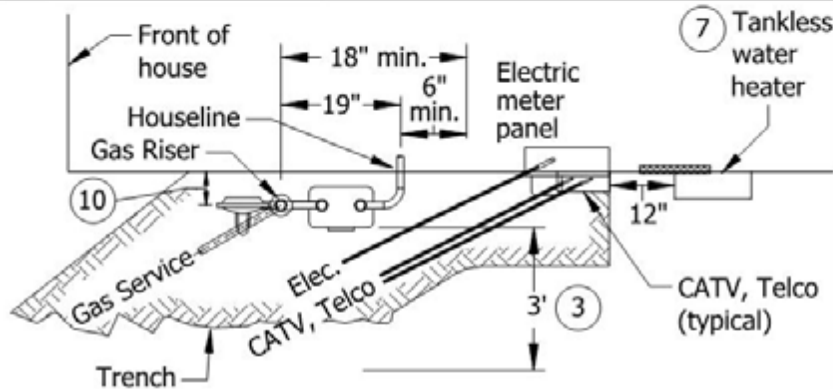

Plan View

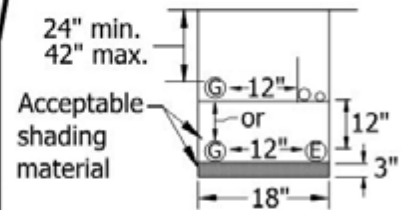

Typical Joint Service Trench

Reference D7103

Not to Scale

© 1998- 2019 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	EDITORIAL CHANGES	LSM	BRB	TPM	08/16/16	D					
B	EDITORIAL CHANGES	IPJ	IPJ	CZH	10/15/19	E					
C						F					

Indicates Latest Revision

☒ Completely Revised

☐ New Page

☐ Information Removed


SHEET
2 OF 5

SDG&E SERVICE STANDARDS & GUIDE

**UTILITY PLACEMENT IN JOINT TRENCH &
GAS METER SET ASSEMBLY INSTALLATION**

SG 1007.2

TYPICAL INSTALLATION WITH SERVICES & METERING ON LEFT SIDE OF STRUCTURE & ELECTRIC METER LOCATED RIGHT OF THE GAS METER (PREFERRED LOCATION)

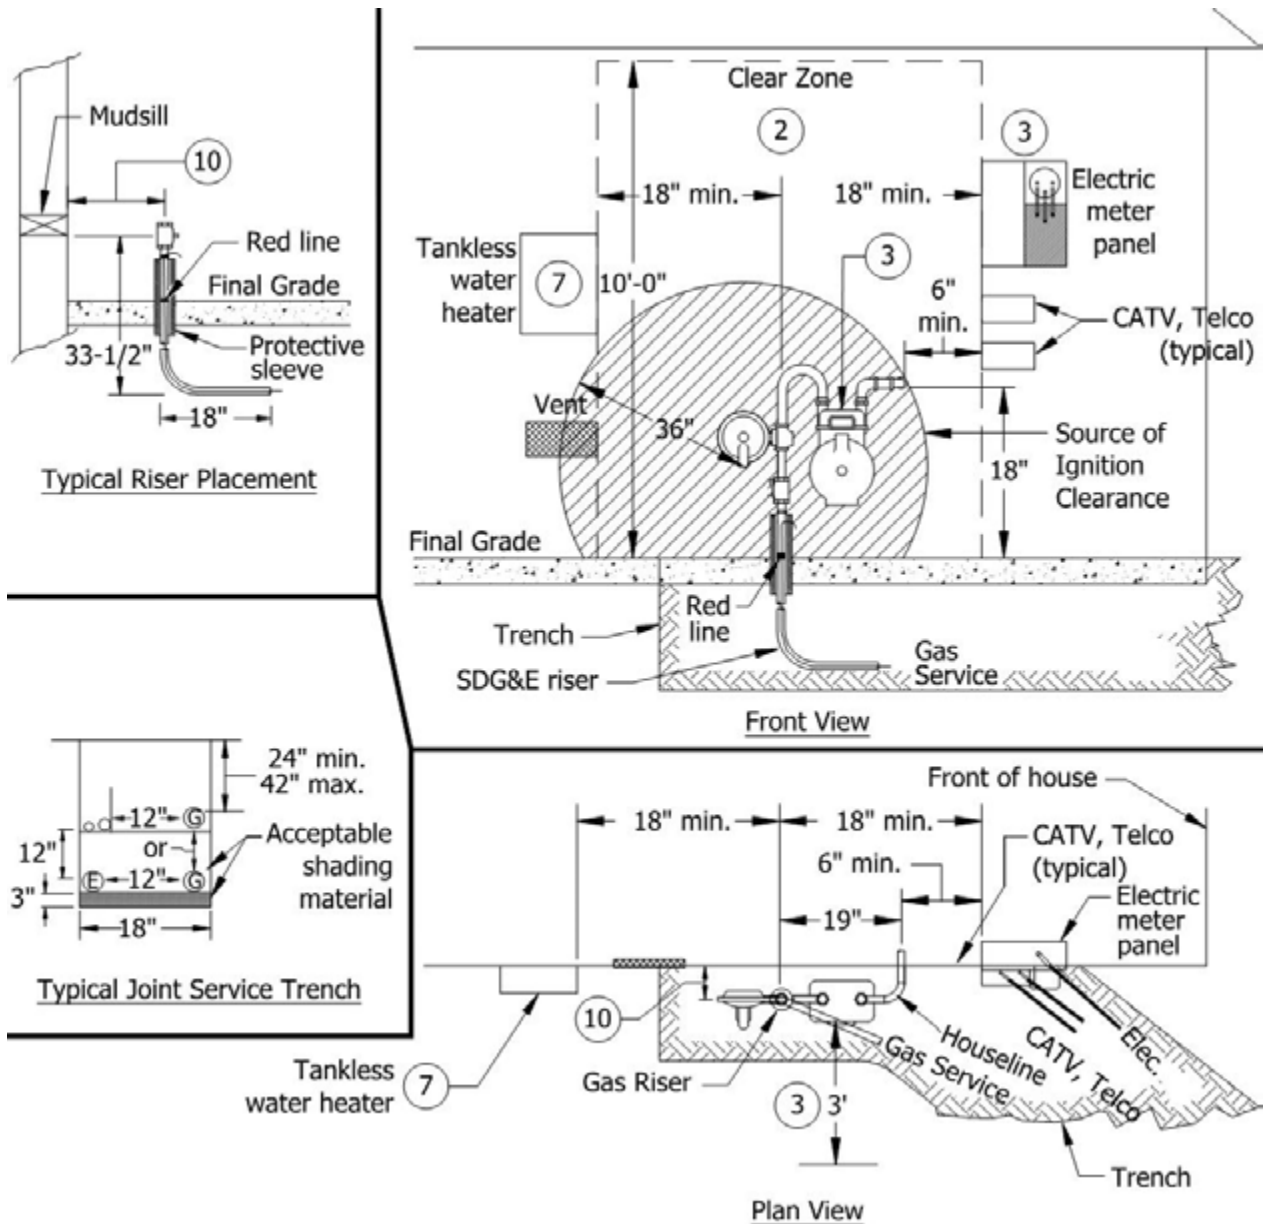

Reference D7103

No to Scale

© 1998- 2019 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	EDITORIAL CHANGES	LSM	BRB	TPM	08/16/16	D					
B	EDITORIAL CHANGES	IPJ	IPJ	CZH	10/15/19	E					
C						F					

Indicates Latest Revision

☒ Completely Revised

☐ New Page

☐ Information Removed


SHEET
3 OF 5

SDG&E SERVICE STANDARDS & GUIDE

**UTILITY PLACEMENT IN JOINT TRENCH &
GAS METER SET ASSEMBLY INSTALLATION**

SG 1007.3

TYPICAL INSTALLATION WITH SERVICES & METERING ON LEFT SIDE OF STRUCTURE AND ELECTRIC METER LOCATED LEFT OF THE GAS METER (ALTERNATE LOCATION)

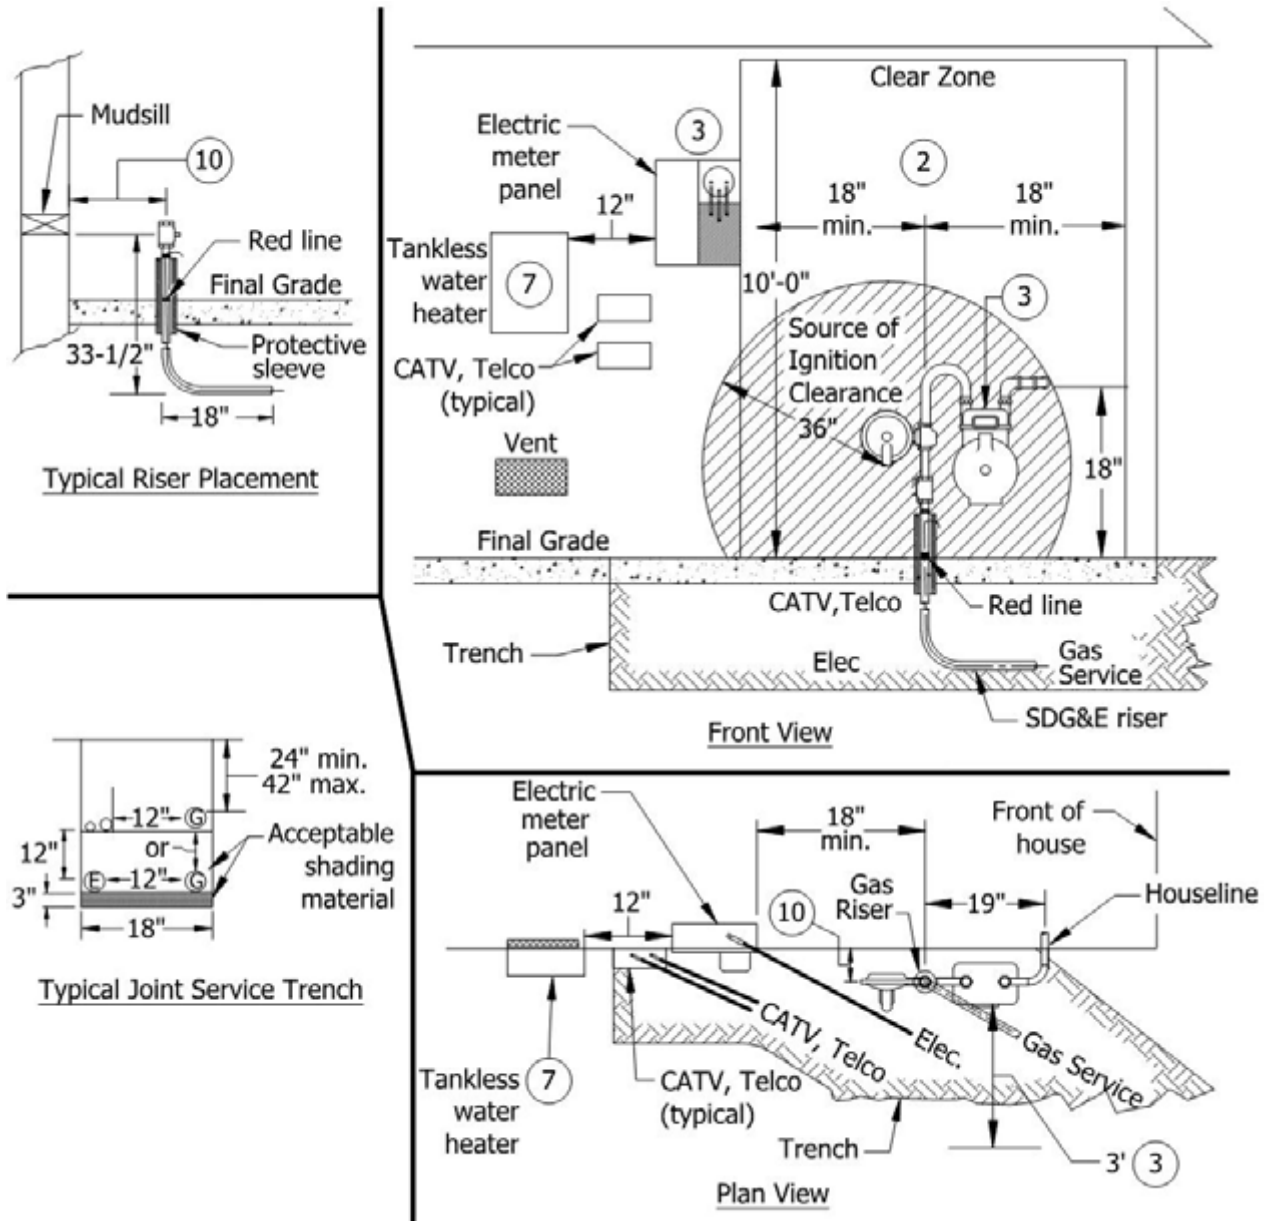

Reference D7103

Not to Scale

© 1998- 2019 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	EDITORIAL CHANGES	LSM	BRB	TPM	08/16/16	D					
B	EDITORIAL CHANGES	IPJ	IPJ	CZH	10/15/19	E					
C						F					

Indicates Latest Revision

☒ Completely Revised

☐ New Page

☐ Information Removed

SHEET
4 OF 5

SDG&E SERVICE STANDARDS & GUIDE

**UTILITY PLACEMENT IN JOINT TRENCH &
GAS METER SET ASSEMBLY INSTALLATION**

SG 1007.4

Notes:

1. Size and dimensions of panels may vary. Illustrations on pages SG 1007.1 – 1007.4 are not to scale.
- 2 Wall area behind meter set assembly including headers, must be free of any obstructions such as water pipes, hose bibs, sewer clean outs, drain spouts, electric conduits, etc. No building vent, window or other openings, covered or uncovered, are allowed within 18" from the Utility gas riser vent, and from final grade to a height of 10'. Fixed windows are acceptable. Equipment, such as but not limited to, cable TV, telephone, inverters, disconnecting devices, transfer switches, etc., are also not allowed within 36" radially of the Utility gas riser vent, and from final grade to a height of 10' above the gas meter set assembly as indicated by the clear zone.
- 3 Maintain 36" clear and level working space in front of gas and electric meters.
5. Electric bonding to or use of the Utility's gas service piping, gas risers or meter facilities for electric grounding is not permitted.
- 7 Tankless water heaters require a minimum 36" radial clearance from the Utility gas riser vent to a height of 10' above grade and outside clear zone. A minimum 12" side clearance to the electric meter panel is required. The tankless water heater is not to be installed directly under electrical service and metering equipment.
8. Utility locations at property line connection point may vary.
9. Trench depth or width may vary according to what utilities are installed. Contact the SDG&E Planner or Inspector for further information.
- 10 The minimum distance between the gas riser and the building exterior is 12". Refer to page SG 1009.1 for additional information on minimum clearances from building walls and corners and page SG 1009.3 for gas riser to wall spacing for larger meters.

NOTE: For relocations or upgrades on existing installations, contact an SDG&E Planner.

Reference D7103

Notes 4 and 6 have been intentionally omitted.

© 1998- 2019 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	EDITORIAL CHANGES	LSM	BRB	TPM	08/16/16	D					
B	EDITORIAL CHANGES	IPJ	IPJ	CZH	10/15/19	E					
C						F					

SHEET 5 OF 5	Indicates Latest Revision	X	Completely Revised	New Page	Information Removed	SG 1007.5
	SDG&E SERVICE STANDARDS & GUIDE					
	UTILITY PLACEMENT IN JOINT TRENCH & GAS METER SET ASSEMBLY INSTALLATION					

This standard provides illustrations and requirements for a prefabricated field installed gas meter cabinet for a single residential gas meter only.

Meter Cabinet Installation

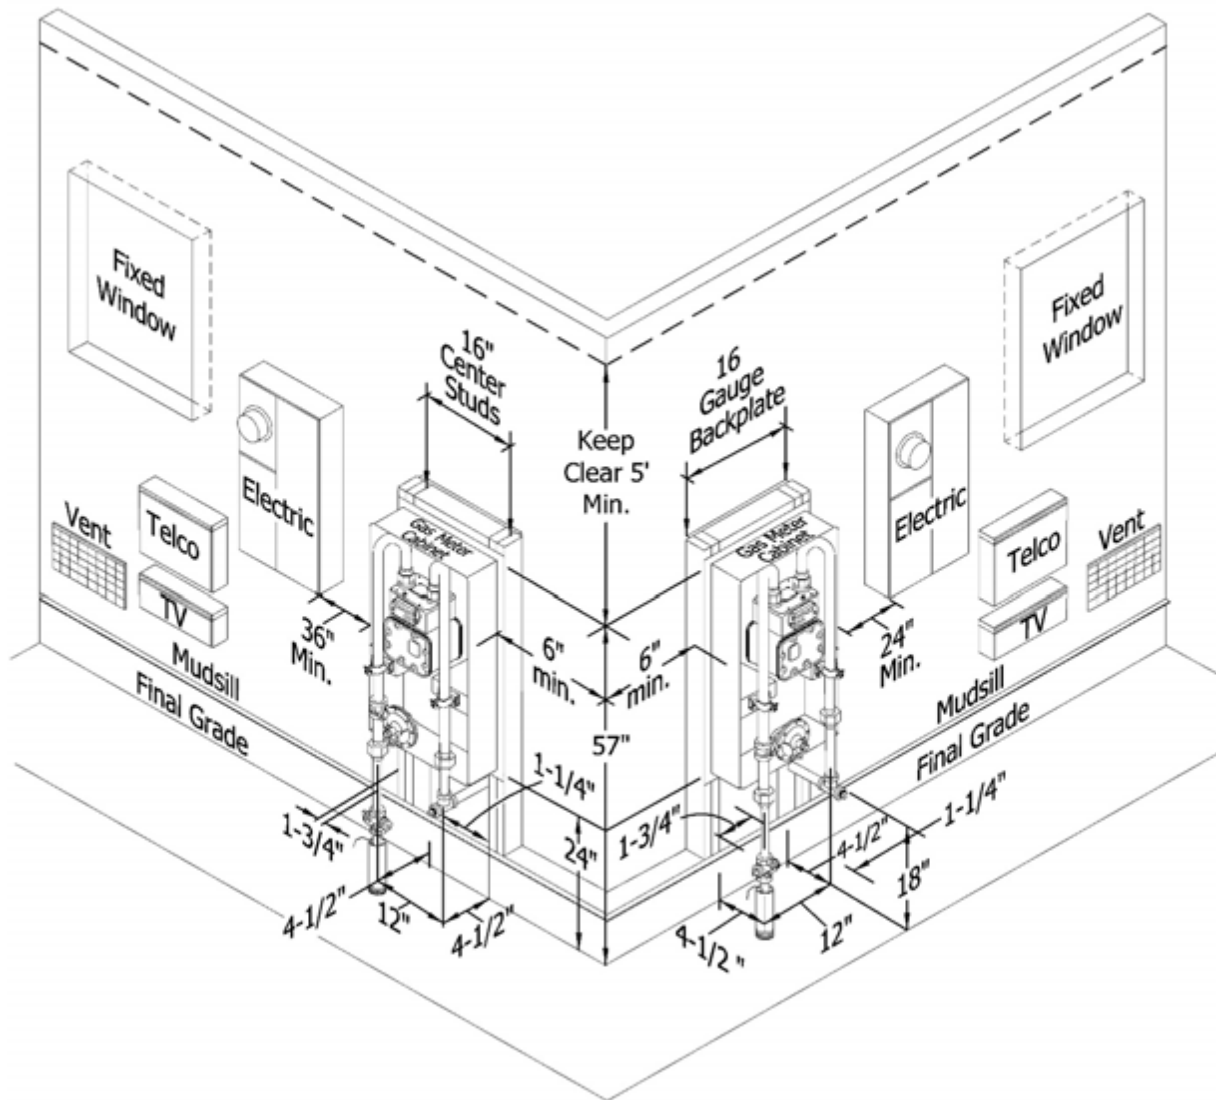


FIGURE 1

Reference GAS D7103.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 3

SDG&E SERVICE STANDARDS & GUIDE

**METER CABINET FOR
SINGLE RESIDENTIAL GAS METER**

SG 1008.1

Installation Requirements

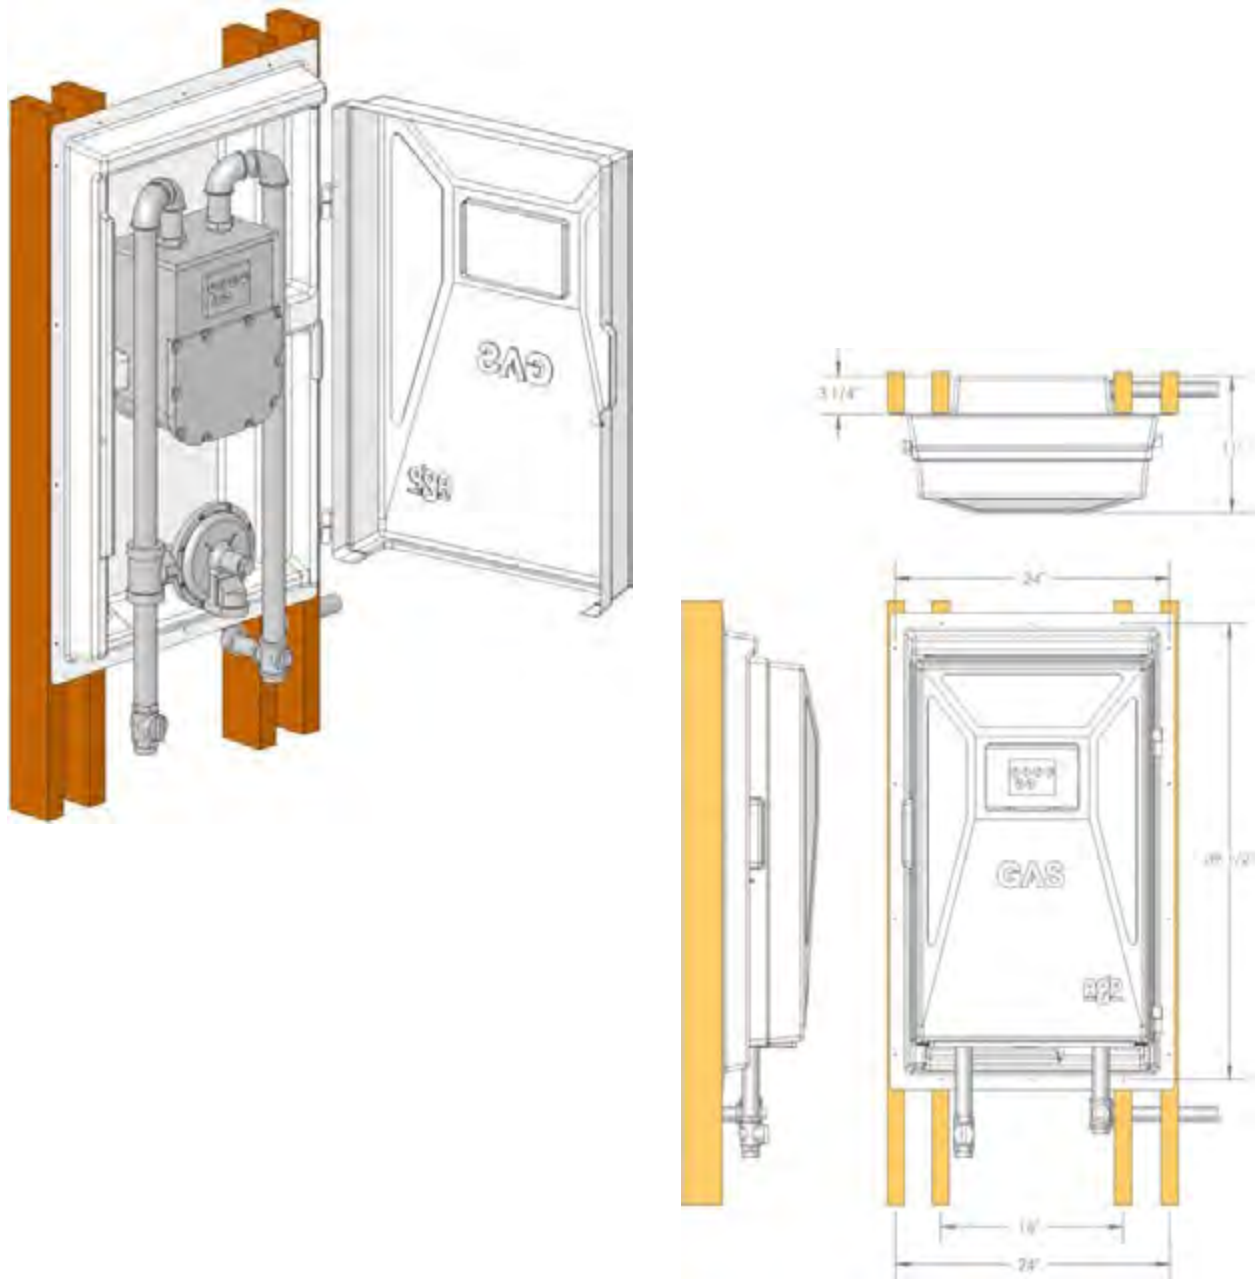


FIGURE 2

Reference GAS D7103.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

**SHEET
2 OF 3**

SDG&E SERVICE STANDARDS & GUIDE
**METER CABINET FOR
SINGLE RESIDENTIAL GAS METER**

SG 1008.2

Installation Notes:

1. Overall dimensions 39 1/2" x 24". Maximum distance between bottom of cabinet and mudsill is 16". Allow houseline stub to extend 3" outside of stucco. Center of SDG&E riser should be 4-1/2" from stucco. Meter sizes D 250 – 630 will fit in the cabinet.
2. The cabinet is designed to fit between studs on 16" centers. Add a second 2" x 4" on each side of the bay to support the flange. Cabinet back fits flush against inside wall.
3. Wall area behind meter cabinet must be free of any obstructions such as water pipes, spigots, clean outs, drain spouts, electric conduits, etc.
4. Maintain 3' clear and level working space in front of gas meter cabinet.
5. No building vent, window, CATV, TELCO or other openings (covered or uncovered) are allowed within 36" from the SDG&E meter cabinet gas riser, and 5' from the top of the meter cabinet. Fixed windows are acceptable.
6. The horizontal distance between the electric panel and gas riser must be a minimum of 36".
7. Meter cabinet must be a minimum of 6" from the edge of the building.
8. The cabinet cover may be painted to match the building.

The prefabricated American Gas Products (AGP) ABS plastic cabinet, part number J-40 (with solid cover), is an approved cabinet. For more information, visit their website at <https://www.americangasproducts.com/>, or contact American Gas Products (AGP) Inc., P.O. Box 4777, Anaheim, CA 92803, via phone at (714) 235-6007 or email at AGP4777@gmail.com.

Reference GAS D7103.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X	Indicates Latest Revision	Completely Revised	New Page	Information Removed
----------	---------------------------	--------------------	----------	---------------------

SHEET
3 OF 3

SDG&E SERVICE STANDARDS & GUIDE

**METER CABINET FOR
SINGLE RESIDENTIAL GAS METER**

SG 1008.3

This standard provides service riser and houseline spacing, clearances and minimum working space requirements for single and multiple gas meter installations.

Minimum Clearance from Building Walls & Corners

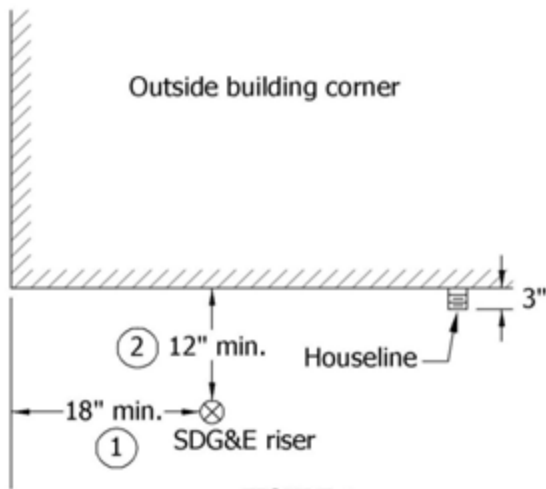


FIGURE 1

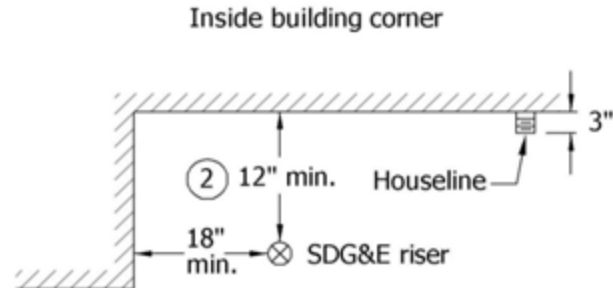


FIGURE 2

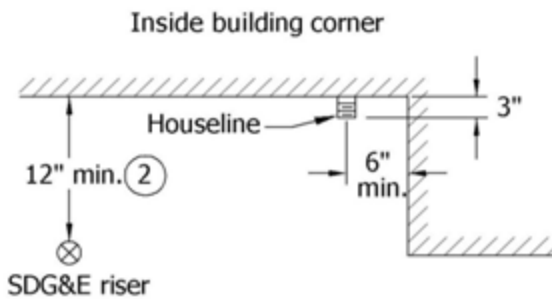


FIGURE 3

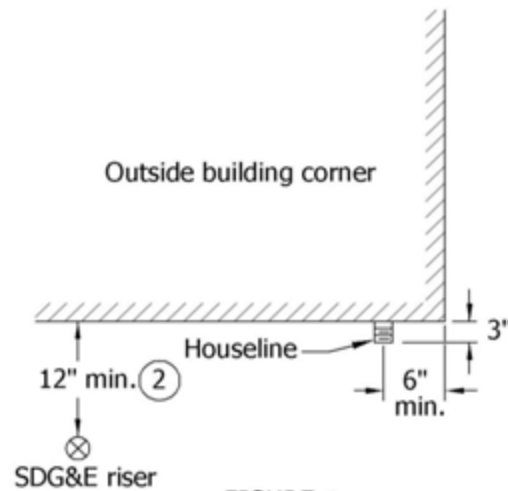


FIGURE 4

Notes:

- ① 18" may be reduced if there is no tripping hazard due to the building configuration.
- ② The SDG&E riser for grouped meters is to be installed 18" out from building wall. Refer to page SG 1010.1, Note 3.

Reference GAS D9157.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

**SHEET
1 OF 3**

SDG&E SERVICE STANDARDS & GUIDE

**GAS SERVICE RISER & HOUSELINE SPACING,
CLEARANCES & MINIMUM WORKING SPACE**

SG 1009.1

Installation Dimensions, Spacing, Clear & Level Working Space

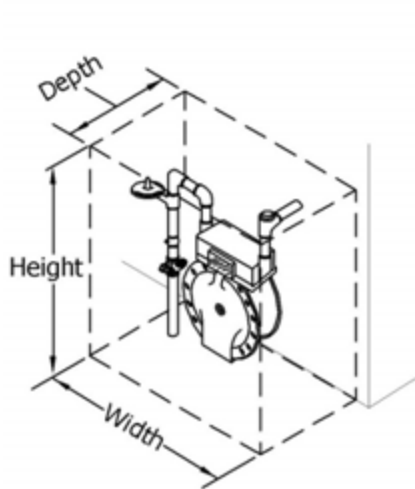


FIGURE 4
Installation Space

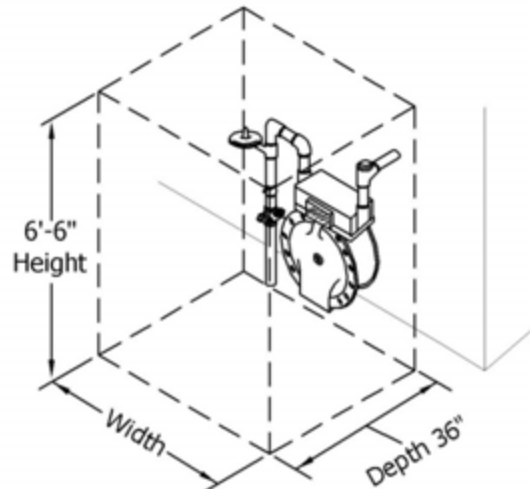


FIGURE 5
Clear and Level Working Space

Notes:

1. Refer to Table 1 – Single Standard (7" WC) Pressure Meter Outside Installations and Table 2 – Single High Pressure (5 PSIG) Meter Outside Installation for dimensions and spacing requirements on page SG 1009.3.
2. Minimum clear and level working space is the area directly in front of the meter set assembly and extends 6'-6" above grade. Refer to Tables 1 and 2 on page SG 1009.3.

General Notes:

1. Definitions: "High Pressure Metering" is gas pressure above 7" water column (WC) (¼ PSIG). "Standard Pressure Metering" is gas pressure equal to 7" WC (¼ PSIG at the meter outlet).
2. The Distribution Engineering and Gas Planning Sections of Gas Engineering must be consulted at least eight (8) weeks prior to the proposed meter installation date for the following cases:
 - a. Any meter larger than an 11M Roots Meter.
 - b. Any meter with a serving pressure greater than 5 PSIG.
 - c. All proposed vault and curb meter box installations.
 - d. The proposed installation of a gas header operating at 5 PSIG.
 - e. The proposed use of a gas meter room.

Reference GAS D9157.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 3	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 1009.2
	SDG&E SERVICE STANDARDS & GUIDE					
	GAS SERVICE RISER & HOUSELINE SPACING, CLEARANCES & MINIMUM WORKING SPACE					

Table 1 – Single Standard (7" WC) Pressure Meter – Outside Installation

Meter Size	Riser to Wall	Riser to Houseline (Horizontal)	Installation Space			Minimum Clear & Level Working Space – 78" Height x Width x 36" Deep
			Height	Width	Depth	
250-630	12"	19"	42"	37"	18"	78" x 37" x 36"
8C	14"	30"	42"	57"	25"	78" x 57" x 36"
11C	14"	30"	42"	57"	25"	78" x 57" x 36"
1.5M/15C	14"	36"	42"	57"	25"	78" x 57" x 36"
2M175	14"	56"	48"	77"	25"	78" x 77" x 36"
3M175	14"	56"	48"	77"	25"	78" x 77" x 36"
5M175	14"	75"	54"	95"	25"	78" x 95" x 36"
7M175	14"	75"	54"	95"	30"	78" x 95" x 36"

Table 2 – Single High Pressure (5-10 PSIG) Meter – Outside Installation

Meter Size	Riser to Wall	Riser to Houseline (Horizontal)	Installation Space			Minimum Clear & Level Working Space – 78" Height x Width x 36" Deep
			Height	Width	Depth	
425-630	12"	56"	36"	77"	28"	78" x 77" x 36"
8C TQM	14"	48"	52"	68"	28"	78" x 68" x 36"
15C	14"	48"	52"	68"	25"	78" x 57" x 36"
2M TQM	14"	48"	52"	68"	25"	78" x 57" x 36"
3M TQM	14"	48"	52"	68"	25"	78" x 68" x 36"
5M175	14"	75"	56"	95"	25"	78" x 68" x 36"
7M175	14"	75"	56"	95"	30"	78" x 95" x 36"
11M175	18"	90"	56"	111"	30"	78" x 95" x 36"

Note:

For serving pressures greater than 10 PSIG and for 16M meters, consult with SDG&E Planner who will coordinate with Region Engineering in Gas Technical Services – Miramar.

Reference GAS D9157.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed


SHEET
3 OF 3

SDG&E SERVICE STANDARDS & GUIDE

**GAS SERVICE RISER & HOUSELINE SPACING,
CLEARANCES & MINIMUM WORKING SPACE**

SG 1009.3

Typical Grouped Gas Meters (Residential)

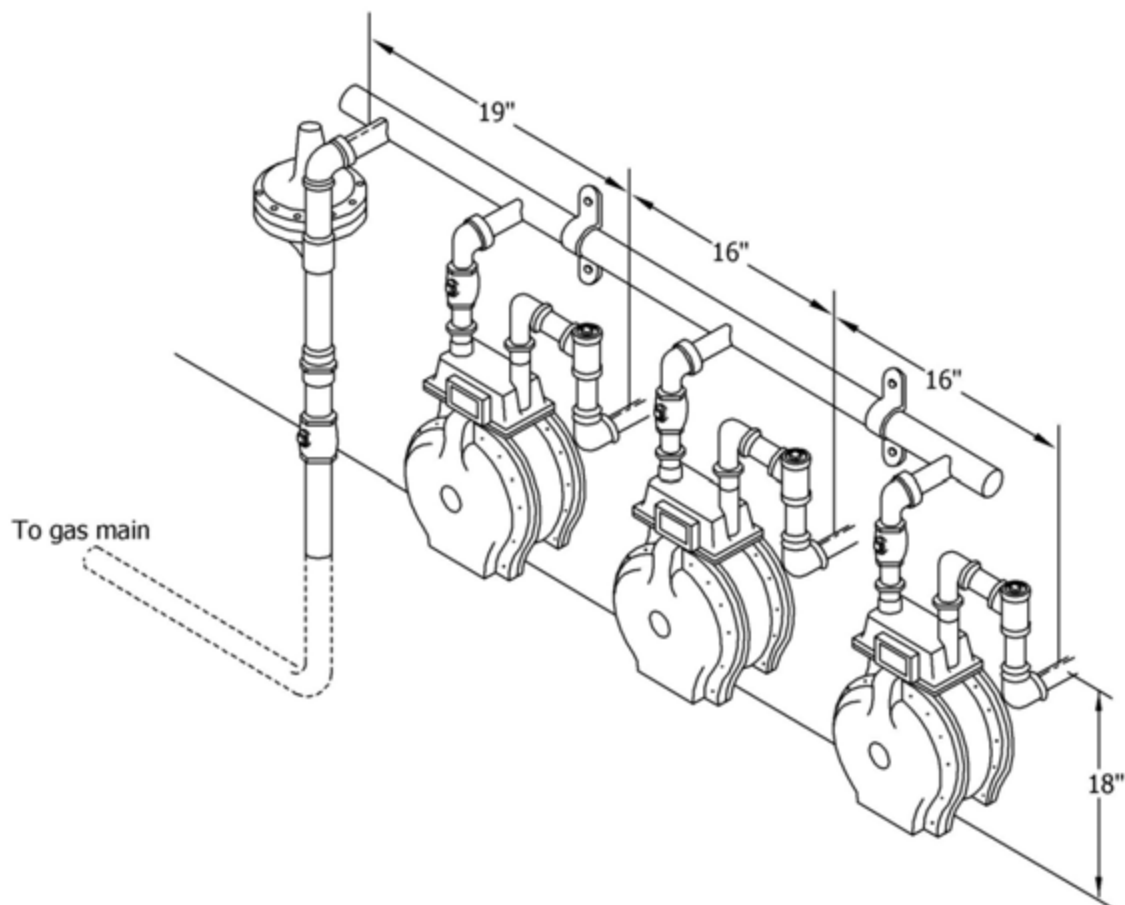

Typical Right Hand Header for Size 250 – 425 Gas Meters

Quantity of Meters	Riser to 1 st Houseline Spacing	Additional Houseline Spacing
2-24	19"	16"
2-24 with 1 large gas meter in 1 st position (11C max. size)	27"	16"

Notes:

1. Meter headers are limited to two tiers to ensure meter accessibility and safety of personnel.
2. Wall area for gas meters must be entirely free of any obstructions such as water pipes, faucets, sewer cleanouts, drain spouts, electrical conduits, cable TV or telephone equipment.
3. The SDG&E service riser is to be installed 18" out from building wall on grouped meter locations.
4. See page SG 1010.8 for Adequate Support for Wall Mounted Meter Headers.

Reference GAS D9157.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	New Page	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

Indicates Latest Revision

☒ Completely Revised

☐ New Page

☐ Information Removed


SHEET
1 OF 8

SDG&E SERVICE STANDARDS & GUIDE

GAS METERS GROUPED ON METER HEADERS


SG 1010.1

Houseline Spacing for Single Tier Left Hand Headers

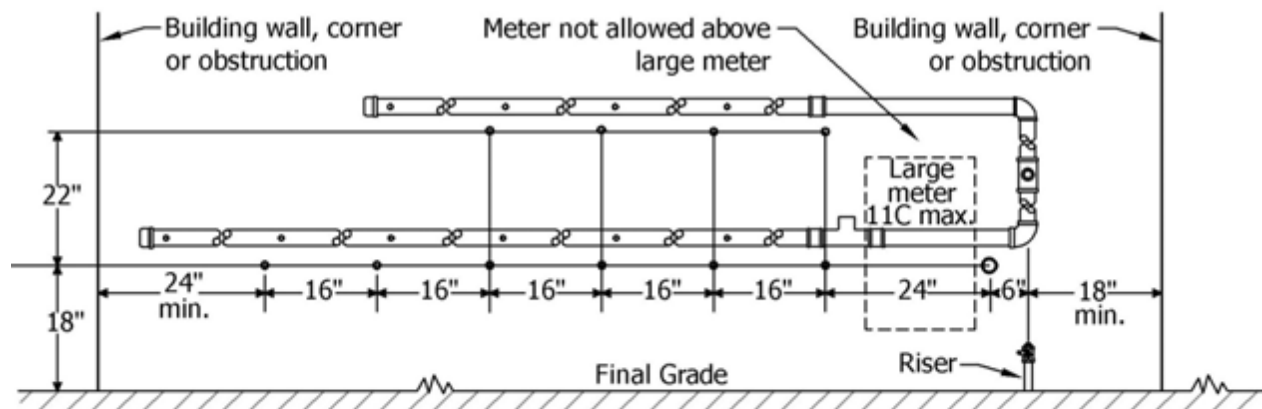

NOTE: Use bottom row for odd houseline.

Dual Tier Header With Large Meter

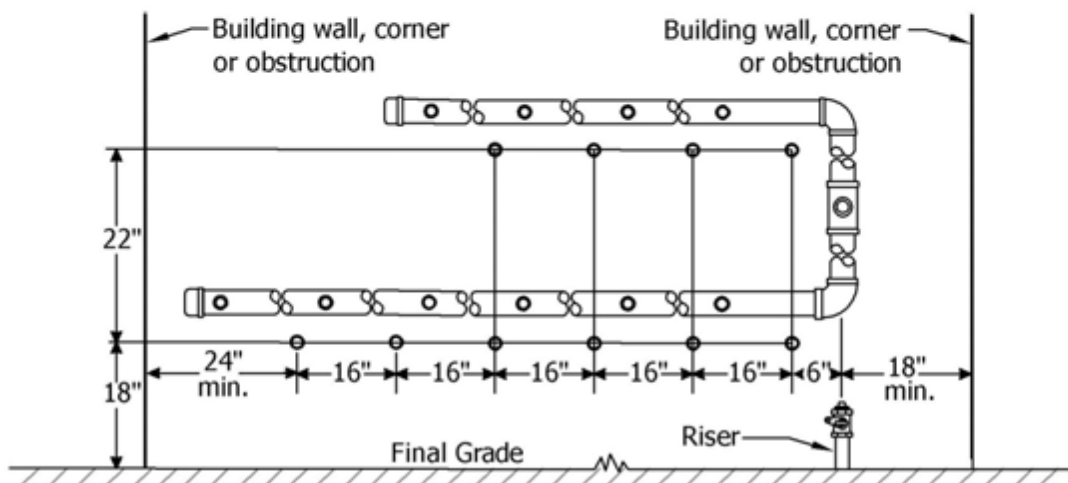

NOTE: Use bottom row for odd houseline.

Dual Tier Header

Reference GAS D9157.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	New Page	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

Indicates Latest Revision



Completely Revised

New Page

Information Removed


SHEET
2 OF 8

SDG&E SERVICE STANDARDS & GUIDE


GAS METERS GROUPED ON METER HEADERS

SG 1010.2

Houseline Spacing for Dual Tier Left Hand Headers

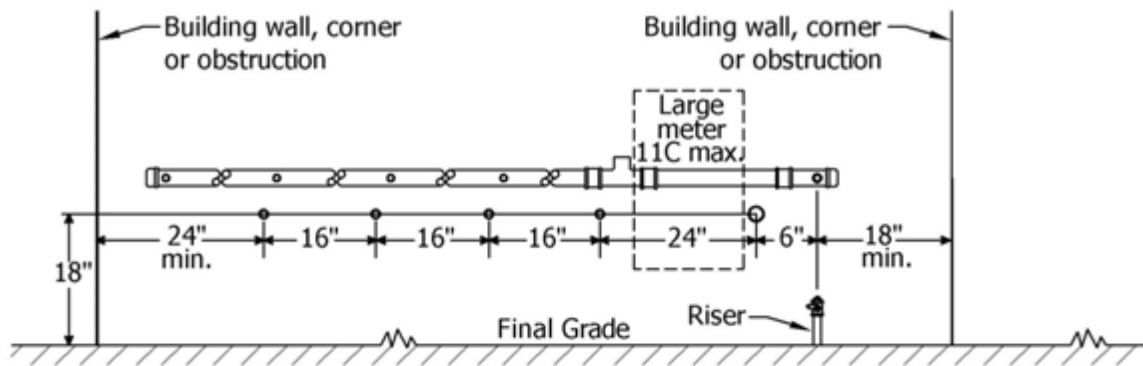

Single Tier Header for 4 with Large Meter

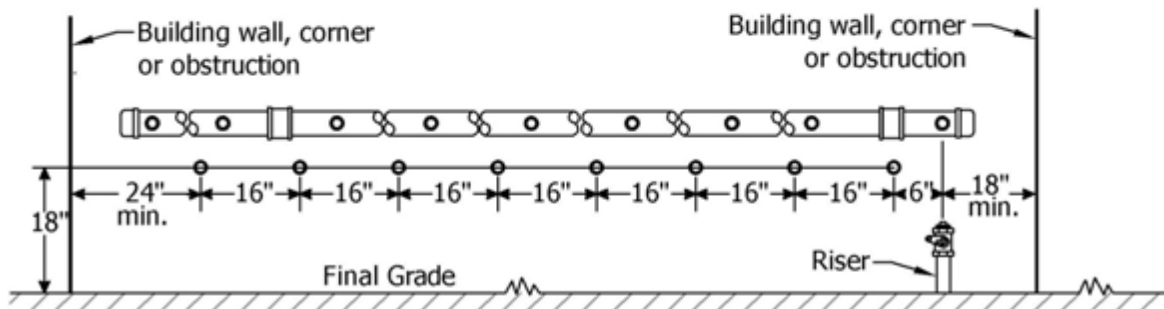

Single Tier Header

Reference GAS D9157.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	New Page	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

Indicates Latest Revision

☒ Completely Revised

☐ New Page

☐ Information Removed


SHEET
3 OF 8

SDG&E SERVICE STANDARDS & GUIDE


GAS METERS GROUPED ON METER HEADERS

SG 1010.3

Houseline Spacing for Single Tier Right Hand Headers

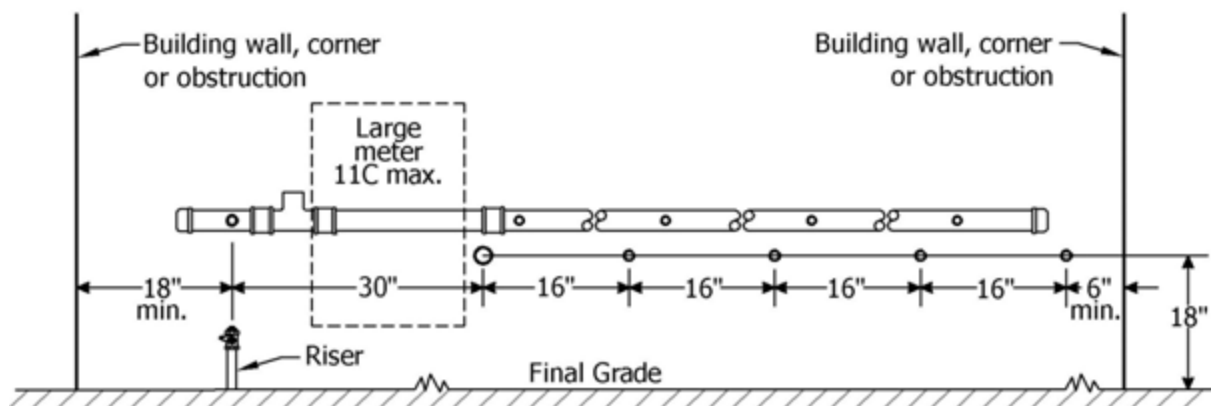

Single Tier Header for 4 with Large Meter

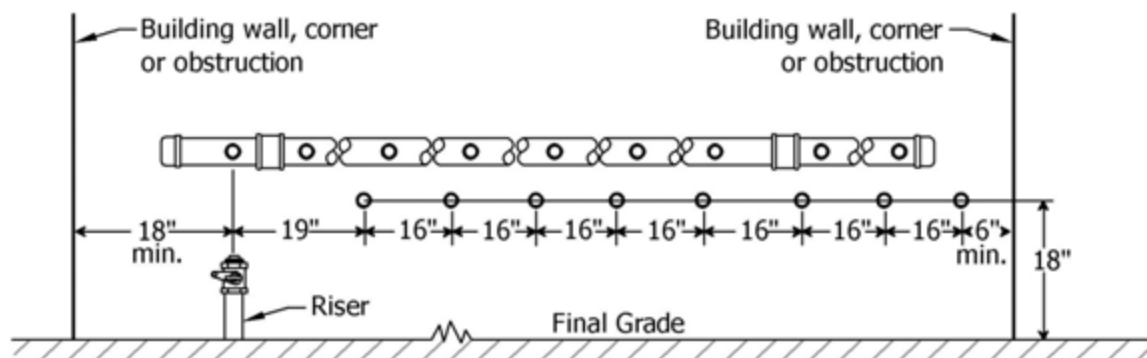

Single Tier Header

Reference GAS D9157.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	New Page	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

Indicates Latest Revision

☒ Completely Revised

☐ New Page

☐ Information Removed


SHEET
4 OF 8

SDG&E SERVICE STANDARDS & GUIDE

GAS METERS GROUPED ON METER HEADERS


SG 1010.4

Houeline Spacing for Dual Tier Right Hand Headers

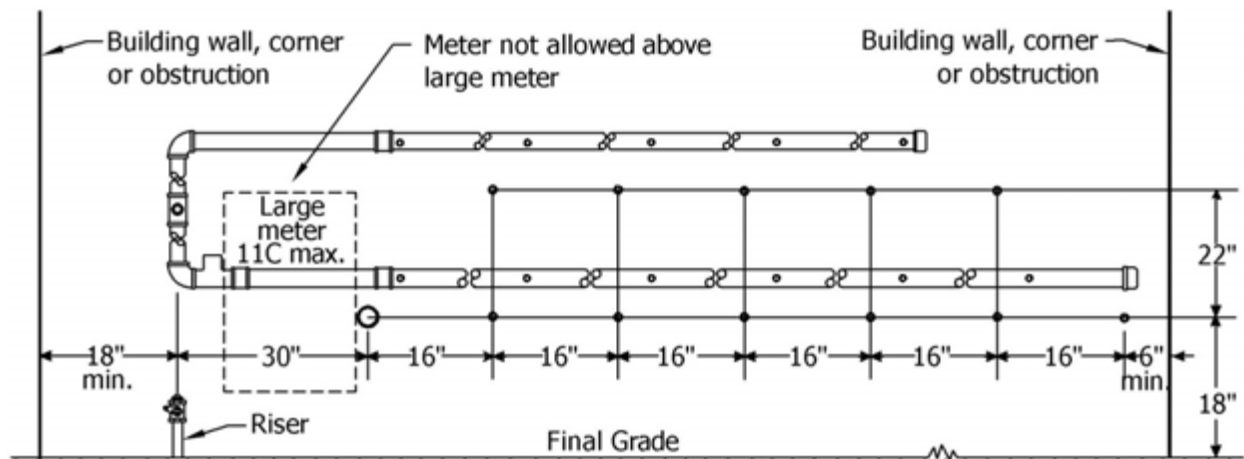

NOTE: Use bottom row for odd houseline.

Dual Tier Header with Large Meter

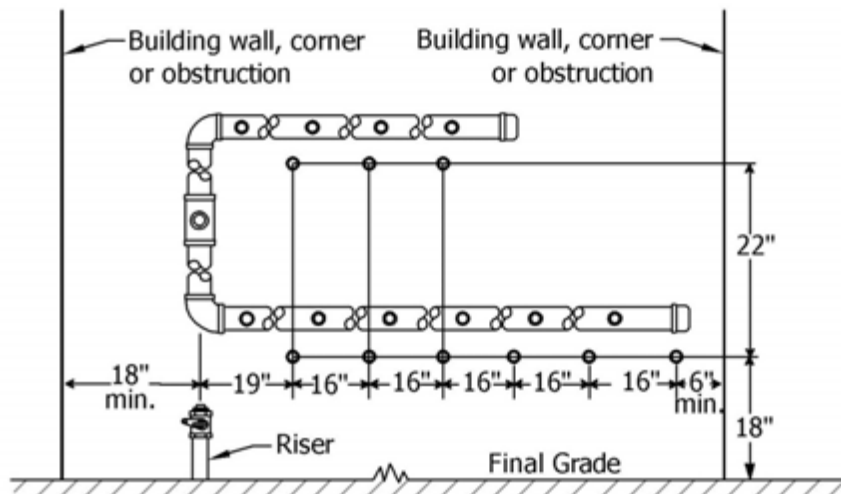

NOTE: Use bottom row for odd houseline.

Dual Tier Header

Reference GAS D9157.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	New Page	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

Indicates Latest Revision

X

Completely Revised

New Page

Information Removed

SHEET
5 OF 8

SDG&E SERVICE STANDARDS & GUIDE

GAS METERS GROUPED ON METER HEADERS

SG 1010.5

Customer-Built Header Support

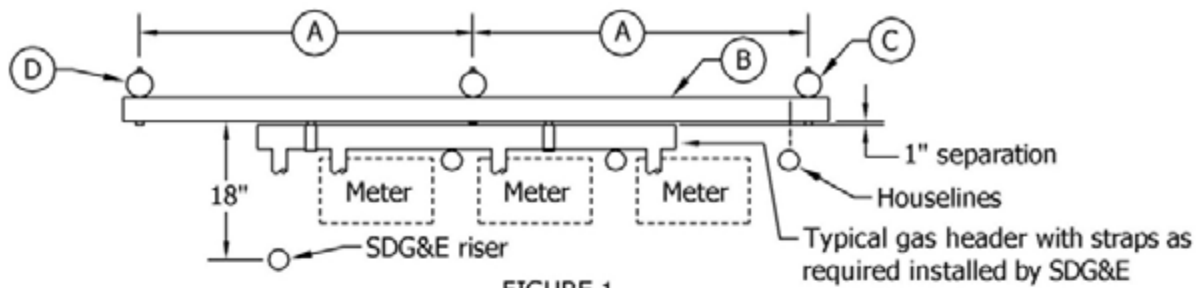


FIGURE 1
Top View

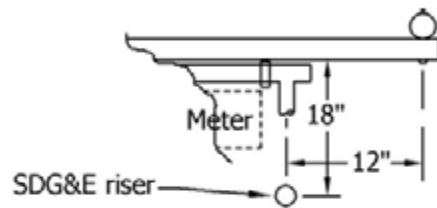


FIGURE 3
Top View
Riser Placement for
Left Handheader

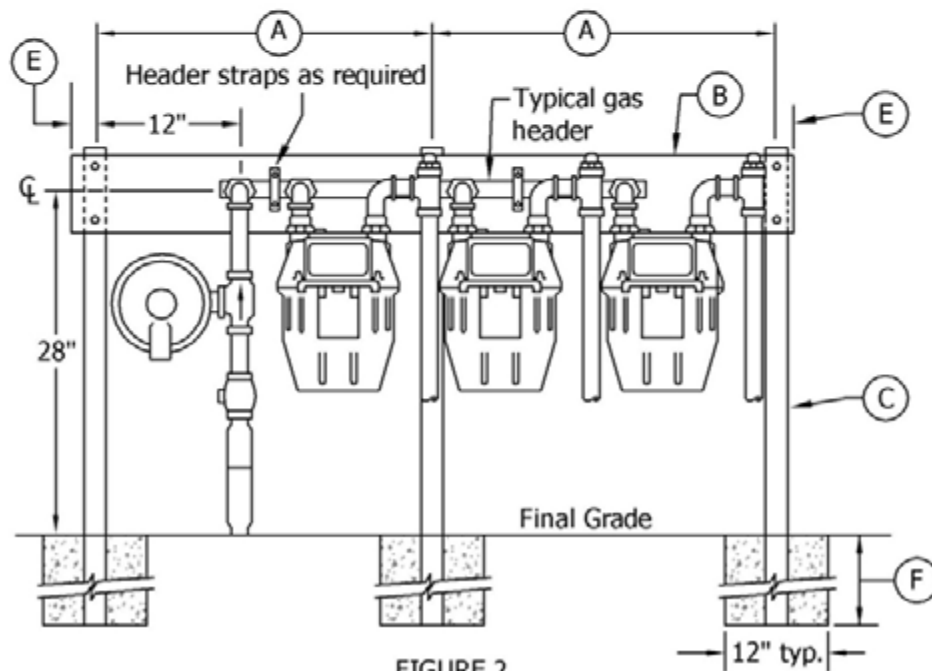


FIGURE 2
Elevation View

Reference GAS D7107.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	New Page	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

Indicates Latest Revision

☒ Completely Revised

☐ New Page

☐ Information Removed

SHEET
6 OF 8

SDG&E SERVICE STANDARDS & GUIDE

GAS METERS GROUPED ON METER HEADERS

SG 1010.6

Notes:

- Ⓐ 60" maximum to center of each stanchion.
- Ⓑ 2" x 6" treated Douglas fir backing for header. See Length Table below for sizing.
- Ⓒ 2-1/2" steel pipe (minimum) set in concrete.
- Ⓓ Minimum attachment is two 3/8" through bolts per stanchion.
- Ⓔ 3" maximum
- Ⓕ 24" minimum

Length (in Inches) Table for Customer-Built Header Support

Number of Meters	2	3	4	5	6	7	8	9	10	11	12
Right Hand Header	57	73	89	105	121	137	153	169	185	201	217
Left Hand Header	53	69	85	101	117	133	149	165	181	197	213

Reference GAS D7107.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	New Page	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

SHEET 7 OF 8	<div></div>	Indicates Latest Revision	<div>X</div>	Completely Revised	New Page	Information Removed	SG 1010.7
	SDG&E SERVICE STANDARDS & GUIDE						
	GAS METERS GROUPED ON METER HEADERS						

ADEQUATE SUPPORT FOR WALL MOUNTED METER HEADERS

The purpose of this standard is to specify requirements which customers/builders must meet to provide adequate support for wall-mounted meter headers. The requirements are detailed below.

When a header is required to serve a newly constructed structure, it is the customer's/builder's responsibility to provide adequate backing for the header attachment.

The mounting wall must meet one of the following requirements:

1. Void-filled concrete block
2. Solid concrete (3½" minimum thickness)
3. 2" x 12" lumber blocking installed between studs and 2" above all houselines. (See Figure 1.)

Mounting wall must be free from any obstructions for mounting the header such as water pipes, water spigots, clean outs, drain spouts, electric conduits, decorative wall finishes with irregular surfaces, etc.

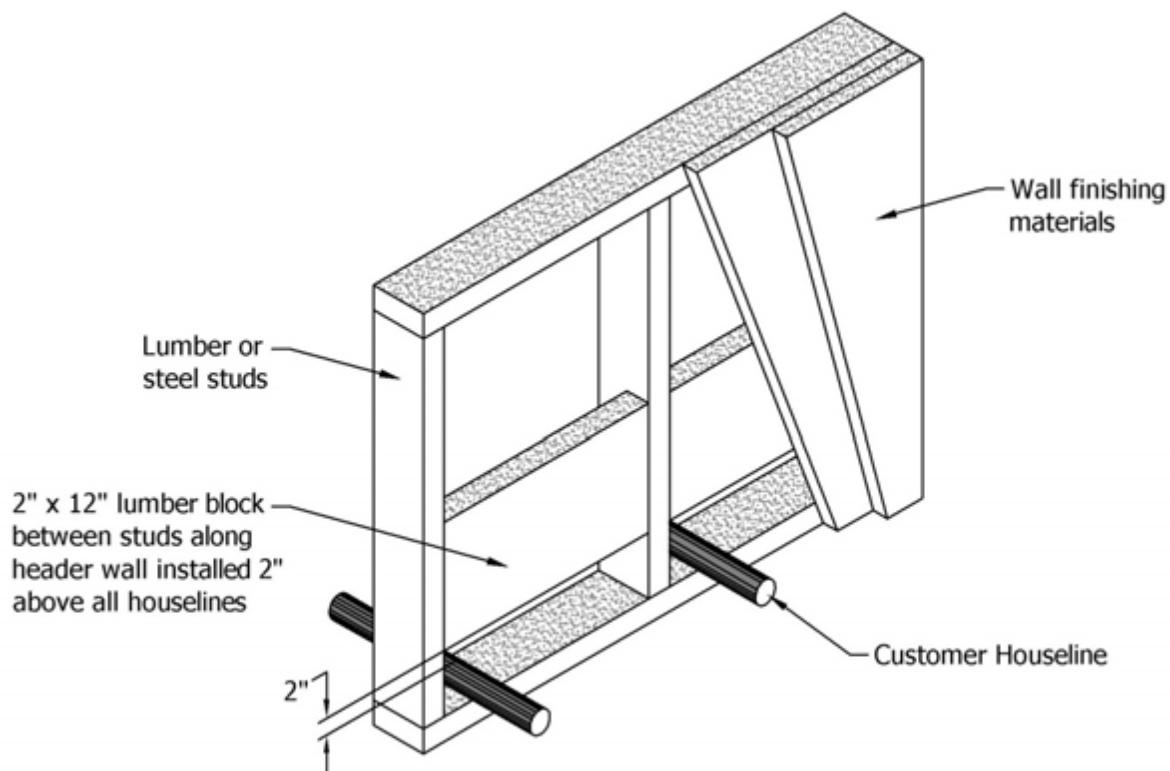


FIGURE 1

Reference GAS D9157.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	New Page	LSM	BRB	TPM	11/01/17	D					
B						E					
C						F					

SHEET 8 OF 8	Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	New Page	Information Removed	SG 1010.8
	SDG&E SERVICE STANDARDS & GUIDE				
	GAS METERS GROUPED ON METER HEADERS				

This standard provides the requirements for meter locations behind wing walls.

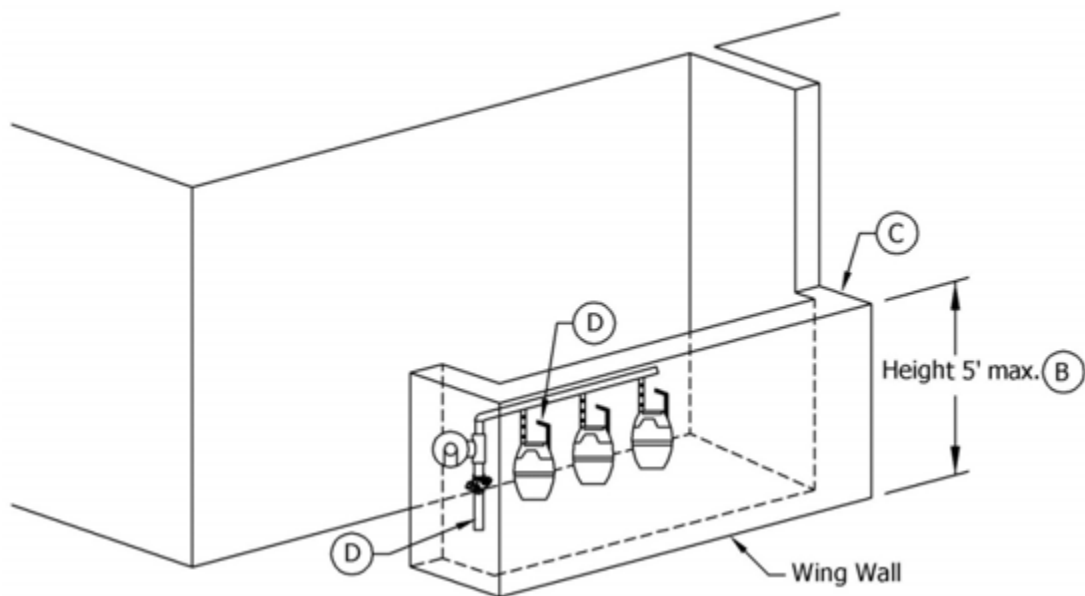


FIGURE 1
Front View

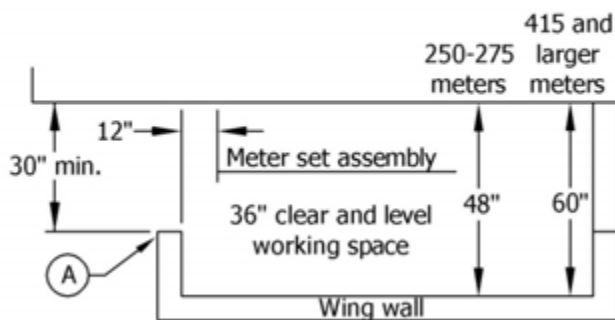


FIGURE 2
Plan View

Notes:

- (A) No door or roof allowed.
- (B) When possible, wing wall height should not exceed 5'.
- (C) Length and width of meter location are determined by size and number of meters to be installed.
- (D) For riser and houseline positions, refer to pages SG 1012.2 – 1012.4.

Reference GAS D7103.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed


SHEET
1 OF 1

SDG&E SERVICE STANDARDS & GUIDE



GAS SERVICE & METER BEHIND WING WALLS

SG 1011

For dimension requirements of meter recesses refer to pages SG 1012.2 - SG 1012.4.

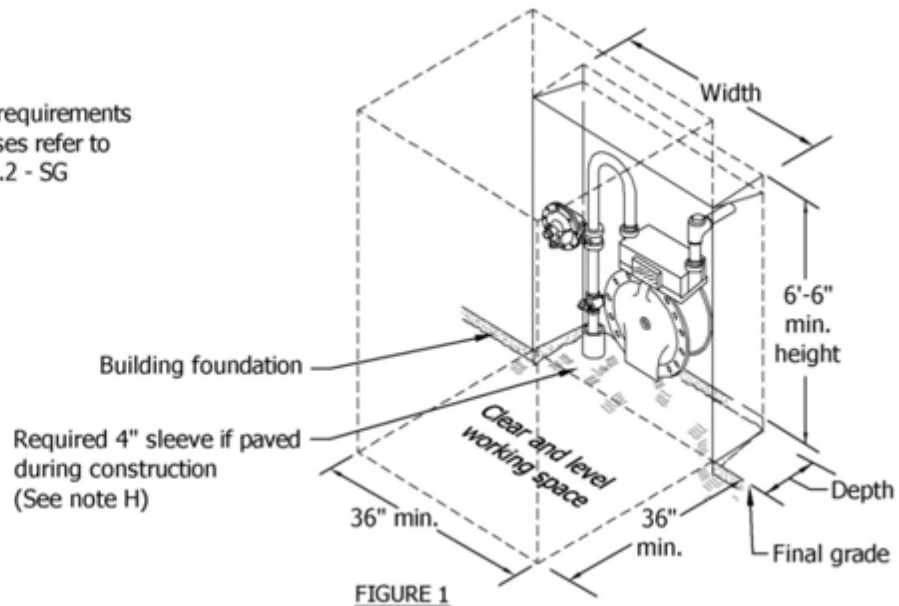

Gas Meter Recess Dimensions, Riser & Houseline Spacing for Typical Header Installations

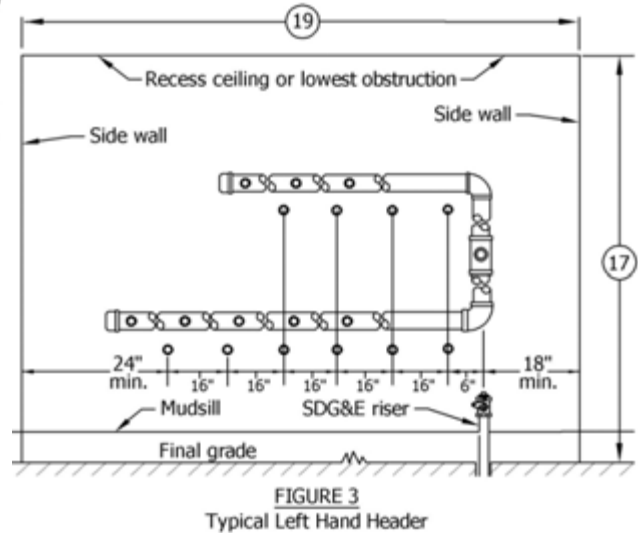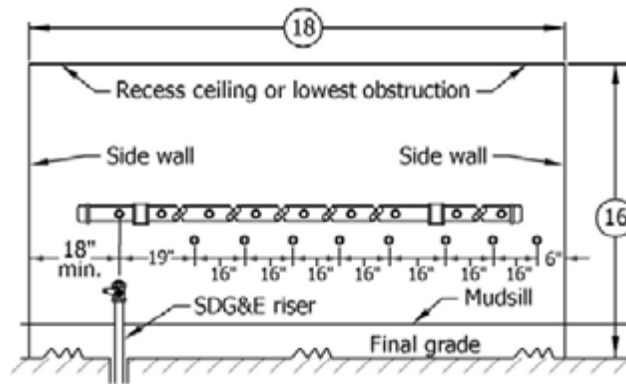

Reference GAS D9157.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 4

SDG&E SERVICE STANDARDS & GUIDE

BUILDING RECESS FOR GAS SERVICE & METERS

SG 1012.1

Single Gas Meter Recess Dimensions, Riser & Houeline Spacing

Table 1: Standard Pressure – 7" Water Column

Meter Size	Riser to Back Wall (Inches)	Riser to Houeline (Inches)	Recess Dimensions (Figure 1)		
			Height (Inches)	Width (Inches)	Depth (Inches)
250-630	12	19	42	37	18
8C	14	30	42	57	25
11C	14	30	42	57	25
1.5M / 15C	14	36	42	57	25
2M	14	56	48	77	25
3M	14	56	48	77	25
5M	14	75	54	95	25
7M	14	75	54	95	30

Table 2: High Pressure – 5 – 10 PSIG

Meter Size	Riser to Back Wall (Inches)	Riser to Houeline (Inches)	Recess Dimensions (Figure 1)		
			Height (Inches)	Width (Inches)	Depth (Inches)
425-630	12	56	36	77	28
8C	14	48	52	68	28
15C	14	48	52	68	25
2M	14	48	52	68	25
3M	14	48	52	68	25
5M	14	75	56	95	25
7M	14	75	56	95	30
11M	18	90	56	111	30

Reference GAS D9157.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 4

SDG&E SERVICE STANDARDS & GUIDE

BUILDING RECESS FOR GAS SERVICE & METERS

SG 1012.2

1. "Building Recess" is an indentation of building wall, foundation and floor. A recess is open on the front so that the meter set assembly is visible. No doors, lattice work, or covers of any type are permitted. The building foundation must not cross any portion of the recess.
2. Only gas-related facilities will be permitted in the recess. Foreign equipment (e.g. ground rods, wires, conduit, electric equipment, CATV and Telco panels, sprinkler controls, water and waste piping, building windows, vents, etc.) is prohibited. Electric bonding to or use of SDG&E gas service piping, gas risers or meter facilities for electric grounding is not permitted. Gas recesses are not to be used for storage areas.
3. The interior of the gas meter access must be gas tight. The recess shall be sealed by the customer at all interior seams, corners, openings, etc., to prevent gas from migrating into any portion of the building or structure. The interior of the recess shall be the same material used on the building exterior provided it is gas tight. Acceptable sealing materials include silicone-based and polyurethane-based compounds (e.g. trade names GE Silicone, Sikaflex 1A or equivalents). Requests for other materials for recess interior may be approved upon prior review by SDG&E.
4. The entire opening of the recess must be clear for installation and maintenance of the meter set assembly. A minimum 3' clear and level working space must be maintained in front of the recess opening. The height of the working space extends 6'-6" minimum above final grade. The wall area above the recess must be free of projections that present a hazard to personnel servicing the meter set assembly. See Figure 1 for details.
5. Electric metering is not permitted above a gas recess.
6. The walls and ceiling of the recess must be flush with the exterior walls. Returns or jams on the side walls or ceiling are prohibited. The ceiling must be level or slope upwards from back to front with a 1" rise per 12" depth.
7. The depth of the recess must not exceed the depth listed for the particular meter size for which the recess was designed to accommodate. When a recess is used on a non-residential structure and the gas load is unknown, the minimum interior height of the recess shall be 66" and the inside depth must not exceed 30".
8. The bottom or floor of the recess may be dirt or paved, and it must be graded to prevent water from collecting inside the recess. During time of construction, if the recess floor is to be paved, an opening 4" in diameter or 4" square must be provided around the SDG&E riser.
9. For a recess housing a single meter, the SDG&E riser shall be 12" from the left side wall. For the riser to back wall dimension, refer to Table 1 and Table 2 below. The customer houseline shall not be closer than 6" to the right side wall.
10. For meter sizes up to and including 11C, houseline(s) must be 18" above final grade. The houselines for the upper level of a tier header must be 40" above the final grade (22" above lower level houselines).

Reference GAS D9157.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision	Completely Revised	New Page	Information Removed
------------------------------------	--------------------	----------	---------------------

SHEET
3 OF 4

SDG&E SERVICE STANDARDS & GUIDE

BUILDING RECESS FOR GAS SERVICE & METERS

SG 1012.3

11. For serving pressures greater than 10 PSIG and for 16M meters, the Planner will consult with Region Engineering in Gas Technical Services – Miramar.

Additional Requirements for Multiple Meters

12. For houseline spacing not given in this standard, refer to pages SG 1010.1 – SG 1010.6.
13. Meter headers must be limited to two tiers to ensure meter accessibility and safety of personnel.
14. SDG&E riser placement for all headers to be 12" from back wall and 18" from sidewall.
15. Depth of multiple meter recess for 250-425 meters is 18" maximum; for 675-11C meters 28" maximum.
- ①⑥ Height of recess for single level header (Figure 2) is 48" minimum above final grade.
- ①⑦ Height of recess for two tier header (Figure 3) is 66" minimum above final grade.
- ①⑧ Width of recess for right hand headers
- a. Single and dual tier (Figure 2) – 18" riser to left sidewall, 19" riser to first houseline, 6" last houseline to right side wall, plus 16" for each additional houseline (250-425 meters).
- ①⑨ Width of recess for left hand headers
- a. Single and dual tier (Figure 3) – 18" riser to right sidewall, 6" riser to first houseline, 24" last houseline to left side wall, plus 16" for each additional houseline (250-425 meters).

Reference GAS D9157.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page


Information Removed

**SHEET
4 OF 4**

SDG&E SERVICE STANDARDS & GUIDE

BUILDING RECESS FOR GAS SERVICE & METERS

SG 1012.4

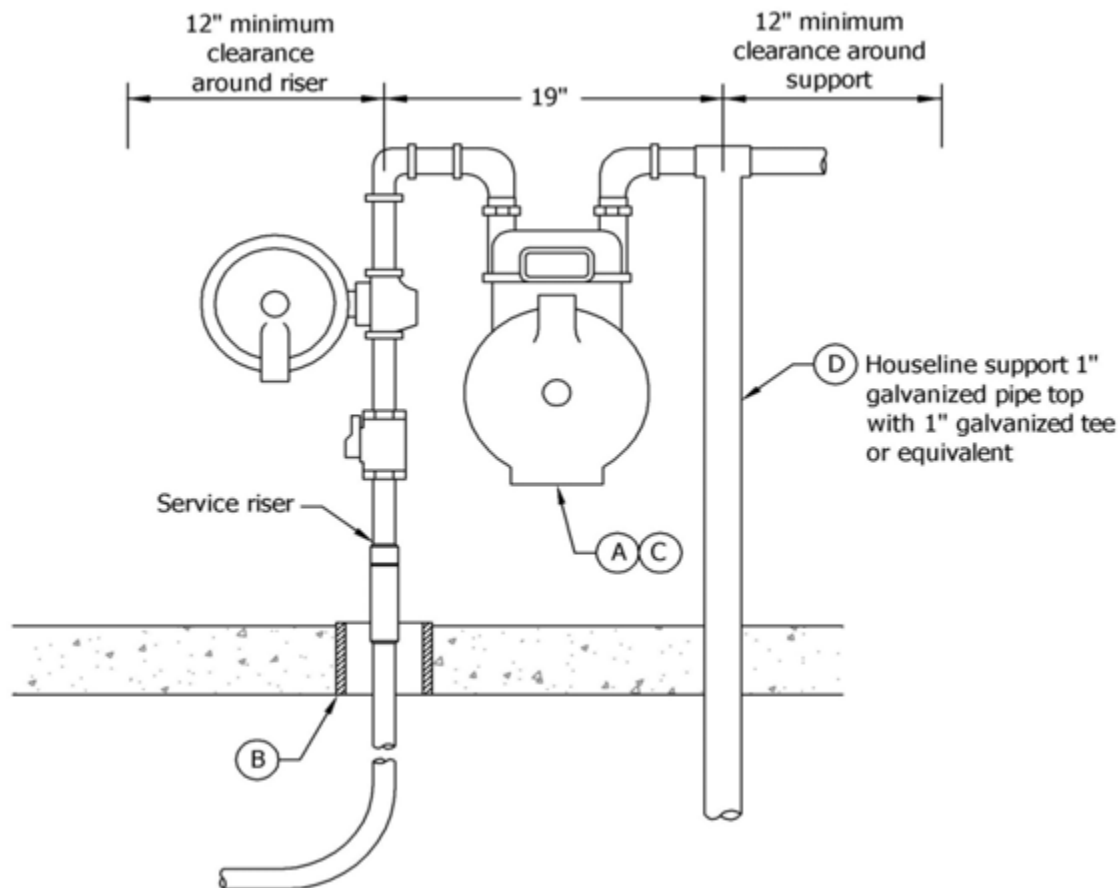

Notes:

- (A) 18" minimum horizontal clearance shall be maintained on all sides of the gas meter excluding the gas service riser and houseline.
- (B) If the area around the gas riser is to be paved, a 4" minimum diameter or 4" minimum square opening must be provided around the riser.
- (C) Meter and metering equipment may be installed:
 - (1) At or near the mobile home closest SDG&E's (Utility) source
 - (2) On a permanently installed structure near the front lot line of the mobile home
 - (3) At or near the corner of the mobile home lot closest to the Utility's source
- (D) The gas meter set shall not depend on a flex gas houseline for support. A post, bracket or other means of support is to be provided by the customer when required by the governmental Authority Having Jurisdiction (AHJ) or the Utility.

Reference GAS D7103.4.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

**SHEET
1 OF 1**

SDG&E SERVICE STANDARDS & GUIDE
MOBILE HOME METER PAD

SG 1013

This standard provides the requirements for customer-provided and -installed “non-removable” barricades. Barricade posts are used to protect meter and service equipment and personnel from vehicular contact and to prohibit encroachment into the working space. Examples include loading zones, driveways, congested areas, alleys, off-street parking such as side yards, etc.

Service and metering equipment located on public or private property must be installed a minimum of 5’ back from face of curb or is considered subject to vehicular contact and requires barricade posts. Meters located on a wall adjacent to any parking area, or area accessible to vehicular traffic, must be protected by non-removable barricade posts. Wheel stops and removable barricade posts are not acceptable substitutes. Maintain a minimum of 3’ clear and level working space in front of the gas meter set assembly. An SDG&E Inspector will determine if a barricade can be omitted when existing structures can protect personnel and equipment. Meters will not be set until the barricades are installed.

Barricades for New Gas Meter Installations
Commercial or Multi-Family (More Than 2 Units)

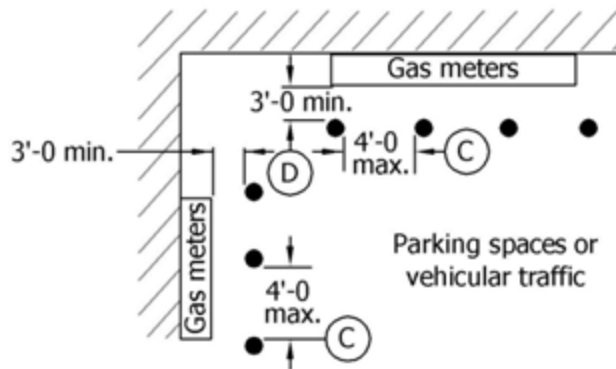


FIGURE 1
Plan View

Heavy Duty and Light Duty Barricade Posts Concrete Footing

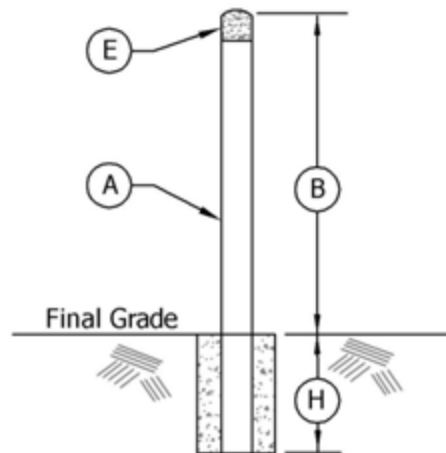


FIGURE 2
Elevation

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
1 OF 3

SDG&E SERVICE STANDARDS & GUIDE

BARRICADES FOR GAS METER SETS

SG 1014.1

Notes:

- (A) Refer to Table 1 below.
- (B) Barricade height shall extend 3" above the meter set assembly or 4' above the final grade, whichever is less.
- (C) For new meter installations, the barricade post separation shall not exceed 4'.
- (D) For new meter installations, the barricade posts must be a minimum of 3' from the face of the meter set.
- (E) All barricade post tops at the same barricade site must be finished in the same manner. The top of the post(s) shall be finished with one of the following:
 - (1) Tack welded steel cap or blank
 - (2) Top 3" of post filled and crowned with concrete
 - (3) Post top may be threaded and finished with an iron cap.
- (F) Welded and black iron areas of the completed barricade post(s) shall be primed and painted white.
- (G) When a stronger barricade is needed, horizontal braces are to be installed as follows:
 - (1) Bottom row 18" above final grade
 - (2) Top row no more than 1/2" below top of post
 - (3) If the barricade posts are topped with threaded iron caps, the top horizontal brace shall be no more than 1/2" below bottom of cap.

Table 1

(A) Barricade Steel Post Galvanized or Black			(H) Concrete Footings		(G) Horizontal Pipe Brace Size	
	Pipe Size (Inches)	Minimum Wall Thickness (Inches)	Diameter (Inches)	Depth (Inches)	Pipe Size (Inches)	Minimum Wall Thickness (Inches)
Light Duty	3	.216	12	24	2	.154
Heavy Duty	4	.188	12	30	4	.188

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

SHEET 2 OF 3	X	Indicates Latest Revision	Completely Revised	New Page	Information Removed	SG 1014.2
	SDG&E SERVICE STANDARDS & GUIDE					
	BARRICADES FOR GAS METER SETS					

Light duty bolt-down barricade posts shall be used only for existing residential and mobile home park meter sets. Bolt-down barricades are allowed to protect an existing single meter or headers for two meters only. Bolt-down barricades shall be installed only on good concrete and where there is potential danger of damaging underground facilities when excavating, or when the customer does not want their paving disturbed.

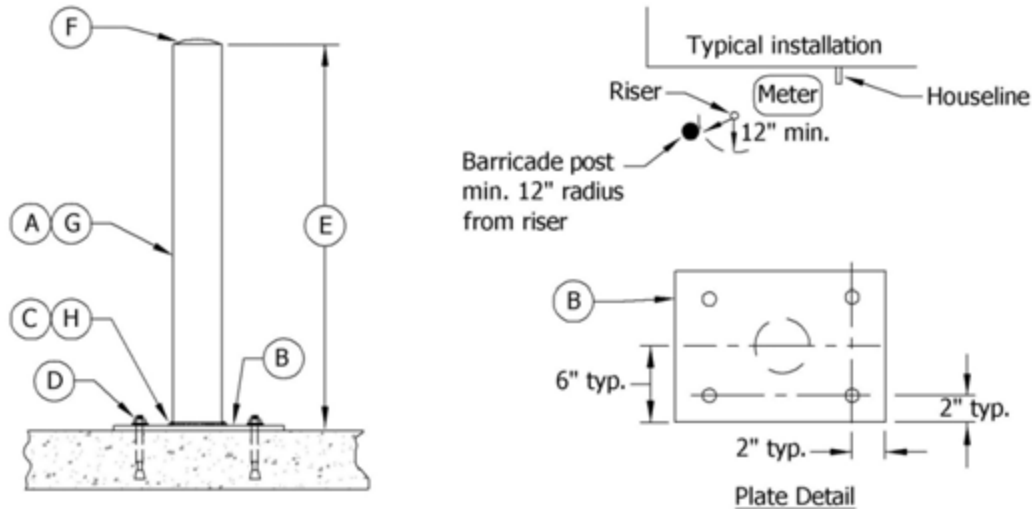


FIGURE 3

Notes:

- (A) 3" black or galvanized steel pipe with a minimum wall thickness of .216".
- (B) Black or galvanized steel plate 1/4" x 12" x 12" minimum.
- (C) 1/4" fillet weld.
- (D) Bolts (4) 5/8" x 4", cadmium coated steel, Hilti "KWIK BOLT" or equivalent with 5/8" flat washer, cadmium coated steel
- (E) Post shall extend 3" above the meter set assembly or 45" above final grade, whichever is less.
- (F) The top of the post shall be finished with one of the following:
 - (1) Tack welded steel cap or blank
 - (2) Top 3" of post filled and crowned with concrete
 - (3) Post top may be threaded and finished with an iron cap.
- (G) Welded and black iron areas of the completed barricade post shall be primed and painted white.
- (H) All precautions must be taken to protect workers and passerby from resulting fumes if choosing to weld on galvanized metal.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
3 OF 3

SDG&E SERVICE STANDARDS & GUIDE
BARRICADES FOR GAS METER SETS

SG 1014.3

This standard shows the minimum horizontal clearances for gas mains or services installed near padmounted equipment or substructures.

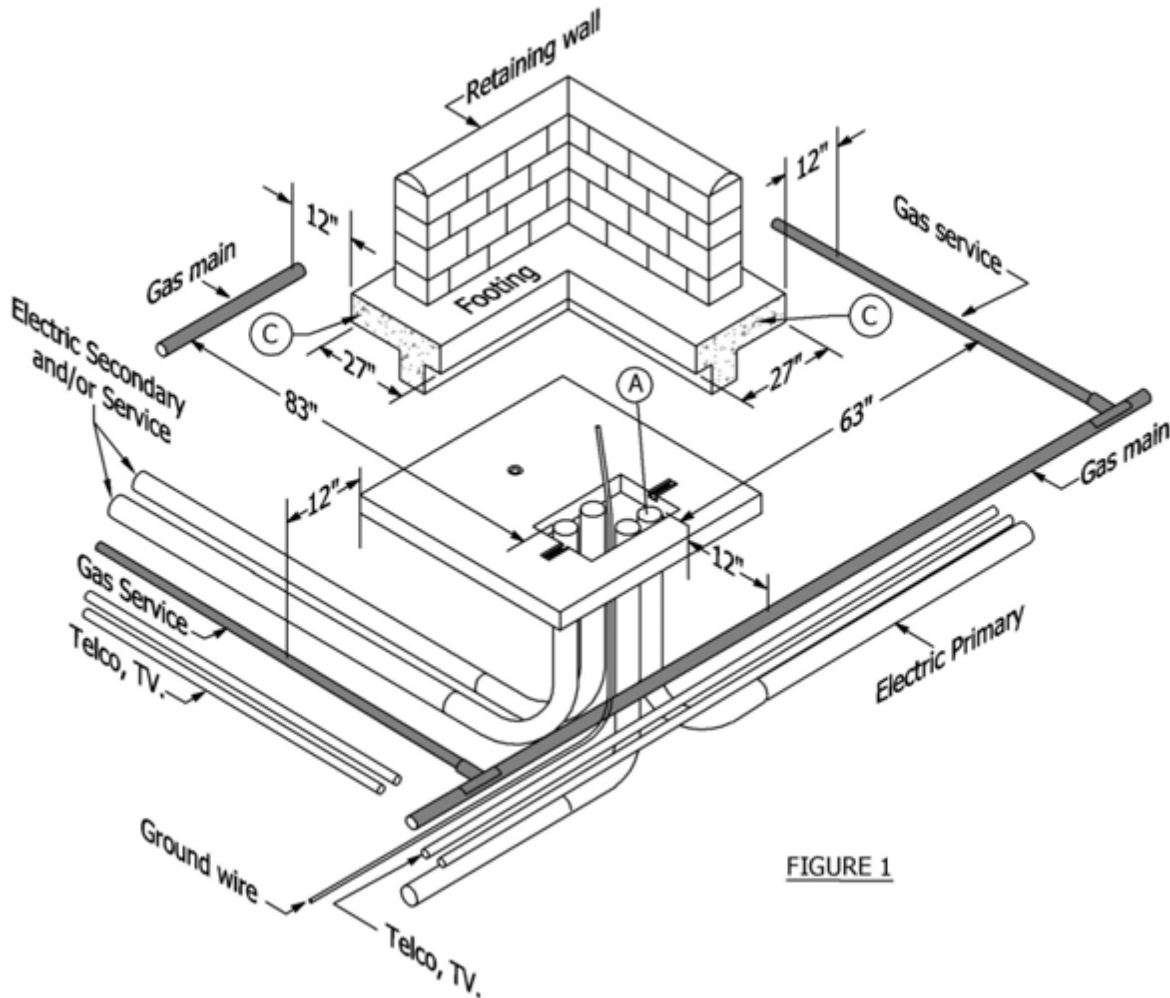


FIGURE 1

Installation Notes:

- (A) Positions of primary and secondary conduits entering and leaving padmounted equipment depend on type of equipment, such as single or three-phase transformers.
- B. Maintain 12" minimum horizontal separation from edge of pad, handholes, vaults, etc., to gas main/service to prevent damage from driven ground rods and provide access to main/service in the future.
- (C) If retaining wall is to be installed, maintain 12" horizontal separation from footing. Footing width in Figure 1 is based on 4'-0" wall height with 3 to 1 slope.
- D. Gas pipe must not be located under any facility such as splice boxes, equipment pads, footings, etc.

Reference GAS D7417.1.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
1 OF 7

SDG&E SERVICE STANDARDS & GUIDE

GAS FACILITIES NEAR UNDERGROUND PADMOUNTED EQUIPMENT OR SUBSTRUCTURES

SG 1015.1

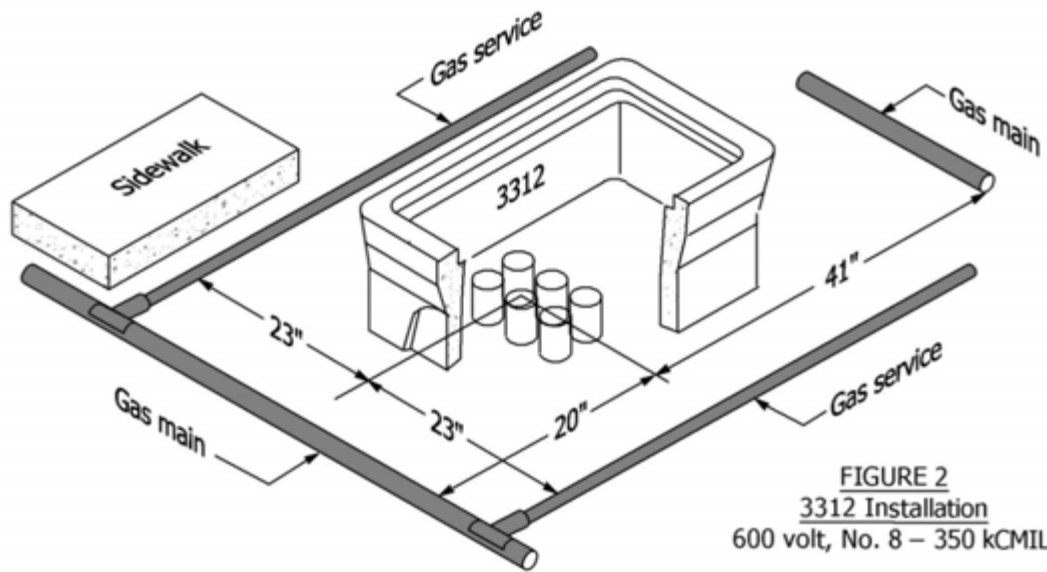


FIGURE 2
3312 Installation
600 volt, No. 8 – 350 kCMIL

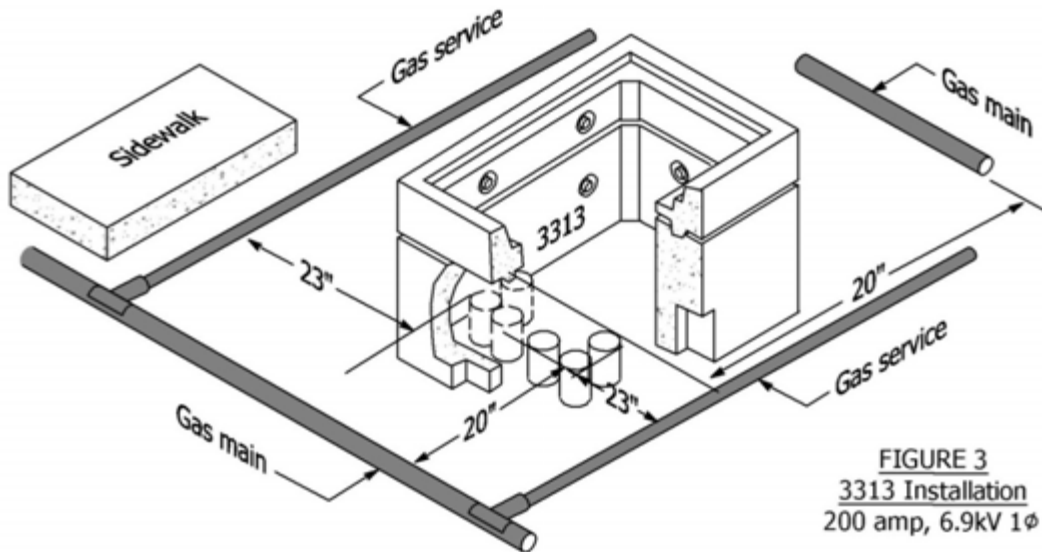


FIGURE 3
3313 Installation
200 amp, 6.9kV 1 ϕ

Notes:

- (A) Minimum dimensions are shown to obtain 12" horizontal separation from gas pipe to substructure or equipment pad.
- (B) Add 12" to dimensions shown if cable TV, telephone and electric conduits are being installed next to substructures or equipment pads in joint trench with gas.

Reference GAS D7417.2.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
2 OF 7

SDG&E SERVICE STANDARDS & GUIDE

**GAS FACILITIES NEAR UNDERGROUND
PADMOUNTED EQUIPMENT OR SUBSTRUCTURES**

SG 1015.2

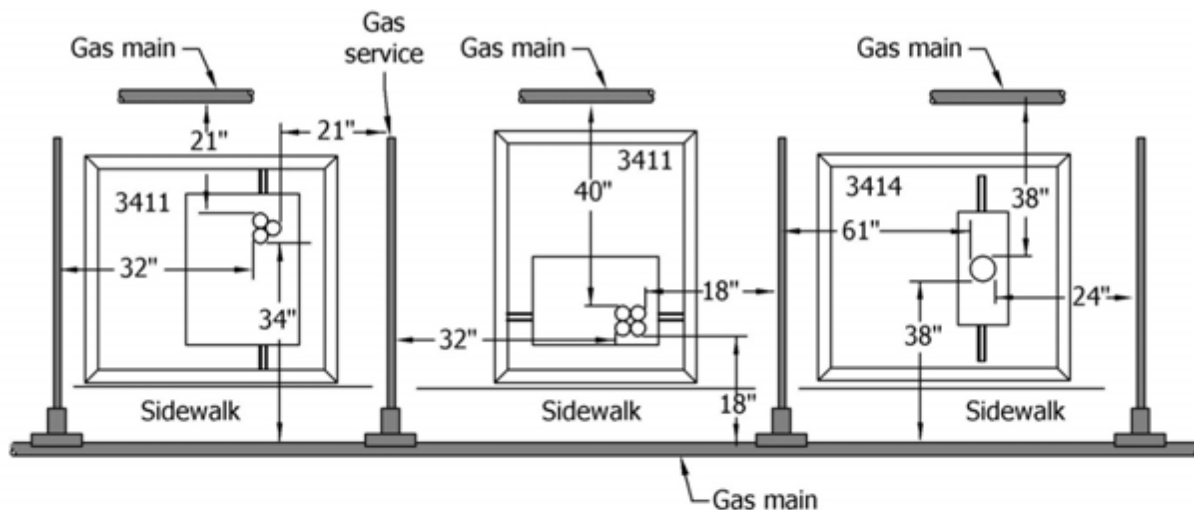


FIGURE 4
3512 Installation
1φ Fused Switching Cabinet

FIGURE 5
3522 Installation
3φ Cable Terminator

FIGURE 6
3414 Installation
Capacitor Rod

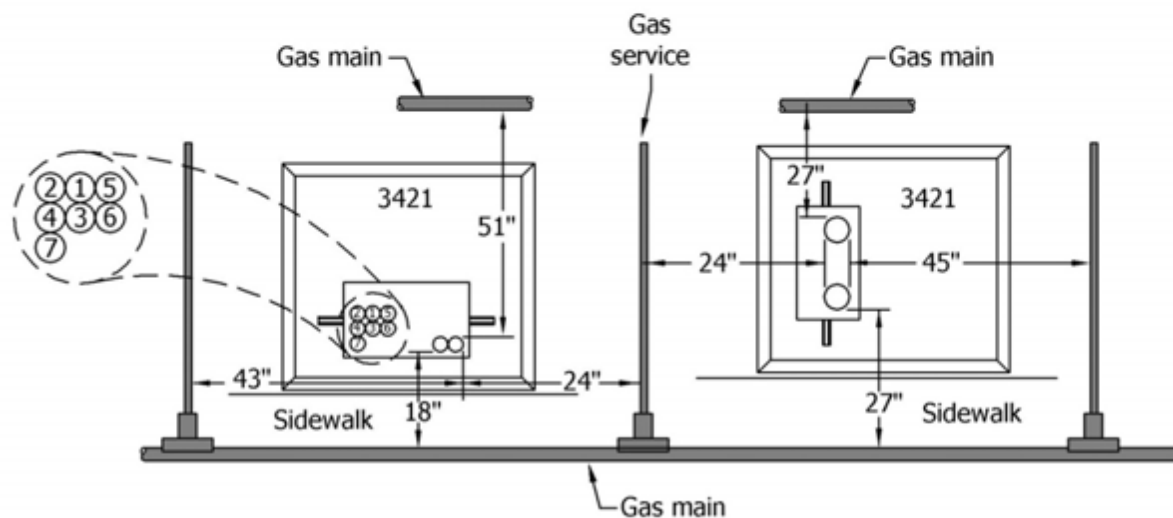


FIGURE 7
3520 Installation
1φ Terminator, 1φ Transformer

FIGURE 8
3513 Installation
3φ Fuse Cabinet

Reference GAS D7417.3.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
3 OF 7

SDG&E SERVICE STANDARDS & GUIDE

**GAS FACILITIES NEAR UNDERGROUND
PADMOUNTED EQUIPMENT OR SUBSTRUCTURES**

SG 1015.3

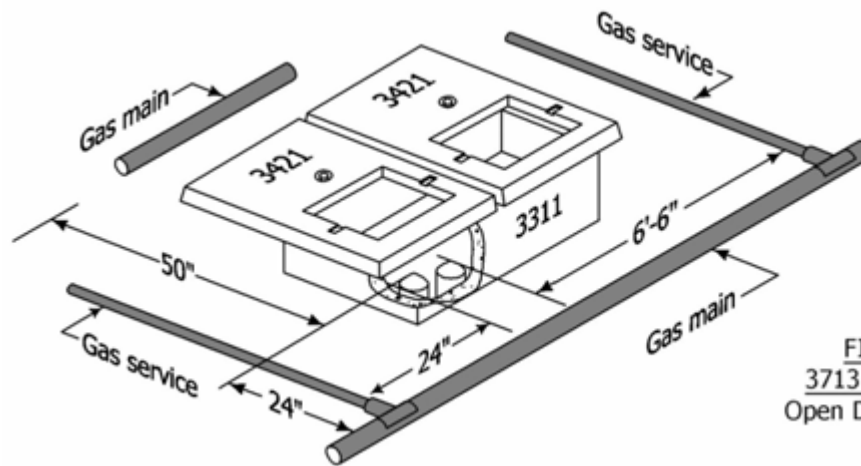


FIGURE 9
3713 Installation
Open Delta Bank 3φ

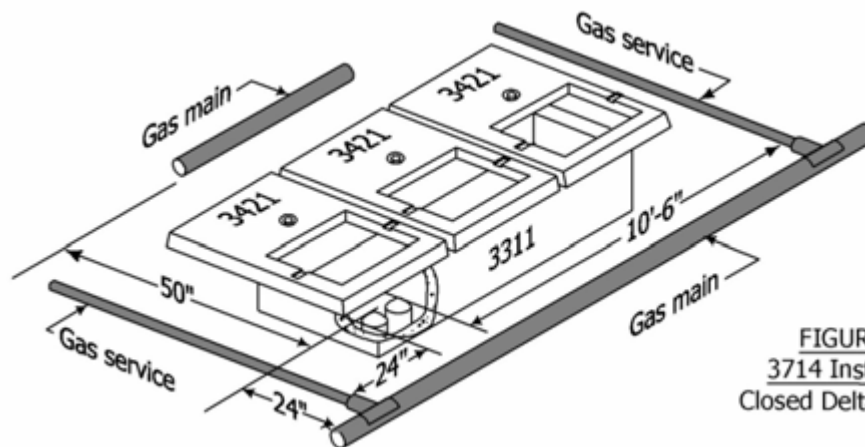


FIGURE 10
3714 Installation
Closed Delta Bank 3φ

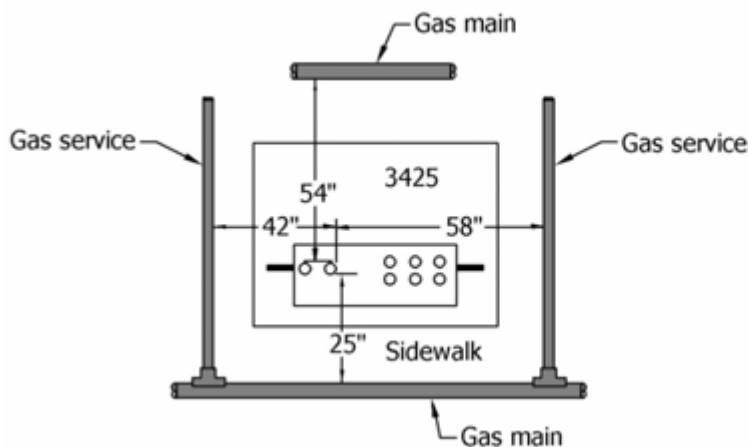


FIGURE 11
3425 Installation
3φ Transformer

Reference GAS D7417.4.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision Completely Revised New Page Information Removed

SHEET
4 OF 7

SDG&E SERVICE STANDARDS & GUIDE

**GAS FACILITIES NEAR UNDERGROUND
PADMOUNTED EQUIPMENT OR SUBSTRUCTURES**

SG 1015.4

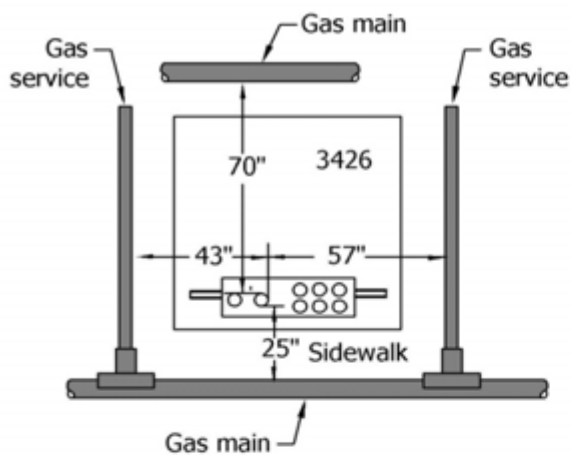


FIGURE 12
3426 Installation
3Ø Transformer

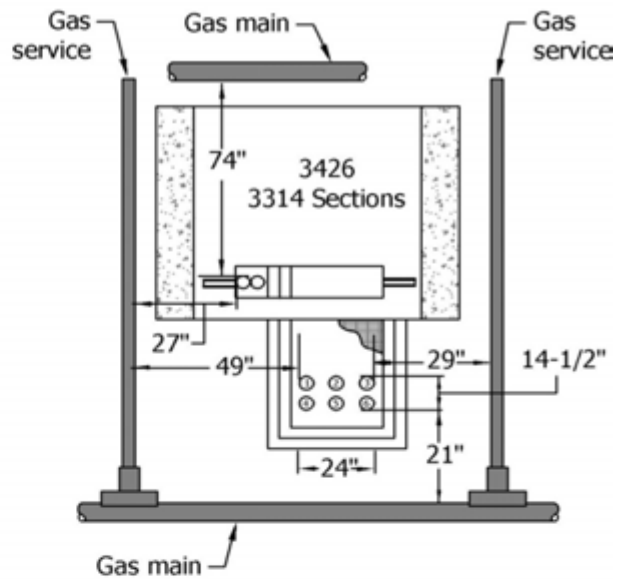


FIGURE 13
3426 Installation - 3314 Sections
3Ø Transformer

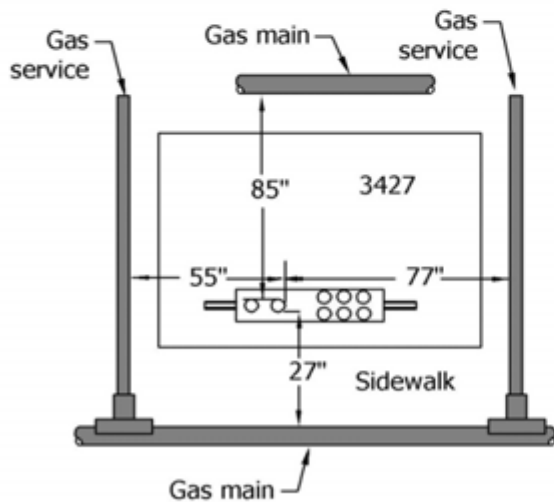


FIGURE 14
3427 Installation
3Ø Transformer

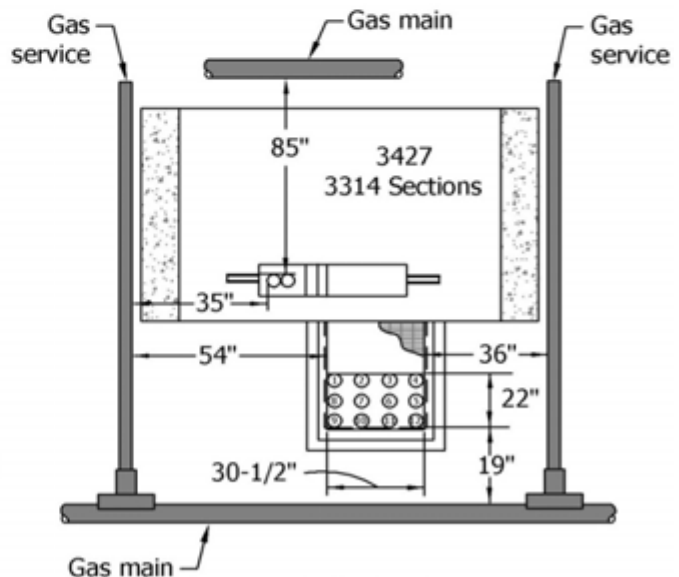


FIGURE 15
3427 Installation - 3314 Sections
3Ø Transformer

Reference GAS D7417.5.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					



Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
5 OF 7

SDG&E SERVICE STANDARDS & GUIDE

**GAS FACILITIES NEAR UNDERGROUND
PADMOUNTED EQUIPMENT OR SUBSTRUCTURES**

SG 1015.5

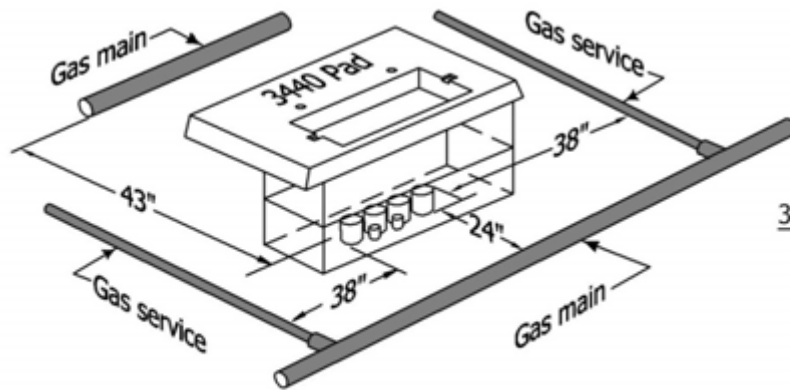


FIGURE 16
3440 Installation - 3311 Sections
12kV 600 Amp
3 ϕ Switch

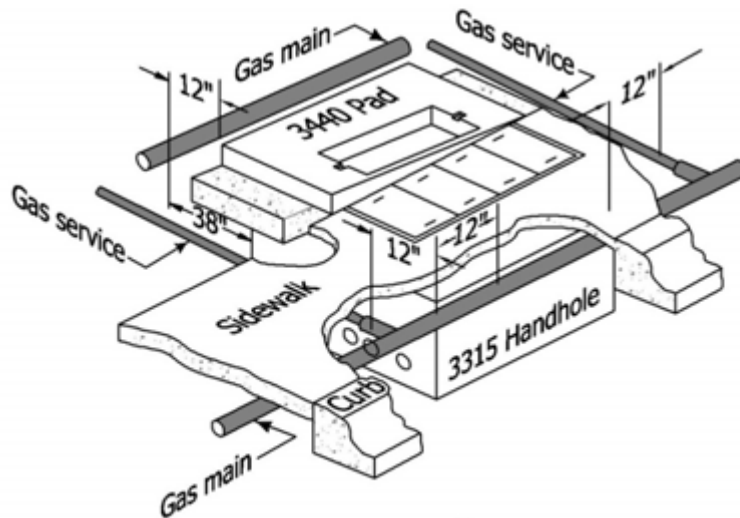


FIGURE 17
3440 Installation - 3315 Handhole
12kV 600 Amp
3 ϕ Switch

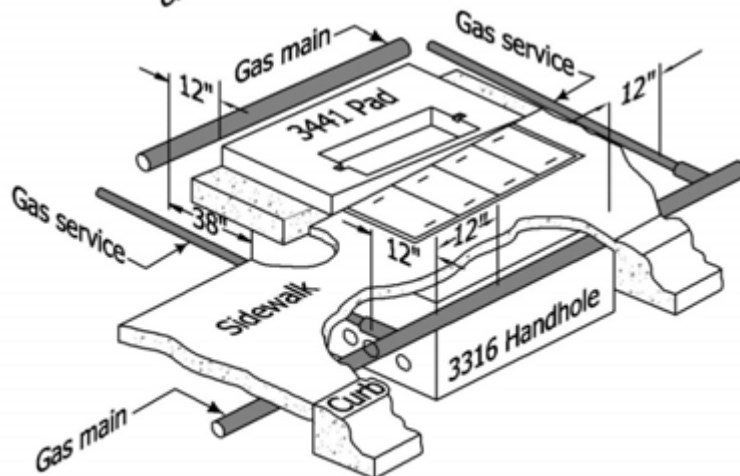


FIGURE 18
3441 Installation - 3316 Handhole
12kV 600 Amp
3 ϕ Switch

Reference GAS D7417.6.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
6 OF 7

SDG&E SERVICE STANDARDS & GUIDE

**GAS FACILITIES NEAR UNDERGROUND
PADMOUNTED EQUIPMENT OR SUBSTRUCTURES**

SG 1015.6

Telephone feeder distribution
cabinets Type 40 C or D

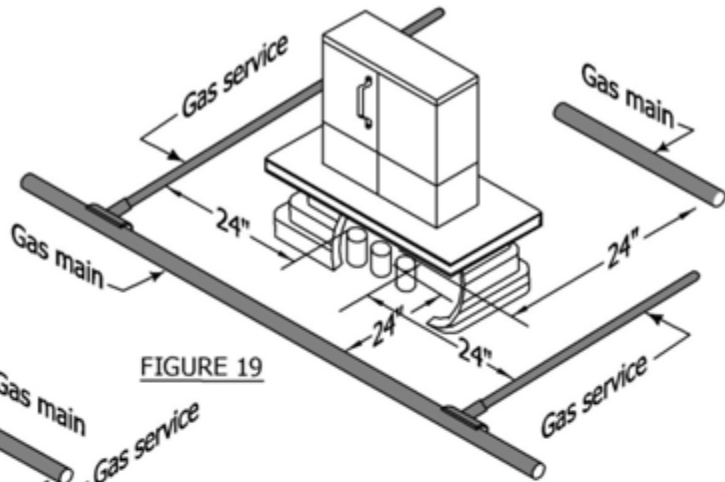


FIGURE 19

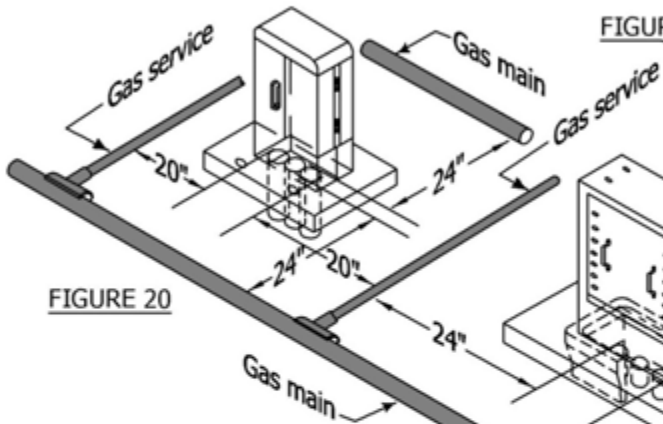


FIGURE 20

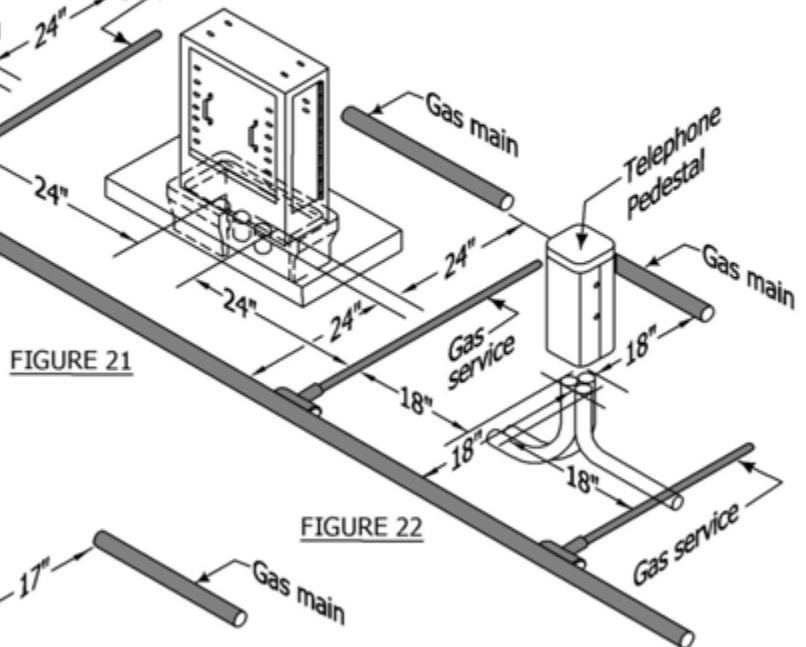


FIGURE 21

FIGURE 22

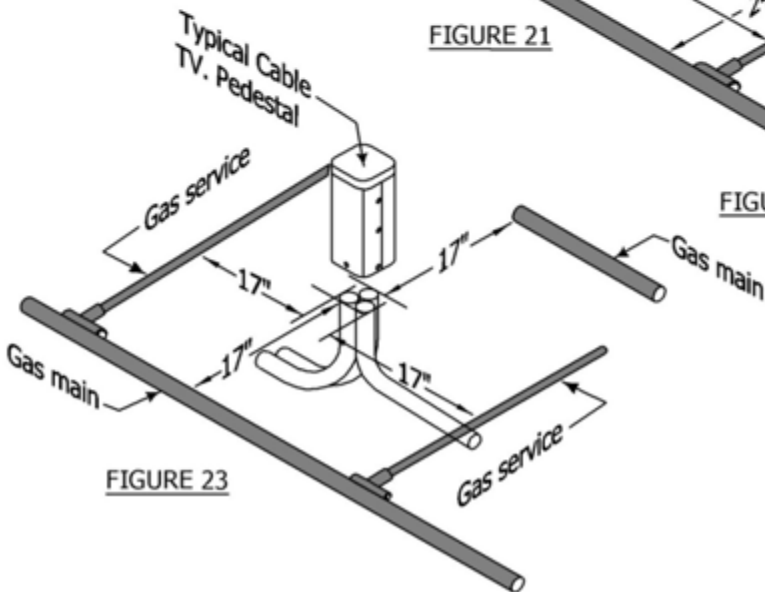


FIGURE 23

Reference GAS D7417.7.

© 1998-2017 San Diego Gas & Electric Company. All rights reserved. Removal of this copyright notice without permission is not permitted under law.

REV	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A	Editorial Changes	LSM	IPJ	TPM	11/01/17	D					
B						E					
C						F					

X Indicates Latest Revision

Completely Revised

New Page

Information Removed

SHEET
7 OF 7

SDG&E SERVICE STANDARDS & GUIDE

**GAS FACILITIES NEAR UNDERGROUND
PADMOUNTED EQUIPMENT OR SUBSTRUCTURES**

SG 1015.7



*San Diego Area Chapter
International Code Council*

Carlsbad, Chula Vista, Coronado, Del Mar, El Cajon, El Centro, Encinitas, Escondido, Imperial Beach, La Mesa, Lemon Grove, National City, Oceanside, Poway, San Diego City, San Diego County, San Marcos, Santee, Solana Beach, Vista

San Diego Area
**Electrical
Newsletters**

January 2020
Based on the
2019 edition of
the California Electrical Code
(2017 National Electrical Code)

About the San Diego Area Electrical Newsletters

The San Diego Area Electrical Newsletters are developed through a cooperative effort of the San Diego Area Inspection Jurisdictions and are approved by the San Diego Area Chapter of the International Code Council.

The newsletters provide the local jurisdictions a resource for interpretation and enforcement of the 2019 California Electrical Code (CEC) based on the 2017 edition of the National Electrical Code (NEC) in compliance with Article 90.4 that reads in part: "The authority having jurisdiction [(AHJ)] for enforcement of the *Code* has the responsibility for making interpretations of the rules, for deciding on the approval of equipment and materials, and for granting the special permission contemplated in a number of the rules."

Examples of specific installations that are generally acceptable in the San Diego Area are included. Check with the local inspection jurisdiction before beginning any installation based on these newsletters.

The 2020 Service Standards & Guide manual published by San Diego Gas & Electric Company (Utility) is referenced to provide the Utility's electrical serving requirements as a courtesy to the electrical industry. These references are shown in boxed text.

Additional California code requirements are found in the following:

- California Green Code
- The California Energy Codes

Participating San Diego Area Inspection Jurisdictions

City of Carlsbad
City of Chula Vista
City of Coronado
City of Del Mar
City of El Cajon
City of El Centro
City of Encinitas
City of Escondido
City of Imperial Beach
City of La Mesa

City of Lemon Grove
City of National City
City of Oceanside
City of Poway
City of San Diego
City of San Marcos
City of Santee
City of Solana Beach
City of Vista
County of San Diego

Boxed language refers to the Utility.
--

San Diego Area Chapter International Code Council

Table of Contents

<u>Code Reference</u>	<u>Subject</u>	<u>Page #</u>
90.7, 110	Approval of Electrical Equipment.....	1
110.3(B),110.14(A)&(D).....	Torque Requirements	2
110.26	Electrical Equipment Rooms	3
110.26(A)&(E)	Dedicated Equipment Space-Outdoor	4
200.6, 210.5(C), 215.12	Identifying Conductors	5
210.52(E).....	Unconditioned Enclosed Patio.....	6
220.....	Electrical Service Plan Check Requirements.....	7
225.30(B).....	Number of Supplies (Feeders)	8
230.2	Number of Services	9
230.70	Service Equipment – Disconnecting Means.....	13
230.95	Ground-Fault Performance Testing.....	14
250 Part III	Grounding Electrode System & Grounding Electrode Conductor.....	16
250.52(A)(3)	Concrete-Encased Electrode (Rebar)	17
250.52(A)(5), 250.53(G), 250.64(B)18	Ground Rods.....	18
342, 344, 358.....	Underground Metal Conduit	19
368.....	Busways.....	20
408.....	Switchboards & Panelboards	21
445.....	Generators	22
450.....	Transformers	24
490.....	Examination of Electrical Equipment Exceeding 1,000 Volts	25
625.....	Electric Vehicle Charging Systems (EVCS).....	27
625.48	Electric Vehicle Supply Equipment (EVSE)	28
690.....	Solar Photovoltaic Systems	29
705.10, Table 705.3.....	Alternate Sources of Power	32
.....	Index.....	33

Approval of Electrical Equipment

Code Reference: 2019 California Electrical Code Article 90.7, 110

Published: January 2008

Revised: January 2020

The authority having jurisdiction (AHJ) has the responsibility for making interpretations of the requirements of the California Electrical Code. It is the intent of this newsletter to address the locally accepted requirements for the listing and labeling of electrical equipment.

Listing and labeling provides prima facie evidence that the electrical equipment is approvable by the jurisdiction. Equipment shall be listed and labeled by a Nationally Recognized Testing Laboratory (NRTL) that is recognized by the Federal Occupational Safety and Health Administration (OSHA), Department of Labor under 29 CFR 1910.7 for electrical equipment.

<https://www.osha.gov/dts/otpc/nrtl/>

Equipment shall be installed per the manufacturer's installation instructions. Switchgear shall be installed per NEMA (National Electrical Manufacturer's Association) Standards. The equipment shall be approved by the jurisdiction for the location of the installation.

Electrical equipment installed without the required label is then required to be evaluated and labeled per this newsletter and per NFPA 790 and 791.

The AHJ may request an evaluation by an approved evaluator for equipment that does not have an acceptable testing agency label.

The following procedure is requested to be followed when a field evaluation is to be done:

1. Field evaluator shall notify the AHJ that they have been contracted to examine equipment.
2. Initial letter shall include the name of the tenant/owner, the address of the location of the equipment, the type of equipment, and the standards to which the equipment will be evaluated. The letter should also indicate if a preliminary evaluation was undertaken and the results of that preliminary evaluation.
3. Upon completion of the evaluation, the evaluator shall notify the AHJ in writing of the results of test, provide a copy of the report, and identify that their evaluation approval label has been affixed to the equipment.

It shall be understood that a completed Field Evaluation report and affixed label to any piece of equipment may only be considered approved for that exact location/environment where it was evaluated. Henceforth, if the piece of equipment is moved to another location, then an additional Field Evaluation shall be required.

Torque Requirements

Code Reference: 2019 California Electrical Code Article 110.3 (B) and 110.14 (A) & (D)

Published: October 1987

Revised: January 2020

Standards such as NEMA, ASTM, ANSI, and UL require all terminals and lugs to pass stringent tests as a part of the listing process. The listings for terminals and lugs include specific torquing requirements. All manufacturers are required to identify appropriate torque numeric values for each type of termination as part of their installation instructions. Calibrated torque tools shall be used to achieve the indicated torque. The contractor is responsible to ensure that all terminations are properly torqued.

The local authority having jurisdiction (AHJ) has established the following inspection requirements:

1. The AHJ may require that torqueing tools and manufacturer's torqueing instructions be on the job site at the time of inspection; or
2. The AHJ may accept a letter from the contractor certifying that all terminations have been torqued in accordance with the manufacturer's instructions; or
3. The AHJ may require that the contractor obtain an approved third-party testing agency to certify the proper torqueing of all terminations.

Notes:

- When equipment torque labels cannot be read, or the label is missing, it is acceptable to use values found in NFPA 70 Informative Annex I.
- If terminals have been over-torqued, then damaged equipment must be replaced.

Electrical Equipment Rooms

Code Reference: 2019 California Electrical Code Article 110.26

Published: October 1987

Revised: January 2020


Section 110.26 uses the term "equipment" instead of "switchboards and panelboards". The intent is to include any type of equipment that contains overcurrent, switching, or control devices. The local authority having jurisdiction (AHJ) has made the following interpretations regarding this section:

1. Section 110.26 (C)(2) applies to equipment individually listed and marked with a rating of 1200A or more and over 6 feet wide.
2. The nameplate rating of the pull section shall determine the rating of the equipment and be included in determining the width of the equipment. Future expansion shall be included in the design of the work space and equipment layout when pull sections are rated 1200A or larger. Consult the Utility for their requirements relating to pull sections.
3. There shall be one entrance to and egress from the required working space not less than 24 inches wide and 6½ feet high at each end of the working space. A single entrance to and egress from the required working space shall be permitted if either a. *unobstructed egress* or b. *extra working space* is provided.
 - a. *Unobstructed egress* is defined as an egress path located entirely outside the minimum required working space area, a minimum of 36 inches in width, and is clear of any obstructions, from the equipment to a safe location outside the room or area.
 - b. *Extra working space* is where the depth of the working space is twice that required by 110.26 (A)(1). A single entrance is permitted provided it is located so that the distance from the equipment to the nearest edge of the entrance is not less than the minimum clear distance specified in Table 110.26 (A)(1). This is a radial measurement from the equipment. (See drawing below.)
4. For electrical rooms containing equipment rated 800 amperes or more, with the access door located within 25 feet of the equipment, the door shall open out (in the direction of egress) and be equipped with panic bars, pressure plates, or other devices that are normally latched but open under simple pressure.
5. Where Personnel Doors are installed, the minimum clear width shall be 32" (See CBC 1010.1.1)

The Utility requires all doors in an electric meter room to be a minimum of 36 inches in width or the width of the pull section, whichever is greater, open in the direction of egress, and be equipped with "lever-operated" hardware. Lever-operated hardware is a type that permits the door to be opened from inside the room without the use of hands.

Consult with the Utility for door dimensions not covered by item 4 above.

Note: 5" conduit requires 6' of working clearance in front of the pull section.

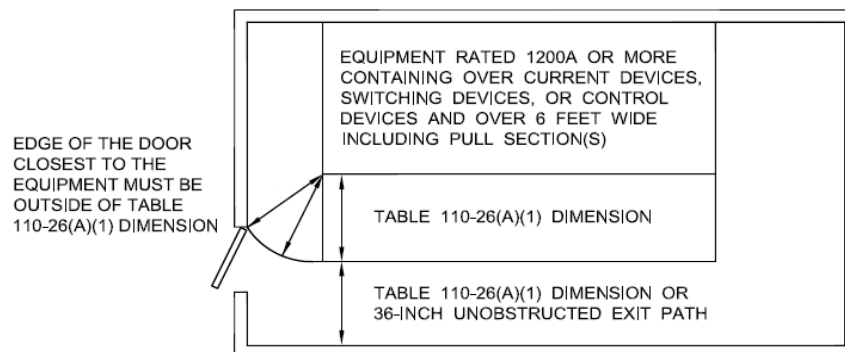

Dedicated Equipment Space – Outdoor

Code Reference: 2019 California Electrical Code Article 110.26 (A) and (E)

Published: August 2005

Revised: January 2020

The intent of this newsletter is to address installations existing gas meters are located within the dedicated equipment space of electrical service equipment.

Effective January 1, 2017, it is no longer acceptable for the gas meter to be located within the dedicated equipment space or the working space of the electrical service equipment.

<p>Where an existing gas meter is located below the electrical service equipment, you must consult the local Utility before starting any work to confirm the new installation meets current standards.</p>
--

Identifying Conductors

Code Reference: 2019 California Electrical Code Article 200.6, 210.5(C), 215.12

Published: January 2008

Revised: January 2020

The objective of this newsletter is to clarify when the identification and posting of the identification means are required for neutrals, branch circuit conductors, and feeder conductors when more than one nominal voltage supplies a premise.

For existing buildings:

- When new branch circuit wiring is extended from an existing panelboard, those new circuits shall not be required to comply with Section 210.5 (C).

Unconditioned Enclosed Patio

Code Reference: 2019 California Electrical Code Article 210.52 (E)

Published: April 1985

Revised: January 2020

Enclosed patios are not considered to be habitable rooms and need not meet the outlet spacing requirements of Sections 210.52 (A) and 210.52 (E)(3) applies and a receptacle outlet shall be required. Receptacles installed will require ground fault circuit interrupter (GFCI) protection. If the existing outdoor receptacle is enclosed by the construction, an additional receptacle must be provided on the building exterior wall per Section 210.52 (E)(1). If adding an additional entrance or exit with grade level access, an additional switched lighting outlet shall be installed as per Section 210.70 (A)(2)(b).

A suitably located single lighting outlet is allowed to serve more than one door.

ALL LIGHTING SYSTEMS MUST COMPLY WITH CALIFORNIA TITLE 24 ENERGY EFFICIENCY REQUIREMENTS.

Electrical Service Plan Check Requirements

Code Reference: 2019 California Electrical Code Article 220

Published: April 1985

Revised: January 2020

The intent of this newsletter is to clarify the general requirements for electrical plans for installations in the San Diego area.

For new, single-family residential services, an approved plot plan showing the size and location of the service equipment is required.* When the service is rated over 200 amperes, additional information may be required by the authority having jurisdiction (AHJ).

All commercial services require complete electrical plans. These plans shall include, but not limited to:

- a description of all loads to be served and location
- service description: voltage, amperage rating, and number of phases
- feeder and branch circuit overcurrent devices
- the size and type of conductors
- Fault Current Calculations
- The Short Circuit Current Rating (SCCR) of equipment
- grounding and bonding details
- the wiring methods to be utilized

Calculations to justify the proposed installation must be provided. Generally, power, lighting and single-line diagrams will be required as well as plans showing the location of all proposed electrical equipment to be installed.

All electrical plans shall be signed as required by the State of California Business and Professions Code and, where applicable, shall contain the Statement of Compliance required by Title 24.

The San Diego Chapter of ICC also recommends that each AHJ require meter locations be shown on all building plans (site) prior to permit issuance and that each AHJ verify these locations in the field prior to its final approval of the gas and electric systems.

Note: These general plan requirements are based on typical installations. An AHJ may find it necessary to require additional plans or calculations at any stage of design or construction.

* Consult with an AHJ for specific requirements based on size of service.

Number of Supplies (Feeders)

Code Reference: 2019 California Electrical Code Article 225.30

Published: May 2000

Revised: January 2020

The intent of this newsletter is to provide clarification for conditions under which multiple supplies and branch circuits for Special Occupancies per Section 225.30 (B) will be accepted.

(B) Special Occupancies. By special permission, additional feeders or branch circuits shall be permitted for the following:

(2) A single building or other structure sufficiently large to make two or more supplies necessary:

- The building is of such size that the separate feeders or branch circuits would be a minimum of 150 feet apart, in a straight line, and
- For existing electrical systems where the service and metering equipment are grouped at one location on a premise serving multiple buildings, each building with multiple tenants can continue to have 6 or less feeders provided the supply (feeder) disconnects are grouped at one location.

PLACARDING REQUIREMENTS

Where a building or structure is supplied by more than one feeder or branch circuit or by any combination of branch circuits and feeders, NEC Section 225.37 requires a permanent plaque or directory to be installed at each feeder and branch circuit disconnect location denoting all other feeders and branch circuits supplying that building or structure and the area served by each.

The plaque or directory required by Section 225.37 shall be manufactured in metal or plastic, suitable for the environment, with engraved or machine-printed lettering or electro-photo-plating in a contrasting color. The plaque shall include a footprint of the entire building, properly oriented, with the area served by each service clearly delineated. The plaques shall be located at the service disconnect and securely fastened by permanent means acceptable to the AHJ. (see sample in the 230.2 Newsletter)

Number of Services

(Page 1 of 4)

Code Reference: 2019 California Electrical Code Article 230.2

Published: December 1981

Revised: January 2020

Some of the multiple services permitted as exceptions to Section 230.2 conflict with other provisions of Section 230, with SDG&E policy, and with established wiring methods in the San Diego area. Such services can present a hazard in certain normal and emergency situations.

The intent of this newsletter is to establish conditions regarding the installation of multiple services that resolve such conflicts and provide for safety in both normal and emergency situations. Contact the authority having jurisdiction (AHJ) for zoning requirements that will determine whether more than one service will be allowed to a premise.

Section 230.2. Number of Services: The basic requirement of 230.2 is that a building or other structure shall be supplied by only one service. However, the use of additional services is permitted by 230.2 (A) through (D). 230.2 (A) through (D) describe those conditions under which more than one service is permitted. If more than one service is installed, 230.2 (E) requires that a permanent plaque or directory be installed at each feeder a disconnect location denoting all other feeders and branch circuits supplying that building or structure and the area served by each.

(B) Special Occupancies. By special permission, additional services shall be permitted for [either of] the following:

(1) Multiple-occupancy buildings where there is no available space for service equipment accessible to all occupants ("Multiple-occupancy" is interpreted to mean "multiple-tenant")

(2) A single building or other structure sufficiently large* to make two or more services necessary

* Structures Sufficiently Large: See SDG&E Service Standards & Guide, page SG 012.1-012.3, for dimensions.

Special permission for (B)(1) will not normally be granted unless the building is sufficiently large enough to qualify for a second service as outlined in (B)(2). For existing buildings, special permission will be considered on a case-by-case basis. Generally, conditions (1) and (2) above will be required as well as a plaque on each sub-panel to identify which service supplies the panel.

The Utility agrees to provide an additional service. Consult the Utility for their requirements.

Number of Services

(Page 2 of 4)

Code Reference: 2019 California Electrical Code Article 230.2

Published: December 1981

Revised: January 2020

(C) Capacity Requirements - Additional services shall be permitted under any of the following:

- (1) Where the capacity requirements are in excess of 2,000 amperes at a supply voltage of 1,000 volts or less

For multiple services, consult utility or reference SDG&E Service Standards & Guide pages SG 012.1-012.3.

- (2) Where the load requirements of a single-phase installation are greater than the serving agency [local utility] normally supplies through one service, or

- (3) By special permission.

Note: The disconnects for such separate services shall be grouped.

(D) Different Characteristics - Additional services shall be permitted for different voltages, frequencies, or phases, or for different uses, such as for different rate schedules.

Note: The disconnects for such separate services shall be grouped. A service of a different class is not required to be grouped with another service of a different class serving the building or structure.

SDG&E will not grant a second service unless the phase-to-neutral voltage is different than that of the existing service, regardless of the number of phases, except for capacity requirements as noted in (C) above.

(E) Identification - Where a building or structure is supplied by more than one service, or any combination of branch circuits, feeders, and services, a permanent plaque or directory shall be installed at each service disconnect location denoting all other services, feeders, and branch circuits supplying that building or structure and the area served by each. See Section 230.2 (E)

Note 1: The plaque or directory required by Section 230.2 shall be manufactured in metal or plastic, suitable for the environment, with engraved or machine-printed lettering or electro-photo-plating in a contrasting color. The plaque shall include a footprint of the entire building, properly oriented, with the area served by each service clearly delineated. The plaques shall be located at the service disconnect and securely fastened by permanent means acceptable to the AHJ.

Note 2: Doors into electrical meter rooms shall be marked with a plainly visible and legible sign stating, "Electric Meter Room", "Electric Room", or "Meter Room". If there are multiple electric meter rooms, the doors must be marked "Electric Meter Room #___ of ___", as appropriate. Reference 2013 California Fire Code, Chapter 6, Section 605.3.1 Labeling.

In addition to the above requirements, when a building has more than one electric meter room, SDG&E requires that a plaque is secured to the exterior door of each electric meter room identifying the suites served by the meters in that room. Reference Service Standards & Guide, pages SG 017.1-017.3

Number of Services


(Page 4 of 4)

Code Reference: 2019 California Electrical Code Article 230.2

Published: December 1981

Revised: January 2020

TYPICAL PLAQUE FOR EXISTING BUILDINGS WITH INTERMIXED SERVICES

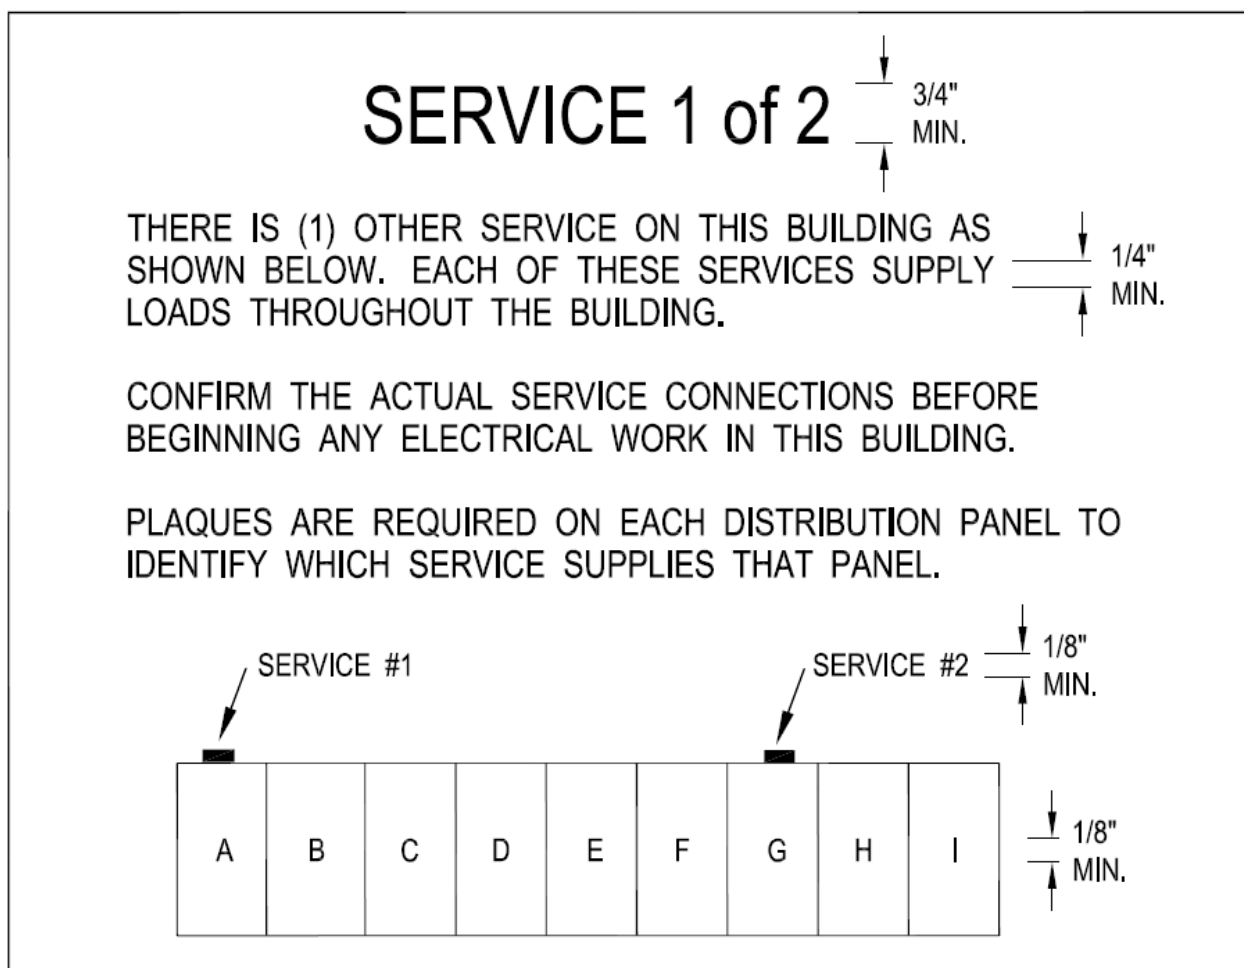

The plaque or directory shall be manufactured in metal or plastic, suitable for the environment, with engraved or machine-printed lettering or electro-photo-plating in a contrasting color. The plaque shall include a properly oriented footprint of the entire building, properly oriented, with the area served by each service clearly delineated. The plaques shall be located at the service disconnect and securely fastened by permanent means acceptable to the AHJ.

Service Equipment – Disconnecting Means

Code Reference: 2019 California Electrical Code Article 230.70

Published: August 2005

Revised: January 2020

The intent of this newsletter is to provide a guideline for the location of a building's service disconnecting means.

Section 230.70 (A)(1) requires that the service disconnecting means be installed in a readily accessible location either outside of a building or structure or inside nearest the point of entrance of the service conductors.

An uncontrolled length of unfused conductor or bus in other than the Utility vault room or the service equipment room represents a hazard to the structure. Some buildings, due to design restrictions cannot have the service disconnecting means immediately adjacent to the service point.

A maximum of 10 feet of unfused conductor or bus from the service point to the building's service disconnecting means is permissible.

Ground-Fault Performance Testing

(Page 1 of 2)

Code Reference: 2019 California Electrical Code Article 230.95

Published: April 1989

Revised: January 2020

Section 230.95 requires that ground-fault protection of equipment shall be provided for solidly grounded wye electrical services of more than 150 volts to ground but not exceeding 1,000 volts phase-to-phase for each service disconnect rated 1,000 amperes or more. The grounded conductor for the solidly grounded wye system shall be connected directly to ground . . . without inserting any resistor or impedance device. Subsection (C) requires testing of such system to assure that the equipment performs its intended function. This code section does not define who is to perform these tests or what information is to be included in the written report for the authority having jurisdiction (AHJ). Additionally, the requirement that these tests be performed on the system "when first installed on-site" often results in a test of a system that is incomplete. (See boxed text.)

A ground-fault protective system includes the ground-fault device (main disconnect and fault current sensor) and all wiring supplied by this device. For this reason, performance testing should normally be accomplished after all wiring is installed to ensure that the ground-fault device functions properly.

The following standards are established to assure that performance testing of ground-fault systems is accomplished in a uniform and acceptable manner:

1. Performance testing shall be performed by a third-party testing company acceptable to the AHJ and capable of demonstrating both the knowledge and the equipment necessary for such tests.
2. The ground-fault protective system must be tested after all wiring is installed and before the building is approved for final occupancy. This test must be performed prior to the AHJ authorizing the local utility to energize the service equipment.

Exception: The use of permanent service equipment for temporary power is common in the industry. The standards established by this newsletter are intended to recognize and permit this use. Where a temporary service is allowed for construction or equipment testing, prior to the final approval of the building, it is permissible for the testing of the ground-fault protective system to be accomplished in two separate parts.

Part 1. Testing of the ground-fault protective device must be completed before the service will be energized, along with testing all neutral and ground connections installed at the time of the Part 1 testing. This provides a reasonable level of protection for the service equipment during the period that temporary wiring is in use.

Part 2. All remaining neutral and ground connections not tested in Part 1 shall then be tested after all wiring is installed and before the building is approved for final occupancy. This testing normally requires a Utility outage, but the outage may be waived at the discretion of the testing company performing the test.

Note: Most ground-fault protective device testing requires that the service be de-energized. There are fees for the Utility to disconnect and reconnect the power. This applies to Part 1 and Part 2 if the service is required to be disconnected. Contact the Utility Planner for additional information.

Ground-Fault Performance Testing

(Page 2 of 2)

Code Reference: 2019 California Electrical Code Article 230.95

Published: April 1989

Revised: January 2014

3. A written record of the testing shall be provided, by the contractor, to the AHJ and shall include:
 - a. A statement that the testing was performed in accordance to the manufacturer's instructions and in accordance with the procedures of the International Electrical Testing Association (NETA)
 - b. The ground-fault set point and trip times are to be provided to the third party doing the testing prior to or at the time of the initial testing (These set points must be provided by a qualified engineering firm and should be based on a short circuit and relay coordination study)
 - c. A statement that the service grounding connections are correctly installed for a ground-fault system
 - d. A statement that all neutral conductors in the distribution system have been tested and found to be ungrounded (Describe the test method used)
 - e. A statement that the ground-fault equipment functioned properly when tested (Include the actual settings and trip-times of the test based on the information required in Section b above)

Grounding Electrode System & Grounding Electrode Conductor

Code Reference: 2019 California Electrical Code Article 250 Part III

Published: December 1981

Revised: December 2020

This section has generated many questions regarding the use of metal underground water pipes as grounding electrodes, the type of grounding electrodes acceptable as supplements to a metal underground piping system, and the type of grounding electrode required where there is no underground water piping on the premises.

The intent of this newsletter is to interpret Sections 250.50, 250.52, and 250.53 so that the requirements for grounding electrode systems are related to typical construction methods in a practical and consistent manner.

The intent of Section 250.50 is to ensure that at least one permanent and effective grounding electrode is installed for every building or structure, and that all electrodes are at the same potential with respect to the earth.

The following requirements for the installation of grounding electrodes meet the intent of Section 250.53, are consistent with typical construction methods, and are mandatory in the San Diego area:

1. Any construction that includes new concrete foundations shall be provided with a concrete-encased electrode installed per the requirements of Section 250.52 (A)(3).

Note: Where a concrete-encased electrode of the type identified in Section 250.52 (A)(3) is not available at final, a grounding electrode consisting of a minimum 20 feet of #2 bare copper conductor buried at a depth of 30" in a trench parallel to and at least 18" away from the foundation of building may be substituted. The conductor forming the grounding electrode must be continuous, unbroken and un-spliced, and be connected to the electrical service. Ground rods are not acceptable substitutes for the required grounding electrodes for new construction. A connector is always required where the grounding electrode conductor enters the service equipment.

2. Other new construction shall be provided with at least one of the grounding electrodes specified in sections 250.52 and installed in compliance with section 250.53. When new or replacement services are installed for existing buildings, existing underground metal water piping systems shall be supplemented by an additional electrode.
3. Grounding electrodes and grounding electrode conductors shall not be installed within wiring compartments with Utility-sealed access doors or covers. When the Utility installs their seal, the compartment is no longer considered accessible for inspection by the authority having jurisdiction (AHJ).

Concrete-Encased Electrode (Rebar)

Code Reference: 2019 California Electrical Code Article 250.52 (A)(3)

Published: May 1980


Revised: December 2020

The NEC makes it clear that underground metal water pipe can no longer be relied upon to assure a permanent and effective ground. To this end, several different grounding electrodes are identified as acceptable alternatives to the water pipe. The two most commonly used are the ground rod and the concrete-encased electrode. The use of ground rods and concrete-encased electrodes has raised questions.

The intent of this newsletter is to identify the minimum requirements for an acceptable concrete-encased electrode constructed of reinforcing steel (rebar), commonly called a "ufer" ground. These minimum requirements are as follows:

1. The #4 (1/2") or larger rebar to which the grounding electrode conductor is connected must be a minimum of 20 feet long, unbroken.
2. The total developed length of rebar at the bottom of the foundation must be no less than 20 feet. Where splices are necessary to obtain the required 20 feet of rebar, they must be made so that the 2 bars overlap by no less than 15 inches and are secured by at least 2 steel tie wires.
3. The rebar may only extend out of the slab in a dry location.
4. The rebar must extend out of the slab at least 6 inches and no more than 18 inches and the point of connection of the grounding electrode connector must be accessible.

Exception to #4: Where the connection of the grounding electrode conductor is encased in concrete and the connector is listed for concrete encasement.

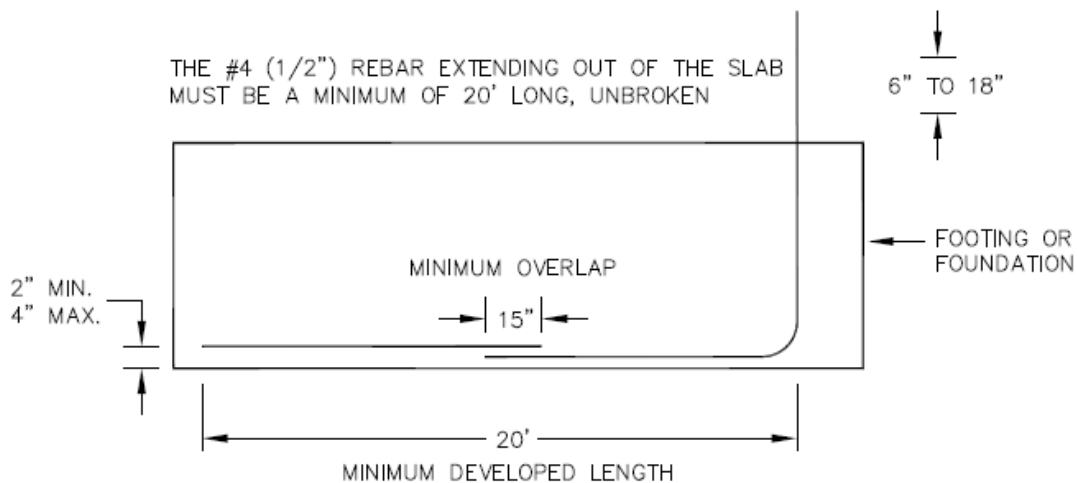

Ground Rods

Code Reference: 2019 California Electrical Code Article 250.52 (A)(5), 250.53 (G), 250.64 (B)

Published: April 1985

Revised: December 2013

The following interpretations are intended to alleviate the more common problems and establish guidelines for a ground rod installation that will be generally accepted in the San Diego area:

1. It is acceptable to install one or more driven ground rods so that no more than 3 inches projects above ground level. Connection of the grounding electrode conductor shall be made on this accessible portion of the rod. The portion of the rod with the listing mark and a ground rod clamp listed for this purpose shall be inspected by the authority having jurisdiction (AHJ). Ground rods should be installed in areas where they are not subject to physical damage or shall be provided with protection from such damage.
2. Due to adverse soil conditions in the San Diego area, galvanized ground rod and/or pipe are not acceptable. Only listed stainless steel or non-ferrous rods are acceptable.

Underground Metal Conduit

Code Reference: 2019 California Electrical Code Article 342, 344, 358

Published: April 1985

Revised: January 2020

It is the finding of the authorities having jurisdiction (AHJs) in the San Diego area that the soil conditions are not suitable for the direct burial of metallic conduits. Experience has shown that direct buried metallic conduits corrode rapidly.

Therefore, the direct burial of metallic conduit is prohibited in the San Diego area.

Exception 1: Listed Rigid Metal Conduit encased in concrete may be installed underground.

Exception 2: Intermediate Metal Conduit, Rigid Metal Conduit, and Electrical Metallic Tubing with an approved "factory-applied" non-metallic coating may be installed underground according to the manufacturer's listing and installation instructions. The AHJ may approve "field-applied" materials utilizing a listed primer and wrap, or coatings, for short sections or repairs of metallic raceways.

<p>Note: These exceptions do not apply to conduits containing Utility-owned conductors. Consult the Utility for their requirements.</p>

Busways

Code Reference: 2019 California Electrical Code Article 368

Published: August 2005

Revised: January 2020

The intent of this newsletter is to provide information only. The guidelines for the testing and acceptance of busway installations to ensure protection against potential life-safety hazards are included. Busways as defined in Article 368 is a raceway consisting of metal enclosures containing factory-mounted, bare or insulated conductors, which are usually copper or aluminum bars, rods, or tubes. Busway installations are common for customer-owned service entrance installations from the Utility's service point to the service equipment, for unmetered feeder installations, for high-rise multifamily construction with remote metering, and for metered feeder installations to accommodate multiple taps for distribution. Several incidents of transposed phase or neutral conductors have resulted in the Utility closing in to a fault condition when energizing a new transformer.

Busways shall be installed to meet the requirements of Article 368 and the manufacturer's installation instructions.

The Utility requires all service entrance and unmetered feeder busways be tested in accordance with the latest edition of the Inter National Electrical Testing Association, Inc. (NETA), Acceptance Testing Specifications for Electrical Power Distribution Equipment and System. An independent testing organization acceptable to the AHJ and the Utility shall perform a continuity test on each busway section to confirm proper phasing and connection after each section is installed. The installer of the system shall provide a written test report to the AHJ and the Utility's Inspector. The AHJ will not release an inspection clearance to the Utility, nor will the Utility energize its transformer and the service until receipt, review, and acceptance of the written test report.

Switchboards & Panelboards

Code Reference: 2019 California Electrical Code Article 408

Published: June 1990

Revised: January 2020

The testing and listing standards for switchboards and panelboards require that the manufacturer identify any equipment intended to be installed in the field. The part or catalog number on a label in the switchboard or panelboard must identify equipment intended for field installation. The manufacturer must also provide any instructions necessary for the proper installation of such equipment. These requirements specifically include terminal connectors.

Most switchboards are designed to be connected to other sections or equipment with splice and through bus. Some switchboards also provide a set of factory-installed terminals for tapping a single circuit ahead of the service main. Very few switchboards are designed for the field installation of terminals on busses in order to make cable connections. Switchboards and panelboards designed for this application will include the required markings and installation instructions at the time they are originally manufactured.

The following procedures are established to ensure that switchboards and panelboards are installed in conformance with the testing and listing standard for such equipment:

1. Plan reviewers will approve plans showing field connection of cable to busses when there is documentation from the original equipment manufacturer (OEM) that the equipment is suitable for the field installation of terminals.
2. All new switchboards and panelboards will be inspected to determine compliance with the listing and manufacturer's instructions provided with the equipment.
3. All installations of new cables in existing switchboards and panelboards will be inspected to determine compliance with the listing and manufacturer's instructions provided with the equipment. In some cases, this will require changes to existing cable connections. Special attention will be given to conductor bending space, the routing of the conductors for heat dissipation in close proximity to the bus, and proper conductor support independent of energized bus.
4. Existing switchboards and panelboards not designed and marked for the field installation of terminals may be modified in the field, when:
 - a. A third-party manufacturer certifies compliance with applicable industry standards by providing approved engineered drawings prepared by a PE registered in the State of California and through a field evaluation acceptable to the AHJ with special attention given to conductor bending space, the routing of the conductors for heat dissipation in close proximity to the bus, and proper conductor support independent of energized bus as well as isolation methods to protect against inadvertent contact to energized bus ahead of the main.

Note: The Utility requires submittal of engineered drawings for approval prior to the installation of terminals or bussing for service entrance use. An example is when a field tap is required in an existing terminating enclosure to facilitate the addition of new service and metering equipment. Reference SDG&E Service Standards & Guide page SG 517.1.

Generators

(Page 1 of 2)

Code Reference: 2016 California Electrical Code Article 445

Published: August 2007

Revised: January 2014

The purpose of this newsletter is to clarify the requirements for permanently installed stationary engine generators such as stand-alone (sole source of power) and back-up generator systems. Also, see Articles 700, 701, and 702 for emergency, legally required, and optional standby systems.

Types of Generator Systems

In general, there are two types of generator systems, "Stand-Alone" and "Back-Up" generators.

"Stand-Alone" – Generator systems provide the primary source of power to the premises wiring system and are not connected to SDG&E's distribution system. There may be additional sources of power, such as solar photovoltaic and batteries, that are interconnected with a "stand-alone" generator system to provide additional reliability.

"Back-Up" – There are two types of back-up generator systems:

1. The "Emergency System" is intended to supply power essential for safety to human life when normal power fails. When required, the generator shall be outside of the building or in a room designed to provide equivalent protection from fire or damage. The room shall be identified "Emergency Generator Room" in 1-inch block letters on a red plaque. Such systems have stringent requirements and use a completely isolated wiring system to ensure service in an emergency. Consult the local fire department for specific requirements pertaining to remote switching and monitoring of emergency generators from the fire control room.
2. The "Standby System" is intended to protect private business or property and may be integrated into existing wiring. These systems can be turned on manually or automatically when the primary power fails. The standby system is intended only to provide back-up electricity and not intended to permanently replace existing Utility power.

Basic Requirements for Generator Systems:

1. A building permit is required.
 - a. Applications for permits must include three copies of a plot plan with a detailed description of the proposed work, the location of the generator, existing structures, utilities, property lines, etc.
 - b. All installations will require a single-line drawing showing the size of the generator, location of generator disconnecting means, the overcurrent protection, grounding and wiring methods, type of transfer device, and the connection to the current premises wiring system.

Generators

(Page 2 of 2)

Code Reference: 2016 California Electrical Code Article 445

Published: August 2007

Revised: January 2014

- c. The generator shall have adequate capacity and rating for the supply of all equipment intended to be operated at one time. (Equipment may be lighting, motors, heating, receptacles, and any other end use equipment the generator is intended to serve.)
 - d. The manufacturer's data sheet(s) for the generator and transfer device shall be submitted.
 - e. The complexity of the job will dictate which disciplines (mechanical, electrical, fire, structural, noise, hazardous materials, zoning, APCD, etc.) need to review and approve the plans. All systems powered by liquid fuel shall be approved by the authority having jurisdiction (AHJ) and all appropriate agencies, i.e. fire departments, County of San Diego, Department of Environmental Health, Hazardous Materials Division, Air Pollution Control District, etc.
- 2. Permanent stationary engine generators shall be listed or evaluated to comply with UL 2200. Engine generators evaluated for hazardous locations are evaluated to both UL 2200 and NFPA 496.
 - 3. Generator systems shall comply with the property line sound level limits. An acoustical analysis may be required prior to final inspection approval.
 - 4. A plaque shall be installed at the electrical service disconnect indicating type and location of the on-site generator power source(s) and its disconnect location. See the sample plaque in Newsletter 705.10.
 - 5. Generator locations must also comply with Article 430.14, Location of Motors.

Note: Portable generators intended for cord and plug connections are not allowed to be hard-wired or cord-connected to a premises wiring system without a code-compliant method of isolating the wiring service from the Utility Service. In addition, portable generators do not qualify as a required stand-alone or back-up system. Electrical permits are not normally issued for portable generators. However, consult with the appropriate AHJ and the Utility for specific requirements.

In compliance with the California Health & Safety Code, the Utility shall be notified in advance of installing "back-up" systems for review and approval of the transfer device and sequence of operations.

Transformers

Code Reference: 2019 California Electrical Code Article 450

Published: December 1981

Revised: January 2017

Means of Disconnect:

Transformers, other than Class 2 or 3, are required to have means of disconnect on the primary side of the transformer. If the means of disconnect is in a remote location, the disconnect shall be lockable in accordance with Article 110.25 and the transformer must be marked with the location of the disconnecting means. The means of identifying the remote disconnect shall be a plaque made of metal or plastic, with engraved or machine-printed letters in a contrasting color to the plaque, which shall clearly identify the location of the disconnect. The plaque shall be attached to the exterior of the transformer or on an adjacent wall with a method acceptable to the authority having jurisdiction (AHJ) per Article 450.14.

Ventilation:

Transformers in enclosed spaces shall have provisions to maintain an ambient temperature that does not exceed the temperature rating of the transformer. Note: Consideration of the conductor insulation temperature rating must be given in areas containing transformers when the ambient temperature exceeds 86 degrees °F (30 degrees °C). Refer to the ampacity correction factors in Table 310.15 (B)(16) when needed. Transformer ventilations may be accomplished by natural or mechanical ventilation, by mechanical cooling, or by other means.

1. Mechanical ventilation that provides for air movement of three cubic feet per minute/per kVA of transformer rating shall be acceptable.
2. Mechanical cooling, which can be demonstrated to maintain an ambient temperature below that of the transformer rating, shall be acceptable.
3. Any other means, including combinations of the above methods which can be demonstrated to maintain an ambient temperature below that of the temperature rating of the transformer, shall be acceptable.

Note: For transformer vault rooms, see Article 450 III.

SDG&E requirements for transformer vaults are contained in the SDG&E's Transformer Vault Specification manual.

Examination of Electrical Equipment Exceeding 1,000 Volts

(Page 1 of 2)

Code Reference: 2010 California Electrical Code Article 490

Published: January 2014

Revised: January 2020

Intent: The San Diego area has seen an increase in the number of primary (systems exceeding 1,000 volts) services and distribution systems in all jurisdictions. The 2016 edition of the California Electrical Code includes a number of requirements for the installation, testing, and grounding of medium-voltage equipment and systems exceeding 1,000 volts nominal. The local authority having jurisdiction (AHJ) may have specific requirements regarding these installations. Consult your local AHJ if there are questions.

Code Requirements (Reference only)

1. Wire methods over 1,000 volts (Article 300.31)
2. Conductors rated 2,001-35kV (Article 310.60)
3. Grounding of AC systems over 1kV (Article 250, Part X)
4. Equipment over 1,000 volts nominal (Article 490)
5. Surge arresters over 1kV (Article 280)
6. Requirements for installations over 600 volts nominal (Article 110, Part III)
7. Transformers (Article 450)
8. Outside branch circuits and feeders over 1,000 volts (Article 225, Part III)
9. Substation design, documentation, and required diagram (Article 490.48)
10. PV systems between 1,000 and 1,500 volts (Article 690.7)

Plan, Equipment, Design, & Submittal Requirements

1. Plan submittals are required for all work.
2. Equipment submittals shall be accurate.
3. Design submittals are required from a State of California Licensed Electrical Engineer.

Utility Requirements

- Refer to Electrical Utility Service Equipment Requirements Committee (EUSERC) drawings.
- Medium-voltage service and metering equipment – See SDG&E Service Standards & Guide SG 601-609
- Consult Utility for possible additional requirements for testing.

Examination of Electrical Equipment Exceeding 1,000 Volts

(Page 2 of 2)

Code Reference: 2016 California Electrical Code Article 490

Published: January 2014

Revised: January 2020

Inspection Requirements

1. Approved plans shall be available at the time of the inspection.
2. Manufacturer's installation instructions shall be available at the time of the inspection.
3. Equipment installed shall be both listed and labeled or field evaluated by an acceptable testing agency. See Electrical Newsletter pg.1 "**Approval of Electrical Equipment**" for additional information.
4. Grounding of Equipment: When working on existing systems, it is necessary to verify that the requirements of Article 250, Part X are met.
5. Terminations: When required by design specifications, hi-pot testing of cables, and/or partial discharge testing (to IEEE standards) shall be performed by a qualified company who either meets NETA standards or is NETA accredited.

Existing Systems

1. When working on existing systems, it is necessary to verify that requirements of CEC 250.190 are met.
2. Minimum testing of the existing equipment shall be line-voltage meggering to verify acceptable resistance and identify blatant defects.

Electric Vehicle Charging Systems (EVCS)

Code Reference: 2016 California Electrical Code Article 625

Published: January 2017

Revised: January 2017

The intent of this newsletter is to clarify general requirements for the permitting and inspection of plug-in Electric vehicles (PEV). For specific requirements, consult your authority having jurisdiction (AHJ).

Plan Review and Design Criteria

The following items shall or may, depending on the AHJ's requirements, be required to obtain a permit for an EVCS installation:

General:

1. Plans are required to have electrical sections and a site plan. If a commercial grade system is proposed, then typically, a registered professional engineer may be required to design the electrical system.
2. For residential system level two, or less, consult the AHJ for further information and permitting requirements.
3. Zoning and Planning approvals may require consideration for setbacks, height limitations, parking requirements, open space easements, Utility easements, etc. Consult with the local zoning technician for further information.
4. For PEV charging stations provided as public accommodations facilities or within covered multi-family dwelling units, the designer should consult the California Building Codes for minimum access requirements.

The Electrical Section of the submittal shall include:

1. Provide cover sheet with each page identified for content.
2. Each submitted sheet shall have a page number.
3. Submit the appropriate number of plan sets and supporting documents when applying for permits. Verify with the AHJ the number of plan sets required.
4. Plans shall include the specifications, the level of charging, physical location of the existing electrical equipment, method of wiring, and new EVCS. Plans shall also indicate the applicable design code edition.
5. An electrical line diagram showing the number of EVCS with voltage and kilowatt ratings, the size of all electrical panel bussing, and the size of the circuit breaker in amperes. Include wiring methods, sizing, grounding, and calculations in conformance with Article 625 and other applicable articles of the CEC.
6. Plans shall also include the manufacturer's data sheets for all equipment. All electrical equipment shall be listed for this purpose. All equipment includes, but is not limited to, inverters, controllers, metering, and interconnection system equipment.
7. All equipment must be in compliance with Article 625.15.

Electric Vehicle Supply Equipment (EVSE)

Note: Applicable to residential installations only

Code Reference: 2016 California Electrical Code Article 625.48

Published: January 2014

Revised: January 2017

The serving Utility does not currently support interconnection of an Electric Vehicle (EV) as a source of electrical energy for the purpose of operating in parallel with the Utility's electrical distribution system. California Electrical Code (CEC) Article 705 will not apply.

Use of an EV as an optional source of standby electrical power must meet the requirements of CEC Article 702 and Utility review and approval of the proposed transfer switch is required.

Additional related laws in the State of California are as follows:

- The legislature of the State of California has enacted the California Health and Safety Code, Division 104, Part 15, Sections 119075 through 119090, which is intended to prevent electricity generated by permanent or portable electric generator from back feeding into a Utility electrical system.
- The California Code of Regulations, Title 8, Section 2320.9 states:
 - No electrical power source, permanent or temporary, shall be connected to a premises wiring system, or parts of such a system, unless positive means are used to prevent the transmission of electricity beyond the premises wiring system, or beyond any intentionally segregated parts of such a system.

When planning for your PEV, consult the Utility for advantageous Time of Use rate schedule information specific to EV charging.

Solar Photovoltaic Systems

(Page 1 of 3)

Code Reference: 2016 California Electrical Code Article 690

Published: August 2005

Revised: January 2014

The intent of this newsletter is to clarify general requirements for permitting and inspection of Solar Photovoltaic systems. For specific requirements, consult your authority having jurisdiction (AHJ).

Other agencies may have requirements in addition to the following building department requirements, and include, but are not limited to:

- California Center for Sustainable Energy (CSE) – State rebates
- California Department of Housing and Community Development (HCD) – State agency for manufactured homes
- County of San Diego Department of Environmental Health (DEH)
- Fire Districts

Plan Review and Design Criteria

The following items shall or may, depending on the AHJ's requirements, be required to obtain a permit for a PV installation:

General:

1. Plans are required to have electrical and structural sections. If a commercial grade system is proposed, then typically registered professional engineers may be required to design the electrical and structural system.
2. For stand-alone PV systems (not interconnected with the Utility's system), consult the AHJ for further information.
3. If the proposed system is for a manufactured home, the State of California must also be contacted. Permit and inspection will be required from the State.
4. If proposed system is ground-mounted and the parcel has a septic system, you must have Department of Environmental Health approval for the location.
5. Zoning and Planning approvals may be required for consideration of setbacks, height limitations, environmentally sensitive areas, brush management areas, open space easements, Utility easements, etc.
6. Supply-side connections require pre-approval by the Utility, the AHJ, and must not violate the panelboard manufacturer's listing.

Solar Photovoltaic Systems

(Page 2 of 3)

Code Reference: 2016 California Electrical Code Article 690

Published: August 2005

Revised: January 2014

The Electrical Section shall include:

1. Provide cover sheet with each page identified for content.
2. Each submitted sheet shall have a page number.
3. Submit appropriate number of plan sets and supporting documents when applying for permits. Verify with AHJ the number of plan sets required.
4. Plans shall include the specifications and physical location of the existing electrical equipment and new PV system. Design plans should also indicate the applicable electrical code edition.
5. An electrical single-line diagram showing the number of photovoltaic panels with voltage and kilowatt output, module series fusing, all disconnects, all inverters with input and output ratings, the size of all electrical panel bussing, and the size of the PV circuit breaker in amperes. Include wiring methods, sizing, grounding, and calculations in conformance with Article 690 and other applicable articles of the CEC.
6. Plans shall also include the manufacturer's data sheets for all equipment. All electrical equipment shall be listed for this purpose. All equipment includes but is not limited to inverters, modules, converters, controllers, and interconnection system equipment.
7. Devices used to ground PV Modules in accordance with CEC 690.43 (A) shall be listed and labeled for use with the specific module used and installed per the module manufacture installation instructions.
8. A plaque identifying the location of all customer self-generation equipment, the service point, the DC disconnect(s), and the AC disconnect for Utility Operation, if required, must be installed on the service equipment per the specifications shown on page 32 of this Newsletter.

The Structural Section shall include:

Plan Review Items:

1. All roof-mounted and ground-mounted solar PV arrays will require an approved plot plan with all property, setback, and easement lines properly marked. Additionally, the location of all overhead power lines shall be shown on the plot plan. Consult with the Utility for clearance requirements from power lines. If the proposed system is roof-mounted, the plans must clearly indicate fire fighter access points and pathways as required by California Building Code (CBC) 3111.1, California Residential Code (CRC) R331, and California Fire Code (CFC) 605.11. An elevation plan may be required. Consult with the AHJ for specific requirements.
2. A plan view of the installation of the PV solar panels including racks or other supports, details of the supporting structure, connections to the roof framing members, and the calculated roof- and wind-loading values.
3. A registered architect, structural engineer, or civil engineer shall also stamp any plans requiring, but not limited to, soils reports, high-strength concrete footings, shop-fabricated support structures, field-fabricated ground-mounted support structures or field welding.
4. Check with the AHJ regarding specific requirements.

Design Criteria Items:

1. Dimensioned layout of the arrays and footing details for the supporting structure.
2. All arrays must be attached to either an approved racking system or the proposed support structure and attachment methods must be certified by a State of California licensed civil or structural engineer or subject to AHJ structural plan review and approval.
3. If the roof- or wind-loading values exceed 5 pounds per square foot (or 7 pounds per square foot depending on the AHJ's requirement), the engineered system's plans and calculations must be stamped by a registered architect, structural engineer, or civil engineer.

Information on the Utility's requirements for interconnection and Net Energy Metering can be found on their website at www.sdge.com/solar. The Utility may require the customer to provide an AC disconnect(s) that is/are capable of being visibly checked in the open position and be lockable. The AC disconnect(s) is/are to be located immediately adjacent to the electric service and meter location. Contact the Utility for exceptions to the location of the AC disconnect(s) location.

PV systems will not be authorized for interconnection until all Utility requirements have been completed which includes the Utility receiving an inspection clearance from the AHJ.


Alternate Sources of Power

Code Reference: 2019 California Electrical Code Article 705.10 (See Table 705.3)

Published: August 2005

Revised: January 2020

This is a sample of the plaque or directory required when there is an alternate source of power connected to the premises wiring system. For this plaque example, a Solar photovoltaic System is the alternate source of power.

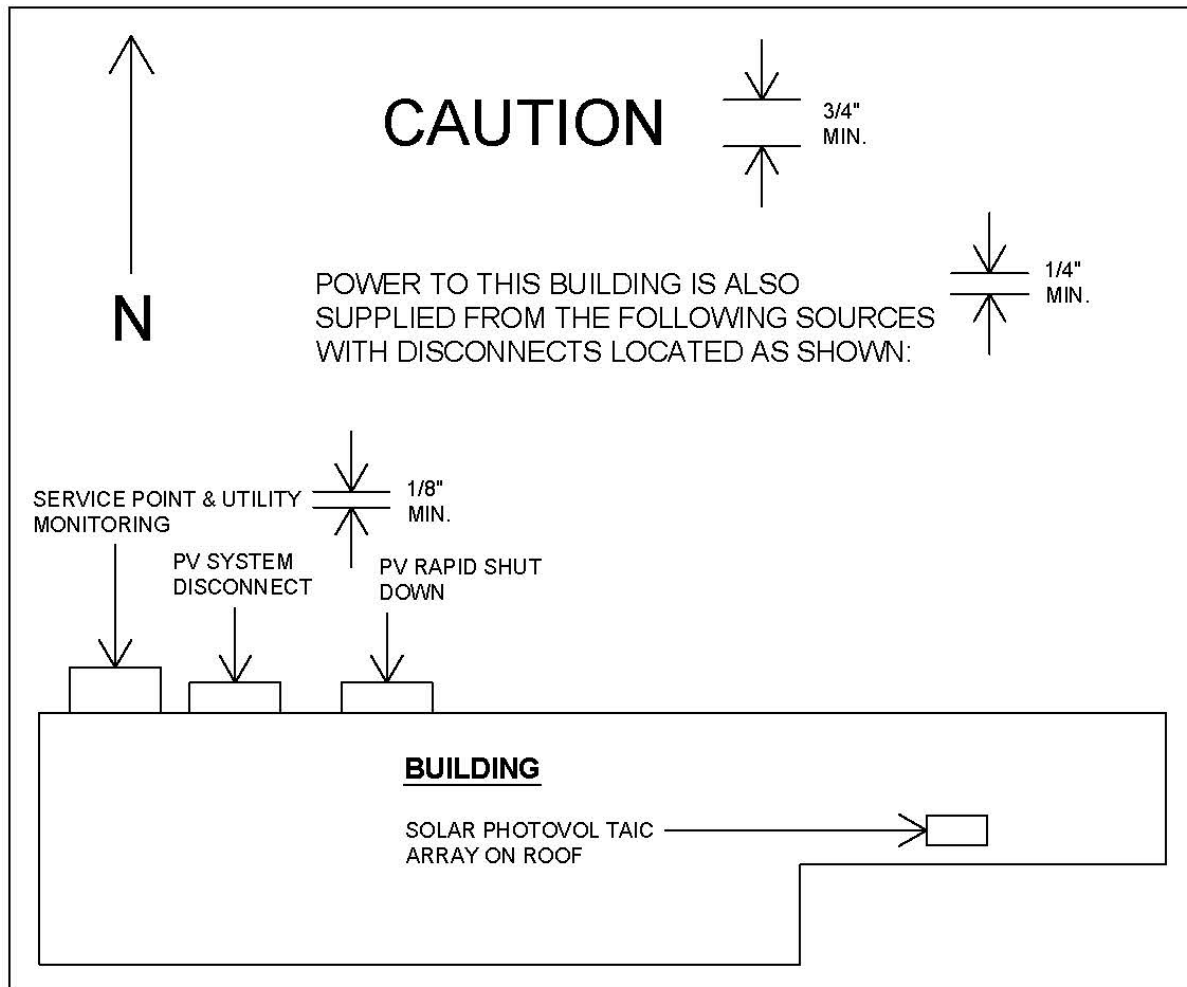

A single plaque shall properly reflect the location of all alternate power sources, the disconnects, and the utility service point(s). The plaque or directory shall be manufactured in metal or plastic, suitable for the environment, with engraved or machine-printed lettering or electro-photo-plating in a contrasting color. The plaque shall include a properly oriented footprint of the entire building. The plaques shall be located at each source disconnect location and securely fastened by a permanent means acceptable to the AHJ.

Index

<u>Subject</u>	<u>Page #</u>
Approval of Electrical Equipment.....	1
Busways.....	20
Concrete-Encased Electrode (Rebar)	17
Electric Vehicle Charging Systems (EVCS).....	27
Electric Vehicle Supply Equipment (EVSE).....	28
Electrical Equipment Rooms.....	3
Electrical Service Plan Check Requirements	7
Examination of Electrical Equipment Exceeding 1,000 Volts	25–26
Generators	22–23
Ground Rods	18
Ground-Fault Performance Testing	14–15
Grounding Electrode System & Grounding Electrode Conductor	16
Identifying Conductors	5
Number of Services.....	9–12
Number of Supplies (Feeders).....	8
Outdoor Dedicated Equipment Space-Outdoor	4
Service Equipment – Disconnecting Means	13
Solar Photovoltaic Systems	29–32
Switchboards & Panelboards.....	21
Torque Requirements	2
Transformers	24
Unconditioned Enclosed Patio	6
Underground Metal Conduit.....	19

